

8/5/87
2PM

04-342976

PERMIT

P 39694

A 30239

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

DISTRICT 4th

HOWARD COUNTY

BUREAU OF ENVIRONMENTAL HEALTH

461-9933

INDEXED

DATE 7/22/87

DATE SYSTEM APPROVED 8/13/87

INSPECTOR RH

{ I.C.O.R. issued only }
Time expired

Norman Collins

IS PERMITTED TO INSTALL X ALTER

ADDRESS 2024 Millers Mill Road, Cooksville, MD 21723 PHONE 795-8618

SUBDIVISION Roxbury ROAD 4080 Roxmill Court LOT 13

PROPERTY OWNER John Carr

ADDRESS

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES NO X

Mr. Collins will be putting in an extra large tank - 2000 gal.

SEPTIC TANK CAPACITY 1000 GALLONS NUMBER OF BEDROOMS 3

TRENCHES - 174 sq. ft. per bedroom. Trench to be 2 feet wide. Inlet 4 feet below original grade. Bottom maximum depth 9 feet below original grade. Effective area begins at 4 feet below original grade. 5 feet of stone below distribution pipe.

LOCATION - Start the first trench 165 feet from the front lot line and 20 feet from the right lot line as seen when facing the property from Roxmill Court. Run trenches along level ground toward the left lot line.

NOTE - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank. OK/LW

105LF of trench Required. SA

PLANS APPROVED BY C. Williams DATE 9/30/83

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E., TANK, DISTRIBUTION BOX, TRENCHES) TO BE 100 FEET FROM WELL. (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(ES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(ES).

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER. NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS.

PERMIT VOID AFTER TWO YEARS.

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED.

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES.

BLDG. PERMIT SIGNED
AND RETURNED 5/6/91
Serial # 37677

*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT


*CALL 461-9933 FOR INSPECTION OF SEPTIC SYSTEMS.

EH - 2-1186

6/20/87

175

105LF

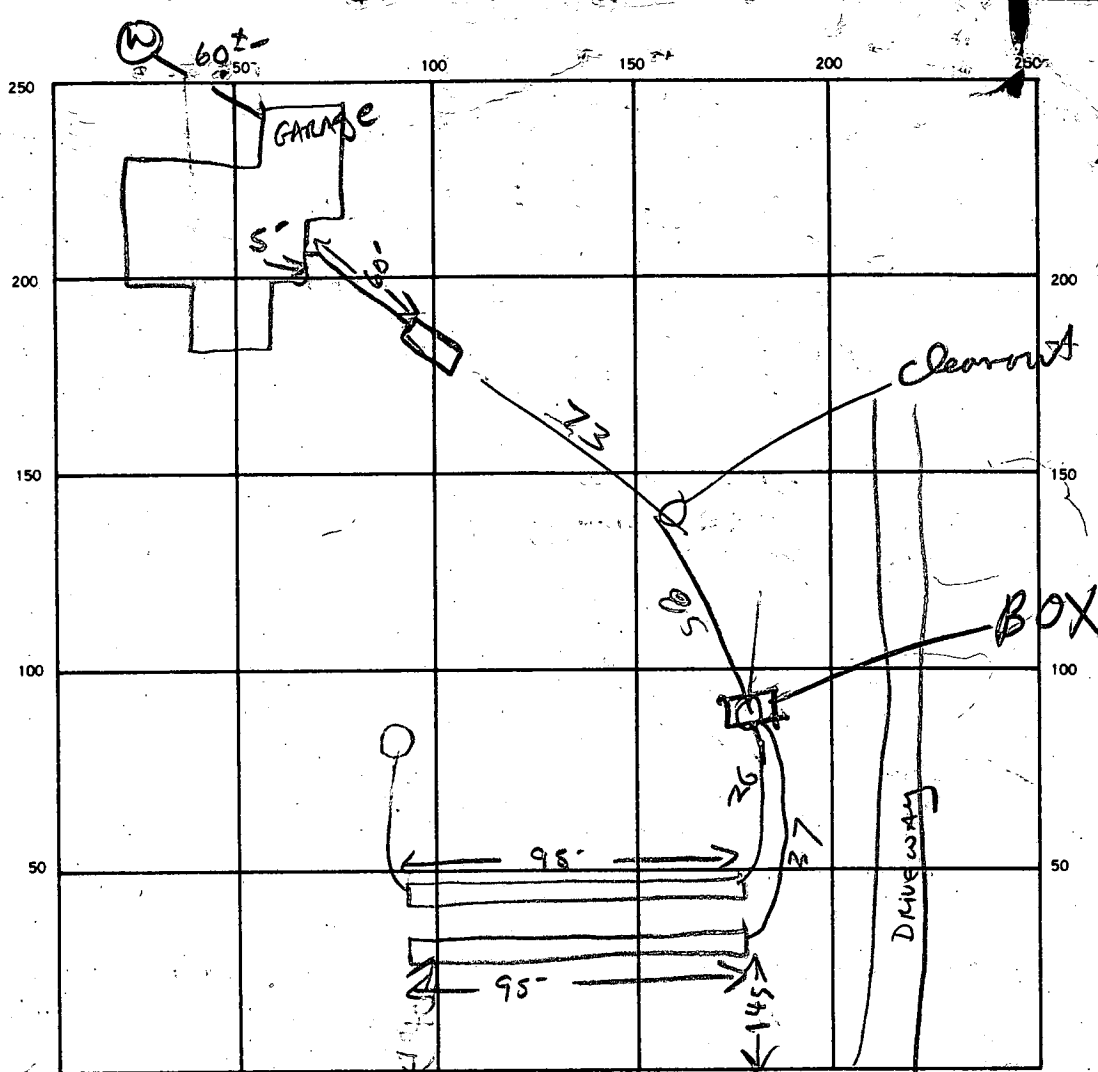

174
3
522

Roxmill Ct

SEPTIC TANK, LEVEL ✓ 2000 GAL CLEANOUTS OK

DISTRIBUTION BOX, LEVEL OK

DRAIN FIELD/TILE FIELD, DEPTH 9 FT. TRENCH WIDTH 2 FT. INLET DEPTH 4 FT.

EFFECTIVE GRAVEL DEPTH 5 FT. TOTAL LENGTH 95 FT. DIAL TO

NUMBER OF TRENCHES 2 ONE SIDEWALL BOTTOM AREA 956 SQ. FT. 522

DRYWELL INSIDE DIAMETER — FT. EFFECTIVE DEPTH BELOW INLET — FT.

ABSORBENT AREA — SQ. FT.

REMARKS 8/4/07 INSPECTED BY SLD. ONLY ONE SEWER CLEANOUT
OK PER SLD
8/5/07 - PIPE FROM TANK TO BOX TO
TRENCHES OK

DATE SYSTEM APPROVED 8/5/07 INSPECTOR Raymond Hodge

SUBDIVISION: ROXBURYLOT NUMBER: 13DRY WELL OR DRY WELL AND TRENCH

		_____ sq. ft./bedroom
	<u>Septic Tank</u>	<u>Minimum Total square Feet</u>
3 bedroom	1000 gallon	_____
4 bedroom	1250 gallon	_____
5 bedroom	1500 gallon	_____

Inlet _____ feet below original grade.

Bottom maximum depth _____ feet below original grade.

Effective area begins at _____ feet below original grade.

NOTE: If trench is used to make up absorbent area, run the trench on level ground and leave a 5 foot earth buffer between dry well and trench.
No trench is to exceed 100 feet in length. Trench inlet to be same as dry well, with _____ feet of stone below distribution pipe.

TRENCHES

Trench to be 2 wide. 174 sq. ft./bedroom
212
848

Inlet 4 feet below original grade.

Bottom maximum depth 9 feet below original grade.

Effective area begins at 4 feet below original grade.

5 feet of stone below distribution pipe.

- NOTE:
- (1) No trench to exceed 100 feet in length.
 - (2) If more than one trench used, a distribution box is required.
 - (3) Trenches to be installed on level ground.
 - (4) Call for inspection of trench before gravel is installed.
 - (5) Provide 6"-8" diameter cleanout and cap to grade or above on septic tank and drywell.
 - (6) If a Garbage disposal is used, increase septic tank capacity by 50% and increase absorbant sidewall area by 22%.

LOCATION: START THE FIRST TRENCH 165' FROM THE FRONTLOT LINE AND 20' FROM THE RIGHT LOT LINE AS SEENWHEN FACING THE PROPERTY FROM ROXMILL COURT.RUN TRENCHES ALONG LEVEL GROUND TOWARD THE LEFTLOT LINE, 9-30-83 C.W. O'NEILL

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

A 30239

P _____

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P.O. BOX 476 ELLICOTT, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT 4th.

DATE 9/28/79

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I. HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER ~~J. Garrett Reilly~~ CARR

ADDRESS Roxbury Mills Rd., Glenwood, Md. 21738 PHONE 489-4481

PROPERTY LOCATION:

SUBDIVISION Roxbury LOT NO. 46 near 13

ROAD AND DESCRIPTION Route 97 4080 Roxmills Rd

SIZE OF LOT 3.05 Acres TYPE BLDG. 3 or 4 Bedrooms

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER

ANY CIRCUMSTANCES.

SIGNATURE OF APPLICANT E. Smariage /s/

BLDG. PERMIT SIGNED
AND RETURNED 3/26/87
BP #10626

APPROVED BY R.H. & D.W.M. FOR DEY WELH DATE 12/2/79 SAW

REJECTED BY _____ FOR _____ DATE _____


HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 11/16/79 - OK HOLD FOR APPROVAL 12/2/79 DMSAID

PERC OK RH

THIS IS NOT A PERMIT

ALSO PRESENT KETTERMAN I II III

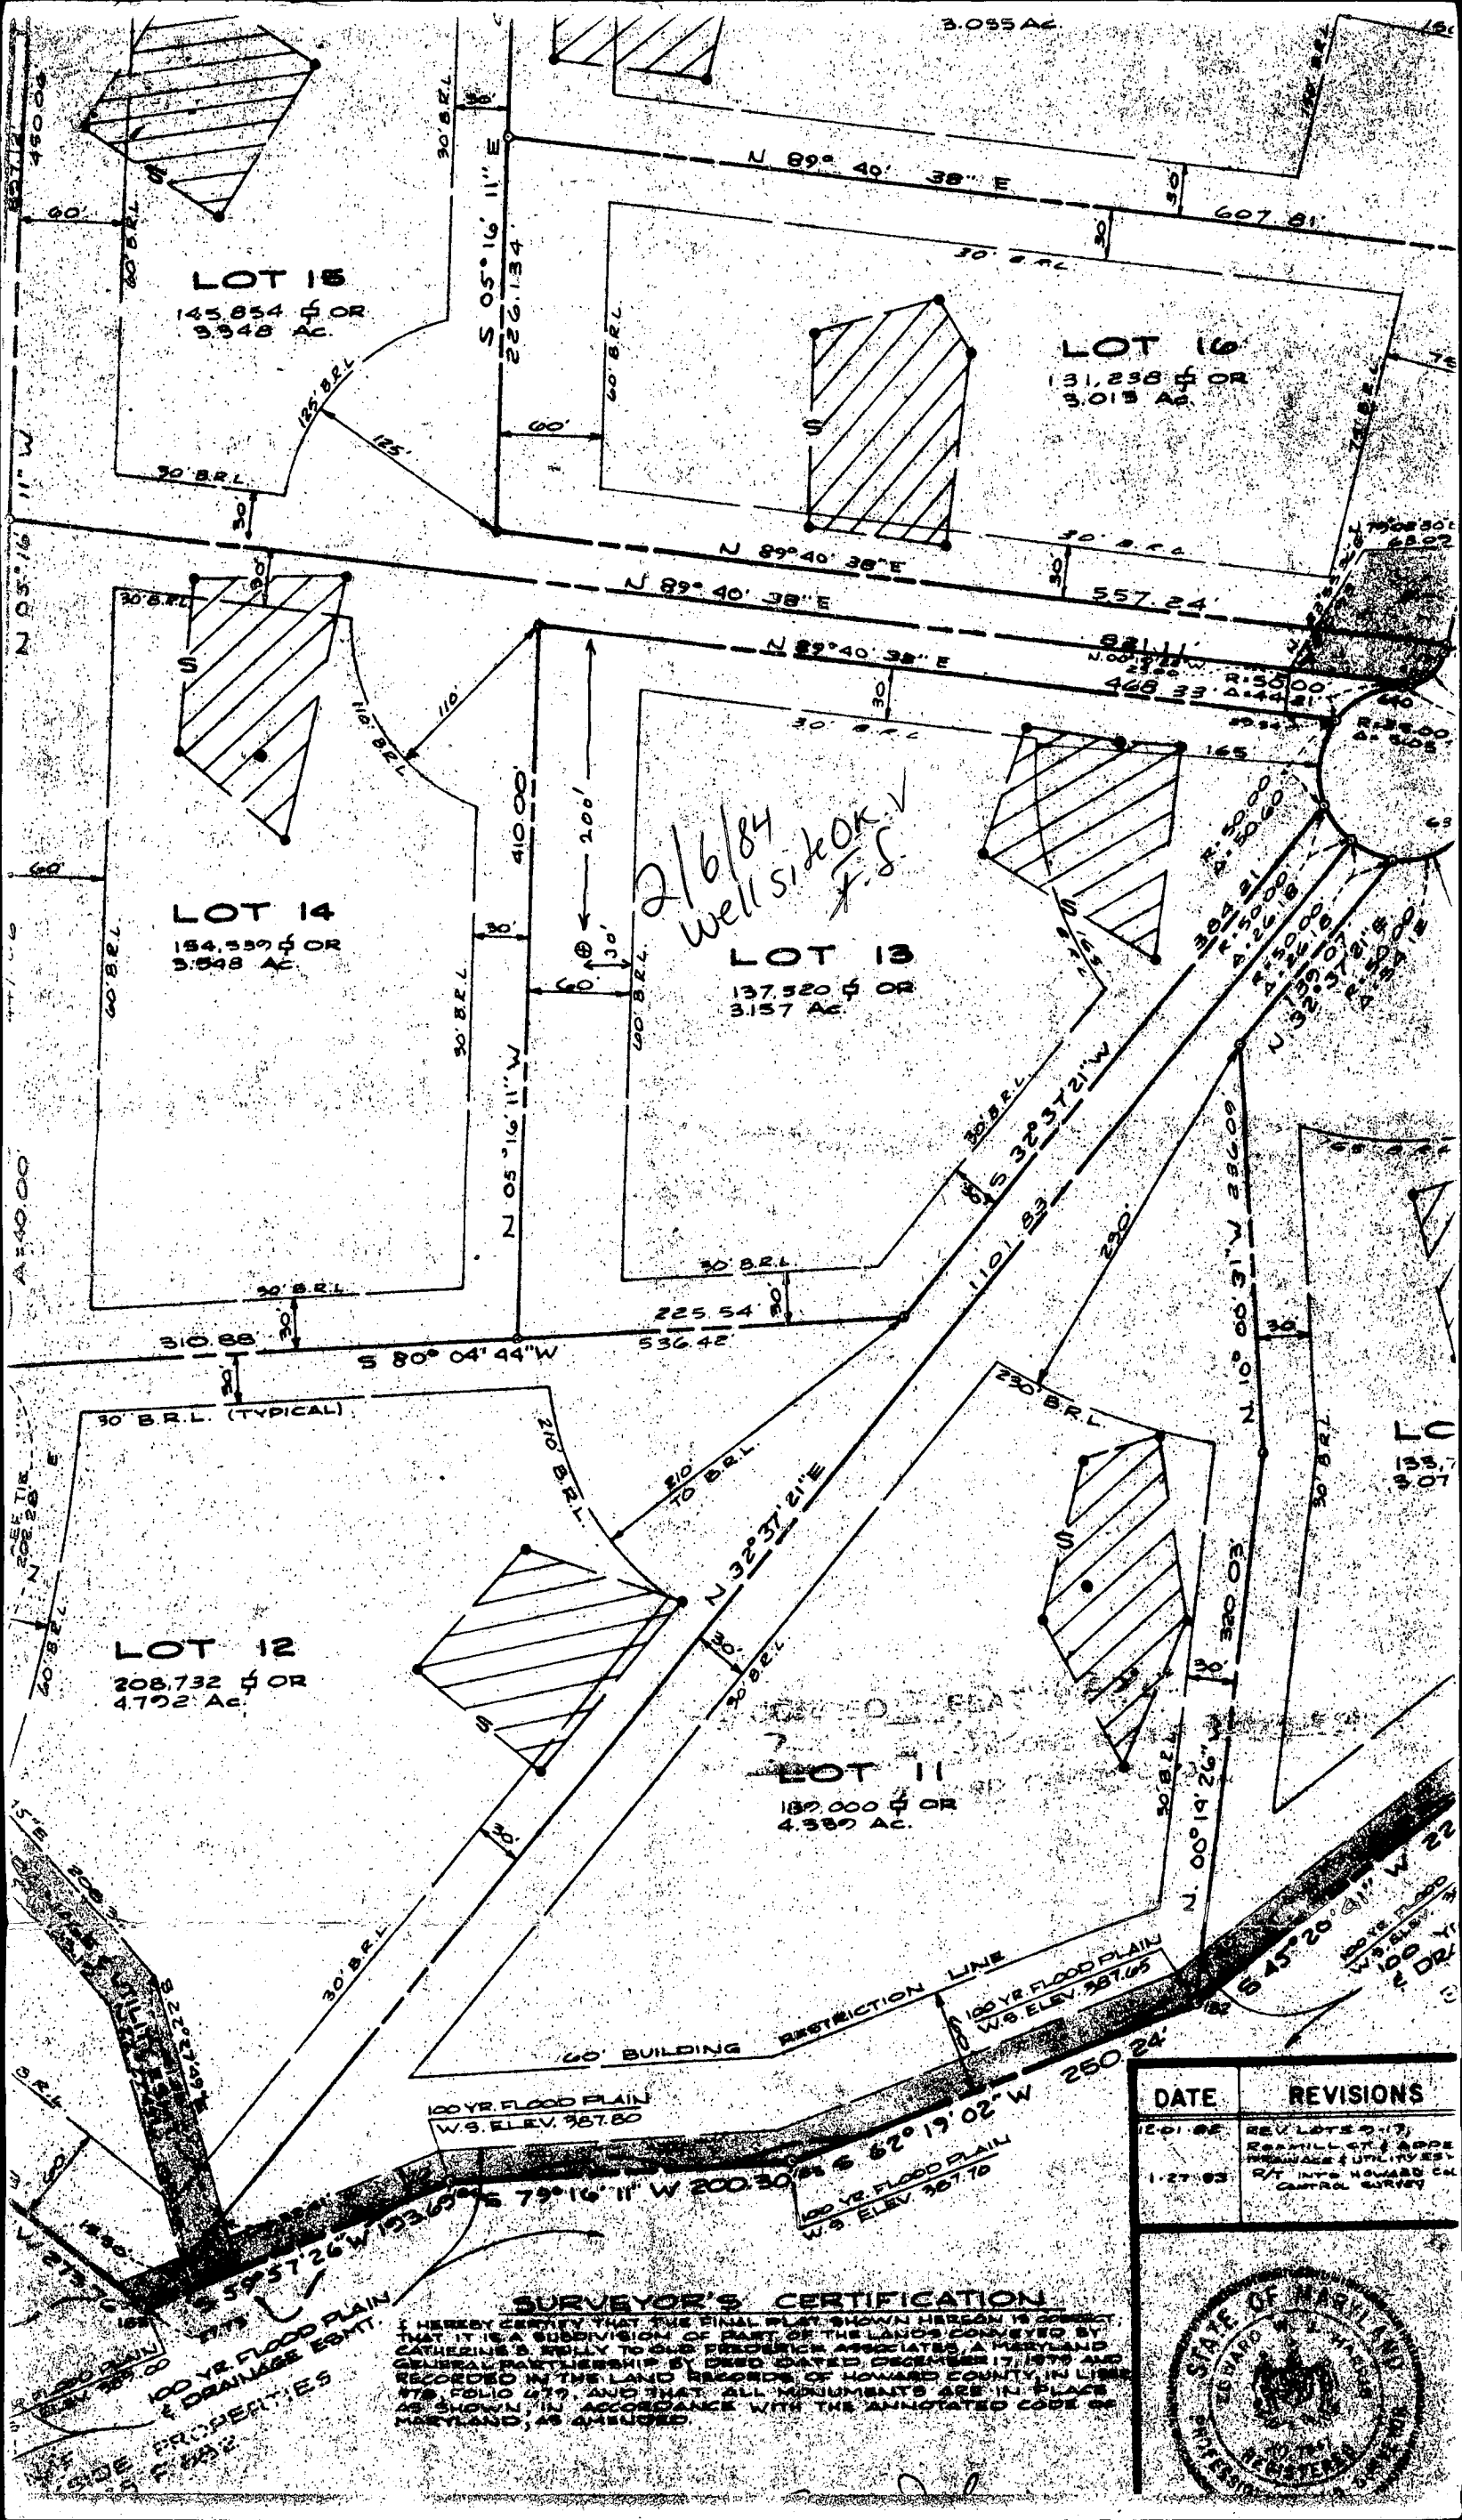

LOT 15

145,854 ± OR
3,348 AC.

LOT 16

131,238 ± OR
3,015 AC.

LOT 14

154,539 ± OR
3,548 AC.

LOT 13

137,520 ± OR
3,157 AC.

LOT 12

208,732 ± OR
4,792 AC.

LOT 11

189,000 ± OR
4,387 AC.

2/6/84
well site OK
F.S.

SURVEYOR'S CERTIFICATION

I HEREBY CERTIFY THAT THE FINAL PLAN SHOWN HEREON IS CORRECT THAT IT IS A SUBDIVISION OF PART OF THE LANDS CONVEYED BY CATHERINE S. BULLY TO ONE FREDERICK ASSOCIATES A MARYLAND GENERAL PARTNERSHIP BY DEED DATED DECEMBER 17, 1979 AND RECORDED IN THE LAND RECORDS OF HOWARD COUNTY IN LIBER 179 FOLIO 479, AND THAT ALL MONUMENTS ARE IN PLACE AS SHOWN, IN ACCORDANCE WITH THE ANNOTATED CODE OF MARYLAND, AS AMENDED.

DATE	REVISIONS
10-01-82	REV LOTS 11-13
1-27-83	REV LOTS 14-16 ADD FLOOD PLAIN & UTILITIES BY INFO HOWARD CO CONTROL SURVEY



Mr. Mrs Joseph Swisher


8541 Pineway Ct

Laurel md 20707

Phone 490-0919 home

992-6163 off - (Patty)

Eden Quinn - Stromberg

B 1 1314 (THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)	SEQUENCE NO. (OEP USE ONLY). STATE OF MARYLAND PERMIT TO DRILL WELL please print or type	OEP PERMIT NUMBER H0-81-0404 fill in this form completely
Date Received 2/7/84-9:30AM 012384 OWNER INFORMATION SWISHER JOSEPH 8541 PINEWAY CT. LAUREL MD 20707	B 3 LOCATION OF WELL HOWARD ROXBURY SECTION 44 46 LOT 48 50 GLENWOOD MILES FROM TOWN (enter 0 if in town) 2 1/10 MI	
DRILLER INFORMATION Joseph L. Mayne 5512 Ridge Rd. Mt Airy, Md. 21771 1/20/84	B 4 DIRECTION OF WELL FROM TOWN (CIRCLE BOX)  NEAR WHAT ROAD Roxmill Court ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX) NORTH WEST SOUTH EAST DISTANCE FROM ROAD 430 FT ENTER FT or MI FT	
B 2 WELL INFORMATION APPROX. PUMPING RATE (GAL. PER MIN.) 5 AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 500 USE FOR WATER (CIRCLE APPROPRIATE BOX) <input checked="" type="checkbox"/> HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY) <input type="checkbox"/> FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION) <input type="checkbox"/> INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT) <input type="checkbox"/> PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE HEALTH DEPARTMENT APPROVAL) <input type="checkbox"/> TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)		
NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL HOWARD COUNTY NAME OEP SIGNATURE DATE ISSUED 7/30/84 CO SIGNATURE NORTH GRID 519000 EAST GRID 0786000 SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X SOURCES OF DRILLING WATER 1. WELL 2. 3. WRITE THE BOX NUMBER FROM THE MAP HERE E 780 6 N 510 9 000 000		
APPROXIMATE DEPTH OF WELL 300 FEET APPROXIMATE DIAMETER OF WELL 6 INCH METHOD OF DRILLING (circle one) BORED (or Augered) JETTED Jettied & DRIVEN AIR-ROTary AIR-PERcussion ROTARY (Hydraulic Rotary) CABLE REVERSE-ROTary DRIVE-POINT other		
REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX) <input checked="" type="checkbox"/> THIS WELL WILL NOT REPLACE AN EXISTING WELL <input type="checkbox"/> THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED <input type="checkbox"/> THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY <input type="checkbox"/> THIS WELL WILL DEEPEMED AN EXISTING WELL PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEMED (IF AVAILABLE)		
Not to be filled in by driller (OEP USE ONLY) APPROP. PERMIT NUMBER GAP FORCE FS WRITE INITIALS IN BOX PERMIT No. H0-81-0404 SPECIAL CONDITIONS		

2/7/84 Location OK.


22' casing

1 1/2' casing above grade

7 bags of cement

grout in progress

OK F.S.

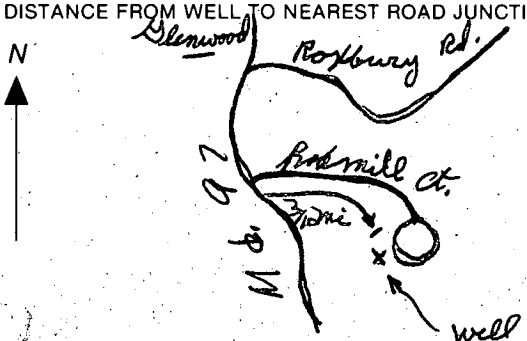

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Well Permit No. HO - 81-0404

Location of property (road) Roxmill Court

Subdivision Roxbury

Well Driller Joseph L. Mayne

Lot 13

Block

Plat

Sec.

Owner

Joseph Swisher

Depth of well / 83'

Distance of measuring point (M.P.) above ground

Static water level (S.W.L.) below M.P.

I. High rate pumping -- reservoir drawdown

Time pump started

Pumping rate

Total time	<u>to reach pumping water level</u>	<u>ft. below M.P.</u>
------------	-------------------------------------	-----------------------

II. Recovery pump test data - observations to be recorded every 15 minutes

[illegible]

C1	4490	SEQUENCE NO. (OEP USE ONLY)	STATE OF MARYLAND WELL COMPLETION REPORT FILL IN THIS FORM COMPLETELY PLEASE PRINT OR TYPE	THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED.
(THIS NUMBER IS TO BE PUNCHED IN COLUMNS 3-6 ON ALL CARDS)		COUNTY NUMBER A 30239		

DATE Received	DATE WELL COMPLETED	Depth of Well	PERMIT NO.
	020784	22 183 26 (TO NEAREST FOOT)	FROM "PERMIT TO DRILL WELL" H0-81-0404
OWNER	last name	first name	
STREET OR RFD	Roxmill Court	Joseph	
SUBDIVISION	Roxbury	TOWN	Glenwood
SECTION		LOT 13	

WELL LOG		
Not required for driven wells		
STATE THE KIND OF FORMATIONS PENETRATED, THEIR COLOR, DEPTH, THICKNESS AND IF WATER BEARING		
DESCRIPTION (Use additional sheets if needed)	FEET	Check if water bearing
	FROM TO	
Brown Slak	0 3	
Gray mica rock	3 183	

GROUTING RECORD	
WELL HAS BEEN GROUTED (Circle Appropriate Box)	yes no Y N
TYPE OF GROUTING MATERIAL	
CEMENT CM	BENTONITE CLAY BC
NO. OF BAGS 7	NO. OF POUNDS 658
GALLONS OF WATER 42	
DEPTH OF GROUT SEAL (to nearest foot)	
from 0 ft.	to 30 ft.
(enter 0 if from surface)	

CASING RECORD	
casing types insert appropriate code below	ST CO
	STEEL CONCRETE
MAIN CASING TYPE	PL OT
	PLASTIC OTHER
Nominal diameter Total depth	
top (main) casing	of main casing
(nearest inch)	(nearest foot)
ST	6 22
60 61	63 64 66 67 70

OTHER CASING (if used)	
diameter	depth (feet)
inch	from to

SCREEN RECORD	
screen type or open hole	ST BR HO
insert appropriate code below	STEEL BRASS OPEN BRONZE HOLE PL PLASTIC OT OTHER

C2	
DEPTH (nearest ft.)	
1 H0	2 21 183
8 9	11 15 17 21
23 24	26 30 32 36
38 39	41 45 47 51
SLOT SIZE 1 2 3	
DIAMETER OF SCREEN (NEAREST INCH)	
56 60	

CIRCLE APPROPRIATE LETTER	
A	A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED
E	ELECTRIC LOG OBTAINED
P	TEST WELL CONVERTED TO PRODUCTION WELL
I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 10.17.13 "WELL CONSTRUCTION" AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE ABOVE CAPTIONED PERMIT, AND THAT THE INFORMATION PRESENTED HEREIN IS ACCURATE AND COMPLETE TO THE BEST OF MY KNOWLEDGE.	
DRILLERS IDENT. NO. 238	
DRILLERS SIGNATURE (MUST MATCH SIGNATURE ON APPLICATION)	
SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)	

C3		
PUMPING TEST		
HOURS PUMPED (nearest hour) 3		
PUMPING RATE (gal. per min. to nearest gal.) 6		
METHOD USED TO MEASURE PUMPING RATE bucket		
WATER LEVEL (distance from land surface)		
BEFORE PUMPING 57		
WHEN PUMPING 87		
TYPE OF PUMP USED (for test)		
A air	P piston	T turbine
C centrifugal	R rotary	O other (describe below)
J jet	S submersible	

PUMP INSTALLED	
DRILLER WILL INSTALL PUMP YES NO	
IF DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS EXCEPT HOME USE	
TYPE OF PUMP INSTALLED	
PLACE (A,C,J,P,R,S,T,O)	
IN BOX - SEE ABOVE:	
CAPACITY:	
GALLONS PER MINUTE (to nearest gallon)	
PUMP HORSE POWER	
PUMP COLUMN LENGTH (nearest ft.)	
CASING HEIGHT (circle appropriate box and enter casing height)	
LAND SURFACE (nearest foot)	

LOCATION OF WELL ON LOT	
SHOW PERMANENT STRUCTURE SUCH AS BUILDING, SEPTIC TANKS, AND/OR LANDMARKS AND INDICATE NOT LESS THAN TWO DISTANCES (MEASUREMENTS TO WELL)	

[illegible]

WPT ADAP.

HOWARD COUNTY HEALTH DEPARTMENT
Bureau of Environmental Health
3525-H Ellicott Mills Drive
Ellicott City, MD 21043
461-9933

APPLICATION FOR PITLESS ADAPTER, WELL PUMP AND PRESSURE TANK INSTALLATION

New Installation ☒
Replacement ☐

Receipt # 39880
Date 8/18/87

Name of Installer Ed James

Telephone 304 725-9263

License Number 11888

Certified Well Pump Installer ☐ Well Driller ☐ Registered Plumber ☒

Name of Property Owner JOHN P. CARR Telephone 255-8929

Subdivision ROXBURY MILLS Lot # 13 Well Tag #

Site Address 4080 ROXBURY MILLS COURT GLENWOOD MD.

Pump

1. Type

- a. Deep well jet ☐
b. Shallow well jet ☐
c. Submersible ☐

2. Make ☐

3. Model # ☐

4. Capacity ☐ GPM

5. Pump exceeds well capacity Yes ☐ No ☐

6. If Yes, is low pressure cutoff switch installed? Yes ☐ No ☐

7. What methods are used to protect the pump and electrical wiring from vibrations? Torque arrestors ☐ Cable guards ☐ Other ☐

Motor

1. Horsepower ☐

2. RPM ☐

3. Voltage ☐

a. 110 ☐

b. 220 ☒

Pitless Adapter

1. Make ☐

2. Model # ☐

3. Depth ☐

Tank

1. Capacity ☐

2. Pressure relief valve? ☐

Piping

1. Type ☐

2. Size ☐

3. NSF and/or BOCA Code approved ☐

4. Depth of supply line ☐

Well data

1. Depth ☐ ft.

2. Yield ☐ GPM

3. Static water level ☐ ft.

4. Will water supply be disinfected by installer? ☐


I understand that it is my responsibility to notify the Howard County Health Department when the installation is ready for inspection (otherwise this permit is null and void).

All information given above is true to the best of my knowledge.

Signature of Applicant: John P. Carr

Date: 18 AUG 87

Note: A sticker indicating approval/status of the installation will be placed on the well casing at the time of the inspection.

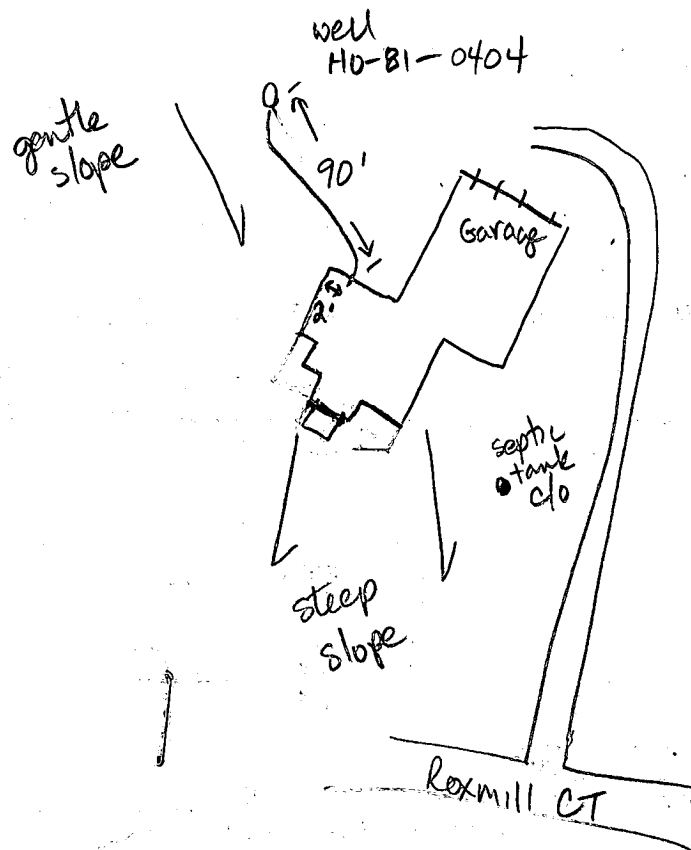

8-19-87

Pitless adaptor at 42 inches below grade. Well line connected to house. Ground on well. JE Nadeau

APPLICATION

PERMIT APPLICATION

DEPARTMENT OF PUBLIC WORKS
BUREAU OF INSPECTIONS LICENSES & PERMITS

3430 COURT HOUSE DRIVE, ELLICOTT CITY, MARYLAND 21043

Health
SERIAL NUMBER
37740

BUILDING ADDRESS (HOUSE NO., STREET, TOWN OR AREA)

4080 ROXMILL CT.

Glenwood Md. 21738

GRADING/SEDIMENT CONTROL ☒ YES ☐ NO

DESCRIPTION OF WORK AUTHORIZED

11 X 16 FT Greenhouse Fan
ATTACHED TO SE CORNER OF
House

LOT NO. PARCEL NO. SEC. AREA BLOCK NO. LIBER FOLIO

13 201 1 14420 1678 550

SUB DIVISION ZONE ZONE MAP ELEC. DIST. CENSUS TR.

Roxbury R 21 4 6040

OWNER'S NAME AND ADDRESS PHONE NO.

JOHN P. GARR 4080 ROXMILL CT.

Glenwood Md 21738 489-5311

OCCUPANT'S NAME AND ADDRESS PHONE NO.

SAME

ARCHITECT OR ENGINEER'S NAME AND ADDRESS PHONE NO.

NONE

CONTRACTOR'S NAME AND ADDRESS PHONE NO.

OWNER

EXISTING USE

SINGLE

PROPOSED USE

SINGLE FAMILY HOME (PLAN)

EST. CONSTRUCTION COST

\$1500.00

LICENSE NUMBER

PERMIT FEE

WATER/WELL SEWER/SEPTIC UTILITIES GAS ELECTRICITY TYPE OF HEAT AC

I have carefully examined and read this application and know the same is true and correct, and that in doing this work, all provisions of Howard County Ordinances and the State Laws of Maryland will be complied with, whether specified or not; and I will notify the Bureau of Inspections, and Permit Twenty-four hours in advance when I am ready for the inspections called for elsewhere in this application; and that no work will be covered up until such inspections have been complied with.

SIGNATURE

3 May 91

DATE

W/S CODE

FOR OFFICE USE ONLY

DISTANCE IN FEET FROM R/W LINE TO FRONT BUILDING LINE

SIDE YARD (DISTANCE IN FEET FROM SIDE BLDG. LINE TO SIDE PROPERTY LINE)

DISTANCE IN FEET FROM SIDE STREET R/W LINE

TO SIDE BUILDING LINE

DISTANCE IN FEET, REAR YD. REQUIRING SET

BACK (CORNER LOT ONLY)

CONDITIONS (IF ANY)

SDP #

Checks payable to DIRECTOR OF FINANCE OF HOWARD COUNTY

CAUTION

To begin construction before a permit placard has been issued and displayed on the job is a violation of the law.
Use and occupancy permit must be applied for two weeks before it will be issued.


IMPORTANT: PLEASE SHOW ZIP CODES AND
AREA CODES WHEREVER REQUIRED.LP-69
Revised

FUNCTION	DATE	SIGNATURE APPROVAL
ZONING/PLANNING		
SHA		
SEDIMENT/GRADING		
BUILDING OFFICIAL		
WATER & SEWER		
HEALTH DEPT.		
FIRE PROTECTION		
STORM WATER MGMT.		

APPROVED

DATE

Distribution of Copies:
White - Building Official
Green - Planning & ZoningYellow - Engineering
Pink - Health Dept.
Gold - S.H.A.

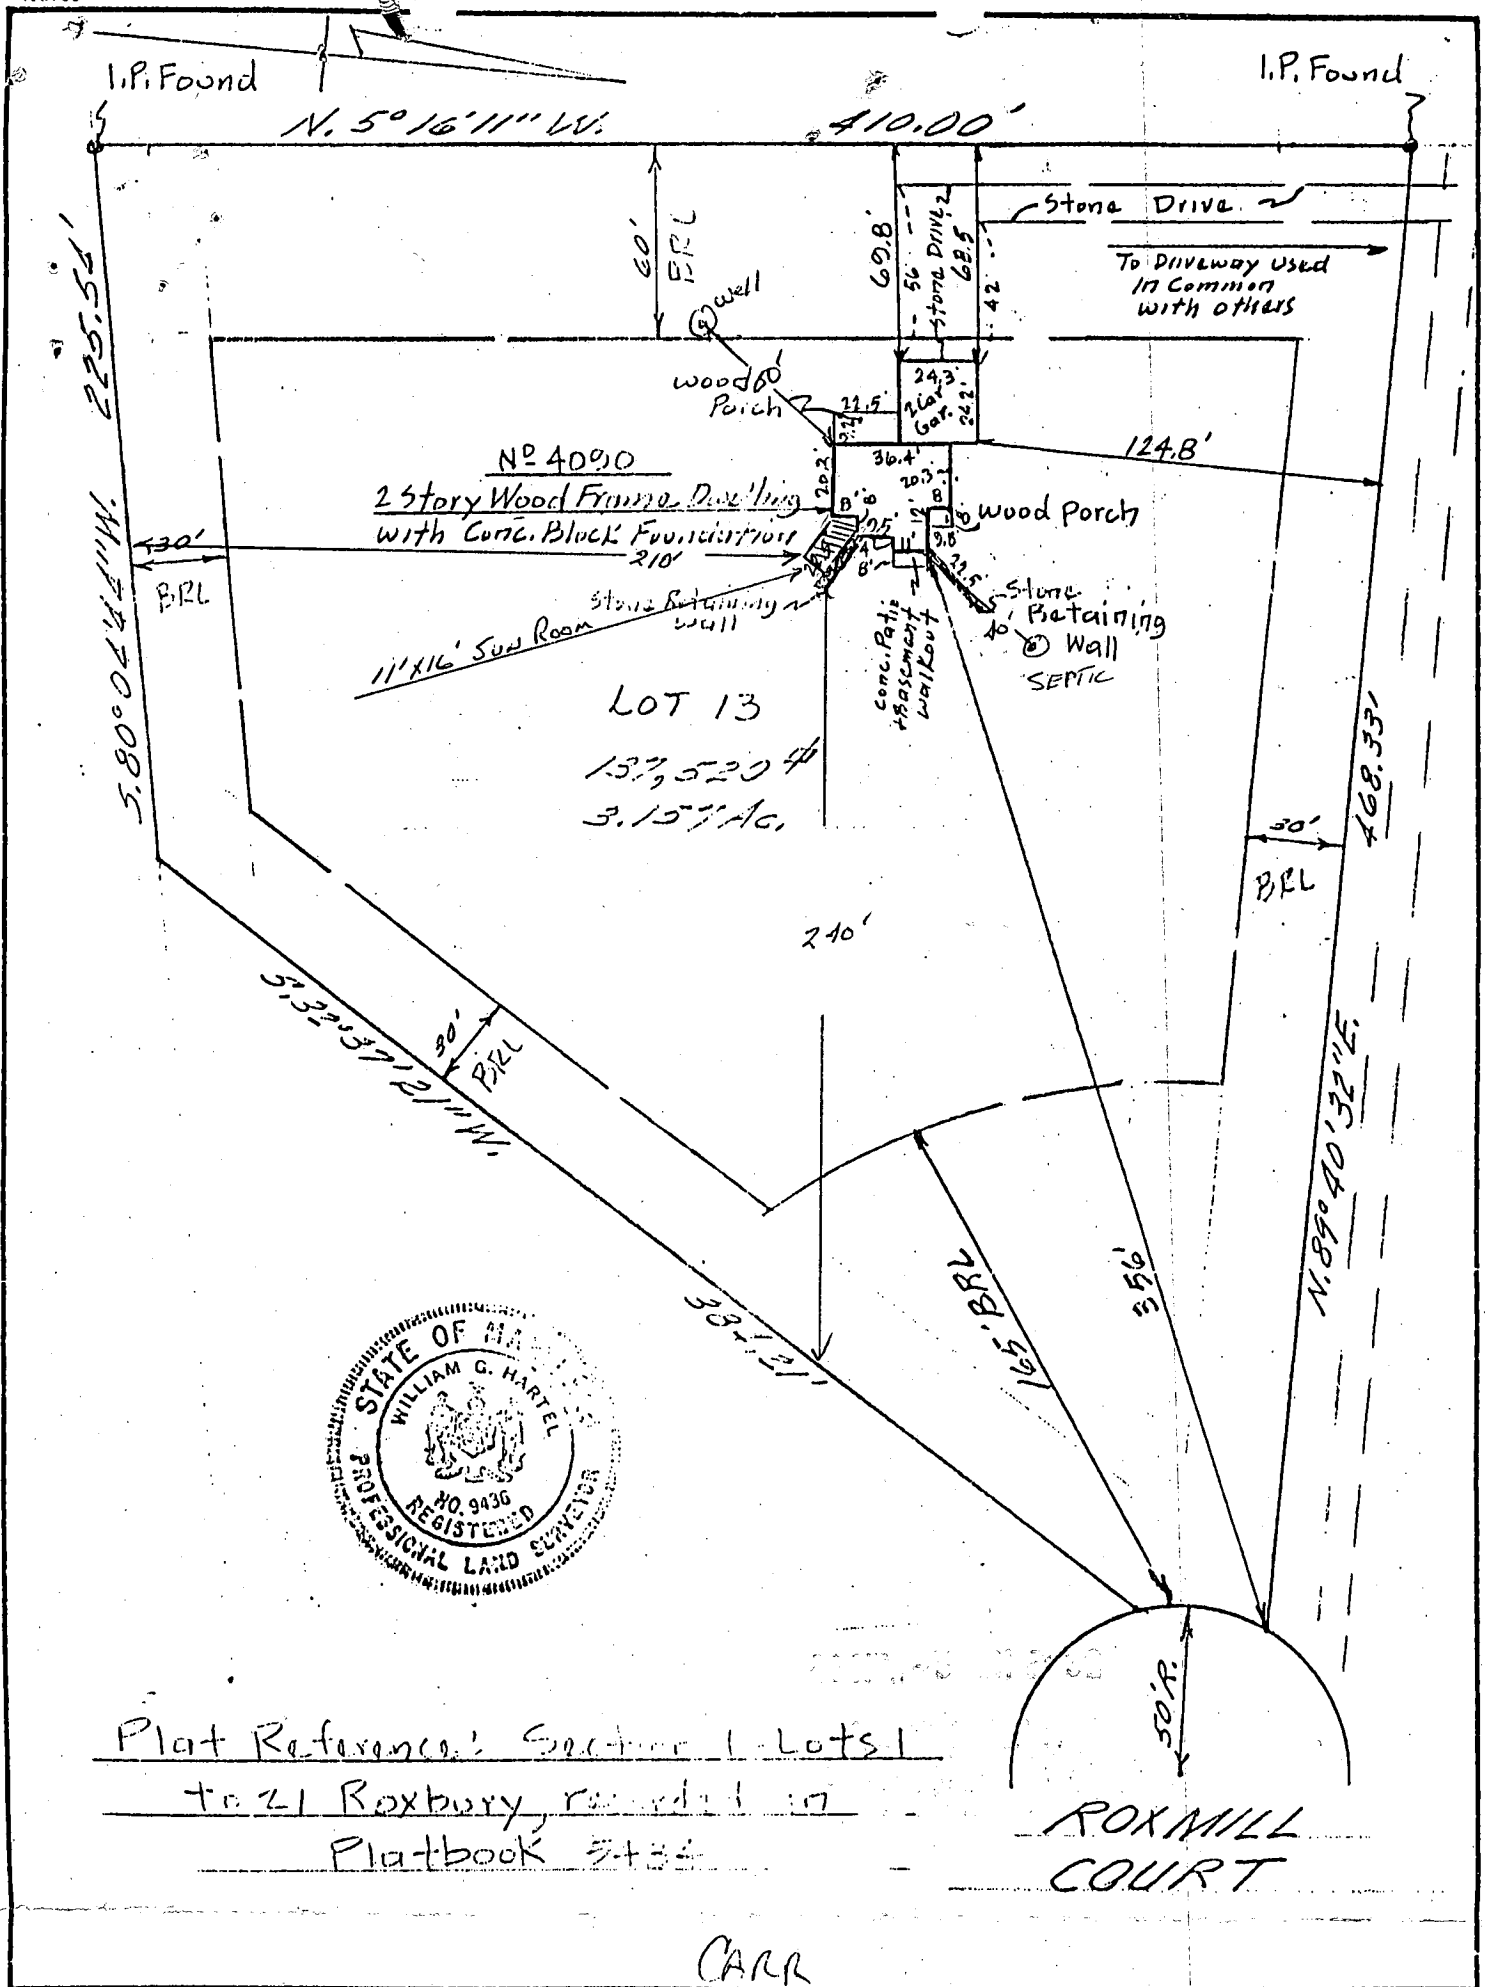

TITLE LOCATION SURVEY					THIS IS TO CERTIFY THAT WE HAVE CONDUCTED A LOCATION SURVEY OF THE IMPROVEMENTS AND THAT THEY ARE LOCATED AS SHOWN HEREON	
PROJECT LOT 13 ROXBURY SECTION 1					SIGNATURE <i>William G. Hartel</i>	
LOCATION 4TH ELECTION DISTRICT, HOWARD CO., MD.					REG. NO. 9436 DATE 1-22-88	
FIELD BOOK	PAGE NO.	DRAWN BY: BWS	CHECKED BY	DATE: 1-22-88	boender associates inc. consulting engineers land surveyors land planners COURT HOUSE SQUARE • ELLICOTT CITY, MD. 21043 (301) 465-7777	
SCALE: 1"=60'			JOB NO.: 0790			
THE INFORMATION ON THIS PLAT SHOWS ONLY THAT THE IMPROVEMENTS INDICATED HEREON ARE CONTAINED WITHIN THE CONFINES OF THE LOT UPON WHICH THEY ARE ERECTED. THIS PLAT IS NOT TO BE CONSTRUED AS, OR USED FOR THE ESTABLISHMENT OF PROPERTY LINES.						