

12/1/85 H20
11/22/85
anytime

PERMIT

OK'd
11/22/85

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

P 36192

A 30332

HOWARD COUNTY

BUREAU OF ENVIRONMENTAL HEALTH

XXXXXX
XXXXXX

461-9933

03-309142

INDEXED

ELLICOTT CITY

DISTRICT 3rd

DATE 11/07/85

Bud Arnold

IS PERMITTED TO INSTALL ☒ ALTER

ADDRESS Jacobs Road, Mt. Airy, Maryland 21771 PHONE 795-7873

SUBDIVISION Wynfield ROAD 2650 Wynfield Road LOT 1, Section 2

PROPERTY OWNER Glen Shaulis

ADDRESS

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES NO ☒

SEPTIC TANK CAPACITY 1250 GALLONS NUMBER OF BEDROOMS 4

TRENCHES - 174 sq. ft. one sidewall area per bedroom.. Trench is to be 2 feet wide.
Inlet 4 1/2 feet below original grade. Bottom maximum depth 11 feet below original grade.
Effective area begins at 4 1/2 feet below original grade. 6 1/2 feet of stone below distribution
pipe. LOCATION: Start the trench 200 feet from the front lot line and 110 feet from the
right lot line as seen when facing the lot from Wynfield Road.

NOTE: No trench to exceed 100 feet in length. If more than one trench used, a distribution
box is required. Call for inspection of trench(s) before and after gravel is installed.
Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank. OK/SA

1- 108' LONG TRENCH WITH "T" INTO LINE. S. ABLE

BUILDING PERMIT SIGNED

AND RETURNED 7502

800 136884 ADDITION

BLDG. PERMIT SIGNED

AND RETURNED 2/24/91

Shaulis # 36693 - deck

PLANS APPROVED BY Frank Skinner DATE 11/15/85

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: IF TRENCH IS USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH.

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER. NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS.

PERMIT VOID AFTER THREE YEARS.


NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA. OR
PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET MANHOLE TO GRADE REQUIRED.

*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APROVAL ON THIS PERMIT

*CALL 992-2330 FOR INSPECTION OF SEPTIC SYSTEMS.

EH - 2-1082

A 30332

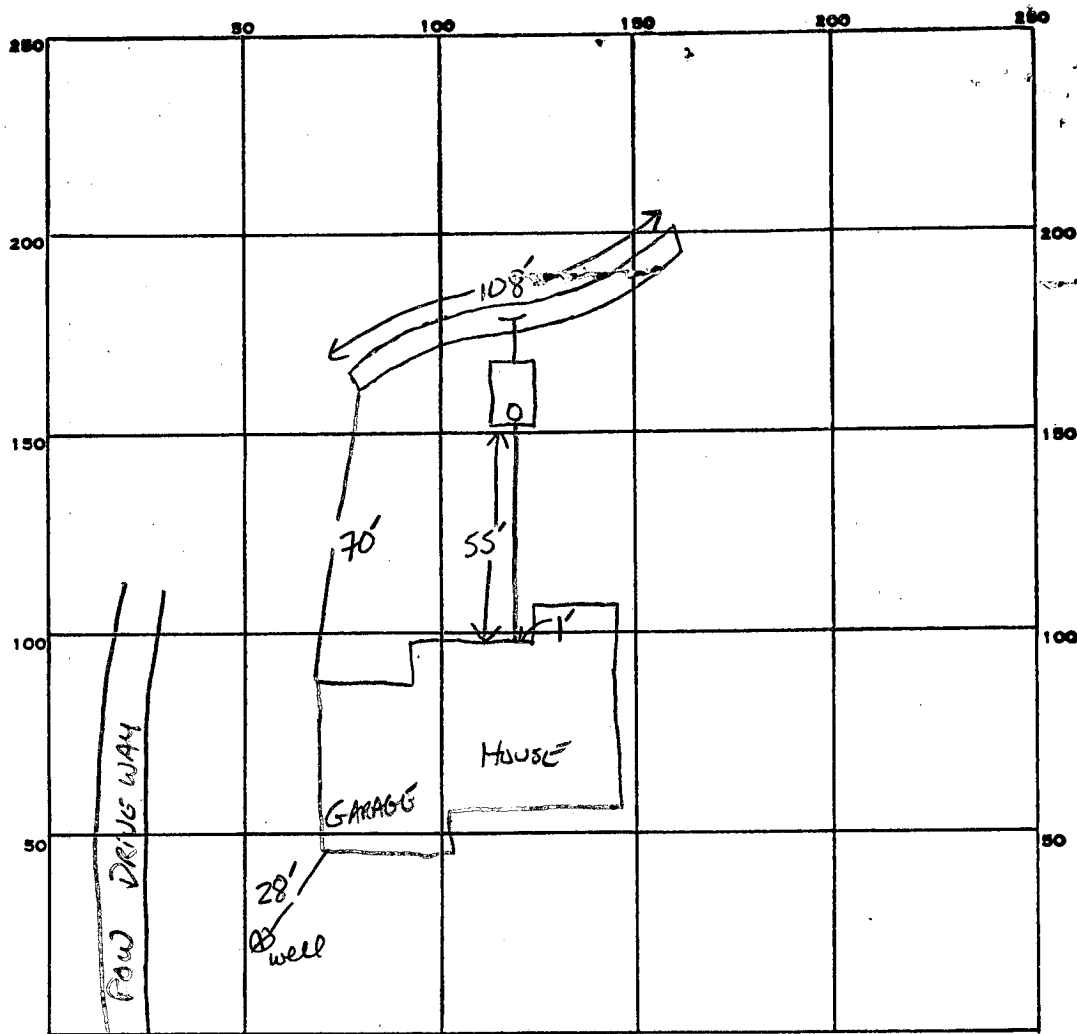

INDICATE NORTH. - NAME ADJOINING ROADWAY AS BASE LINE.
WYNFIELD Rd.

PERMIT CARD ☒

SEPTIC TANK, LEVEL ☒ 1250 GAL

CLEANOUTS ☒ ST

DISTRIBUTION BOX, LEVEL N/A

TILE FIELD, DEPTH 11 FT. TRENCH WIDTH 2-4.5' FT.

INLET 4.5 ft

GRAVEL DEPTH 6.5 IN. TOTAL LENGTH 108' FT.

BUILDING PERMITTED SIGNED
AND RETURNED

NUMBER OF TRENCHES 1

ONE SIDEWALL

TOTAL BOTTOM AREA 702

1540
648
7020

SEEPAGE PITS, INSIDE DIAMETER _____ FT. DEPTH BELOW INLET _____ FT.

ABSORBENT AREA 702 SQ. FT.


REMARKS 11-21-85 OK TO SPARE TRENCH AS DUG; SIDE COLLAPSING; STABLE 11-21-85

ADD ALL PIPE IN TRENCH; CEMENT INLET & OUTLET TANK; PERFOR TRENCH (CALL FOR FIND IN
ATTN: S. ABEL

11/22/85 OK TO COVER TRENCH & all other areas

DATE SYSTEM APPROVED 11/22/85

INSPECTOR B. J. [Signature]

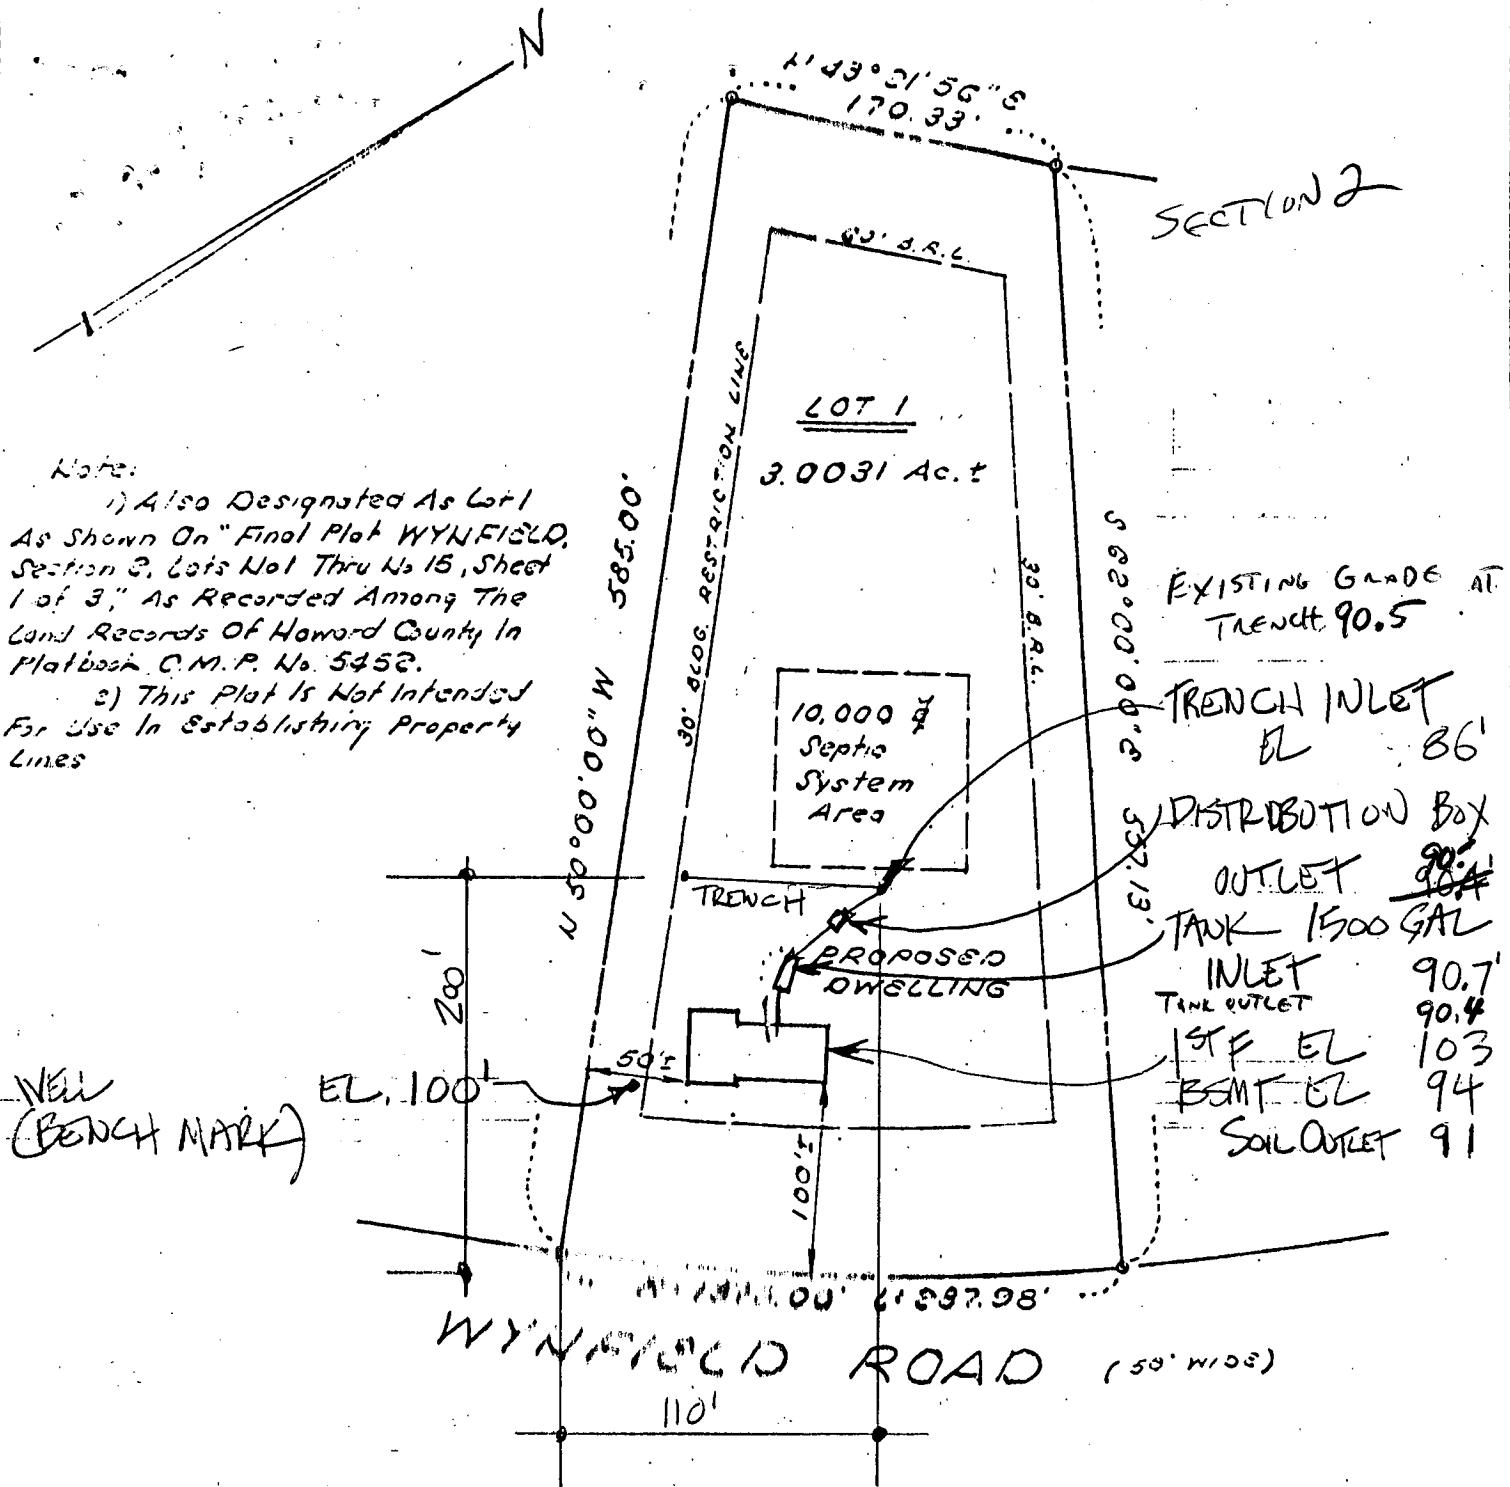

SHAULIS RESIDENCE
WYNFIELD ROAD
3rd ELECTION DISTRICT
HOWARD COUNTY, MARYLAND
Scale: 1" = 100' Date: 3.26.85

PREPARED BY
KIDDE CONSULTANTS, INC.
CONSULTING ENGINEERS
8101 SANDY SPRING ROAD
LAUREL, MARYLAND 20707
8016 (301) 792-8086 Wash (301) 953-1821

PRELIMINARY

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

A 30332

P _____

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P.O. BOX 476 ELLICOTT, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT 3rd.

DATE 10/31/79

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Land Associates Glen Shaulis

ADDRESS 3450 Ft. Meade Rd., No. 206, Laurel, Md. 20810 PHONE Tom Munz - 792-2242
or Ted Snovell - 265-6543

PROPERTY LOCATION:

SUBDIVISION Hoffman property LOT NO. 31

ROAD AND DESCRIPTION Route 144 2650 Wynfield Rd.

SIZE OF LOT 3 acres plus TYPE BLDG. 3 or 4 bedrooms

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER

ANY CIRCUMSTANCES.

SIGNATURE OF APPLICANT /s/ Ted Snovell for Land Associates

APPROVED BY R.H. & D.W.M. FOR DRY WELL DATE 12/27/79

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 11/9/79 OK R.H. B.P. # 64955

Copy given to Jim D.

BLDG. PERMIT SIGNED
AND RETURNED 5-31-85


THIS IS NOT A PERMIT

31

LOT 31

SOIL PROFILE

0

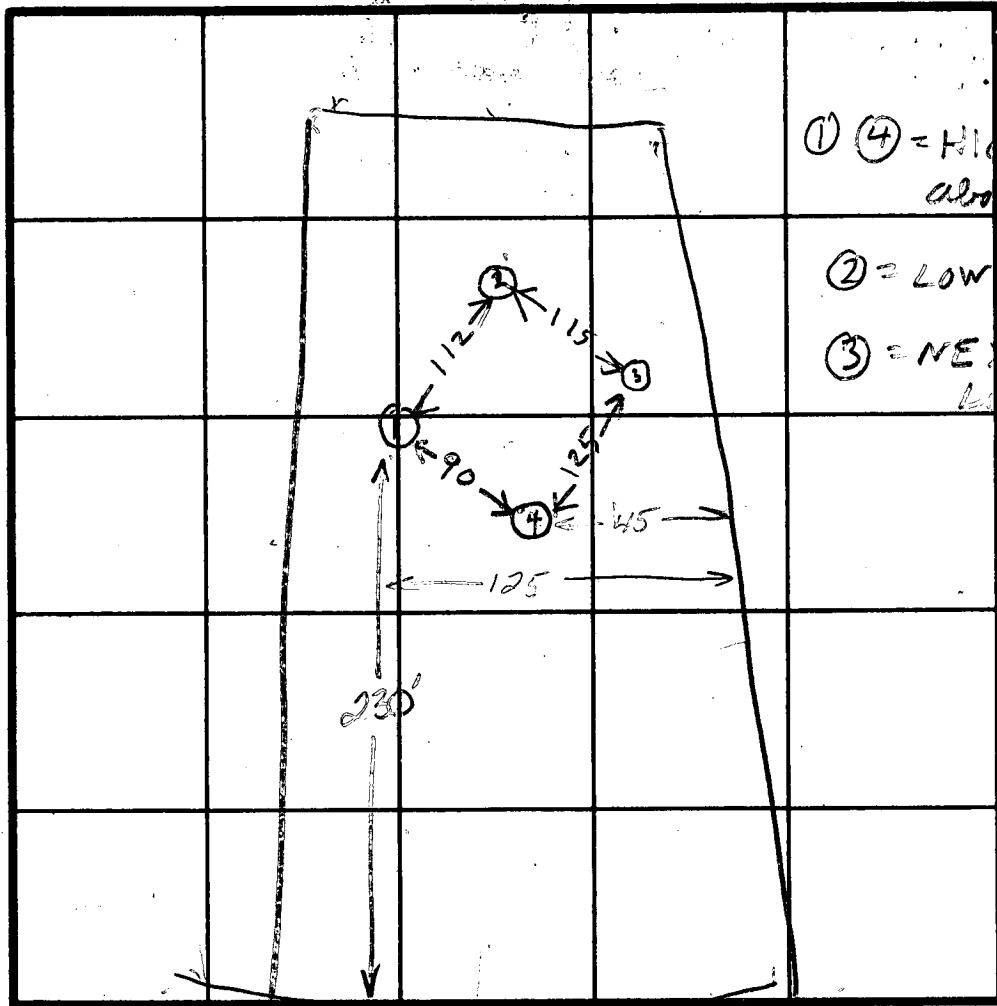① ④ = HIGH
about same

② = LOWEST

③ = NEXT
LOWEST

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

PROMISED RD

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
11/9/79	1D	14	317	343	343	405	20
11/9/79	1S	5	317	321	321	327	6
	2S	5	322	330	330	340	10
	2D	14 1/2	324	340	340	400	20
	3S	4	326	328	328	334	6
	3D	14 1/2	328	338	330	350	12
	4D	15 1/2	338	344	344	355	11
11/9/79	4S	5	338	340	340	343	3

// mm. GWC

REMARKS

TYPE OF SOIL

TESTED BY



BH

ALSO PRESENT


JIM

GLEN Shaulis
640 Dunwich Way
Baltimore, Md.
21221
574-4161

RECEIVED
FEB 10 1961
FEDERAL BUREAU OF INVESTIGATION
U. S. DEPARTMENT OF JUSTICE

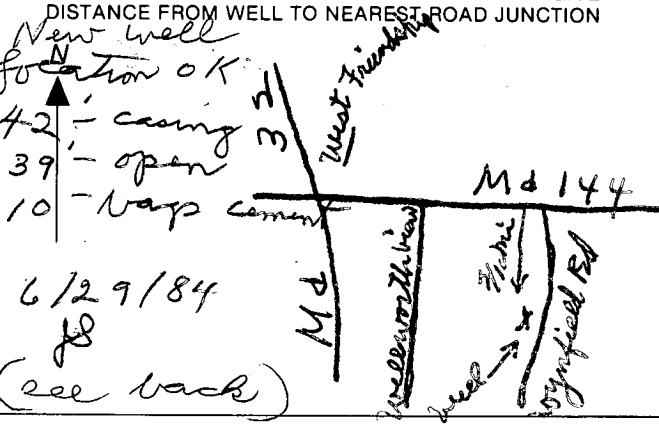B 1 3583 (THIS NUMBER IS TO BE PUNCHED IN COLS 3-6 ON ALL CARDS)	SEQUENCE NO. (OEP USE ONLY)	STATE OF MARYLAND PERMIT TO DRILL WELL please print or type	OEP PERMIT NUMBER 40-81-0571 fill in this form completely
Date Received: 6/22/84 052284 OWNER INFORMATION SHAKES GLENN 15 Last Name 13 Owner First Name 34 640 DUNWICH WAY 36 Street or RFD 55 BALTIMORE MD 21221 57 Town 70 State 72 Zip 76		B 3 LOCATION OF WELL HOWARD 8 COUNTY 21 WYNFIELD 23 SUBDIVISION 42 SECTION 2 LOT 1 44 46 48 50 WESTFRIENDSHIP 52 NEAREST TOWN 71 MILES FROM TOWN (enter 0 if in town) 7/10 MI 73 76 77 78	
DRILLER INFORMATION Joseph L. Mayne 238 Driller's Name 77 License No. 80 Joseph L. Mayne Firm Name 5512 Ridge Rd. NW, Chevy, Md. 21771 Address Joseph L. Mayne 5/22/84 Signature Date		B 4 DIRECTION OF WELL FROM TOWN (CIRCLE BOX)  ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX) NORTH ☒ WEST ☐ EAST ☐ SOUTH ☐ Wynfield Road Route 144 11 NEAR WHAT ROAD 30 ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX) NORTH ☒ WEST ☐ EAST ☐ SOUTH ☐ 34 52 37 DISTANCE FROM ROAD ENTER FT or MI FT 38 39	
B 2 WELL INFORMATION APPROX. PUMPING RATE (GAL. PER MIN.) 5 8 12 AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 500 14 20		NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL HOWARD A30332 COUNTY NAME COUNTY NO. OEP SIGNATURE STATE HEALTH INSERT S ☐ 41 DATE ISSUED 053184 Frank Skimin 11/30/84 43 48 CO SIGNATURE EXP. DATE NORTH GRID 000 EAST GRID 000 50 55 57 63	
USE FOR WATER (CIRCLE APPROPRIATE BOX) ☒ HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY) ☐ FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION) ☐ INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT) ☐ PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE HEALTH DEPARTMENT APPROVAL) ☐ TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)		SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X SOURCES OF DRILLING WATER 1. WELL 2. 3. WRITE THE BOX NUMBER FROM THE MAP HERE E 810 6 N 530 3 000 000	
APPROXIMATE DEPTH OF WELL 260 FEET 24 28 APPROXIMATE DIAMETER OF WELL 6 INCH NEAREST INCH		METHOD OF DRILLING (circle one) BORED (or Augered) JETTED Jetted & DRIVEN 30 AIR-ROTARY AIR-PERCussion ROTARY (Hydraulic Rotary) 37 CABLE REVERSE-ROTARY Drive-POINT other _____	
REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX) ☒ THIS WELL WILL NOT REPLACE AN EXISTING WELL ☐ THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED 39 ☐ THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY ☐ THIS WELL WILL DEEPEMED AN EXISTING WELL PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEMED (IF AVAILABLE) 41 _____ 52		DRAW A SKETCH BELOW SHOWING LOCATION OF WELL IN RELATION TO NEARBY TOWNS AND ROADS AND GIVE DISTANCE FROM WELL TO NEAREST ROAD JUNCTION  Howard Wynfield West Friendship 42 - casing 3 39 - open 10 - 1000 cement 6/29/84 JS (see back)	
Not to be filled in by driller (OEP USE ONLY) APPROP. PERMIT NUMBER _____ GAP _____ 54 63 FORCE FS WRITE INITIALS IN BOX PERMIT NO. 40-81-0571 67 68 70 71 72 73 74 75 76 77 78 79			
SPECIAL CONDITIONS			

H081-0571

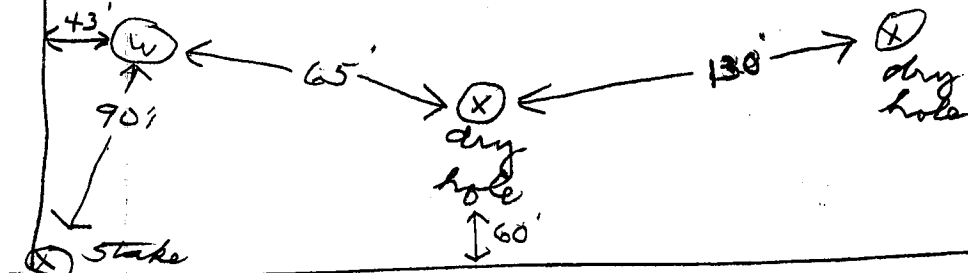

Wynfield Rd

~~10:30 AM - Ghrs~~ 2nd
6/29/84 7:30 Ghr. yield test

Page 1 of 1
Date: June 22, 1984

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Well Permit No. HO - 81-0571
Location of property (road) Route 144
Subdivision Wynfield Lot 1 Block Plat Sec. 2
Well Driller Joseph Mayne Owner Glen Shaulis

Depth of well 300'
Distance of measuring point (M.P.) above ground 1'
Static water level (S.W.L.) below M.P. 38'

High rate pumping -- reservoir drawdown

Time pump started 7:30 Pumping rate 8 GPM
Total time 45 min to reach pumping water level 228 ft. below M.P.

11. Recovery pump test data - observations to be recorded every 15 minutes

TIME (in 15 minute intervals)	WATER LEVEL below M.P.	PUMPING RATE time to fill 5 gallon bucket	FLOW METER READING (if used)	CALCULATED FLOW (gallons per minute)
6/22/84 Could not stabilize flow of pumps. At this time well is producing less than 1/2 gal a minute. After 2 hours told Mayne crew to stop. JS				
6/22/84 checked site, pumping operation closed down & gone. 4:00 P.M. JS				
This well abandoned - filled in 6/29/84				
6/29/84 - Pump test - New well (see location on back of Permit)				
11:00	232'	30 sec		2 GPM
11:15	232'	30		2
11:30	232'	30		2

C1 3275 SEQUENCE NO. (OEP USE ONLY)
(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)

STATE OF MARYLAND
WELL COMPLETION REPORT
FILL IN THIS FORM COMPLETELY
PLEASE PRINT OR TYPE

THIS REPORT MUST BE SUBMITTED WITHIN
45 DAYS AFTER WELL IS COMPLETED.

COUNTY NUMBER A 30332

DATE Received

DATE WELL COMPLETED

Depth of Well

PERMIT NO.
FROM "PERMIT TO DRILL WELL"

8 9 10 11 12 13

14 15 16 17 18 19 20

21 22 23 24 25 26

27 28 29 30 31 32 33 34 35 36 37

OWNER SHANLIS last name GLENN first name
STREET OR RFD ROUTE 144 TOWN WEST FRIENDSHIP
SUBDIVISION WYNFIELD ESTATES SECTION 2 LOT 1

WELL LOG

Not required for driven wells

STATE THE KIND OF FORMATIONS
PENETRATED, THEIR COLOR, DEPTH,
THICKNESS AND IF WATER BEARING

DESCRIPTION (Use additional sheets if needed) FEET FROM TO Check if water bearing

BROWN SHALE 0 36
GRAY mica Rock 36 300

GROUTING RECORD

WELL HAS BEEN GROUTED
(Circle Appropriate Box)

yes ☒ Y no ☐ N

TYPE OF GROUTING MATERIAL

CEMENT ☒ CM BENTONITE CLAY ☐ BC

NO. OF BAGS 10 NO. OF POUNDS 940

GALLONS OF WATER 60

DEPTH OF GROUT SEAL (to nearest foot)

from 0 ft. to 39 ft.
(enter 0 if from surface)

CASING RECORD

casing types insert appropriate code below

ST CO
STEEL CONCRETE
PL OT
PLASTIC OTHER

MAIN CASING TYPE Nominal diameter top (main) casing (nearest inch) Total depth of main casing (nearest foot)

5 4 6 2
60 61 63 64 66 70

OTHER CASING (if used) diameter inch depth (feet) from to

SCREEN RECORD

screen type or open hole insert appropriate code below

ST BR HO
STEEL BRASS OPEN HOLE
PL OT
PLASTIC OTHER

DEPTH (nearest ft.)
41 300
8 9 11 15 17 21
23 24 26 30 32 36
38 39 41 45 47 51

SLOT SIZE 1 2 3

DIAMETER OF SCREEN (NEAREST INCH)

GRAVEL PACK IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68

OEP USE ONLY (NOT TO BE FILLED IN BY DRILLER)

T (E.R.O.S.) WQ
70 72 74 75 76
TELESCOPE CASING LOG INDICATOR OTHER DATA

C 3

PUMPING TEST

HOURS PUMPED (nearest hour) 6

PUMPING RATE (gal. per min. to nearest gal.) 2

METHOD USED TO MEASURE PUMPING RATE bucket

WATER LEVEL (distance from land surface)

BEFORE PUMPING 38

WHEN PUMPING 232

TYPE OF PUMP USED (for test)

A air P piston T turbine
C centrifugal R rotary O other (describe below)
J jet S submersible

PUMP INSTALLED

DRILLER WILL INSTALL PUMP (CIRCLE) (YES or NO) YES ☒ NO ☐

IF DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS EXCEPT HOME USE TYPE OF PUMP INSTALLED PLACE (A,C,J,P,R,S,T,O) IN BOX - SEE ABOVE:

CAPACITY: GALLONS PER MINUTE (to nearest gallon)

PUMP HORSE POWER


PUMP COLUMN LENGTH (nearest ft.)

CASING HEIGHT (circle appropriate box and enter casing height)

LAND SURFACE (nearest foot)

LOCATION OF WELL ON LOT

SHOW PERMANENT STRUCTURE SUCH AS BUILDING, SEPTIC TANKS, AND/OR LANDMARKS AND INDICATE NOT LESS THAN TWO DISTANCES (MEASUREMENTS TO WELL)

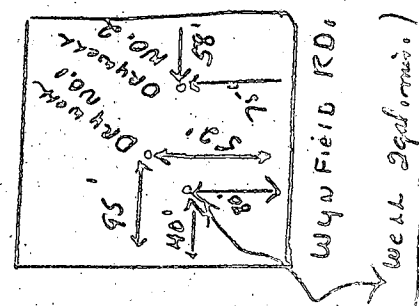

CIRCLE APPROPRIATE LETTER
A A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED

E ELECTRIC LOG OBTAINED

P TEST WELL CONVERTED TO PRODUCTION WELL

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 10.17.13 "WELL CONSTRUCTION" AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE ABOVE CAPTIONED PERMIT, AND THAT THE INFORMATION PRESENTED HEREIN IS ACCURATE AND COMPLETE TO THE BEST OF MY KNOWLEDGE.

DRILLERS IDENT. NO. 238

DRILLERS SIGNATURE (MUST MATCH SIGNATURE ON APPLICATION)

SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Well Permit No. HO - 81-0571

Location of property (road) _____

Subdivision Wynfield Lot 1 Block _____ Plat _____ Sec. 2Well Driller Joseph R. Mayne Owner Glen ShaulinDepth of well 300Distance of measuring point (M.P.) above ground 1Static water level (S.W.L.) below M.P. 38

High rate pumping -- reservoir drawdown

Time pump started 7:30 A.M.Pumping rate 8 gal.Total time 45 min to reach pumping water level 228 ft. below M.P.

1. Recovery pump test data - observations to be recorded every 15 minutes


TIME (in 15 minute intervals)	WATER LEVEL below M.P.	PUMPING RATE time to fill $\frac{1}{2}$ gallon bucket	FLOW METER READING (if used)	CALCULATED FLOW (gallons per minute)
7:45	120	6 sec.		10
8:00	195	7		9
8:15	228	7 $\frac{1}{2}$		8
8:30	228	28		2 $\frac{1}{4}$
8:45	228	28		2 $\frac{1}{4}$
9:00	228	28		2 $\frac{1}{4}$
9:15	228	28		2 $\frac{1}{4}$
9:30	228	28		2 $\frac{1}{4}$
9:45	228	28		2 $\frac{1}{4}$
10:00	228	28		2 $\frac{1}{4}$
10:15	232	28		2 $\frac{1}{4}$
10:30	232	30		2
10:45	232	30		2
11:00	232	30		2
11:15	232	30		2
11:30	232	30		2
11:45	232	30		2
12:00	232	30		2
12:15	232	30		2
12:30	232	30		2
12:45	232	30		2
1:00	232	30		2
1:15	232	30		2
1:30	232	30		2
1:45	232	30		2

SECTION 2

人'之'也。

1) Also Designated As Lot 1
As Shown On "Final Plat WYNFIELD,
Section 3, Lots Not Thru No 15, Sheet
1 of 3," As Recorded Among The
Land Records Of Howard County In
Platbook C.M.P. No. 5452.

2) This Plot Is Not Intended
For Use In Establishing Property
Lines

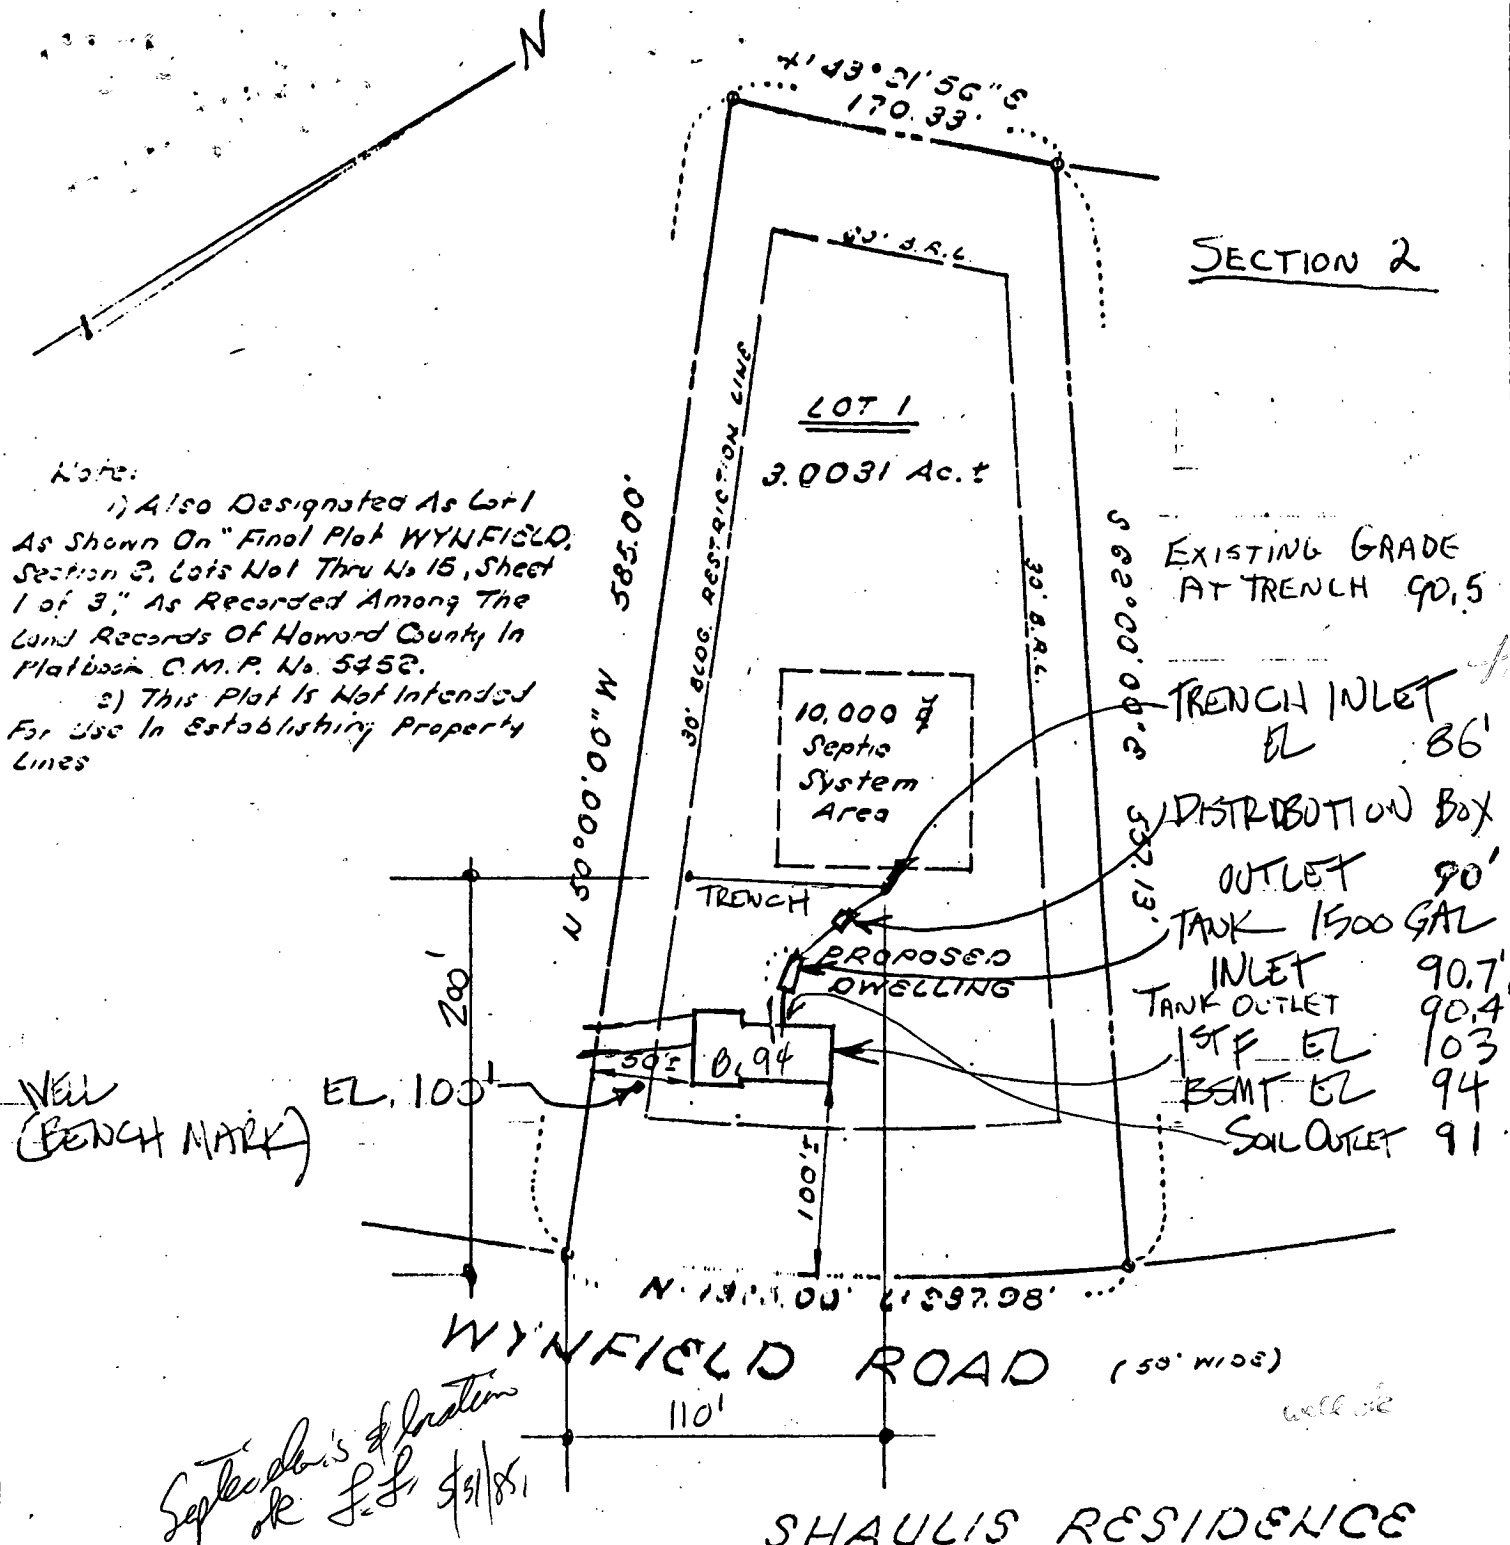

SHAULIS RESIDENCE
WYNFIELD ROAD
3rd ELECTION DISTRICT
HOWARD COUNTY, MARYLAND
Scale: 1" = 100' Date: 3-26-85

PREPARED BY

KIDDE CONSULTANTS, INC.
CONSULTING ENGINEERS

8101 SANDY SPRING ROAD
LAUREL, MARYLAND 20707

8016 (301) 792-8096

Wosh (301) 953.1821

Q.P. # 64955

DEPARTMENT OF INSPECTIONS, LICENSES AND PERMITS
3430 COURT HOUSE DRIVE
ELICOTT CITY, MD 21043
PERMITS (410) 346-2515 INSPECTIONS (410) 313-1810
AUTOMATED INFORMATION (410) 313-3800

HOWARD COUNTY
PERMIT APPLICATION

PERMIT NUMBER
B 0013 6884

Property Owner's Name CHARLES & KELLI MOSES
Address 2650 WYNFIELD RD
City WEST FRIENDSHIP State MD Zip Code 21794
Home Phone 410-469-5689 Work Phone _____
Applicant's Name & Mailing Address, (if other than stated hereon):
TICO MCCREARY
STEWART/MCCREARY ARCH.
8329 MAIN ST.
ELICOTT CITY, MD 21043
Phone 410-465-7687 Fax 410-465-7137

Building Address 2650 WYNFIELD RD
Suite/Apt. #: _____ SDP/WP/Petition #: _____
Census Tract 603000 Subdivision _____
Section _____ Area _____ Lot 1
Tax Map 15 Parcel 243 Grid 18
Zoning PADEO Map Coordinates _____ Lot size 3.0031 AC

Existing Use SFD
Proposed Use SFD
Estimated Construction Cost 70,000.00
Description of Work RE. RM ADDIT. 21' x 27'
OVER FULL RENT.

Contractor Company OWNER
Contact Person _____
Address _____
City _____ State _____ Zip Code _____
License No. _____ Fax _____
Phone _____

Occupant or Tenant SAME AS OWNER
Contact Name _____
Address _____
City _____ State _____ Zip Code _____
Phone _____ Fax _____

Engineer or Architect Company STEWART/MCCREARY ARCH.
Contact Person TICO MCCREARY
Address 8329 MAIN ST.
City ELICOTT CITY State MD Zip Code 21043
Phone 410-465-7687 Fax 410-465-7137

BUILDING DESCRIPTION - COMMERCIAL

Building Characteristics
Height: _____
No. of stories: _____
Gross area, sq. ft. per floor: _____
Use group: _____
Construction type:
Reinforced Concrete _____
Structural Steel _____
Masonry _____
Wood Frame _____
State Certified Modular _____

Utilities
Water Supply: _____
Public _____
Private _____
Sewage Disposal: _____
Public _____
Private _____
Electric Yes ☐ No ☐
Gas Yes ☐ No ☐
Heating System:
Electric ☐ Oil ☐
Natural Gas ☐
Propane Gas ☐
Sprinkler system: N/A ☐
Full _____
Partial _____
Other Suppression _____
of Heads _____

BUILDING DESCRIPTION - RESIDENTIAL

Building Characteristics
SF Dwelling ☒ SF Townhouse ☐
Depth _____ Width _____
1st floor: 30.5' 92'
2nd floor: 30.5' 44.5'
Basement: 35.5' 65.5'
Finished Basement ☐ Unfinished Basement ☒
Crawl space ☐ Slab on Grade ☐
No. of Bedrooms 4
Multi-family dwellings:
No. of efficiency units: _____
No. of 1 BR units: _____
No. of 2 BR units: _____
No. of 3 BR units: _____
Other Structure: _____
Dimensions: _____
Footings: _____
Roof: _____
State Certified Modular _____
Manufactured Home _____

Utilities
Water Supply: _____
Public _____
Private ☒
Sewage Disposal: _____
Public _____
Private ☒
Electric Yes ☒ No ☐
Gas Yes ☒ No ☐
Heating System:
Electric ☐ Oil ☐
Natural Gas ☒
Propane Gas ☐
Sprinkler system: N/A ☐
NFPA #13D _____
NFPA #13R _____
Other: _____

THE UNDERSIGNED HEREBY CERTIFIES AND AGREES AS FOLLOWS: (1) THAT HE/SHE IS AUTHORIZED TO MAKE THIS APPLICATION; (2) THAT THE INFORMATION IS CORRECT; (3) THAT HE/SHE WILL COMPLY WITH ALL REGULATIONS OF HOWARD COUNTY WHICH ARE APPLICABLE THERE TO; (4) THAT HE/SHE WILL PERFORM NO WORK ON THE ABOVE REFERENCED PROPERTY NOT SPECIFICALLY DESCRIBED IN THIS APPLICATION; (5) THAT HE/SHE GRANTS COUNTY OFFICIALS THE RIGHT TO ENTER ONTO THIS PROPERTY FOR THE PURPOSE OF INSPECTING THE WORK PERMITTED AND POSTING NOTICES.

Applicant's Signature Tico McCreary
Print Name TICO MCCREARY
Date 6.12.02
Title/Company V.P. - STEWART/MCCREARY ARCH

Checks payable to: **DIRECTOR OF FINANCE OF HOWARD COUNTY**
** PLEASE WRITE NEATLY AND LEGIBLY. **

FOR OFFICE USE ONLY

AGENCY _____ DATE _____ SIGNATURE APPROVAL _____
Development/DPZ _____
Street/Highway _____
Building Official _____
Development/DPZ _____
Health _____
Fire Protection _____
Sediment control approval required prior to issuance? _____
YES ☐ NO ☐

CONTINGENCY CONSTRUCTION START: ☐
ONE STOP SHOP: ☐


DPZ SETBACK INFORMATION
Front: _____
Rear: _____
Side: _____
Side St: _____
All minimum setbacks met? YES ☐ NO ☐
Is Entrance Permit required? YES ☐ NO ☐
Historic District? YES ☐ NO ☐
Lot Coverage for New Town Zone _____
SDP/Red-line approval date _____

PROPERTY ID# 013073
Filing fee \$ 25.00
Permit fee \$ _____
Excise tax \$ _____
Add'l per fee \$ _____
TOTAL FEES \$ _____
Sub-total paid \$ _____
Balance due \$ 25.00
Check # 12417
Validation # _____

Accepted by CNC


White: Building Official Green: LDD, DPZ Yellow: DED, DPZ Pink: Health Gold: SHA

Rev: 5/17/00

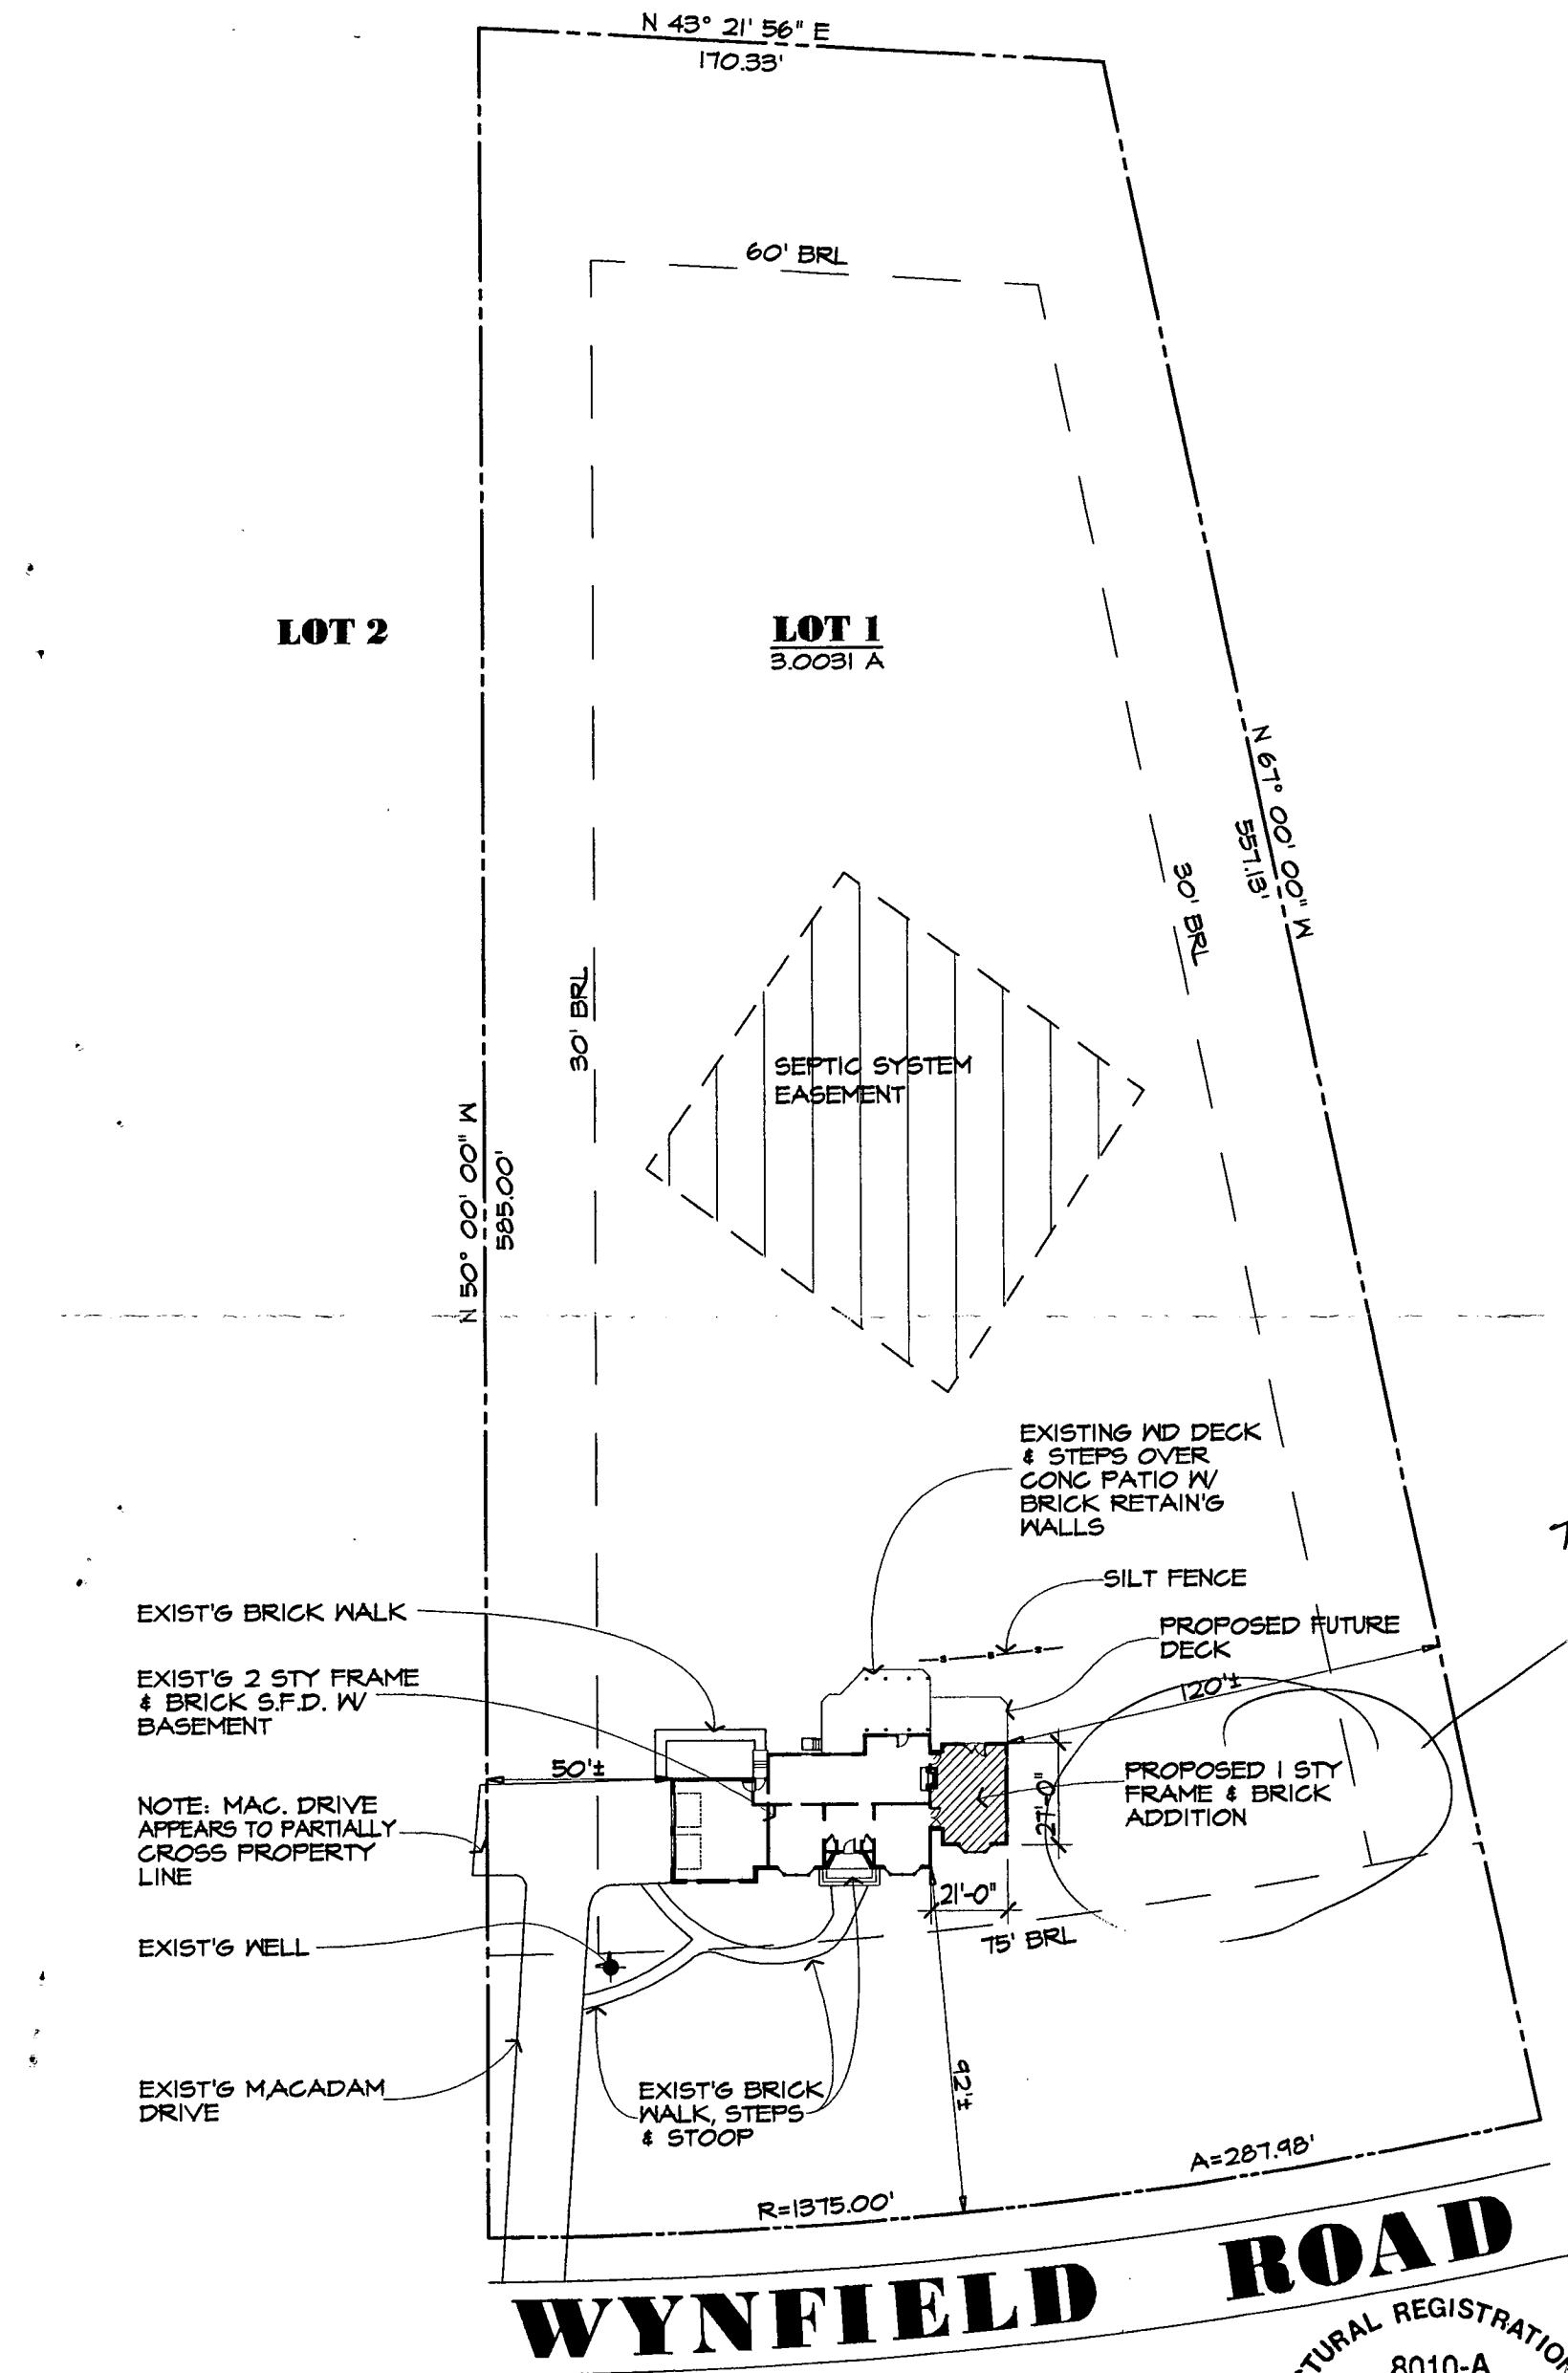

7/5/02
LOCATION MEETS SEP. SPECS. for well & septic
(KN)

LOT 1, SECTION 2, WYNFIELD, HOWARD COUNTY, MD
MAP 15, GRID 18, PARCEL 243, PLAT #5457, 3RD
ELECTION DISTRICT
2650 WYNFIELD ROAD, WEST FRIENDSHIP, MD 21794
ZONED: RRDEO

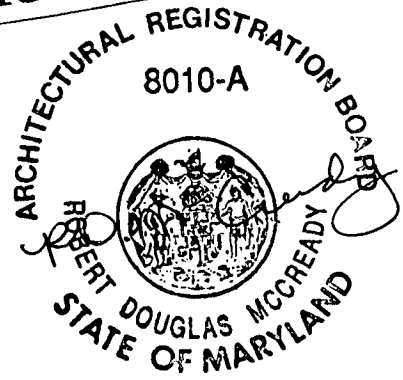

STEWART McCREADY
ARCHITECTS PA

8328 MAIN STREET
ELLCOTT CITY, MD 21043
FAX (410) 465-7737
MD 465-7887