

APPLICATION

A 27831

P _____

SEWAGE DISPOSAL TESTING

Retest
4/27/78
1:30 p.m.

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT 1000 GALTAM DISTRICT 3
ENVIRONMENTAL HEALTH SERVICES

P. O. BOX 476, ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 465-5000, EXT. 356

VOID

DATE 4/17/78

DRY WELL - 360 SFT SIDEWALL AREA BELOW INLET
DRY WELL INLET TO BE 3 FT DEEP MAX
DRY WELL BOTTOM TO BE 13 FT DEEP MAX
PLACE THE DRY WELL 100 FT FROM THE
CENTER OF THE RD & 120 FT FROM THE RIGHT
SIDE OF THE LOT AS SEEN

TO THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE
DISPOSAL SYSTEM. WHEN FACING THE LOT FROM

PROPERTY OWNER

James W. Dickey Jeffrey Sunderland

ADDRESS

Forsythe Road, Sykesville, Md. PHONE 489-7148
6154 Clearlake Ct., Col., Md. 21045

PROPERTY LOCATION:

SUBDIVISION

Day Road Dickey Farms

LOT NO.

7

ROAD AND DESCRIPTION

Jim's Way - Gravel road

SIZE OF LOT

4.18

TYPE BLDG.

3

NUMBER OF BEDROOMS

IF NOT SINGLE RESIDENCE DESCRIBE _____

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC
FACILITIES BECOME AVAILABLE.

SIGNATURE OF APPLICANT

Carol R. Clark

APPROVED BY

Raymond Dodge

FOR

Drywell

(KIND OF SYSTEM)

DATE

4/27/78

REJECTED BY

FOR

(KIND OF SYSTEM)


DATE

HOLD PENDING FURTHER TESTS

DATE

REASONS FOR REJECTION OR HOLDING _____

THIS IS NOT A PERMIT

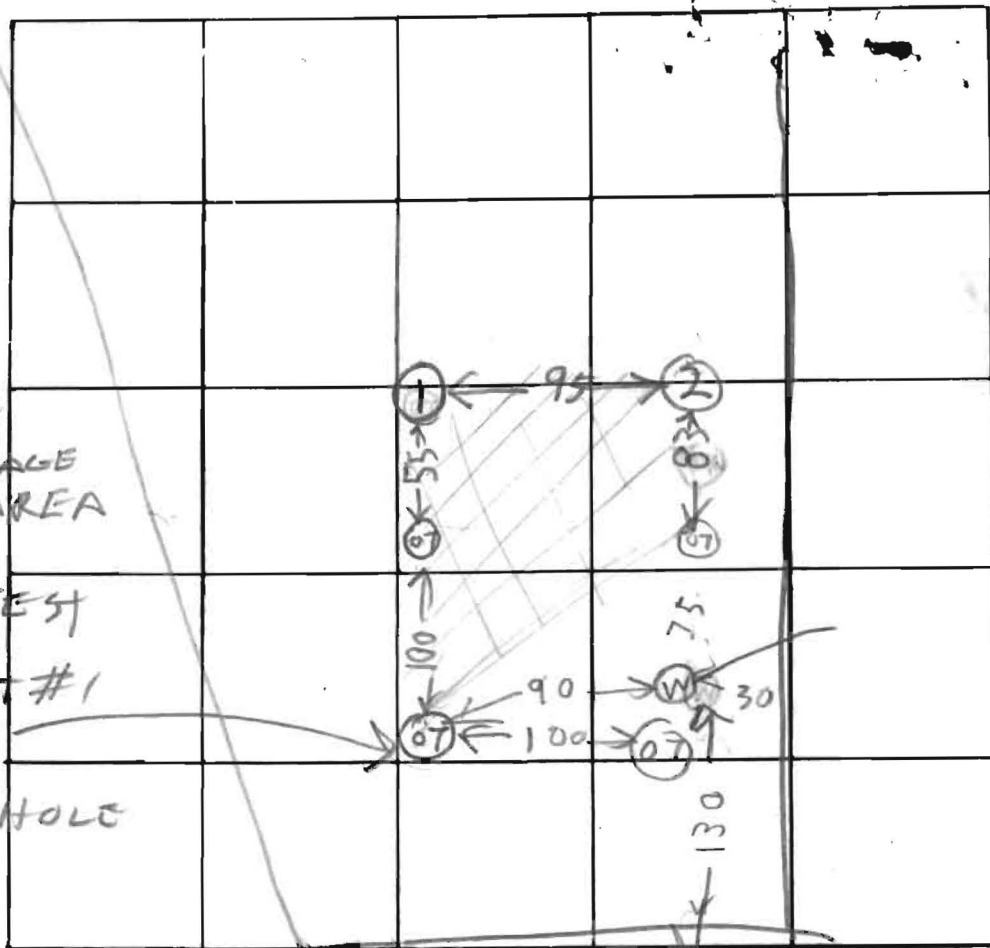

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
4/27/78	1D	12	150	152	152	155	3
4/27/78	1S	4	150	155	155	209	9
" "	2V	9	ALL SAND				

REMARKS _____

TYPE OF SOIL _____

TESTED BY B. HOLTGES

ALSO PRESENT: KALLEN BACKHOE
C. CLARK ROALESTATO

Dickey Farms Comments.

Lot 7 - Lot was approved for building
& signed by Dr Boyde Feb 78
On Mar 78 CBS discovered
that a water well had been
pulled in the Per Test Area
when he made the well Grout
Inspection. P Sunderland the
Owner & Easterday the well Puller
were informed Retest Run
April 1978 by B.H. Retest Passer
& pec area was modified to
allow correct Distance from
existing Well Easterday Inc
started to sue Sunderland
May 1980. In June 1980
They settled out of Court.

3/11/81 RH

approved for

lot #7

1-12-78

#1 high test
hole

x1


x6

x2

x4

x5

x3



2ft. contours
est.

lot corner 5'-7' lower than
#1 hole

#6 & #2 2'-3' lower
than #1 hole

Where is road? (not marked)
3/23/78

Appears to be F.F. hand
writing No measurements
or scale



HOWARD COUNTY HEALTH DEPARTMENT

Joyce M. Boyd, M.D., County Health Officer

June 26, 1991

Reply to:

Mrs. Jennifer Johnson
13850 Forsythe Road
Sykesville, Maryland 21784

RE: Dickey Farms - Lot 7
Day Farm Road
Well Tag Number: HO-73-2632

Dear Mrs. Johnson:

This is to advise that the above referenced property passed the standard percolation test on April 27, 1978 and is considered a buildable lot utilizing well and septic system.

This is to advise that the well for the above referenced lot was constructed in accordance with the Maryland Well Construction Regulations (COMAR 24.04.04). A copy of the well driller's completion report is enclosed.

The yield test indicated a flow rate of 14 gallons per minute. Water quality sampling to satisfy Certificate of Potability requirements occurs after all plumbing is complete and generally is the final prerequisite to occupancy approval.

If you have any questions regarding this matter, please call me at 461-9933.

Very truly yours,

Craig Williams, Director
Water and Sewerage Program

CW:jr

Enclosures

Bureau of Environmental Health
3525-H Ellicott Mills Drive Ellicott City, Maryland 21043-4544
Water and Sewerage, Permits 461-9933 Community Environmental Health 461-9944
Technical Services 461-9955 Director 461-9956 TDD 313-2323