

PERMIT

SEWAGE DISPOSAL SYSTEM

P 12142 A 11782

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY

ELLICOTT CITY

DISTRICT___

DATE 8/31/66

INDEXED


Debra Corp. Owner - John E. Ruth Co. is PERMITTED TO INSTALL X ALTER
ADDRESS 400 Overbrook Rd., Baltimore 28, Md. PHONE
A SEWAGE DISPOSAL-SYSTEM LOCATED AT
SUBDIVISION River Park Estates ROAD River Rd. LOT 13, Sec.
PROPERTY OWNER Debra Corp.
ADDRESS
SPECIFICATIONS - 3 bedrooms
DRAIN FIELD DEPTHFEET, BOTTOM AREASQ. FT.
SEEPAGE PITS ABSORBENT SIDE-WALL AREASQ. FT.
SEPTIC TANK CAPACITY 750 GALLONS
FOR GARBAGE GRINDER, INCREASE DISPOSAL AREA 22% & TANK CAPACITY 50%.
OTHER Dry well - 16 ft. square - set block and top for 12 ft. diameter and fill in rest of pit with gravel. Depth of dry well 9 ft. deep below
fill in rest of pit with gravel. Depth of dry well 9 ft. deep below inlet pipe. Inlet pipe no deeper than 4 ft. below original grade.
Place dry well 43 ft. from front lot line and 91 ft. from right side line as seen when facing lot from River Rd.
PLANS APPROVED BY D. W. Monaghan DATE 5/10/66
FILE SEPTIC TANK AND DISTRIBUTION BOX WITH WATER BEFORE CALLING FOR AN INSPECTION, COVER NO WORK

FILL SEPTIC TANK AND DISTRIBUTION BOX WITH WATER BEFORE CALLING FOR AN INSPECTION. COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COMMISSIONERS NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTIFY THE HEALTH DEPARTMENT 48 HOURS BEFORE EXCAVATIONS ARE TO BE BACK FILLED.

a 11782

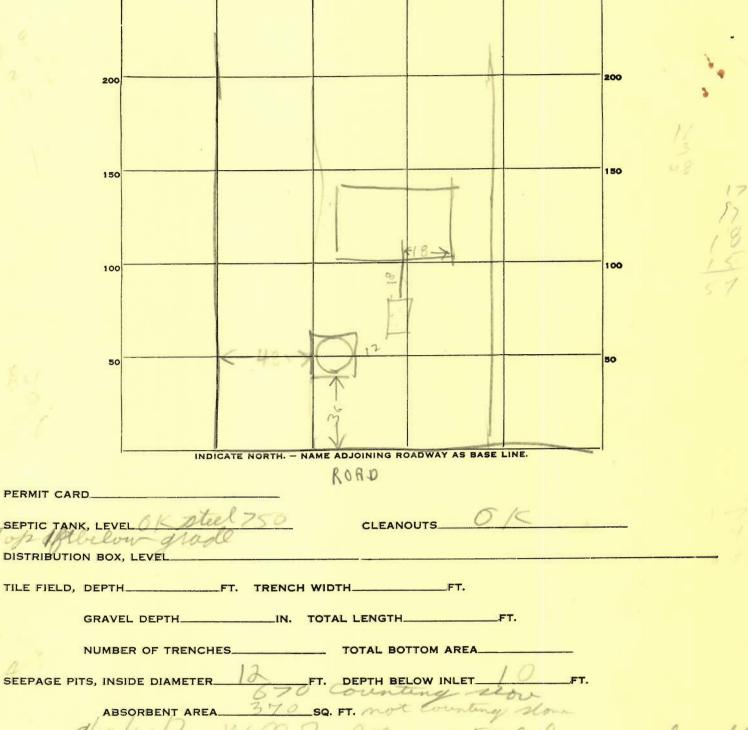

250

Perimeter of Day Well Inlet is 2FT below original grand 4x 16 x 9 = 596 sq ftrequired country stone

Date SYSTEM APPROVED 9/5/66 INSPECTOR Raymond Hodges