

Menu Save Reset Cancel Help

Record Detail * (This section is required.)

Permit Type	Permit Number	Opened Date
Building/Residential/Misc/Tanks	B20003714	10/27/2020
Description of Work		
SFD/ INSTALL (1) 120 GALLON ABOVE-GROUND PROPANE TANK AND RUN SUPPLY LINE TO COOKTOP INSIDE		

[check spelling](#)

Address * (This section is required.)

Search Reset Clear Get Parcel & Owner

Street #	Street Name	Street Type
2612	WYNFIELD	RD
Unit Type	Unit #	X Coordinate
-Select-		-76.94154
		Y Coordinate
		39.29786
City	State	Zip Code
WEST FRIENDSHIP	MD	21794
		Primary
		Yes

Parcel * (This section is required.)

Search Reset Clear Get Address & Owner

GIS ID *	Parcel	Parcel Area	Land Value	Improved Value	Exemption Value	Plan Area
887266	34	3.14	221800	560400	338600	RURAL
Legal Description						
IMPSLOT 3 3.147 A6 A[J2612 WYNFIELD RD[JWYNFIELD SEC 1						

[check spelling](#)

Block	Lot	Census Tract	Council Dist	Inspection Dist	Supervisor Dist	Map #	DAP Zone
	3	603000	5				
Plan Area	State Tax Id	Subdivision Name					
	1403308669	WYNFIELD					
Section	Area	Tax Map					
		15					
Grid	Zoning District	ADC Map					
15-18	RR-DEO	4813-K3					
SDP No.	Final Plan No.	WP File No.					
	F-81-059						
Record Plat No.	WS Contract No.	FDP No.					
4870							
Owner Occupied	Year Built	Historic District					
☐ Yes ☐ No	1985	☐ Yes ☒ No					
Historic District Registry No.	Stat Area	Flood Plain					
	3-05	☐ Yes ☒ No					
Building No							

Approved
10/29/20
AH

Owner * (This section is required.)

Search

Reset

Clear

Name ***Address Line 1****Address Line 2****Address Line 3****Mail City****Mail State**MD **Mail Zip Code****Phone****Primary**Yes **E-mail****Cell Number****Fax Number****Professionals** (This section is not required.)

Search

Reset

Clear

License # ***Business Name****License Type** *Propane Gs **First Name****Middle Name****Last Name****Primary**No **Address Line 1****Address Line 2****City****State**MD **ZIP Code****Phone 1****Phone 2****Fax****E-mail****Applicant** (This section is not required.)

Search

As Owner

As Lic. Prof

As Contact

Type *Applicant **First Name****MI**S **Last Name****Relationship**-Select- **Full Name****Primary**Yes **Organization Name****Street Address****Address Line 2****City****State**MD **Zip Code****Phone****Cell****Fax****E-mail ***

Addtl Info

Est Construction Cost *	Housing Units *	Number of Buildings *	Public Owned
3119	0	0	No
Construction Type			
-Select-			

TANK INFORMATION

RESIDENTIAL TANK INFORMATION

Capital Project-No Fee *	Capital Project Number	Fee Exempt *	Roadside Tree Project Permit *	Roadside Tree Permit #
☐ Yes ☒ No		☐ Yes ☒ No	☐ Yes ☒ No	
Existing Use	Number of Tanks Installed *	Number of Tanks Removed *		
SFD	1	0		
Water Supply	Sewage Disposal	Expiration Date	Relocate Existing Tank *	
Private	Private	4/27/2021	0	

PAYMENT INFORMATION

Check 1	Payee 1	Check 2	Payee 2	SAP Doc No	SAP Entered

Submit

Cancel

46,599.4 AC
 0.1577 AC
 1,802.4 AC
 48,559.4 AC

TOTAL

50' Tank to Septic
 114' Tank to Well


Approved for
 LP tank
 B2000-3714
 10/29/20

Ricardo Molina

WYNFIELD

SHEET 2

North





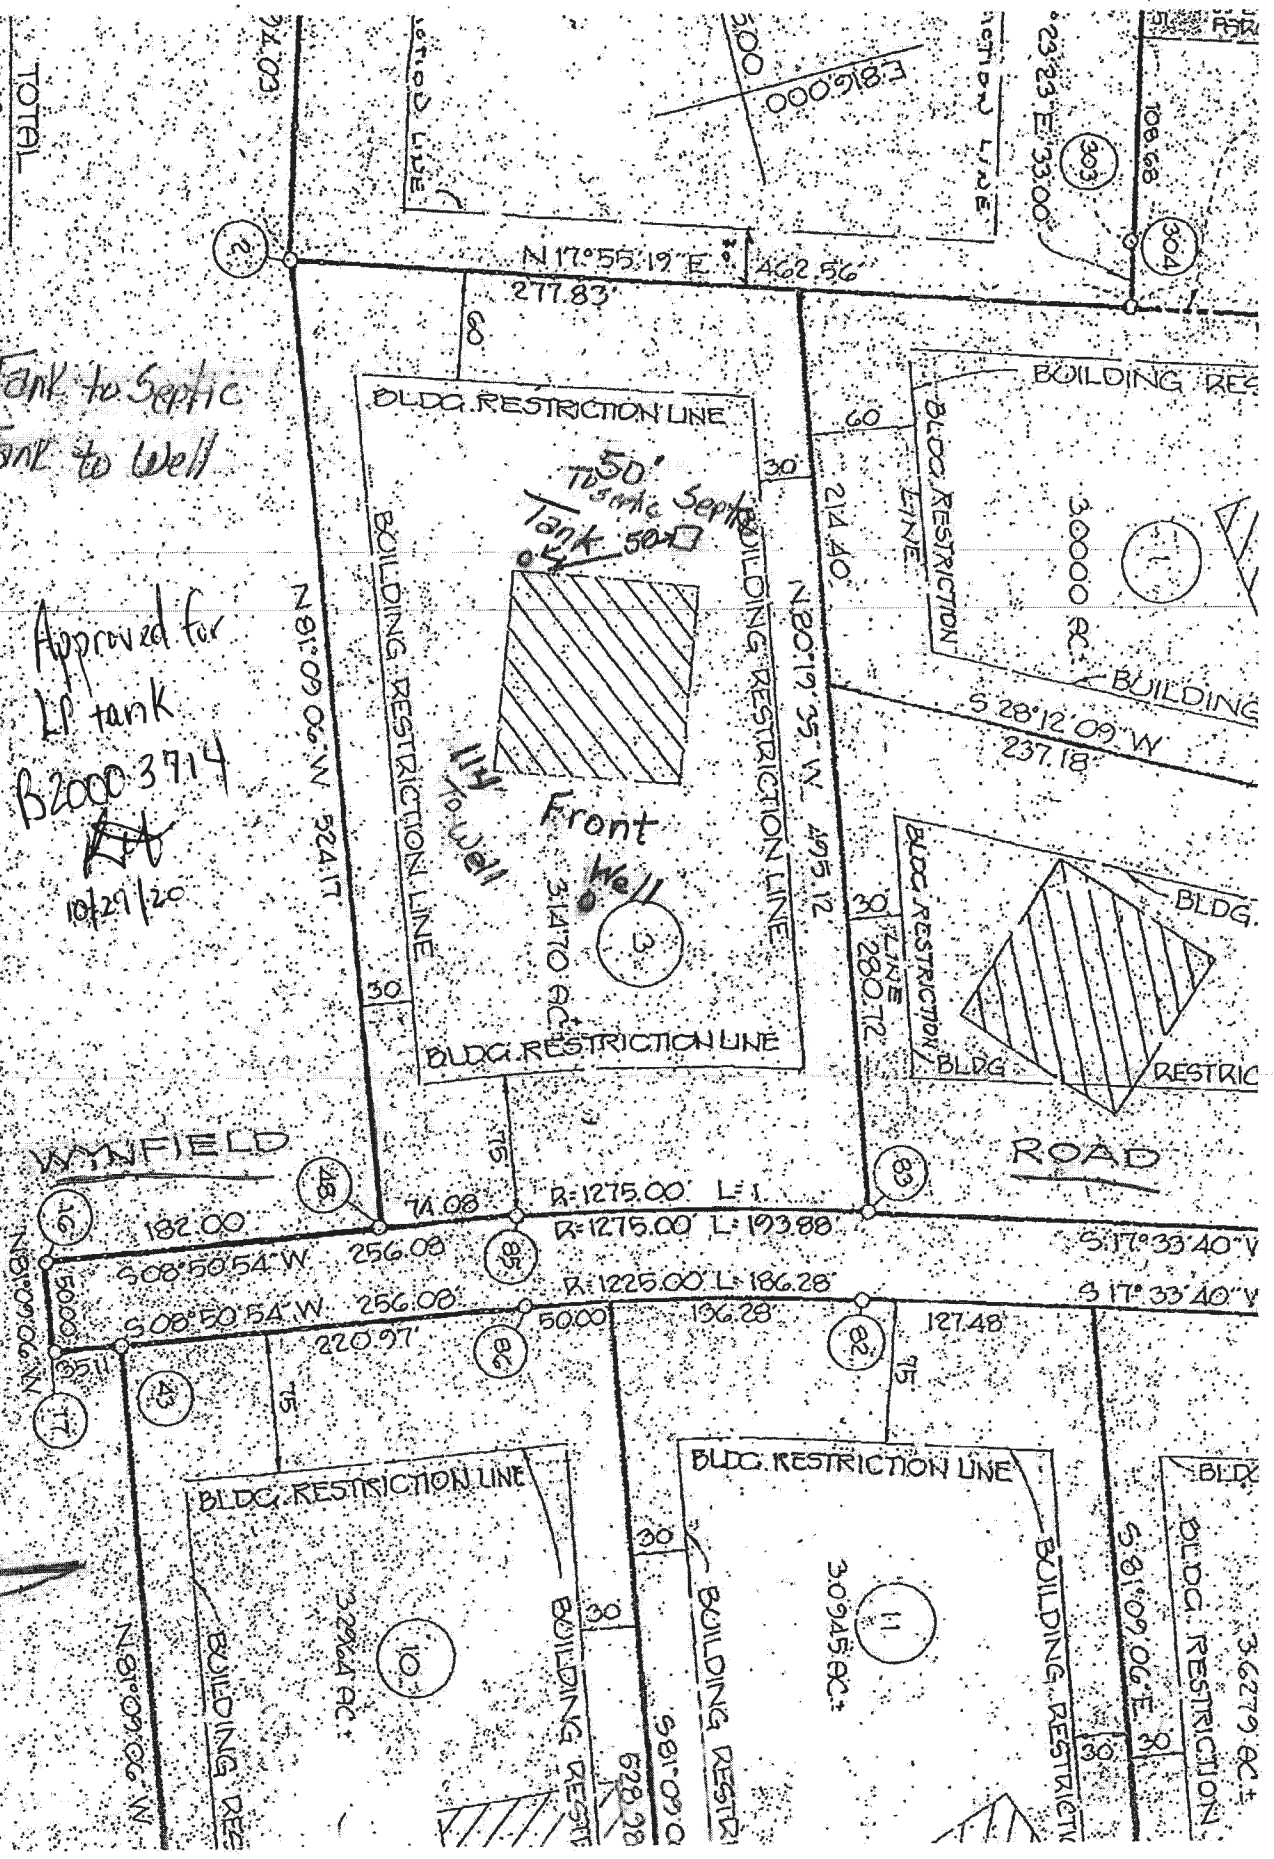


Real Property Data Search

Search Result for HOWARD COUNTY

View Map		View GroundRent Redemption		View GroundRent Registration	
Special Tax Recapture: None					
Account Identifier:		District - 03 Account Number - 308669			
Owner Information					
Owner Name:		MOLINA RICARDO FORBES ANISHKA CYNTISH		Use:	RESIDENTIAL
Mailing Address:		2612 WYNFIELD RD WEST FRIENDSHIP MD 21794-9517		Principal Residence:	YES
				Deed Reference:	/19619/ 00234
Location & Structure Information					
Premises Address:		2612 S WYNFIELD RD WEST FRIENDSHIP 21794-0000		Legal Description:	LOT 3 3.147 A6 A 2612 WYNFIELD RD WYNFIELD SEC 1
Map:	Grid:	Parcel:	Neighborhood:	Subdivision:	Section:
0015	0018	0034	3020202.14	2002	
					Block:
					3
					Lot:
					3
					Assessment Year:
					2019
					Plat No:
					4870
					Plat Ref:
Town: None					
Primary Structure Built		Above Grade Living Area		Finished Basement Area	
1985		2,856 SF			
				Property Land Area	
				3.1400 AC	
				County Use	
Stories	Basement	Type	Exterior	Quality	Full/Half Bath
2	YES	STANDARD UNIT	FRAME/	5	3 full/ 1 half
					Garage
					1 Attached
Last Notice of Major Improvements					
Value Information					
		Base Value		Value	
				As of	
				01/01/2019	
				As of	
				07/01/2020	
				As of	
				07/01/2021	
Land:		221,800		261,000	
Improvements		416,000		384,500	
Total:		637,800		645,500	
Phase-In Assessments				642,933	
Preferential Land:		0			645,500
					0
Transfer Information					
Seller: JACQUES ARTHUR DUBRUTZ		Date: 08/13/2020		Price: \$675,000	
Type: ARMS LENGTH IMPROVED		Deed1: /19619/ 00234		Deed2:	
Seller: SPITZER GLENN M		Date: 04/20/2004		Price: \$580,000	
Type: ARMS LENGTH IMPROVED		Deed1: /08241/ 00536		Deed2:	
Seller: BALLENGER CREEK ASSOCIATES		Date: 07/18/1984		Price: \$37,500	
Type: ARMS LENGTH IMPROVED		Deed1: /01269/ 00298		Deed2:	
Exemption Information					
Partial Exempt Assessments:		Class		07/01/2020	
County:		000		0.00	
State:		000		0.00	
Municipal:		000		0.00 0.00	
				0.00 0.00	
Special Tax Recapture: None					
Homestead Application Information					
Homestead Application Status: No Application					
Homeowners' Tax Credit Application Information					
Homeowners' Tax Credit Application Status: No Application				Date:	

CODE/APPENDIX 2010/2011A APPROVED UP
RELEASED FOR PRODUCTION
O.C. DATE

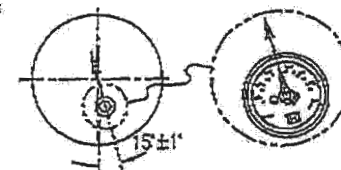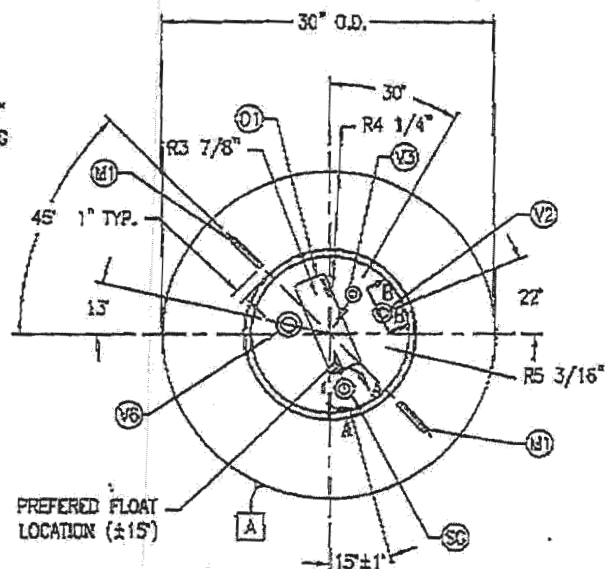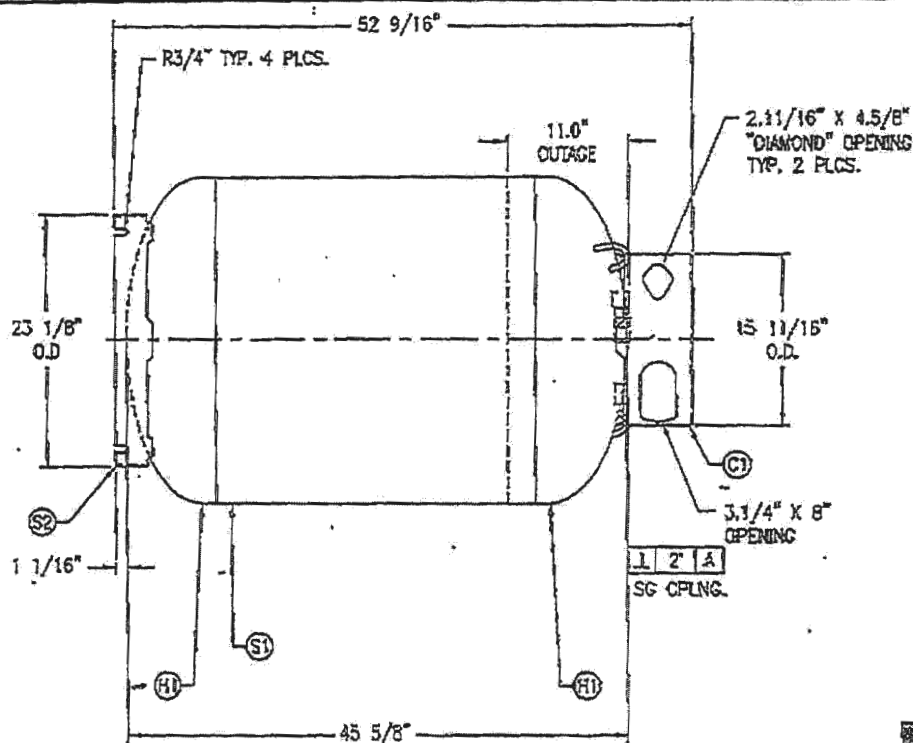

NOTES:

1. INSIDE OF THE TANK TO BE CLEAN, DRY & FREE OF RUST, SLAG & OTHER FOREIGN PARTICULATE MATTER.
2. FOR NON-CORROSIVE SERVICE.
3. SLEEVE & PROTECTIVE COVER (FOR TOP OF GUARD) TO BE PUT ON TANK AFTER PRODUCTION.
4. ATTACH NAMEPLATE TO GUARD WITH FOUR RIVETS. PRIMARY HEAD OF RIVETS LOCATED ON EXTERIOR OF GUARD.
6. INSTALL SIGHT GAUGE DIAL AS SHOWN IN DETAIL A.
7. SEE DT DETAIL FOR CORRECT LENGTH OF DIP TUBE.

SYN	DATE	BY	REVISION	APP	REF	REV.	NOTES
1		TA		MR	C1042		
2		TA		MR	C1043	G	
3		MR		MR	C1044	D	
4		MR		MR	C1045	A	
5		EGG					

SPECIFICATIONS			
O.D. 30	LGTH. 45.5/8	SH.	
MAWF 250	PSI @ 820 °F	FD.	
BT-1	MMT-20 TO 250 PSI	GR. 120	SA 32.7
EXT	TEST	WT. 291#	CLT. 18.1
XRAY		CORR. ALY	SH
CRN L48B5.5C		HD	
WELD DETAILS: M-1932		CODE: ASME SECTION VIII DIV. 1	
STD. TOLERANCES (UNLESS OTHERWISE NOTED): M-2461		LATEST EDITION & APPENDIX	



420# ASME DOMESTIC
STORAGE TANK

DESIGNED BY LC	DATE	SCALE: NONE
APP. BY JD	DATE	DRAWING NO.: 6762

TAN 121