

PUB. SEWER STATUS VERIFIED BY \_\_\_\_\_

ISSUE DATE: 12/15/09

APPROVAL DATE: 12/17/2009

# PERMIT

P 532468

A REPAIR

## ON-SITE SEWAGE DISPOSAL SYSTEM HOWARD COUNTY HEALTH DEPARTMENT BUREAU OF ENVIRONMENTAL HEALTH

-J.M. Contracting LLC IS PERMITTED TO INSTALL ☐ ALTER ☒

ADDRESS: 425 Obrecht Road, Sykesville, MD 21784 PHONE NUMBER: 443-277-7526

SUBDIVISION: Talbots Last Shift LOT NUMBER: 12A

ADDRESS: 5199 Talbots Landing Road PROPERTY OWNER: John & Rose Torosino

SEPTIC TANK CAPACITY (GALLONS): N/A

PUMP CHAMBER CAPACITY (GALLONS): N/A

NUMBER OF BEDROOMS: 3

SQUARE FEET OF HOUSE: ~1500

LINEAR FEET OF TRENCH REQUIRED: 95

TRENCHES:	Trench to be 3.0 feet wide. Inlet 4.0 feet below original grade. Bottom maximum depth 10 & 7 feet below original grade. Effective area begins at 7.0 & 4.0 feet below original grade. 6 & 3 feet of stone below distribution pipe.
LOCATION:	Install trenches on contour downhill of failed trench. Upper trench has 10 foot bottom, and lower trench has 7 foot bottom. Both trenches have 3 feet of Effective Sidewall and 4 foot separation to rapidly permeable soil materials (very gravelly loamy sand). Set distribution box at top trench. Both trenches are within area defined as septic reserve (Perc Cert 11/12/1980).
PURPOSE:	The existing septic system has failed and the property owner has requested repair. Connection to public sewer is not possible: the property is not in Metropolitan District, and no capital project is planned that would make connection possible.

PLANS APPROVED: Robert Bricker DATE: 12/15/09

NOTE: PERMIT VOID AFTER 2 YEARS

NOTE: CONTRACTOR RESPONSIBLE FOR SCHEDULING A PRE-CONSTRUCTION INSPECTION FOR ALL INSTALLATIONS


NOTE: WATERTIGHT SEPTIC TANKS REQUIRED

NOTE: ALL PARTS OF SEPTIC SYSTEM SHALL BE 100 FEET FROM ANY WATER WELL

NOTE: MANHOLE RISERS REQUIRED ON ALL SEPTIC TANKS AND PUMP CHAMBERS

**NEITHER THE HOWARD COUNTY COUNCIL OR THE HEALTH DEPARTMENT IS  
RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM  
PERMITTEE RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT  
CALL 410-313-1771 FOR INSPECTION OF SEPTIC SYSTEM**

Sarena Dylan CT.

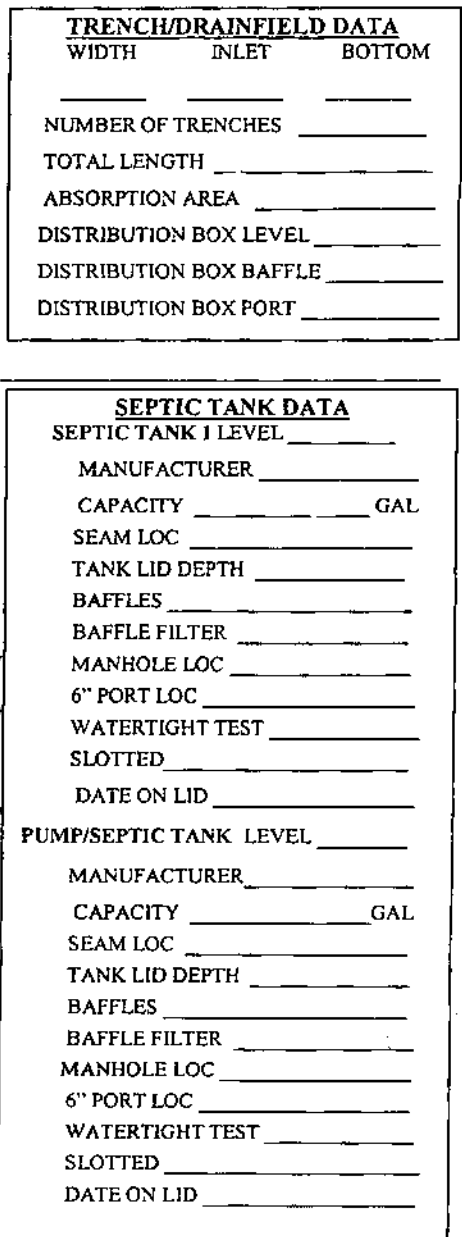

FINAL INSPECTOR Robert Buckner DATE OF APPROVAL 12/17/2009