





Right Elevation
SCALE: 3/16" = 1'-0"

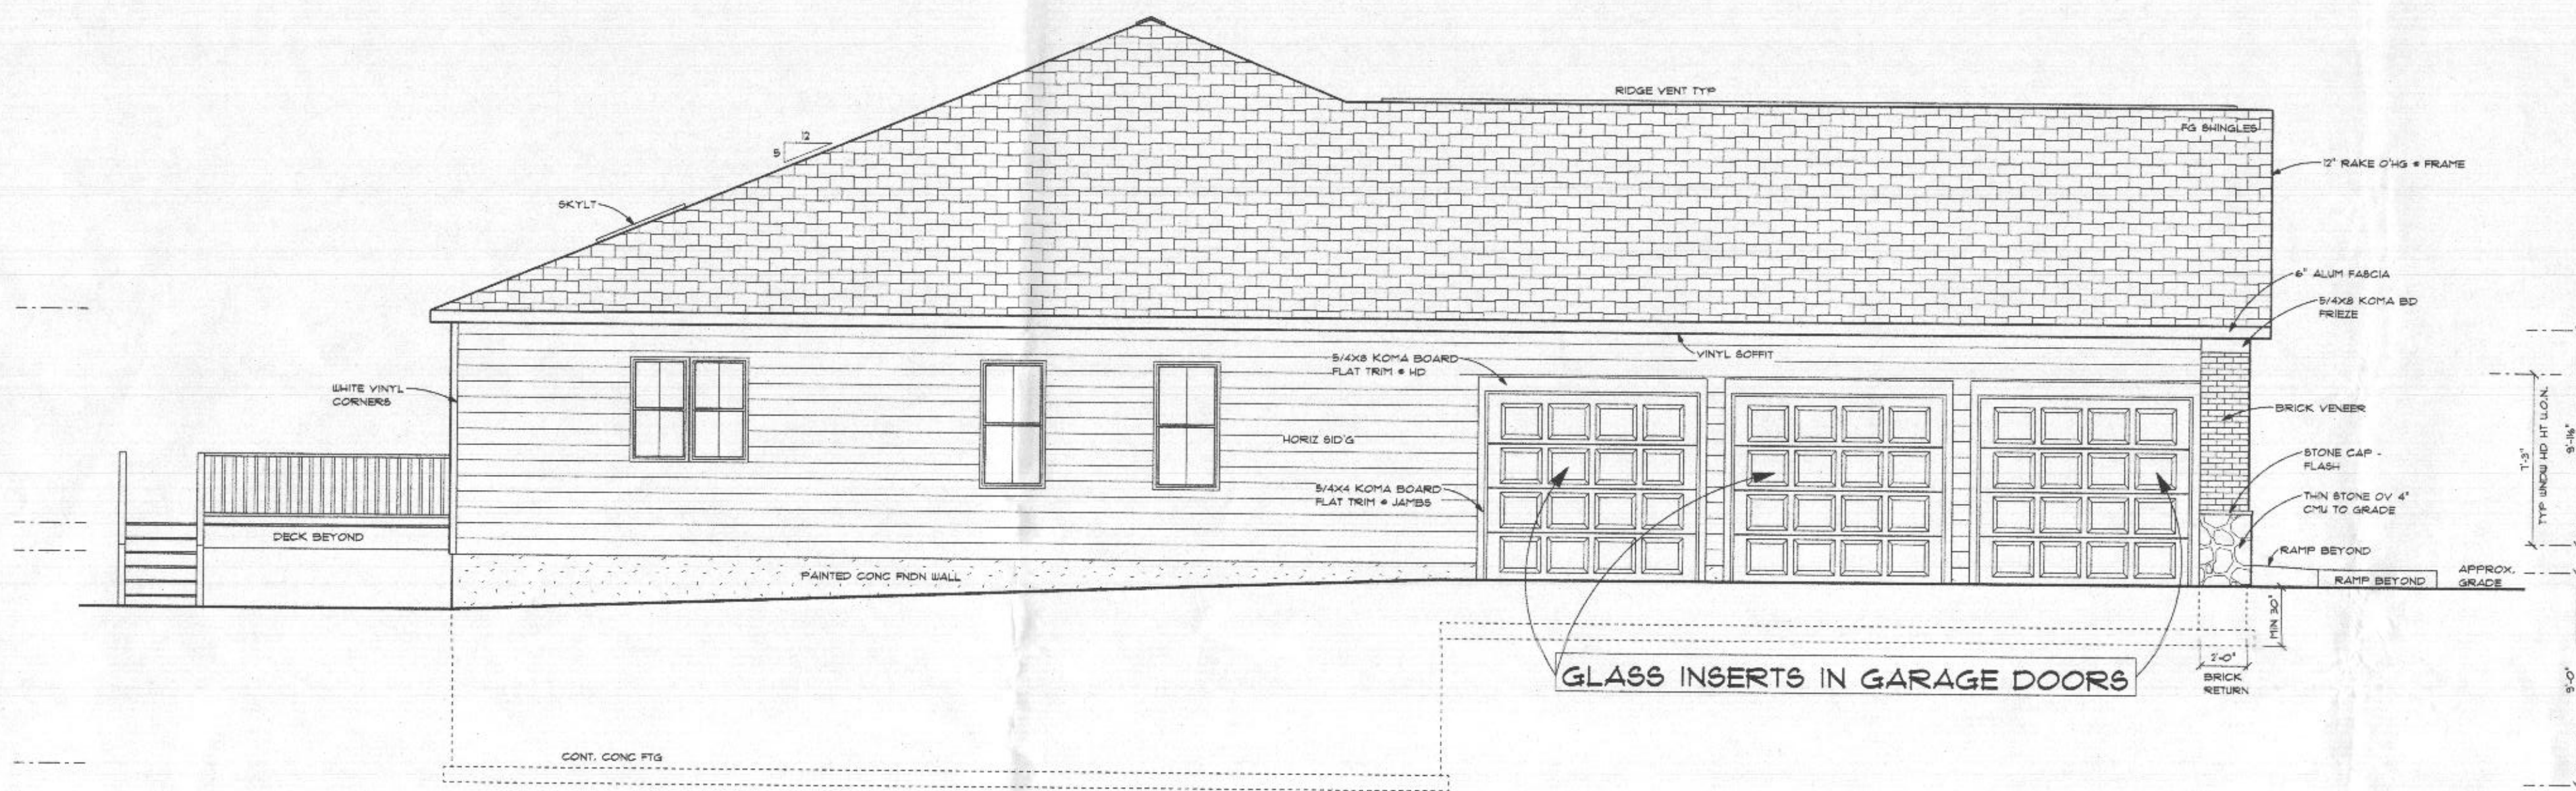

Left Elevation
SCALE: 3/16" = 1'-0"

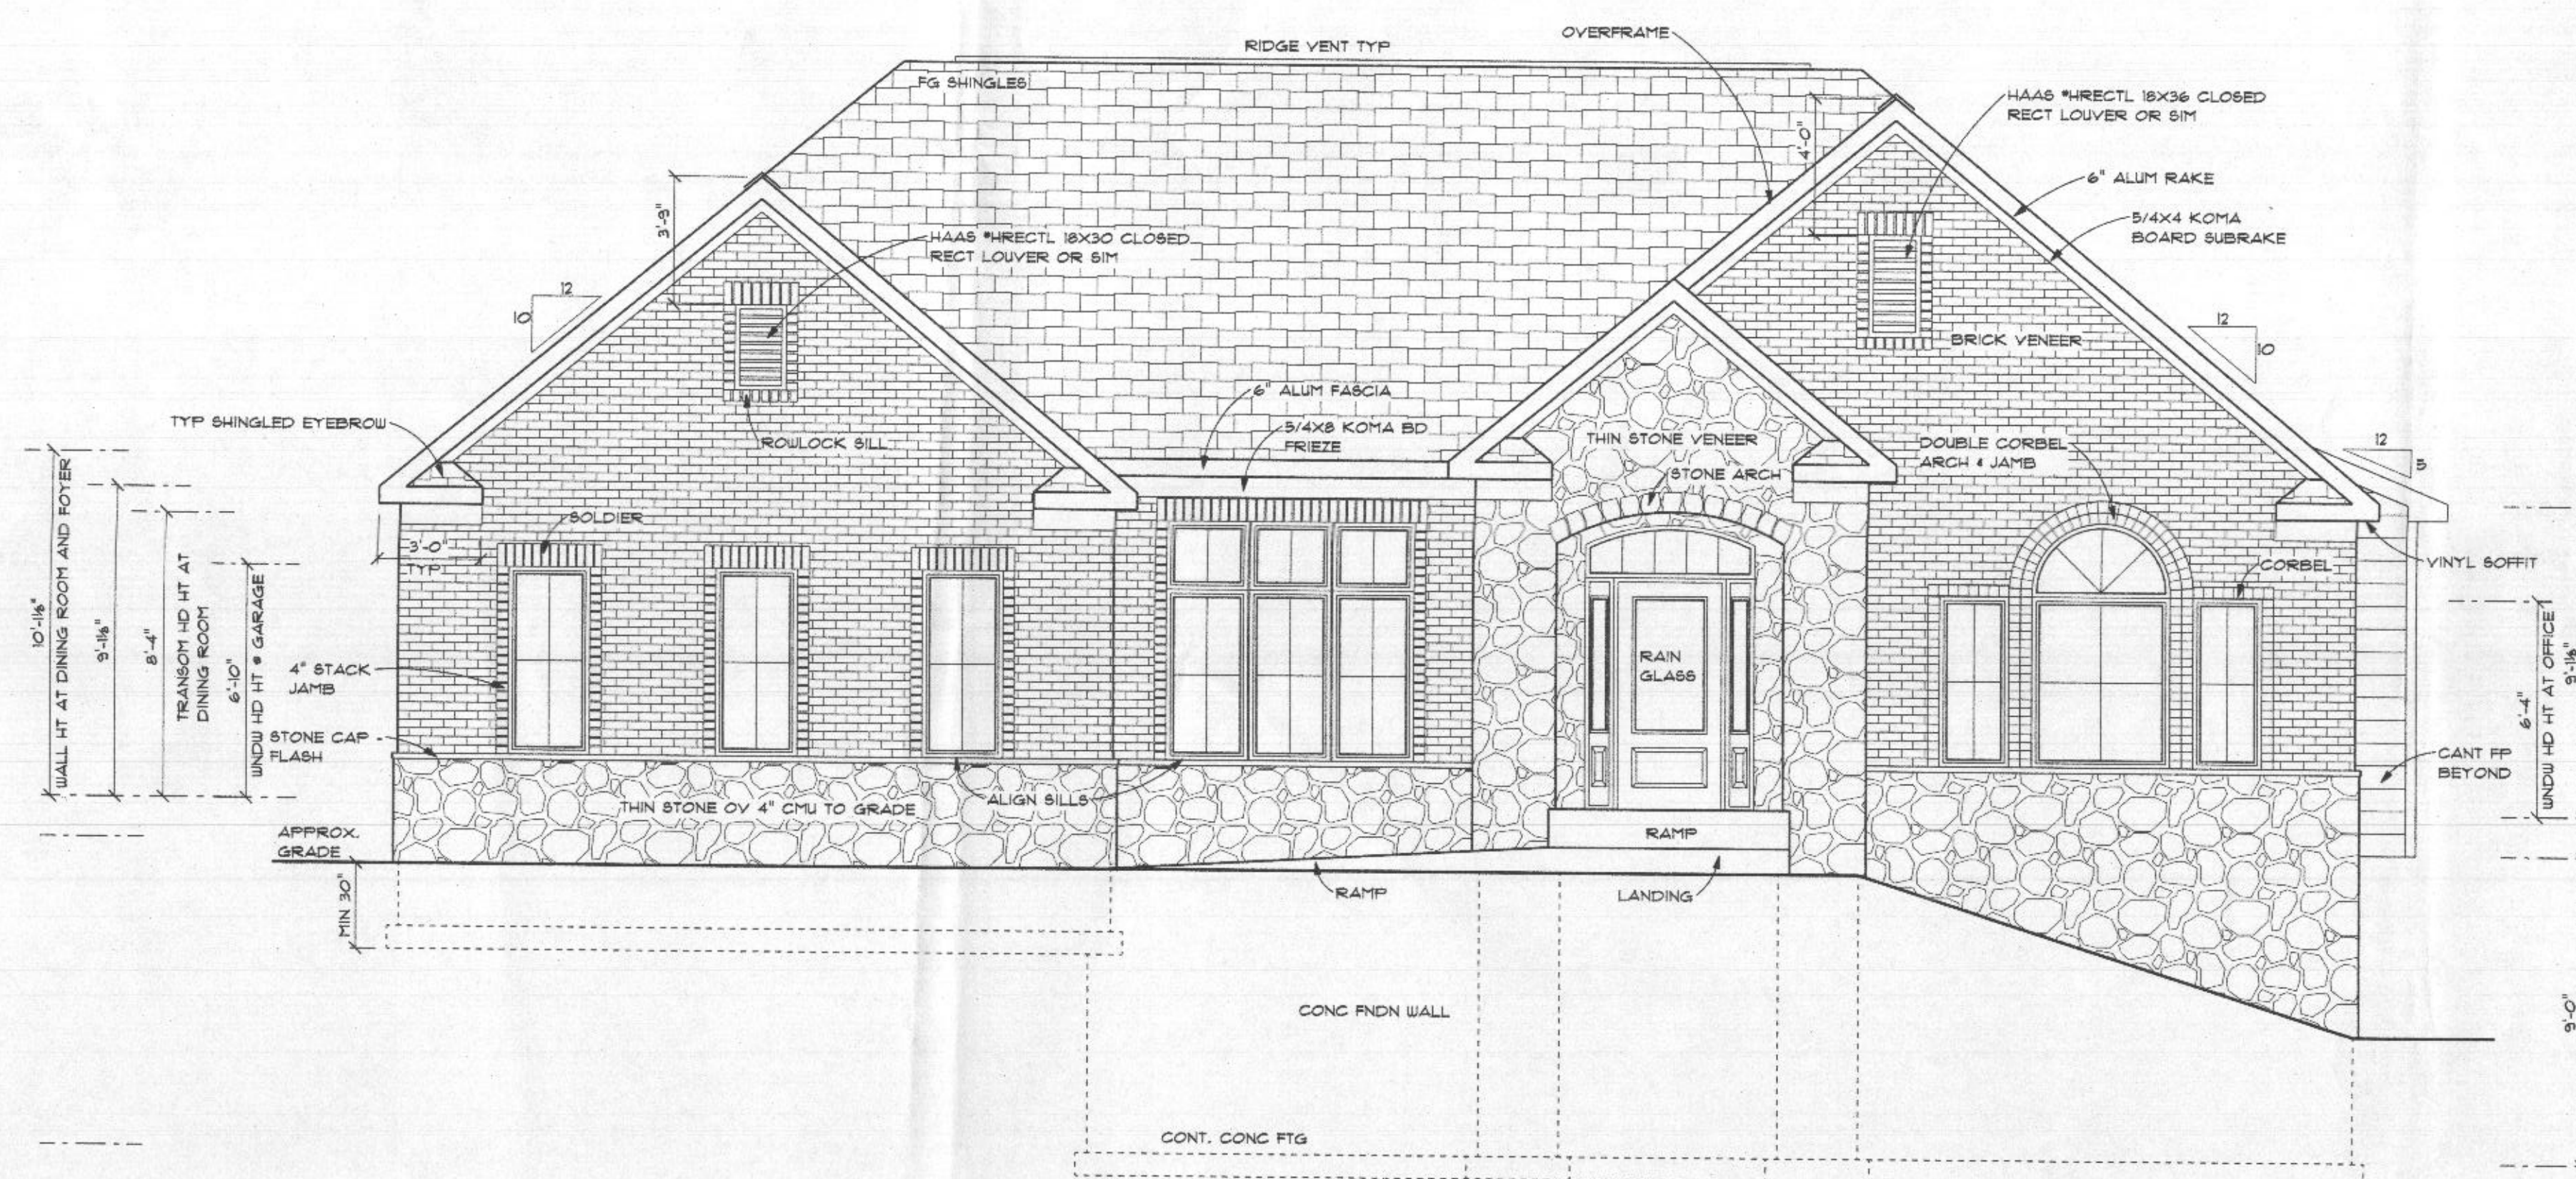

Front Elevation
SCALE: 1/4" = 1'-0"

NOTE: FRONT, SIDES & REAR.
WHITE VINYL SOFFIT & WHITE
ALUM. FASCIA.

NOTE: INSULATOR
ANTI-AIR INFILTRATION SYSTEM:
CAULKING AT EXTERIOR JOINTS,
BEAMS, AND OPENINGS AROUND
DOOR AND WINDOW JAMBS, FOAM
SEALER AT OPENINGS ON
EXTERIOR WALLS.

NOTE: CARPENTER
TYVEK HOUSE WRAP ALL 4 SIDES

UNITED DOUBLE-HUNG WINDOWS
5900 DOUBLE HUNG, LOW-E TILT &
WASH WINDOWS W/ GRILLES
SCREENS, WOOD EXTENSIONS &
CASINGS EXCEPT GARAGE

NOTE: USE WINDOW DEVICES WHERE
REQUIRED PER IRC 2021 R312.2

NOTE: HERITAGE 30 YEAR LAYERED
ARCHITECTURAL SHINGLE BY TAMKO


INTERIOR SPRINKLER
STANDARD HEADS EXPOSED

Plans OK,
match OSDS.
5 BR layout
JES 12/16/22


LOT 1 PRESERVE AT
WAVERLY GLEN

2021 CODE

The Nugget

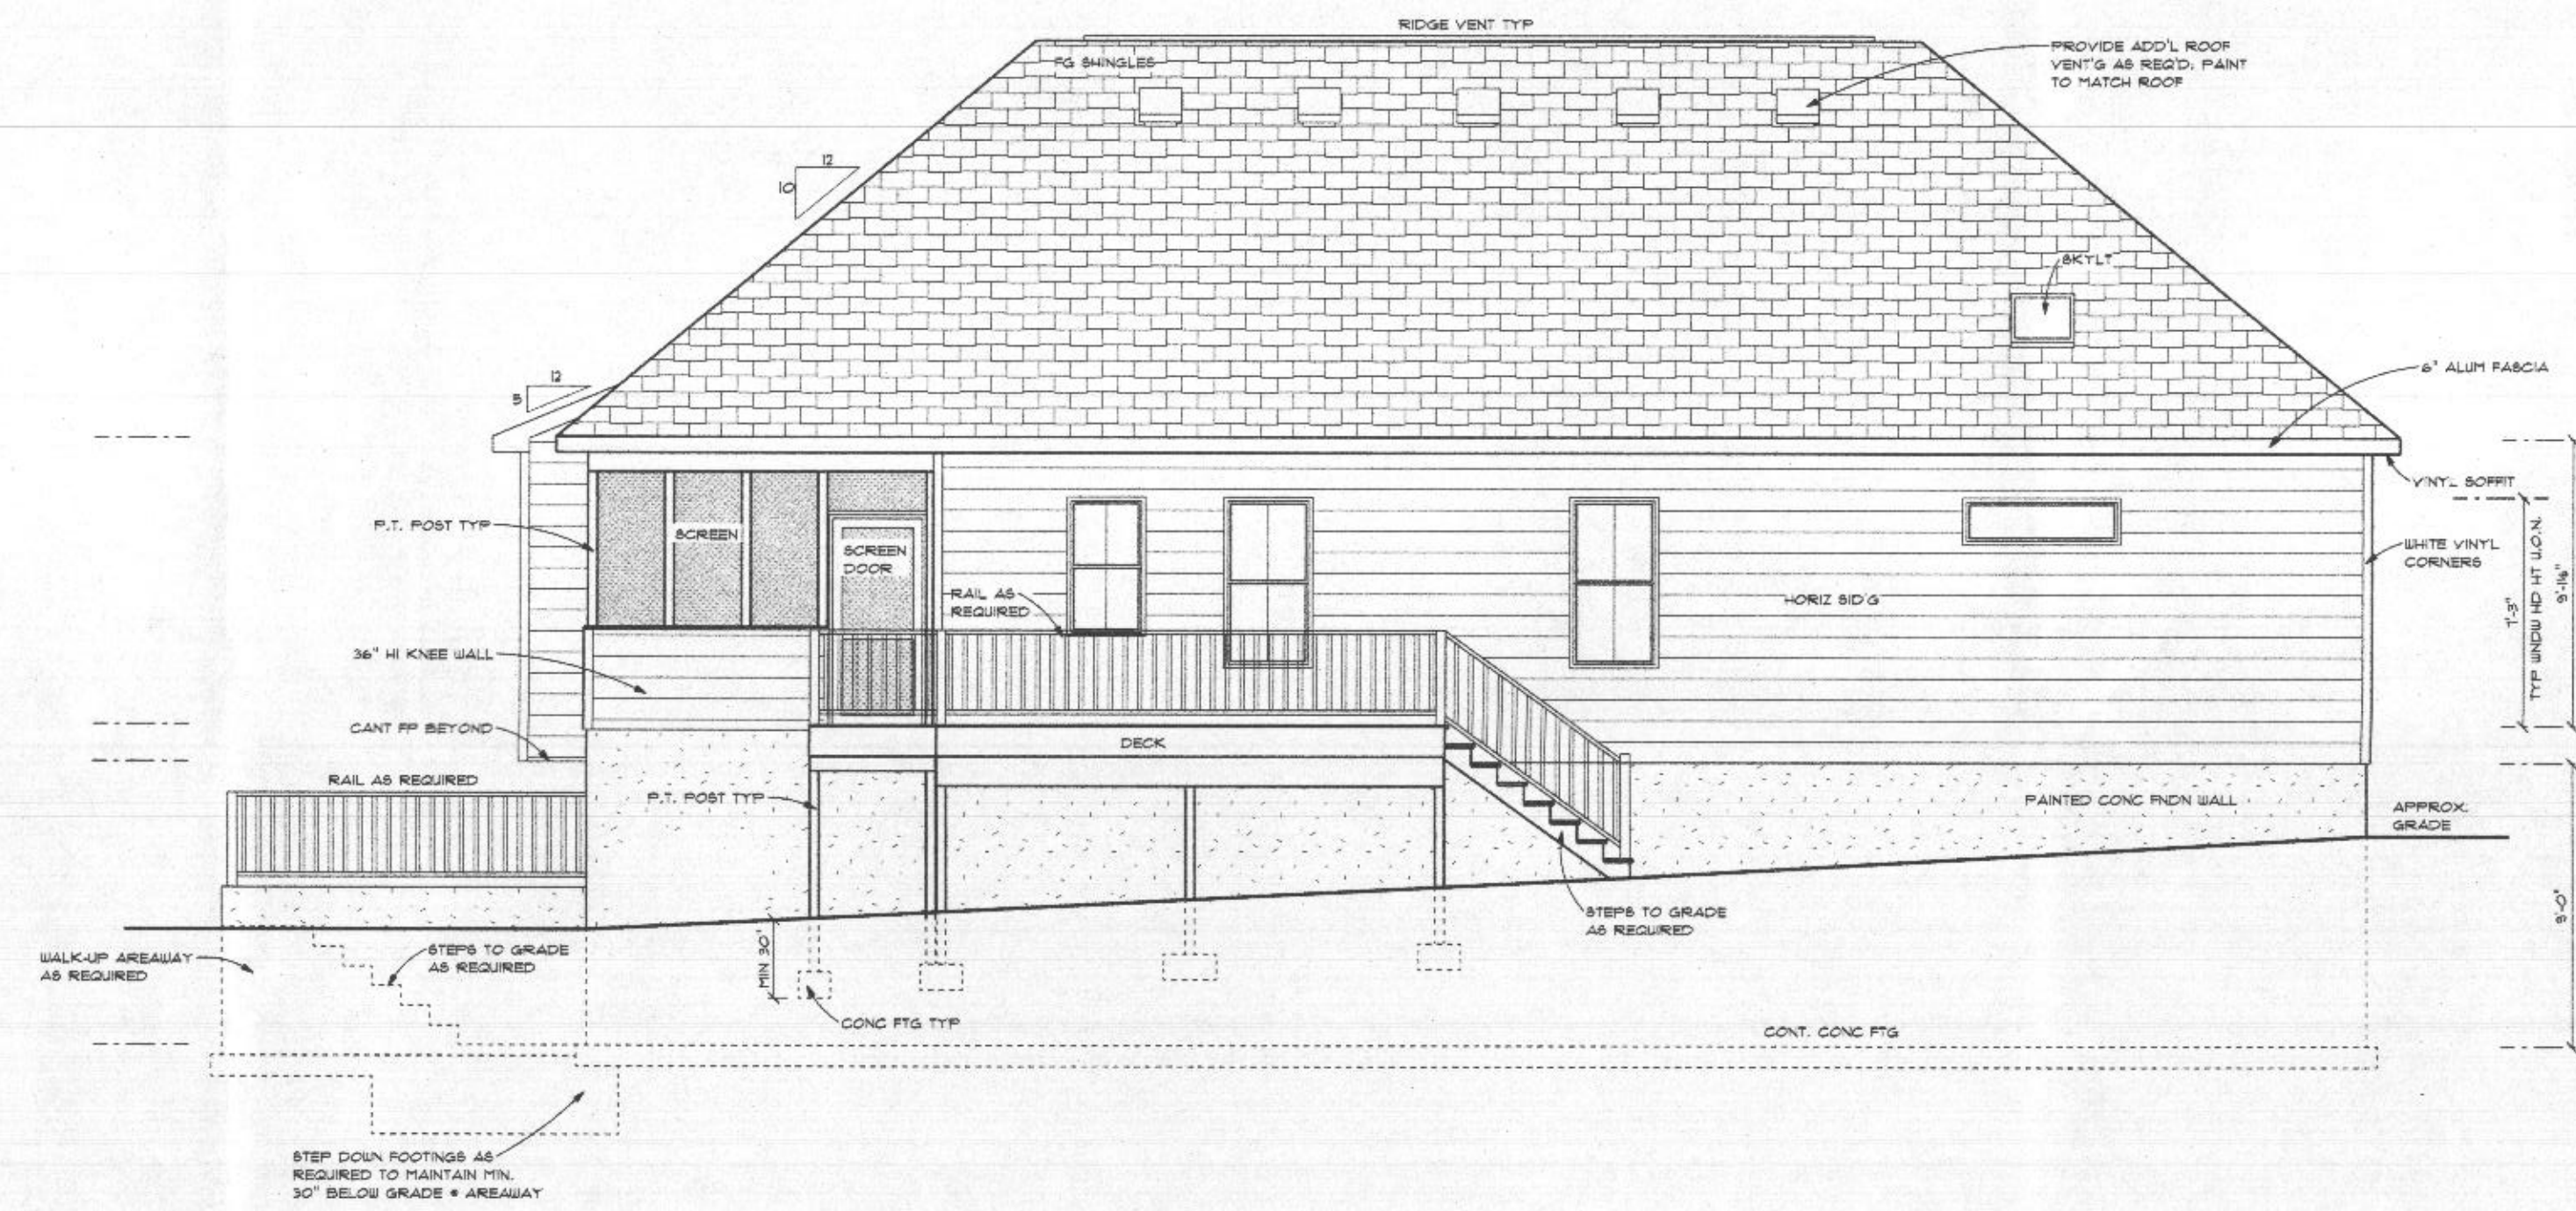


Rear Elevation
SCALE: 3/16" = 1'-0"

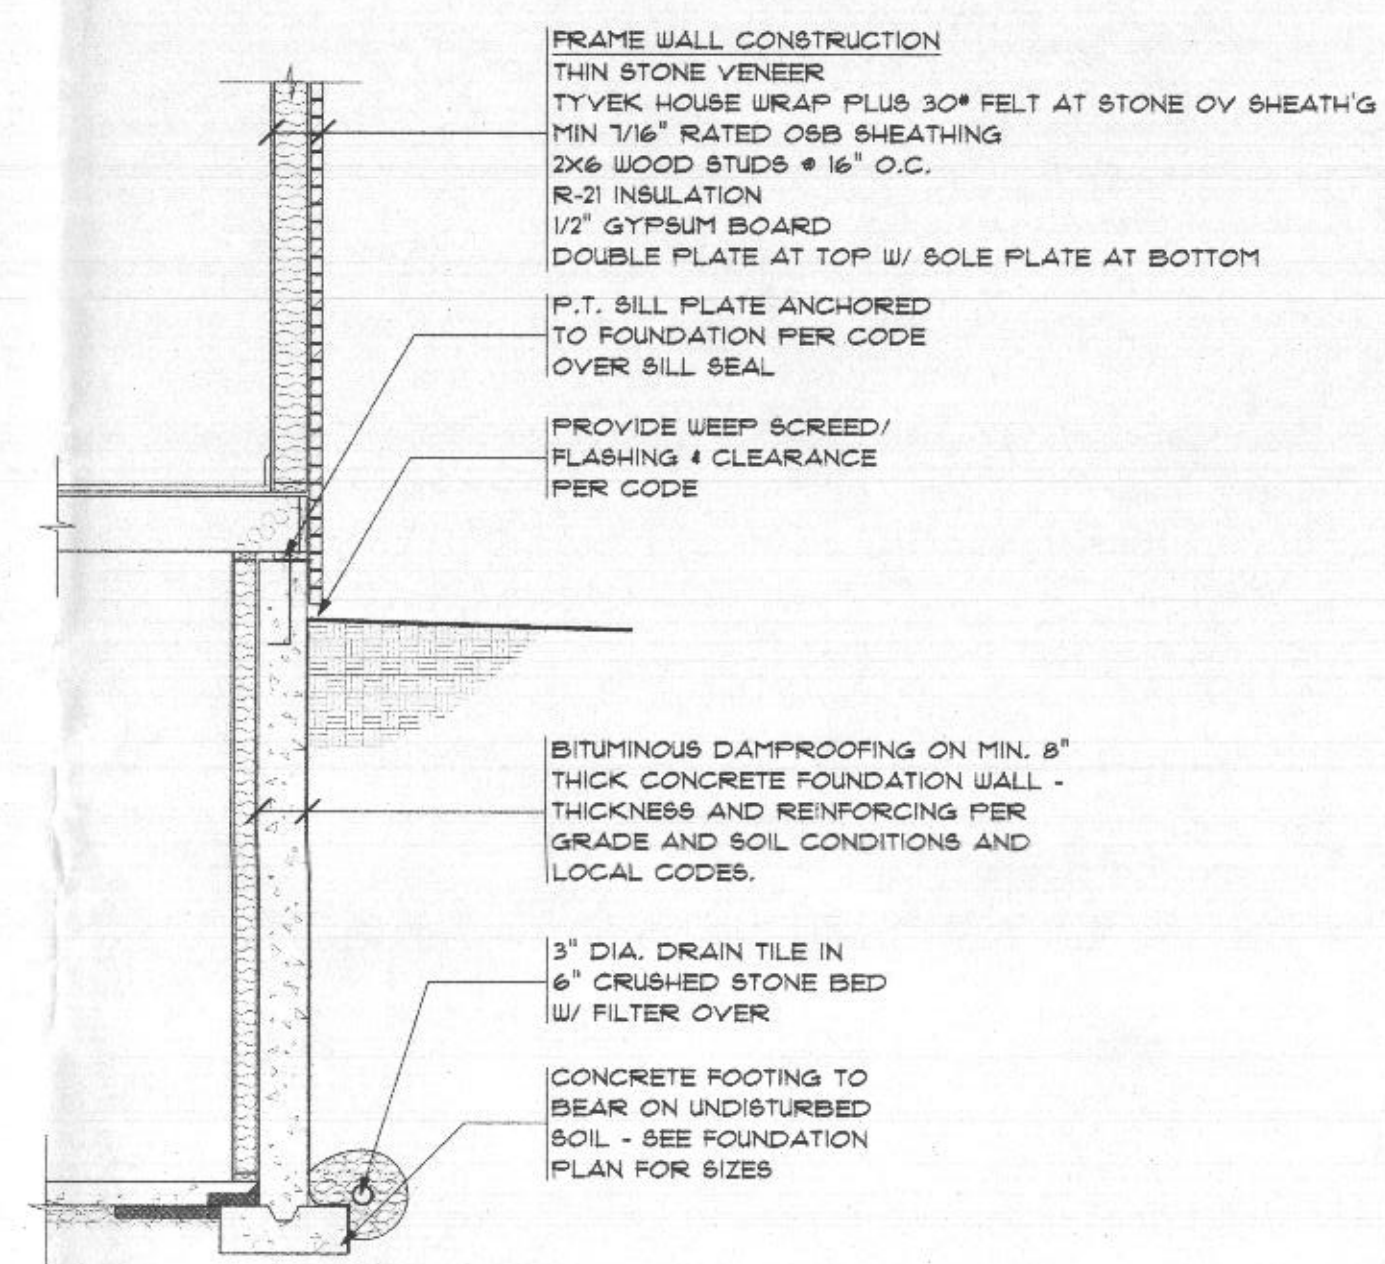


PARTIAL • THIN STONE

PROVIDE APPROVED CORROSION-RESISTIVE FLASHING AT THE INTERSECTION OF MASONRY AND WOOD FRAME CONSTRUCTION, OVER PROJECTING TRIM, WHERE DECKS, PORCHES, AND THE LIKE ARE ATTACHED TO WOOD FRAME CONSTRUCTION; AT ROOF TO WALL AND ROOF TO CHIMNEY INTERSECTIONS; IN ROOF VALLEYS, AT ALL ROOF PENETRATIONS; AT ALL WALL OPENINGS; AT ALL CAVITY INTERRUPTIONS AT MASONRY VENEER; AND ALL OTHER LOCATIONS REQUIRED TO PREVENT WATER PENETRATION OF THE STRUCTURE.

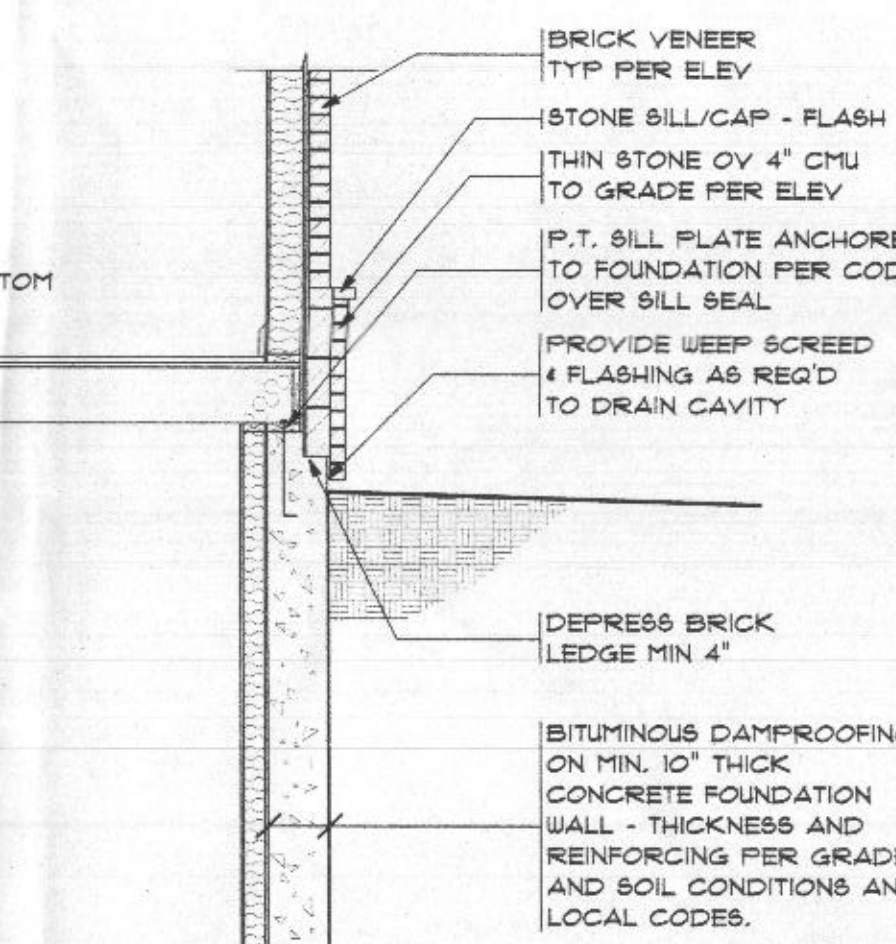

PARTIAL • BRICK

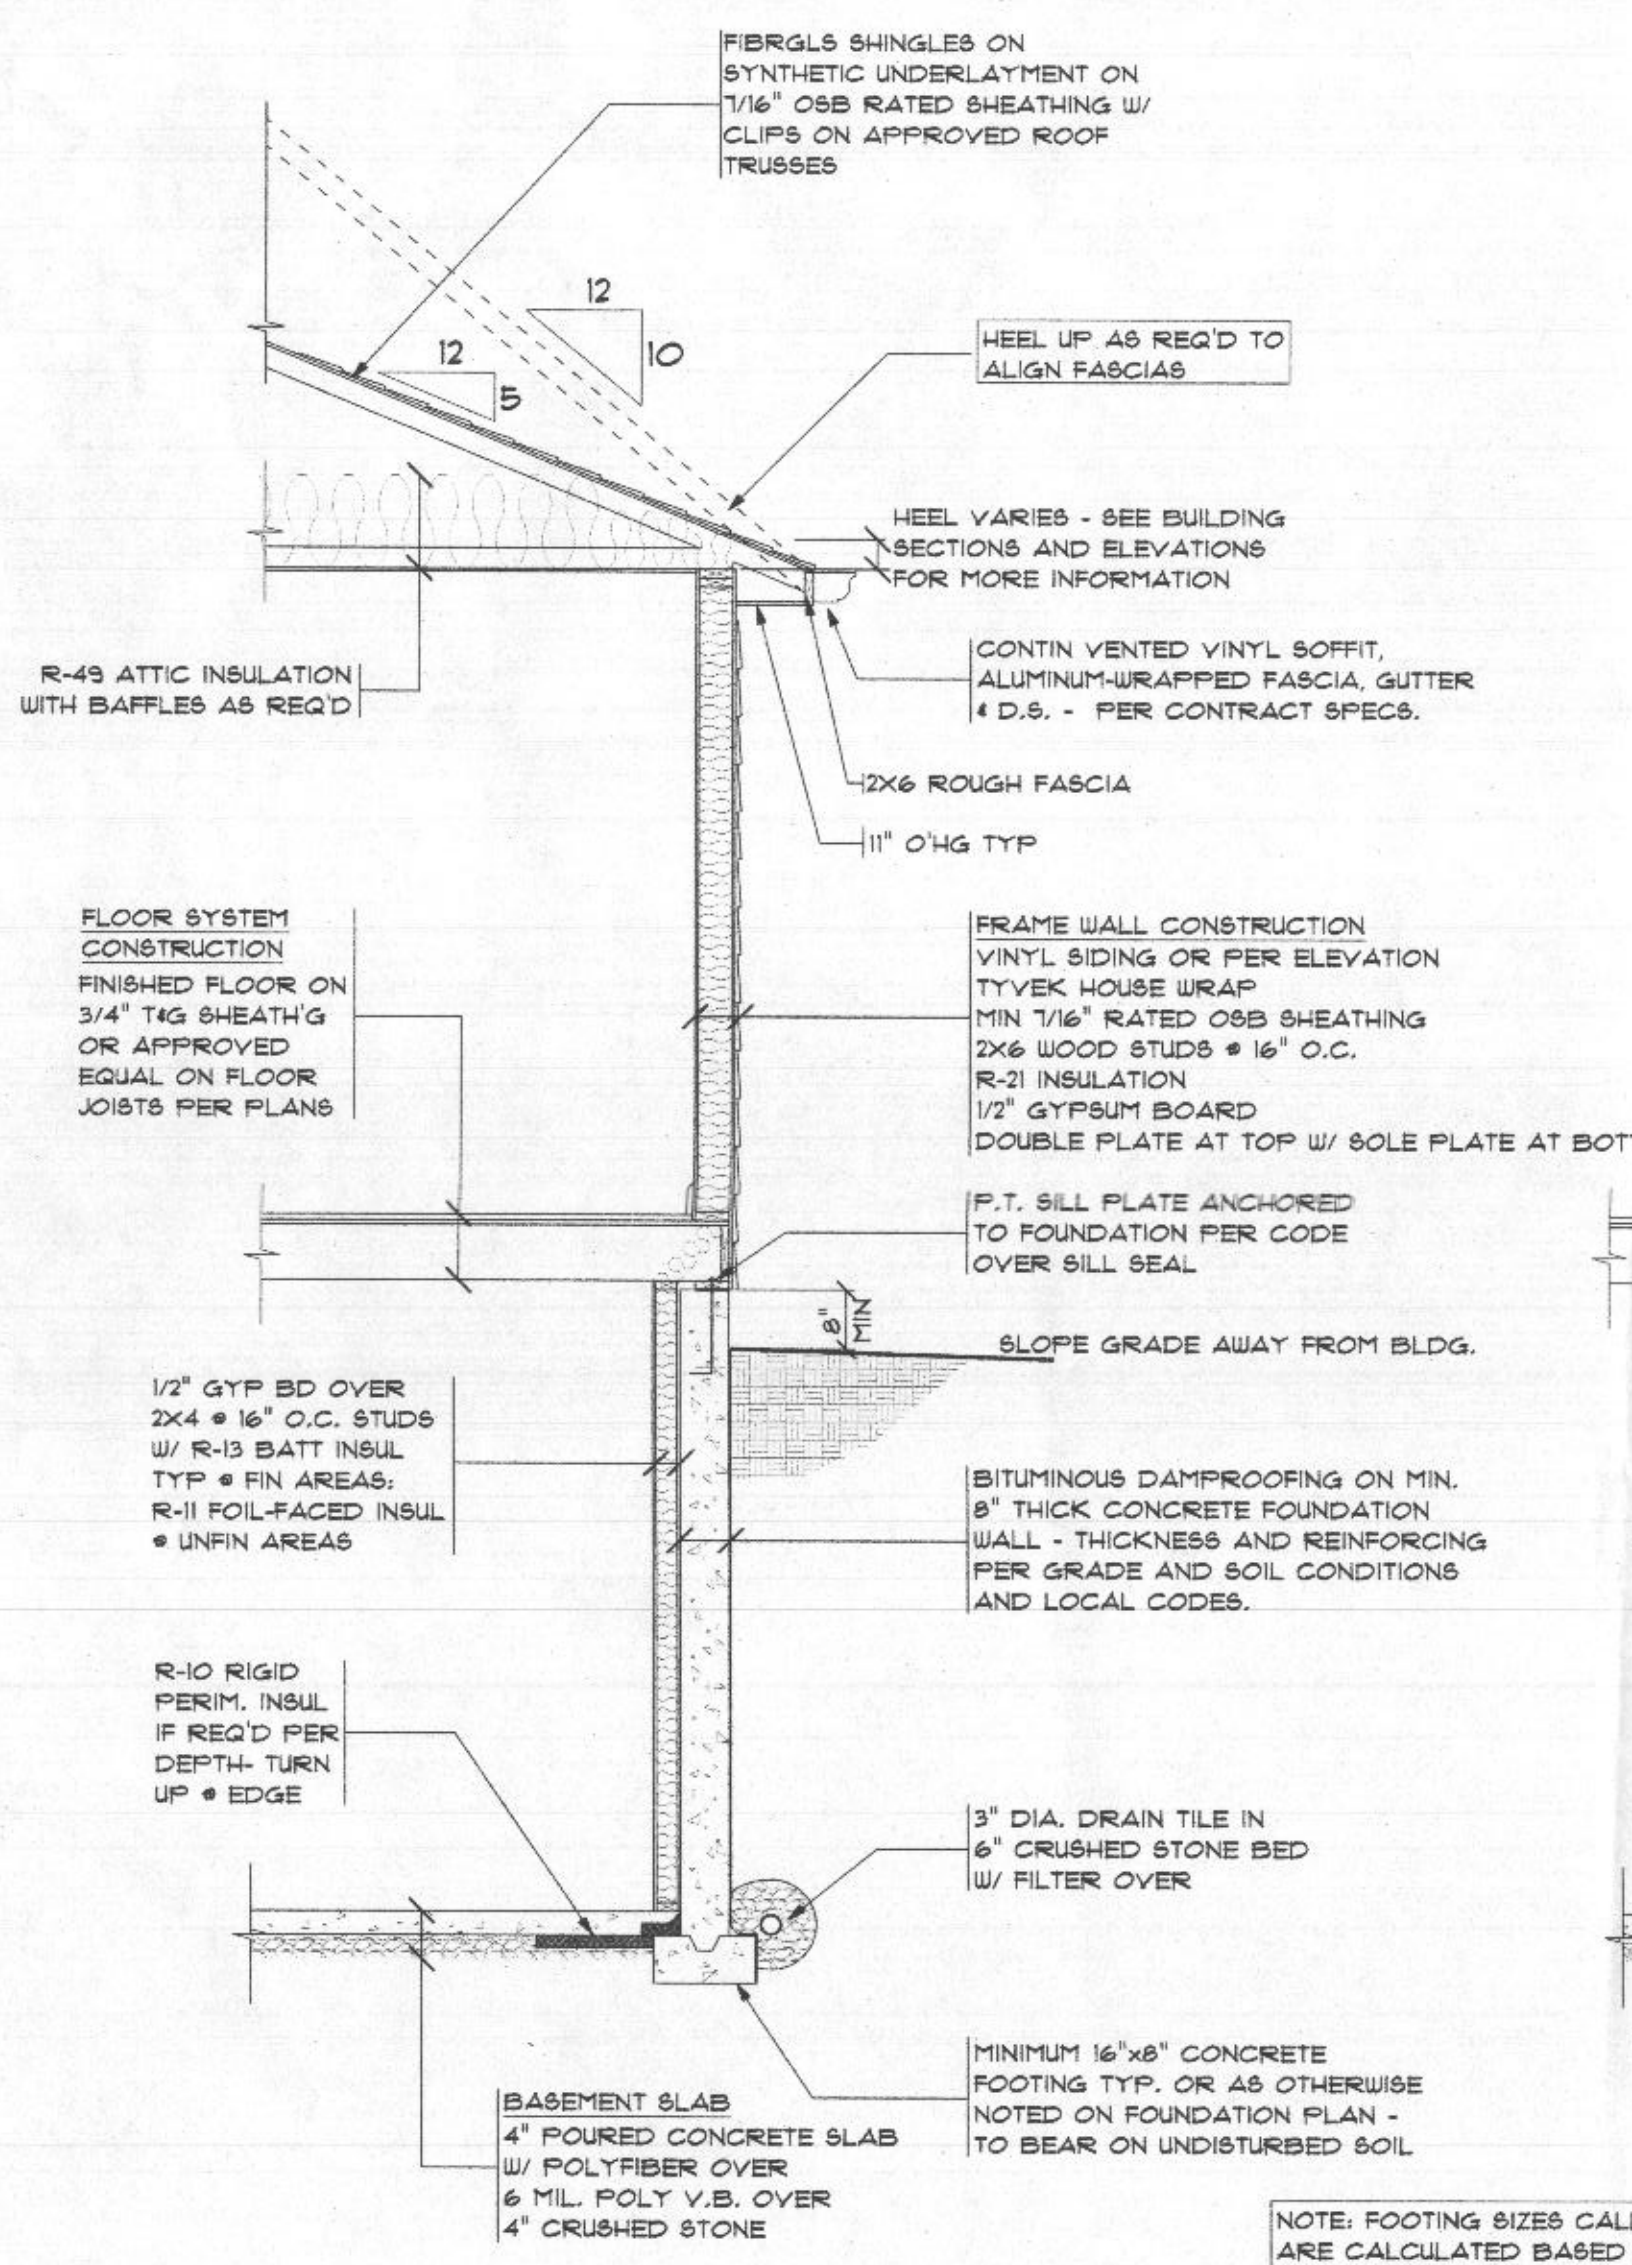

Frame Wall Section
SCALE: 3/8" = 1'-0"

2018 IECC ENERGY CODE COMPLIANCE REQUIREMENTS

THE BUILDING SHALL CONFORM TO THE FOLLOWING MANDATORY REQUIREMENTS PER THE 2018 INTERNATIONAL ENERGY CONSERVATION CODE:	
COMPLIANCE CERTIFICATE	A PERMANENT CERTIFICATE APPROVED BY THE LOCAL JURISDICTION DESCRIBING THE R-VALUES, U-FACTORS, AND SHGC OF THE BUILDING COMPONENTS AND BUILDING AIR LEAKAGE TEST RESULTS SHALL BE AFFIXED TO THE ELECTRICAL DISTRIBUTION PANEL OR ANOTHER LOCATION APPROVED BY THE LOCAL JURISDICTION, PER IECC R403.14 (IRC N1101.14).
AIR LEAKAGE	ALL NEW CONSTRUCTION BUILDINGS SHALL BE CONSTRUCTED TO LIMIT THE THERMAL ENVELOPE AIR LEAKAGE TO 3 AIR CHANGES PER HOUR AT 50 PASCALS OF PRESSURE AND TESTED VIA A BLOWER DOOR TEST PER IECC R402.4 (IRC N1102.4).
MAXIMUM FENESTRATION U-FACTOR AND SHGC	THE MAXIMUM U-FACTOR ALLOWED USING EITHER THE TOTAL UA ALTERNATIVE METHOD PER IECC R402.1.5 (IRC N1102.1.5) OR THE SIMULATED PERFORMANCE ALTERNATIVE PER IECC R405 (IRC N1105) SHALL BE 0.48 FOR VERTICAL FENESTRATION AND 0.75 FOR SKYLIGHTS PER IECC R402.5 (IRC N1102.5).
HVAC CONTROLS	EACH HEATING AND COOLING SYSTEM SHALL HAVE AT LEAST ONE THERMOSTAT PER IECC R403.1 (IRC N1103.1). THE THERMOSTAT CONTROLLING THE PRIMARY HEATING AND COOLING SYSTEM SHALL BE A PROGRAMMABLE THERMOSTAT PER IECC R403.1.1 (IRC N1103.1.1).
HEAT PUMP SUPPLEMENTARY HEAT	HEAT PUMPS WITH SUPPLEMENTARY ELECTRIC RESISTANCE HEAT SHALL HAVE CONTROLS THAT, EXCEPT DURING DEFROST, PREVENT SUPPLEMENTAL HEAT FROM OPERATING WHEN THE HEAT PUMP COMPRESSOR CAN MEET THE HEATING LOAD PER IECC R403.1.2 (IRC N1103.1.2).
DUCT SEALING	WHEN NEW FORCED AIR SYSTEMS ARE PROVIDED, ALL DUCTS, AIR HANDLERS, AND FILTER BOXES SHALL BE SEALED PER IECC R403.1.1 (IRC N1103.1.1). DUCT TIGHTNESS SHALL BE VERIFIED BY EITHER A ROUGH-IN OR POSTCONSTRUCTION TEST PER IECC R403.3.3 (IRC N1103.3.3) UNLESS DUCTS AND AIR HANDLERS ARE LOCATED ENTIRELY WITHIN THE BUILDING THERMAL ENVELOPE.
BUILDING CAVITIES AS DUCTS OR PLENUMS	BUILDING FRAMING CAVITIES SHALL NOT BE USED AS DUCTS OR PLENUMS PER IECC R403.3.5 (IRC N1103.3.5).
MECHANICAL SYSTEM PIPING INSULATION	MECHANICAL SYSTEM PIPING CAPABLE OF CARRYING FLUIDS ABOVE 105°F OR BELOW 55°F SHALL BE INSULATED TO R-3 MINIMUM PER IECC R403.4 (IRC N1103.4). PIPING INSULATION EXPOSED TO WEATHER SHALL BE PROTECTED FROM DEGRADATION AND DECAY PER IECC R403.4.1 (IRC N1103.4.1).
CIRCULATING HOT WATER SYSTEMS	CIRCULATING HOT WATER SYSTEMS SHALL BE PROVIDED WITH AN AUTOMATIC OR READILY ACCESSIBLE MANUAL SWITCH TO TURN OFF THE CIRCULATING PUMP WHEN THE SYSTEM IS NOT IN USE PER IECC R403.5.1 (IRC N1103.5.1).
MECHANICAL VENTILATION	THE BUILDING SHALL BE PROVIDED WITH VENTILATION PER IECC R1505 OR OTHER APPROVED MEANS OF VENTILATION PER IECC R403.6 (IRC N1103.6). WHOLE-HOUSE VENTILATION FANS SHALL MEET EFFICIENCY STANDARDS PER IECC TABLE R403.6.1 (IRC TABLE N1103.6.1).
EQUIPMENT SIZING	HEATING AND COOLING EQUIPMENT SHALL BE SIZED IN ACCORDANCE WITH ACCA MANUAL S BASED ON BUILDING LOADS CALCULATED IN ACCORDANCE WITH ACCA MANUAL J OR OTHER APPROVED HEATING AND COOLING CALCULATION METHODOLOGIES PER IECC R403.7 (IRC N1103.7).
SYSTEMS SERVING MULTIPLE DWELLING UNITS	SYSTEMS SERVING MULTIPLE DWELLING UNITS SHALL CONFORM TO IECC SECTIONS C403 AND C404.
SNOW MELT SYSTEMS CONTROLS	SNOW AND ICE MELT SYSTEMS SUPPLIED THROUGH ENERGY SERVICE TO THE BUILDING SHALL INCLUDE AUTOMATIC CONTROLS CAPABLE OF SHUTTING OFF THE SYSTEM WHEN THE PAVEMENT TEMPERATURE IS ABOVE 50°F AND NO PRECIPITATION IS FALLING, AND AUTOMATIC OR MANUAL CONTROLS CAPABLE OF SHUTTING OFF THE SYSTEM WHEN THE OUTDOOR TEMPERATURE IS ABOVE 40°F PER IECC R403.9 (IRC N1103.9).
POOLS AND INGROUND PERMANENTLY INSTALLED SPAS	POOLS AND INGROUND SPA HEATERS SHALL HAVE AN ACCESSIBLE ON-OFF SWITCH MOUNTED ON THE OUTSIDE OF THE HEATER THAT ALLOWS SHUT-OFF WITHOUT AFFECTING THE THERMOSTAT SETTING PER IECC R403.10.1 (IRC N1103.10.1). GAS-FIRED HEATERS SHALL NOT HAVE CONSTANT BURNING PILOT LIGHTS. HEATERS SHALL HAVE TIME SWITCHES OR OTHER CONTROL METHODS TO AUTOMATICALLY TURN ON AND OFF PER A PRESET SCHEDULE PER IECC R403.10.2 (IRC N1103.10.2). HEATED POOLS AND INGROUND SPAS SHALL BE PROVIDED WITH A VAPOR-RETARDANT COVER PER IECC R403.10.3 (IRC N1103.10.3).
LIGHTING EQUIPMENT	A MINIMUM OF 90% OF THE LAMPS IN PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL BE HIGH-EFFICACY LAMPS PER IECC R404.1 (IRC N1104.1).
FUEL GAS LIGHTING SYSTEMS	FUEL GAS SYSTEMS SHALL NOT HAVE CONTINUOUSLY BURNING PILOT LIGHT SYSTEMS PER IECC R404.1.1 (IRC N1104.1.1).

PRESCRIPTIVE R-VALUE COMPLIANCE PATH


THE BUILDING SHALL ALSO CONFORM TO THE FOLLOWING PRESCRIPTIVE REQUIREMENTS:

THE BUILDING CONFORMS TO THE PRESCRIPTIVE REQUIREMENTS DETAILED IN THE CHART BELOW PER IECC R402.1.2 & R402.1.3 (IRC N1102.1.2 & N1102.1.3). EQUIVALENT U-FACTORS MAY BE SUBSTITUTED FOR REQUIRED R-VALUES PER IECC R402.1.4 (IRC N1102.1.4). THE BUILDING SHALL ALSO CONFORM TO THE DETAILED REQUIREMENTS OF IECC R402.2 (IRC N1102.2).


COMPONENT	REQUIRED VALUE
CEILING/ROOF	R-49 (COMPRESSED OVER WALL TOP PLATE AT EAVES) OR R-38 (UNCOMPRESSED OVER WALL TOP PLATE AT EAVES)
WALLS	R-20 CAVITY OR R-13 CAVITY PLUS R-5 CONTINUOUS
BASEMENT WALLS	R-10 CONTINUOUS OR R-13 CAVITY
SLAB	R-10, 2" DEPTH
CRAWL SPACE WALLS	R-10 CONTINUOUS OR R-13 CAVITY
FLOORS OVER UNCONDITIONED SPACE	R-19
DUCTS OUTSIDE CONDITIONED SPACE	R-6 FOR SUPPLY DUCTS IN ATTICS R-6 FOR ALL OTHER DUCTS
HOT WATER PIPES	R-3 UNLESS OTHERWISE ALLOWED BY IECC R403.5.3 (IRC N1103.5.3)
FENESTRATION	U-FACTOR = 0.32 MAX; SHGC = 0.40 MAX
SKYLIGHTS	U-FACTOR = 0.55 MAX; SHGC = 0.40 MAX

HVAC: EQUIPMENT - GOODMAN
ZONE 1: 92% EFFICIENCY NATURAL GAS
FURNACE WITH 14 SEER A/C UNIT 3 TON
ZONE 2: 14 SEER HEAT PUMP 3 TON

TRINITY HOMES
TRINITY HOMES MARY LAND LLC T/A

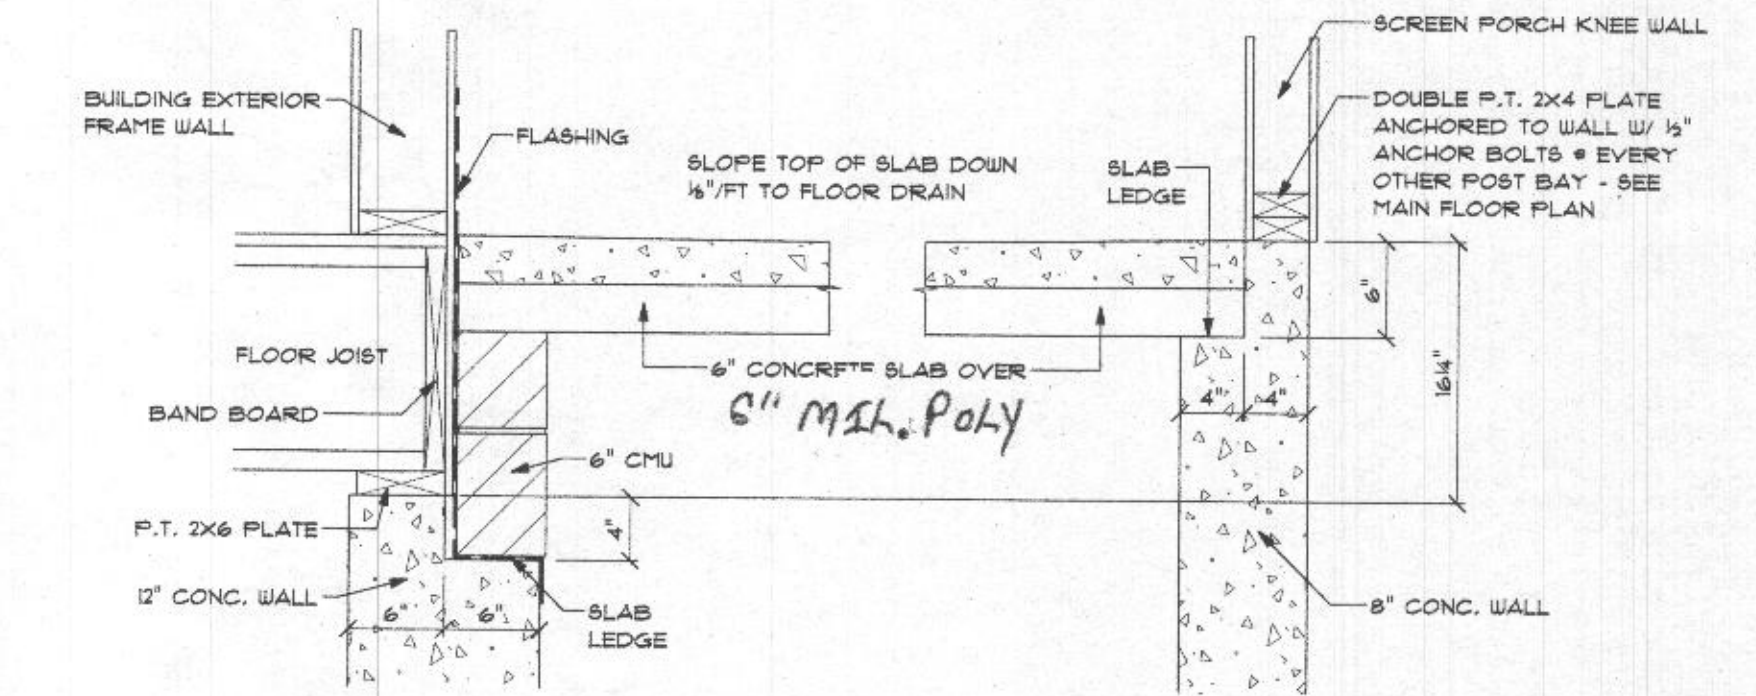

DI Screen Porch Slab Detail Section

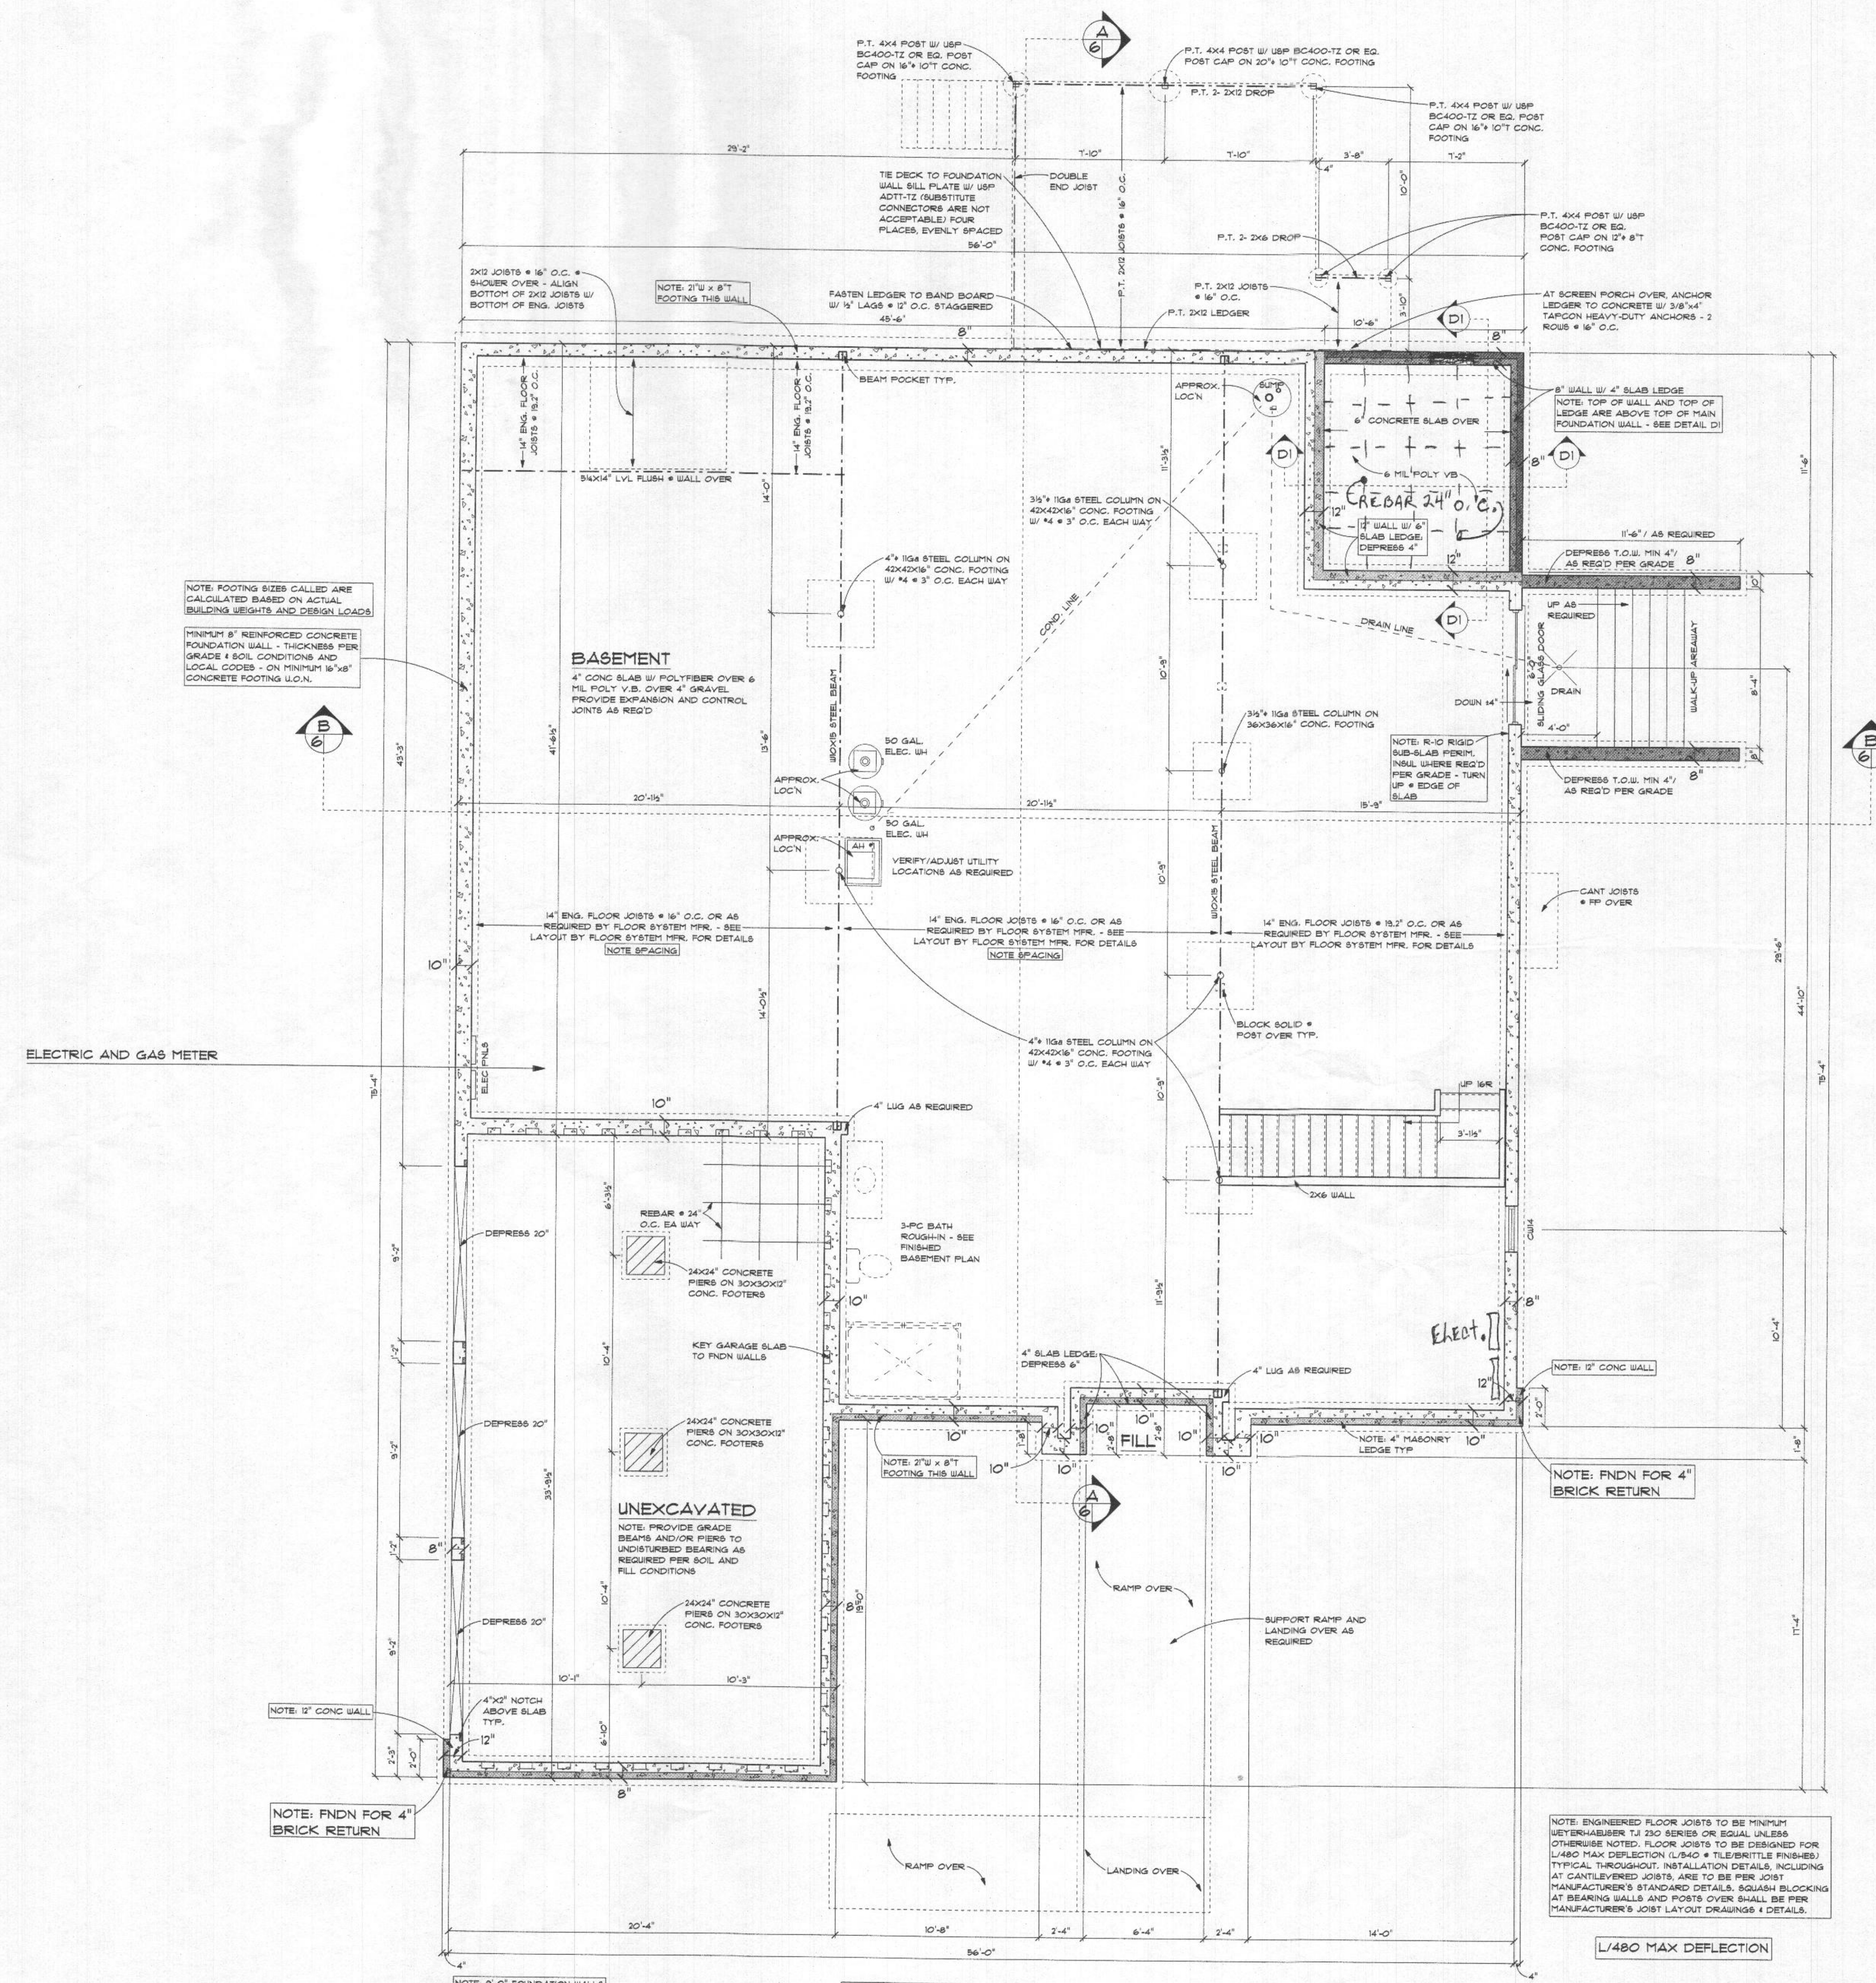

Foundation Plan
SCALE: $\frac{1}{4}" = 1'-0"$

HVAC
C.F.A. =

NOTES

1. 1000 PSF SOIL BEARING CAPACITY ASSUMED.
2. BEAMS, JOISTS, HEADERS AND RAFTERS TO BE 8-PF #1/2 OR EQUAL TYPICAL THROUGHOUT UNLESS OTHERWISE NOTED
3. VERIFY SIZE AND LOCATIONS OF DOORS AND WINDOWS THIS PLAN PER GRADE AND BUILDER

NOTE: 9'-0" FOUNDATION WALLS

NOTE: ENGINEERED FLOOR JOISTS TO BE MINIMUM WYERHAEUSER TJ 230 SERIES OR EQUAL, UNLESS OTHERWISE NOTED. FLOOR JOISTS TO BE DESIGNED FOR 1/4" MAX DEFLECTION ($L/840$) * TILE/BRITTLE FINISHES. TYPICAL THROUGHOUT. INSTALLATION DETAILS, INCLUDING AT CANTILEVERED JOISTS, ARE TO BE PER JOIST MANUFACTURER'S STANDARD DETAILS. SQUASH BLOCKING AT BEARING WALLS AND POSTS OVER SHALL BE PER MANUFACTURER'S JOIST LAYOUT DRAWINGS & DETAILS.

L/480 MAX DEFLECTION


2021 CODE

The Nugget

DATE 11-04-2022

SHEET NO. A-3

© 2022

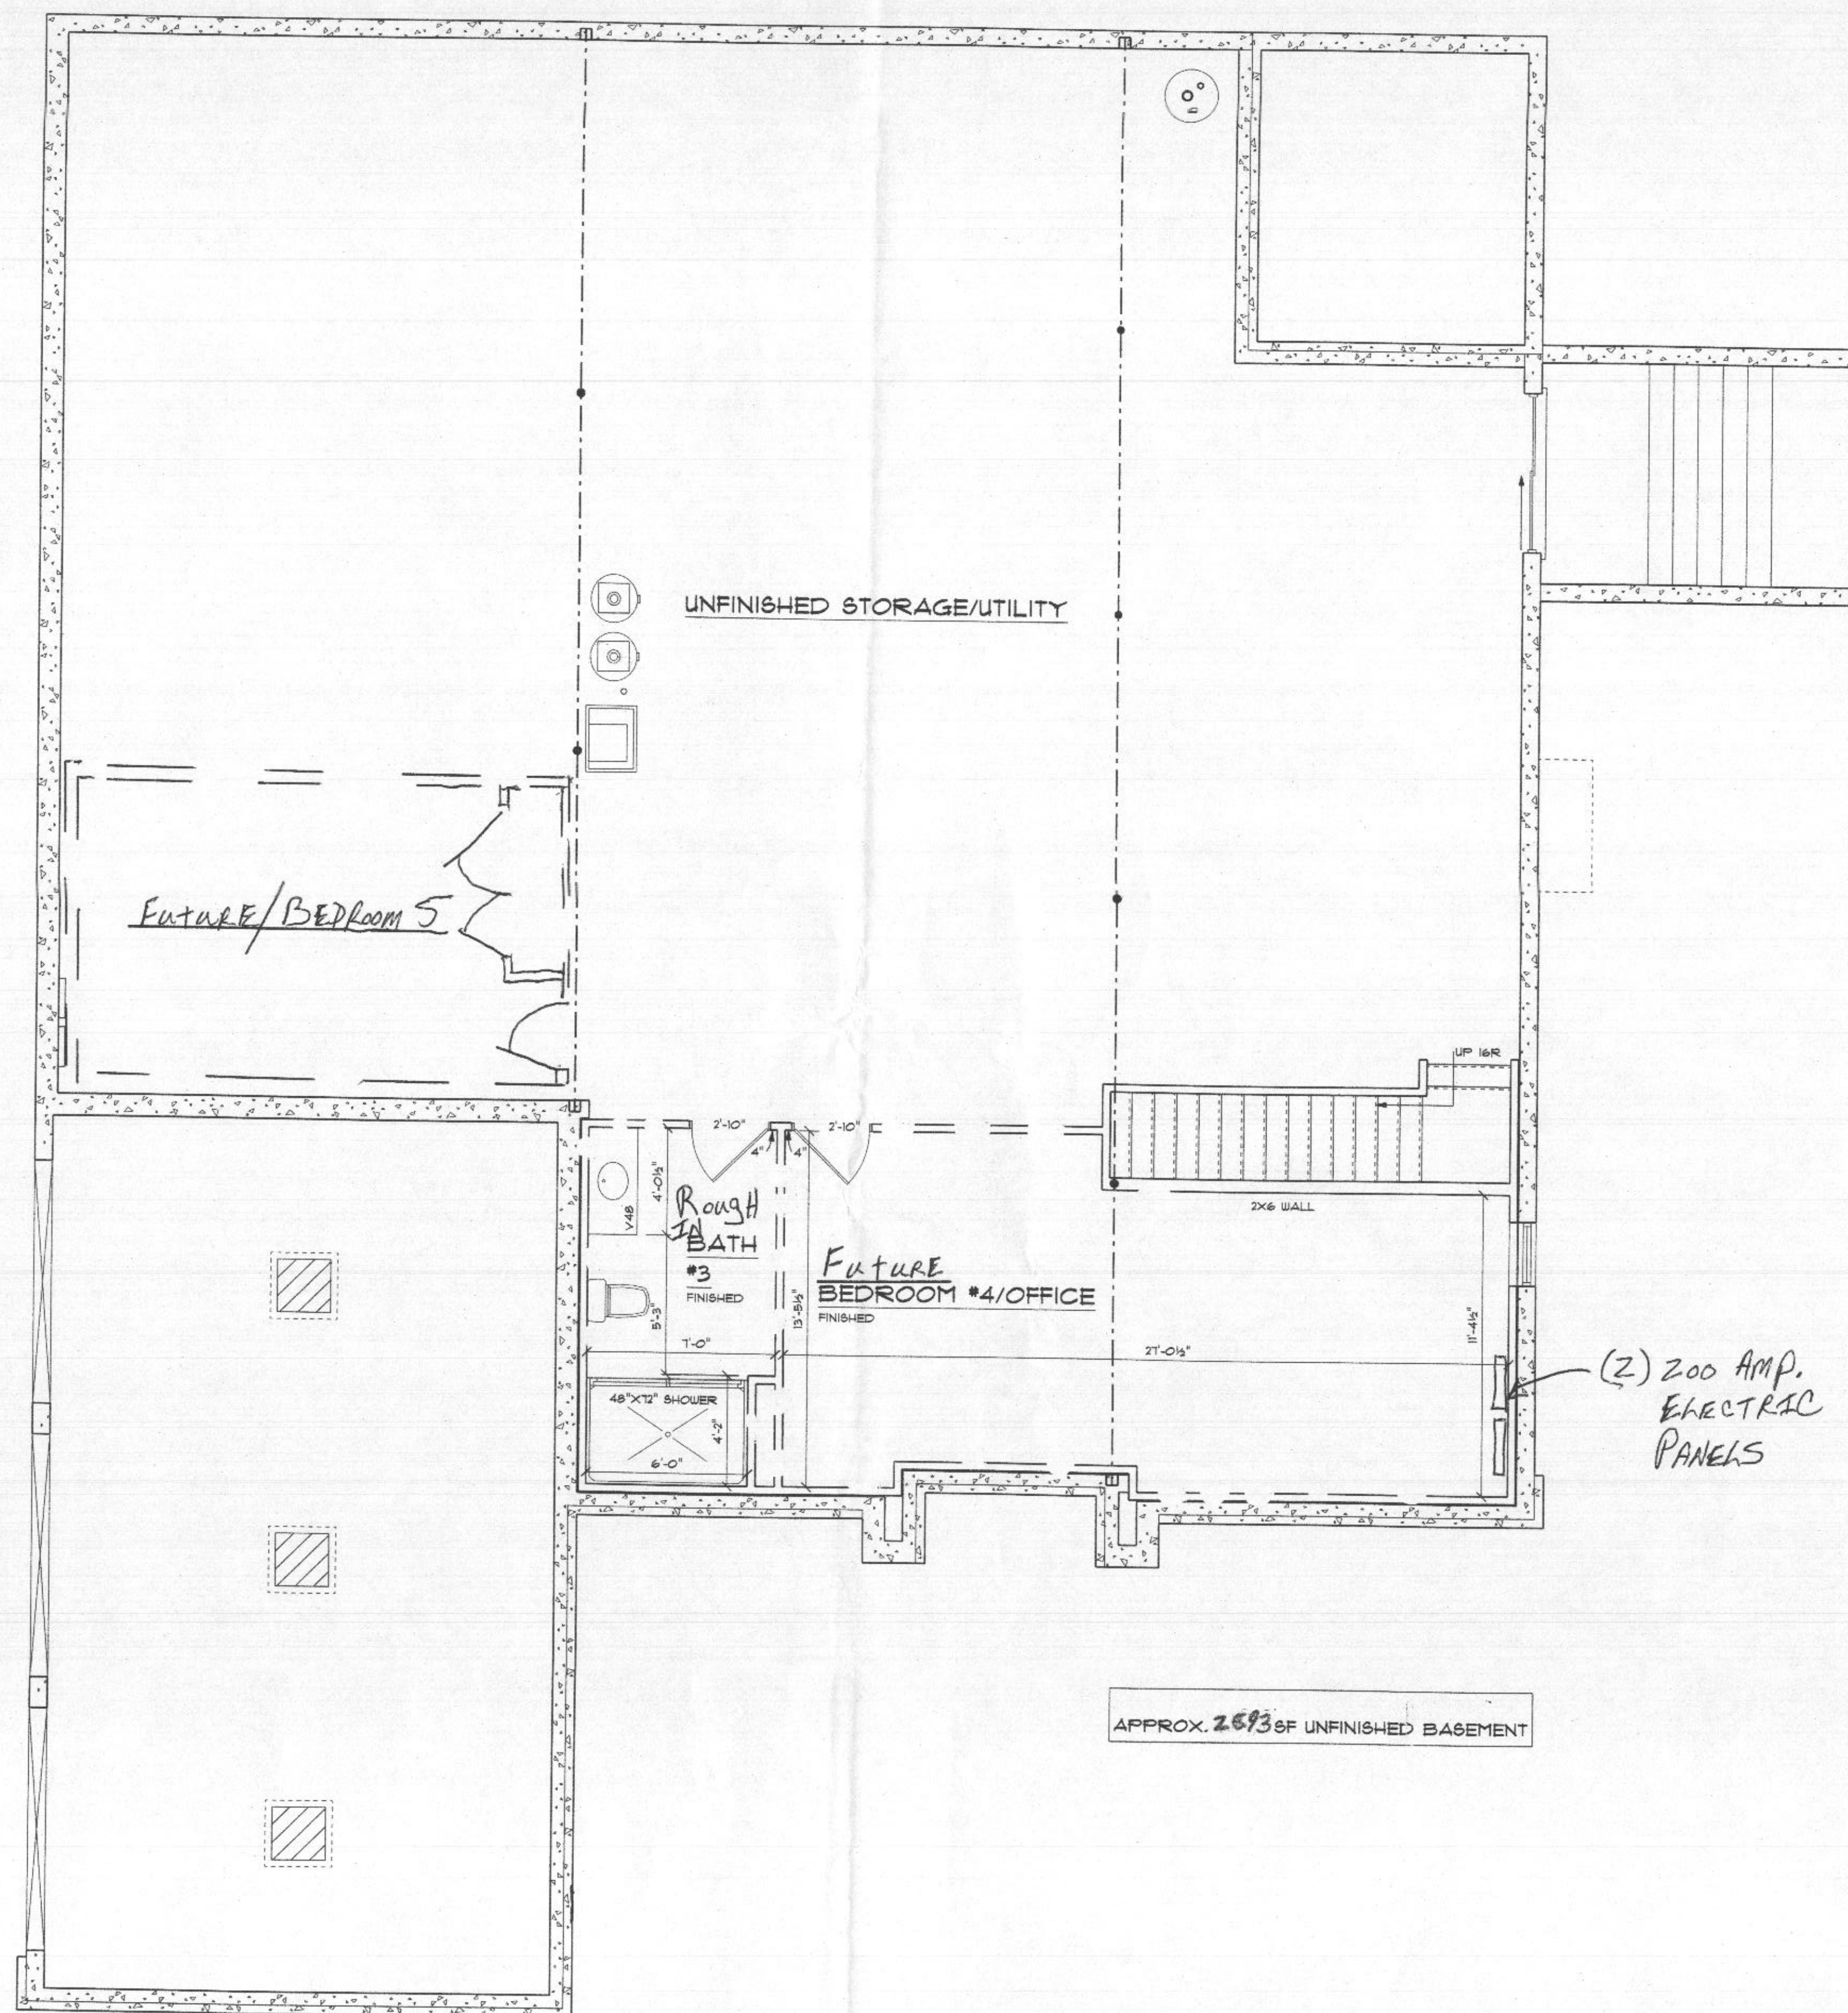

Finished Basement Plan
 SCALE: 1/4" = 1'-0"

APPROX. 2,693 SF UNFINISHED BASEMENT

THE PRESERVE AT WAVERLY GLEN INTERIOR TRIM PACKAGE

DOORS: MAIN FLOOR AND BASEMENT - PREHUNG MASONITE, RAISED CAMDEN

DOOR HARDWARE: SATIN NICKEL STOPS, KNOBS, HINGES, AND HANDLES

DOOR TRIM: MAIN FLOOR AND BASEMENT - 3/4" BEADED EDGE CASING, FINGER JOINT

BASE: MAIN FLOOR AND BASEMENT - 5/8" WM-163E

CHAIR RAIL: TWO PIECES WM-302 W/ 4/4" BEADED BOTTOM BACKER IN DINING ROOM

CROWN MOULDING: THREE PIECE 4 5/8" CROWN W/ BEADED BOTTOM BACKER W/ #183 TRIM IN OFFICE, DINING ROOM, FOYER, AND HALL

COFFERED CEILING: TWO PIECE 4 5/8" CROWN W/ BOTTOM BACKER

NOTE: CARPENTER
ALLOW 4" FOR 3/4" CASING ON MAIN FLOOR AND FINISHED BASEMENT

FRAMER NOTE:
FULL-HEIGHT WALL

NOTE: ELECTRICIAN:
HARDWARE BOX INSIDE FIREPLACE

FAMILY ROOM FIREPLACE: HEATILATOR
FIREPLACES PROPANE GAS PRE
ENGINEERED DIRECT VENT FIREPLACE
F.P. ROUGH OPENING, HEATILATOR FIREPLACE

CONTACT INFO:
FIRESIDE HEARTH & HOME
BONNIE GEYER (703) 367-9218
CALL TO:
1) SET/INSTALL F.P.
2) SET MANTEL & SURROUND & START UP F.P.


GARAGE DOOR OPENERS

ADULT HEIGHT POWDER ROOM VANITY

NOTE: 9' CEILINGS U.O.N.
2X6 EXTERIOR WALLS U.O.N.

NOTE: INTERIOR STAIRS SHALL CONFORM TO THE FOLLOWING GEOMETRY:

STRAIGHT:
RISER HEIGHT 7.75" MAX
TREAD DEPTH 10" MIN
NOBING .75" MIN 1.25" MAX
(NOTE: NOBING MAY BE OMITTED & TREAD DEPTH OF 11" OR GREATER)


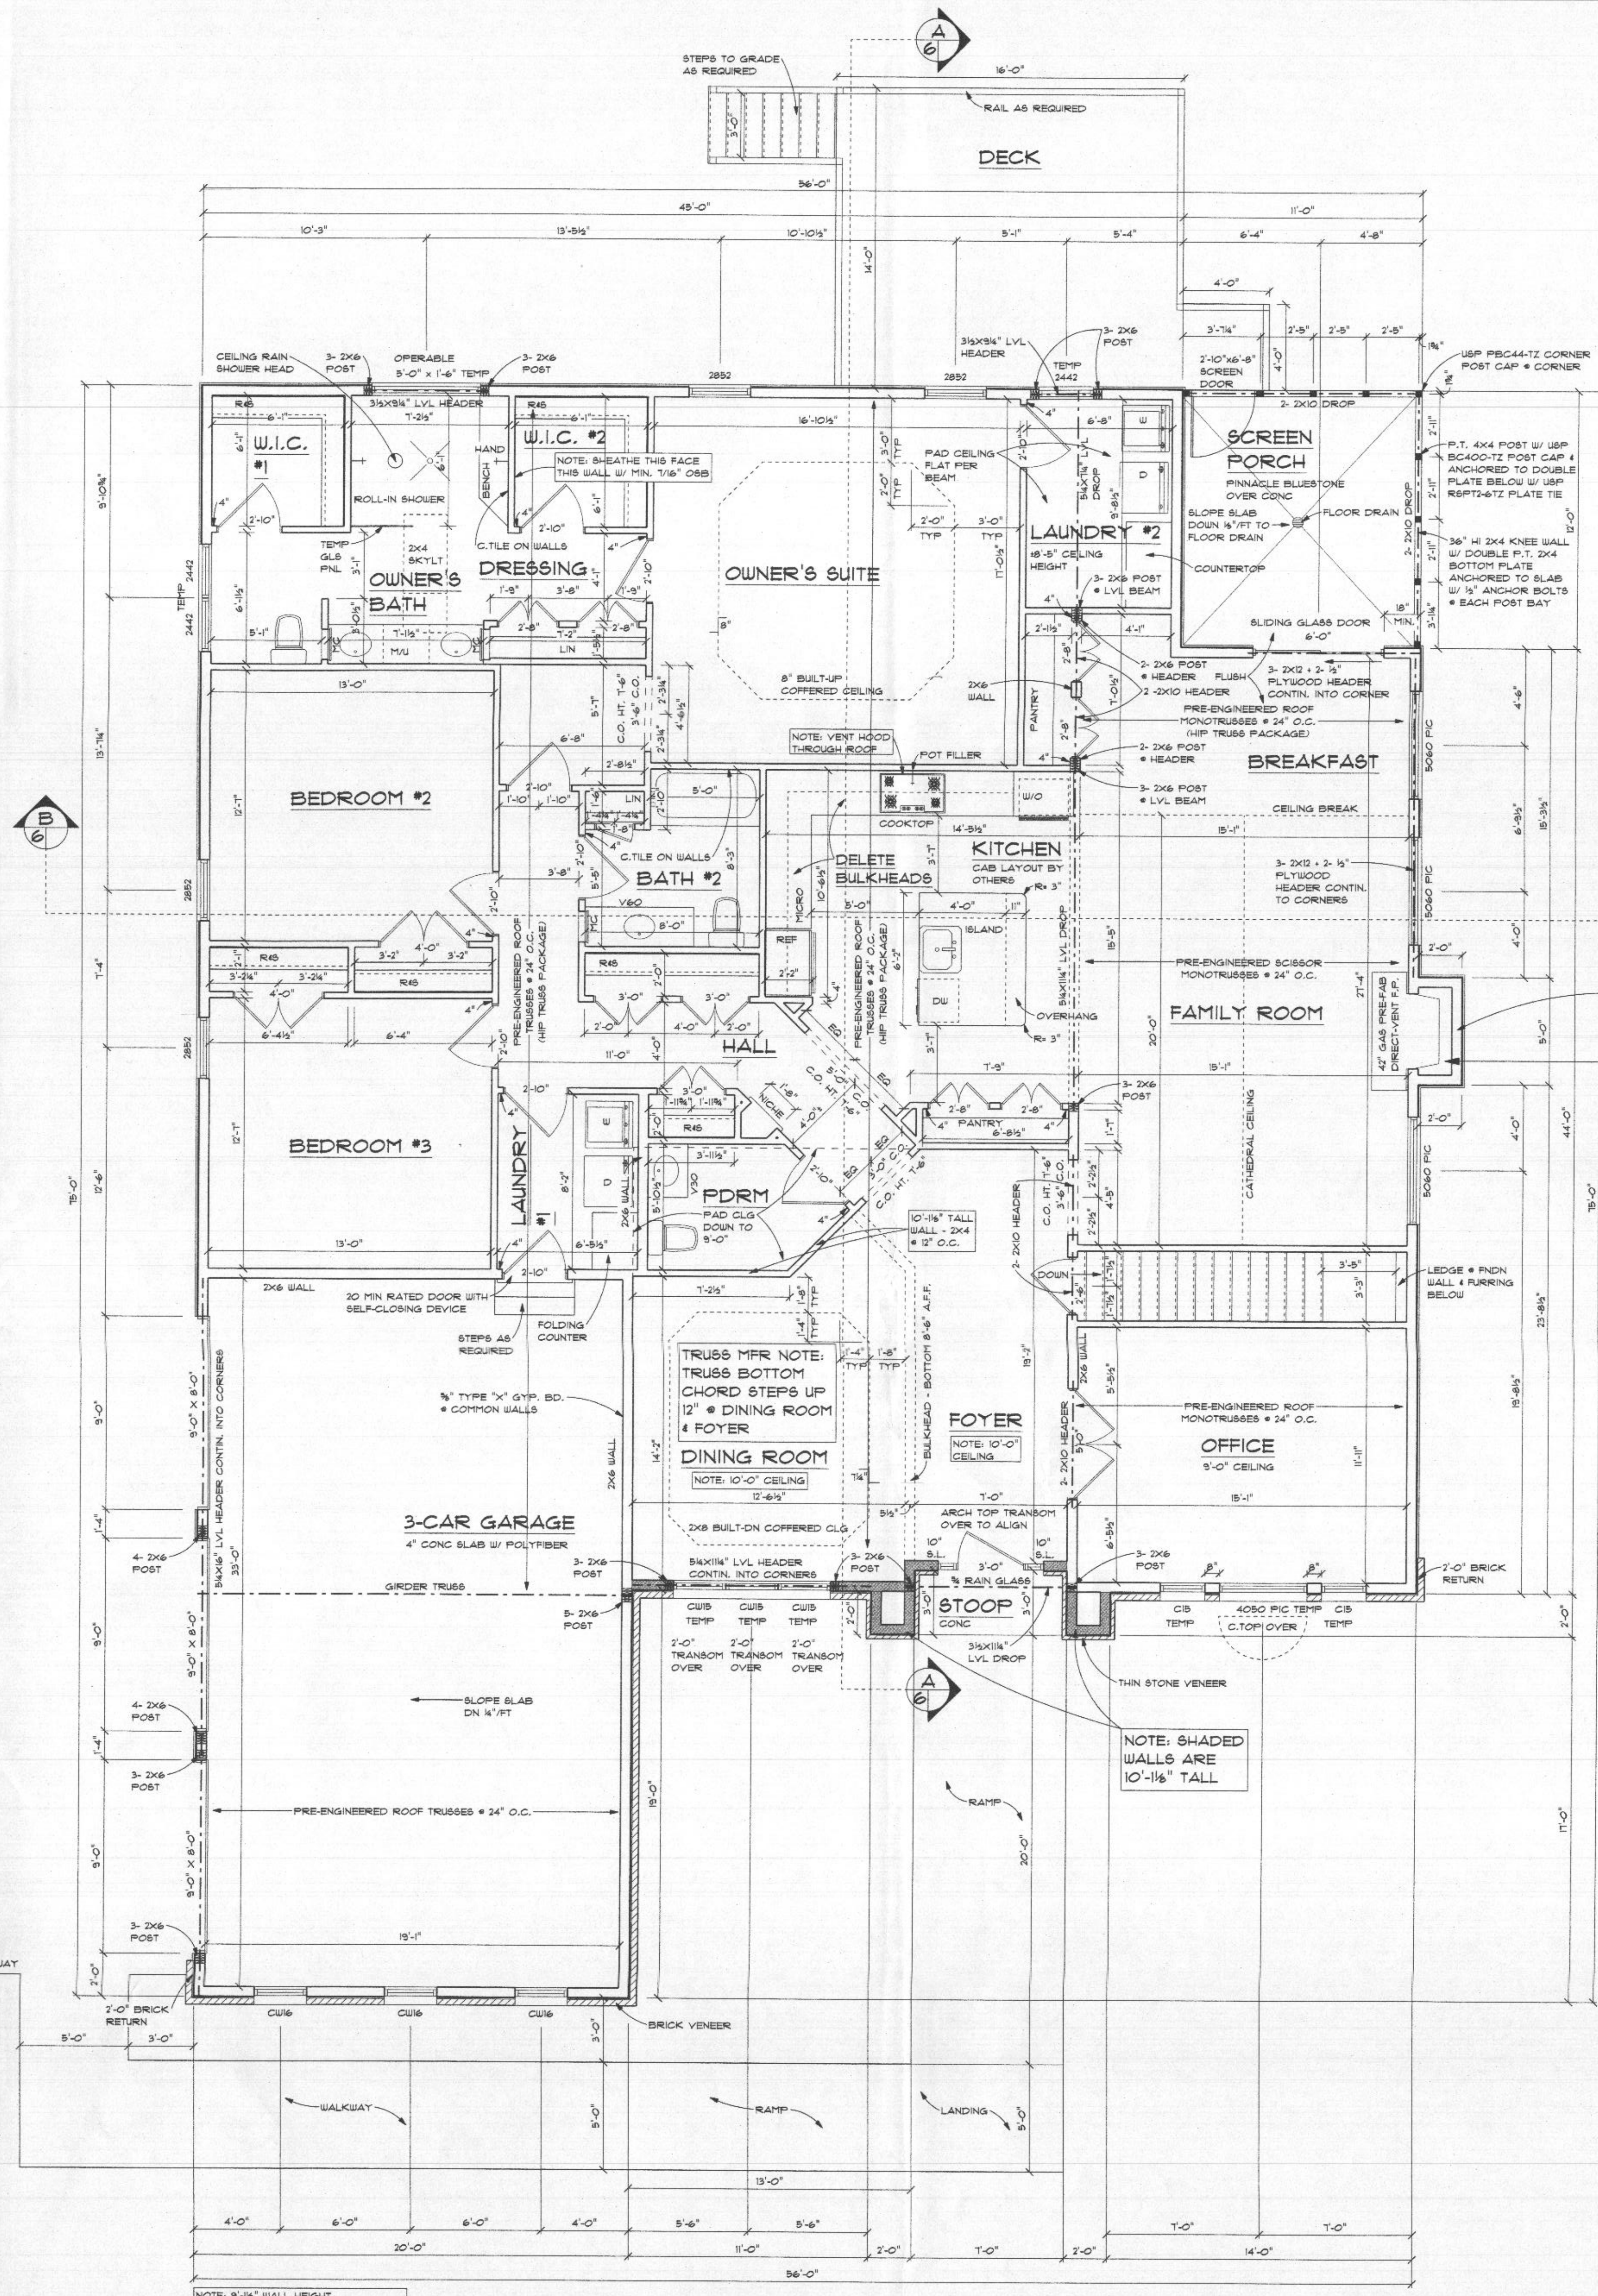



APPROX. 2,766 SF MAIN FLOOR

Main Floor Plan
SCALE: 1/4" = 1'-0"

2021 CODE

The Nugget

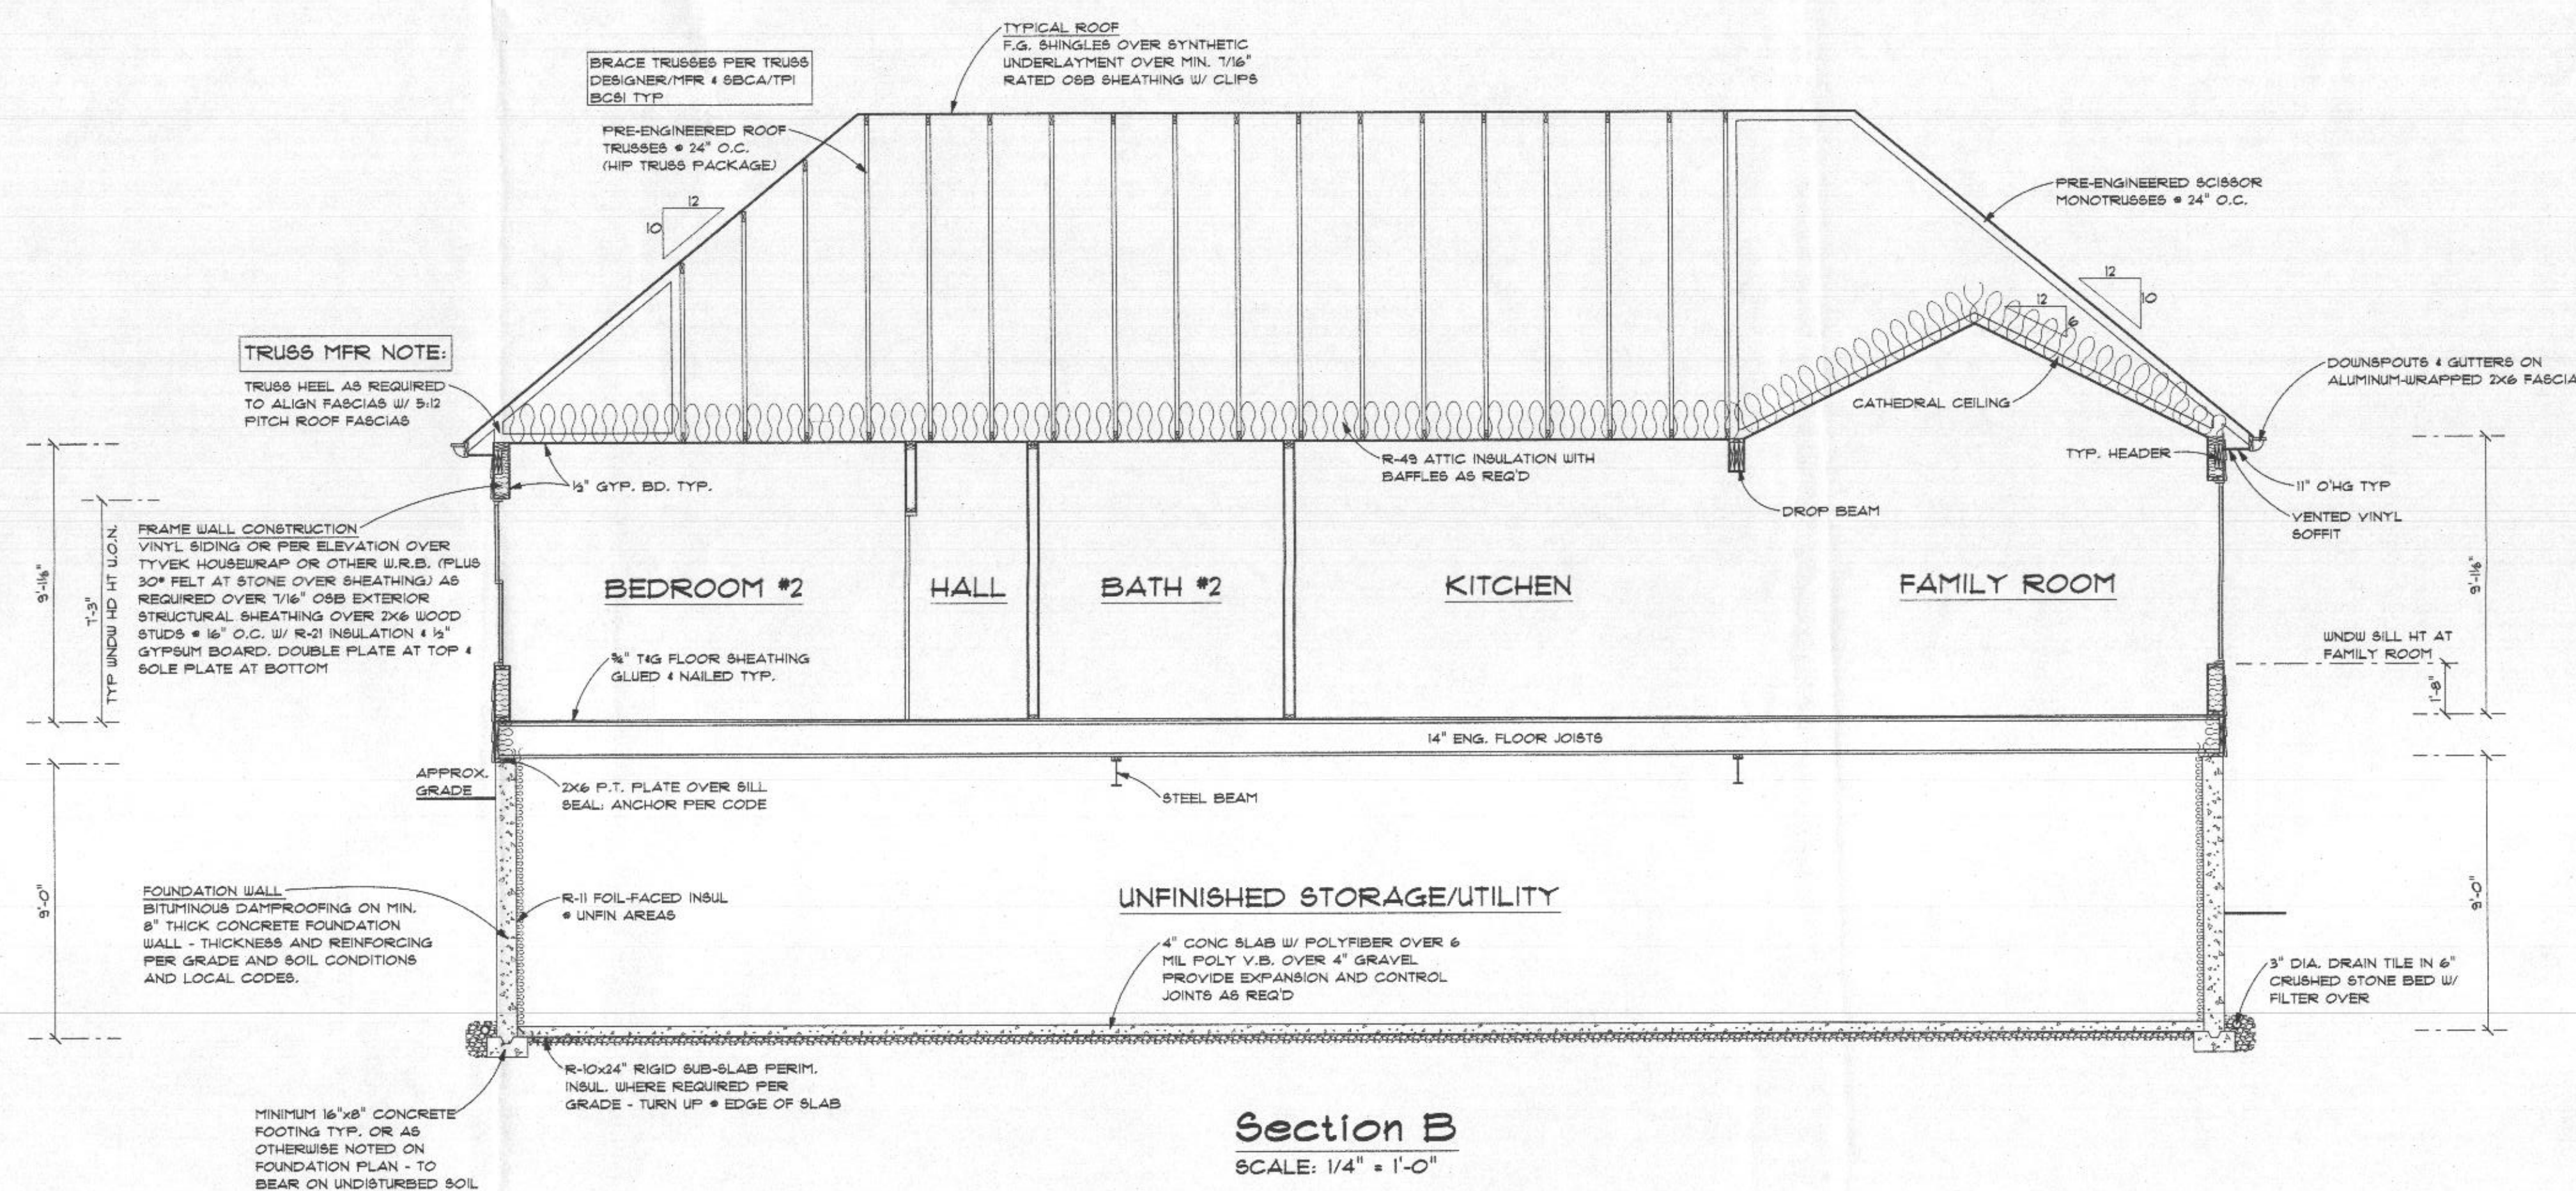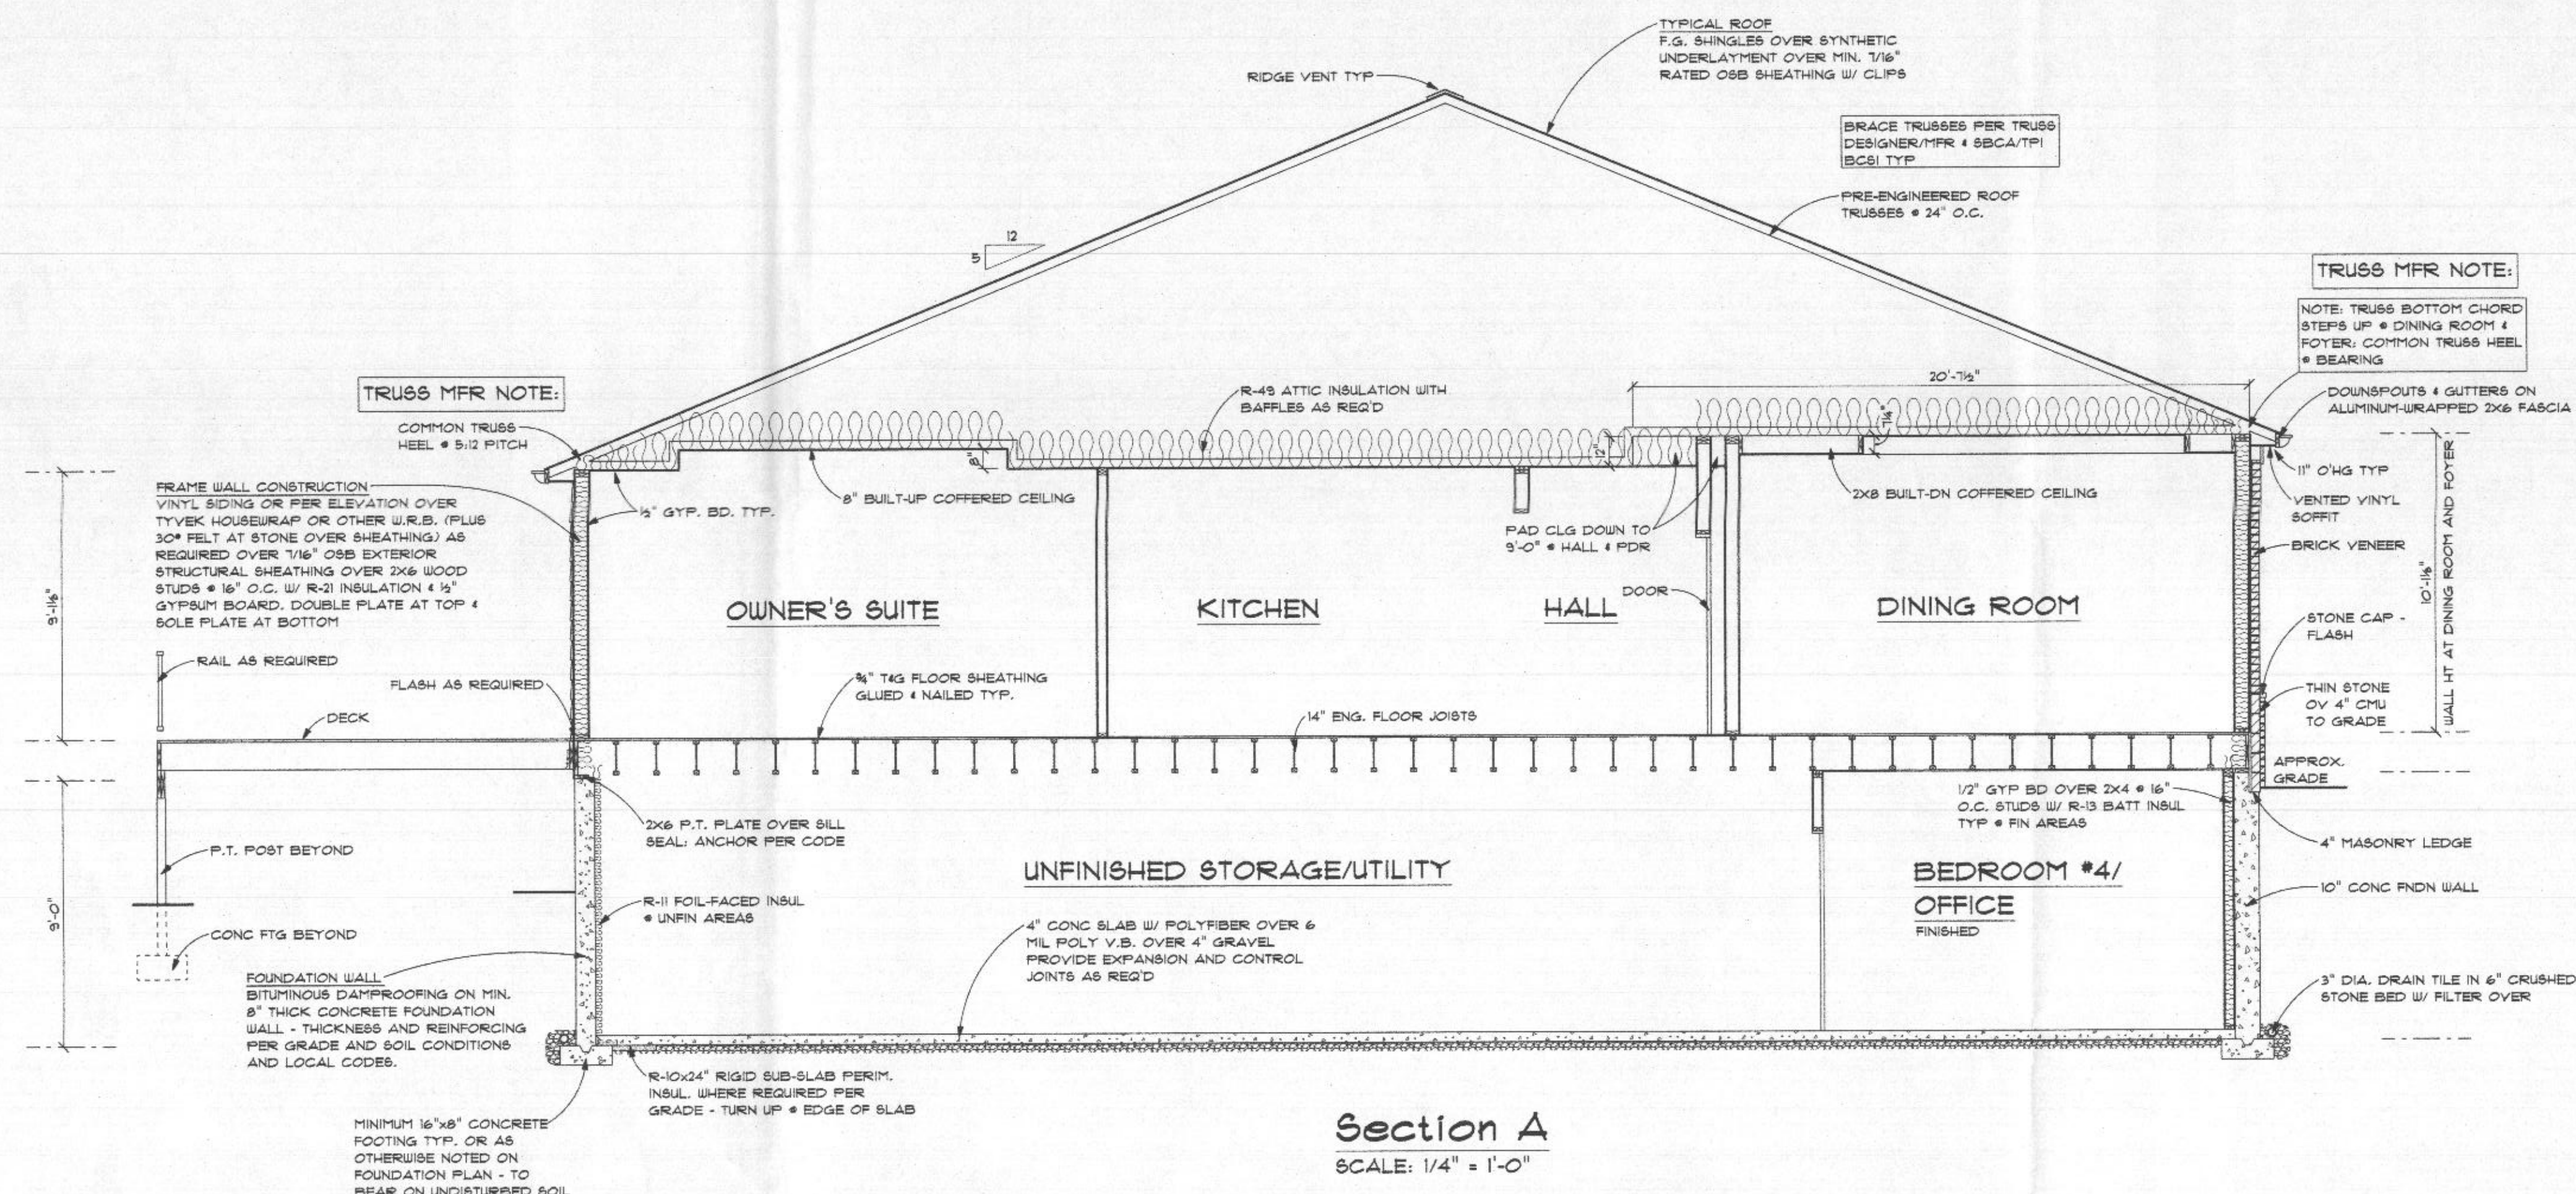

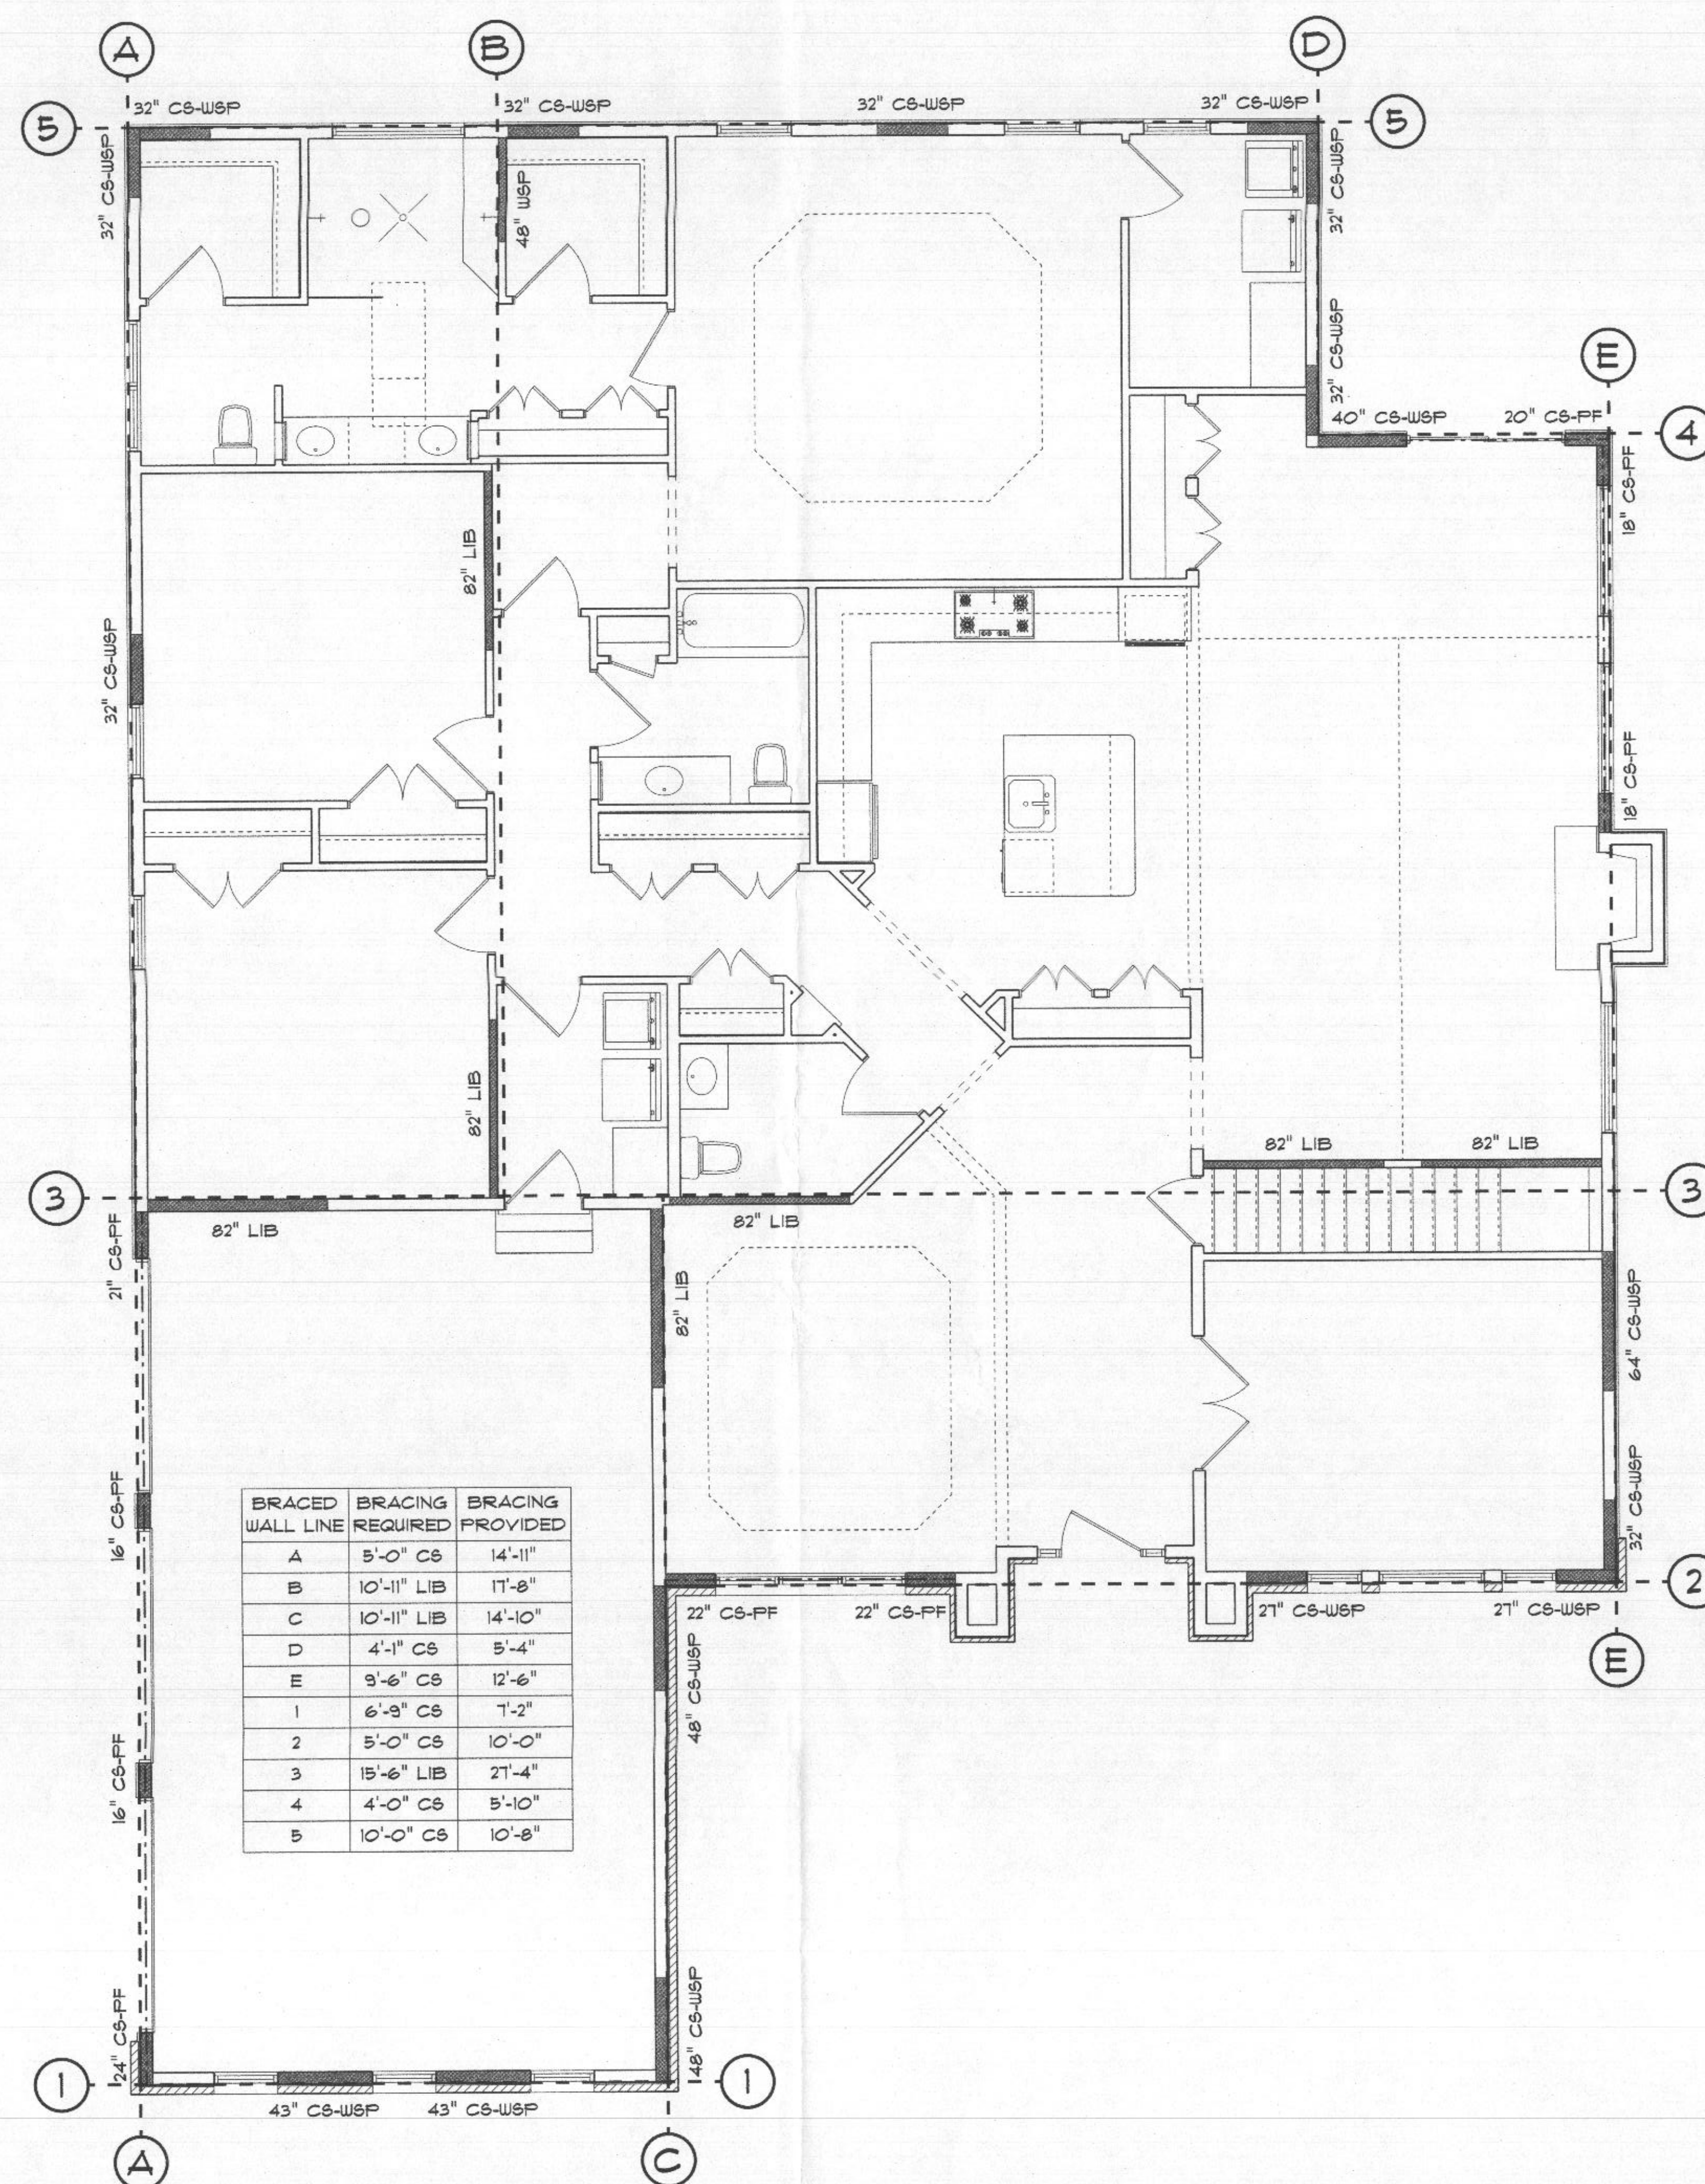

Main Floor Bracing Plan

SCALE: 1/4" = 1'-0"