

Record Detail * (This section is required.)

Permit Type	Permit Number	Opened Date
Building/Residential/Misc/Tanks	B26001958	06/10/2026

Description of Work

SFD/ INSTALL (1) 500GAL UNDERGROUND PROPANE TANK

↳ will be for the
new pool not the
house.

[check spelling](#)

Address * (This section is required.)

Search Reset Clear Get Parcel & Owner

Street #	Street Name	Street Type
4385	OLD ROXBURY	RD
Unit Type	Unit #	X Coordinate
--Select--		-77.05365
		Y Coordinate
		39.25218
City	State	Zip Code
BROOKEVILLE	MD	20833
	Primary	
	Yes	

Approved 6/11/26
AA

Parcel * (This section is required.)

Search Reset Clear Get Address & Owner

GIS ID *	Parcel	Parcel Area	Land Value	Improved Value	Exemption Value	Plan Area
928795	82,133	1.58	302000	590300	288300	RURAL

Legal Description

IMPSLOT 1 1.582 A.[]4385 OLD ROXBURY RD[]ELEANOR HELEN JOHNSON PR

[check spelling](#)

Block	Lot	Census Tract	Council Dist	Inspection Dist	Supervisor Dist	Map #	DAP Zone
	1	605601	5				
Plan Area	State Tax Id	Subdivision Name					
	1404320077	Eleanor Helen Johnson Prope					
Section	Area	Tax Map					
		21					
Grid	Zoning District	ADC Map					
21-19	RC-DEO	4812-B10					
SDP No.	Final Plan No.	WP File No.					
	F-09-077						
Record Plat No.	WS Contract No.	FDP No.			Primary		
20858					Yes		
Owner Occupied	Year Built	Historic District					
☐ Yes ☐ No	1961	☐ Yes ☒ No					
Historic District Registry No.	Stat Area	Flood Plain					
	4-09	☐ Yes ☒ No					
Building No							

Owner * (This section is required.)

Search Reset Clear

Name *

PRINC

Address Line 1

4385 OLD ROXBURY RD

Address Line 2

Address Line 3

Mail City	BROOKEVILLE
Mail State	MD
Mail Zip Code	20833
Phone	410-239-9515
Primary	Yes
E-mail	
Cell Number	Fax Number

Professionals (This section is not required.)

License # *	Business Name		
20020089549	TEVIS OIL, INC.		
License Type *	First Name	Middle Name	Last Name
Plumb/Gas	FRANK	E	HENSLEY
Primary	Address Line 1		
Yes	82 JOHN STREET		
	Address Line 2		
	City	State	ZIP Code
	WESTMINSTER	MD	21157-0000
	Phone 1	Phone 2	Fax
	4432777364		
	E-mail		
	FHENSLEY@MODERNCOMFORTSYSTEMS.COM		

Applicant (This section is not required.)

Search As Owner As Lic. Prof As Contact

Type *	First Name	MI	Last Name
Applicant	MICHELLE		CLANCY
Relationship	Full Name		
Applicant	MICHELLE CLANCY		
Primary	Organization Name		
Yes	APPLIED & APPROVED PERMITS LLC		
	Street Address		
	P.O. BOX 310		
	Address Line 2		
	City	State	Zip Code
	PERRY HALL	MD	21128
	Phone	Cell	Fax
	443-340-1229		
	E-mail *		
	MICHELLE@APPLIEDANDAPPROVED.COM		

Addtl Info

Est Construction Cost *	Housing Units *	Number of Buildings *	Public Owned
700	0	0	No
Construction Type			
329 - Structures Other Than Buildings (Retaining Walls/Tents)			

TANK INFORMATION

RESIDENTIAL TANK INFORMATION

Capital Project-No Fee *	Capital Project Number	Fee Exempt *	Roadside Tree Project Permit *	Roadside Tree Permit #
☐ Yes ☒ No	(Text)	☐ Yes ☒ No	☐ Yes ☒ No	(Text)
Existing Use *	Number of Tanks Installed *	Number of Tanks Removed *		
SFD	1 (Number)	0 (Number)		

Notes:

1. Setback distances as shown to the principal structure from property lines are approximate. The level of accuracy for this drawing should be taken to be no greater than plus or minus 3 feet. No Property corners confirmed.
2. Fences have been located by approximate methods.

MD ROUTE
(R/W WIDTH VARIES)

ARC = 176.74'
RADIUS = 569.61'

SVA SLOPE &
GRADING ESMT.

ADJACENT FOREST RESTRICTED

approximate
location for pool
currently being
built

LOT 1
1.582 Acres


W/S setbacks
field verified on 6/11/26
for

Approved for LP tank
B26001958

6/11/26



DETAIL
SCALE: 1"=30'

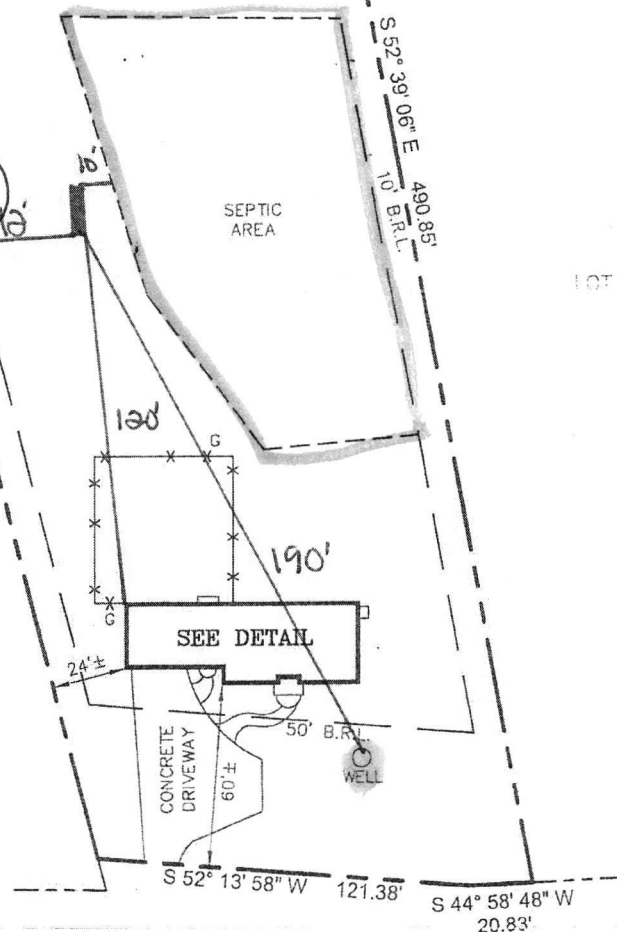

OLD ROXBURY ROAD
(R/W WIDTH VARIES)

LOCATION DRAWING
LOT 1

ELEANOR HELEN JOHNSON PROPERTY
HOWARD COUNTY, MARYLAND

SURVEYOR'S CERTIFICATE

"THE INFORMATION SHOWN HEREON HAS BEEN BASED UPON THE RESULTS OF A FIELD INSPECTION PURSUANT TO THE DEED OR PLAT OF RECORD. EXISTING STRUCTURES SHOWN HAVE BEEN FIELD LOCATED BASED UPON MEASUREMENTS FROM PROPERTY MARKERS FOUND

REFERENCES

PLAT BK.
PLAT NO. 20858






SNIDER & ASSOCIATES
LAND SURVEYORS

20270 Goldenrod Lane, Suite 110
Germantown, Maryland 20878
301/948-5100, Fax 301/948-1286



ABOVEGROUND/UNDERGROUND PROPANE STORAGE TANKS 120 - 1000 Gallons

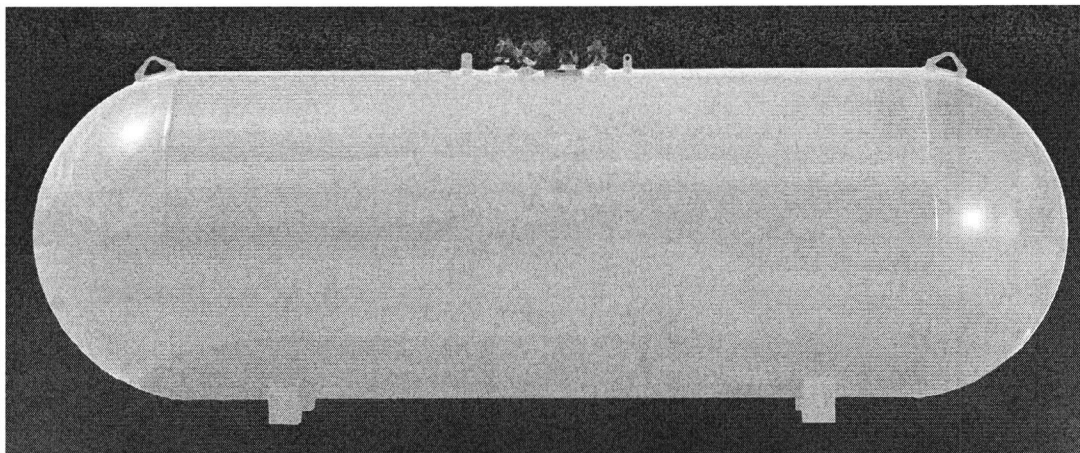

PRESSURE VESSEL CODES & REGISTRATION

- Designed and constructed in accordance with the ASME Section VIII, Division 1 Code
- Registered with the National Board of Boiler & Pressure Vessels Inspectors
- Complies with NFPA 58
- Conforms to specifications set forth by the Railroad Commission of Texas

VESSEL FEATURES

- Tanks fully fitted with RegO valves and Rochester liquid level gauges
- Dual service options for aboveground or underground applications
- Product supplied with steel dome (custom colors available upon request) or plastic AG/UG shroud, specify at time of order
- Container pressure rated at 250 PSI @ 400°F
- Vacuum purged
- Stainless steel data plate
- Anode bolt connection located under the dome
- #54 liquid level outage valve orifice

PROCESS CONTROL

All welded products are x-rayed and pressure tested @ 325 PSI per ASME Sec VIII, Div I requirements, followed by rigorous leak test inspections, both pre and post valving

STORAGE & DISTRIBUTION

Contact Propane Education & Research Council for additional resources and information at propane.com

PAINT SPECIFICATIONS

At the time of order, customer must specify intended application thus determining paint applied at the time of manufacturing

Aboveground tank applications:

- Painted Sky White with super durable TGIC polyester powder paint for maximum rust protection
- Custom colors available upon request
- If an aboveground painted tank is intended for underground use, tank must be field painted for such application

Underground tank applications:

- Painted gray with a "ready to bury", durable epoxy powder paint for underground applications
- Product used underground may require additional protective coating and cathodic protections, contact your federal, state or local authorities for specifications

Made With Pride



Made In the U.S.A.



ABOVEGROUND/UNDERGROUND PROPANE STORAGE TANKS 120 - 1000 Gallons

ABOVEGROUND/UNDERGROUND VESSEL DIMENSIONS & SPECIFICATIONS

(All Vessel Dimensions are Approximate)

Part Number	Description	Water Capacity Gal/l	Outside Diameter In/mm	Head Type	Overall Length In/mm	Overall Height In/mm	Leg Width In/mm	Leg Spacing In/mm	Weight Lbs/kg	Quantity	
										Full Load	Per Stack
68280.6	120 Gallon AG/UG Storage Tank, Gray	120 454.2	24" 609.6	Ellip	5' 8" 1727.2	3' 1 3/16" 944.5	10 1/8" 257.2	3' 0" 914.4	312 141.5	96	12
68281.6	250 Gallon AG/UG Storage Tank, Gray	250 946.3	30" 762	Hemi	7' 10" 2387.6	3' 6 15/16" 1090.6	12 3/4" 323.9	3' 6" 1066.8	462 209.5	54	9
68282.6	320 Gallon AG/UG Storage Tank, Gray	320 1211.3	30" 762	Hemi	9' 7" 2921	3' 6 15/16" 1090.6	12 3/4" 323.9	4' 0 1/4" 1225.6	567 257.2	45	9
68283.26**	500 Gallon AG/UG Storage Tank, Gray	500 1892.7	41" 1041.4	Hemi	8' 8 1/2" 2654.3	4' 4" 1320.8	16 1/4" 412.8	3' 6" 1066.8	987 447.7	30	5
68284.26**	1000 Gallon AG/UG Storage Tank, Gray	1000 3785.4	41" 1041.4	Hemi	15' 11" 4851.4	4' 5 3/4" 1365.3	16 1/4" 412.8	9' 0" 2743.2	1739 788.8	15	5

† Federal, state or local regulations may contain specific applicable requirements for protective coatings and cathodic protection. The purchaser and installer are responsible for compliance with such federal, state, local and NFPA industry regulations, including, but not limited to, proper purging prior to putting into service. Cathodic protection is required. Coating (s) must be continuous, uninterrupted and must comply with local, state or national codes or regulations.

* Drain **No Drain

