

03-306402

6-15-88
2 PM

File
House
connected
main

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY

BUREAU OF ENVIRONMENTAL HEALTH
461-9933

INDEXED

P 40257

A 37202

DISTRICT 3rd

DATE 10/13/89

DATE SYSTEM APPROVED 10/13/88

INSPECTOR C. B. O.

Paul Schissler/South Carroll Backhoe, Inc. IS PERMITTED TO INSTALL X ALTER

ADDRESS 4410 Salem Bottom Road, Westminster, Maryland 21157 PHONE 875-4197

SUBDIVISION Salopha Property ROAD 701 River Road LOT 3

PROPERTY OWNER Bruce H Wilkins

ADDRESS

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES NO X

SEPTIC TANK CAPACITY 1000 GALLONS NUMBER OF BEDROOMS 3

TRENCHES - 187 sq. ft. per bedroom. Trench to be 3 feet wide. Inlet 3 feet below original grade. Bottom maximum depth 5 feet below original grade. Effective area begins at 3 feet below original grade. 2 feet of stone below distribution pipe.

LOCATION - SHALLOW SYSTEM ONLY. Beginning from the rear right lot corner, place 1st trench 590 feet down the rear (1008.7') lot line and 20 feet off the rear line as seen when facing property from River Road. Run trenches along contour back towards the right (289.5') lot line.

NOTE - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank. or/cw

PLANS APPROVED BY B. Nixon DATE 5/18/87

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E., TANK, DISTRIBUTION BOX, TRENCHES) TO BE 100 FEET FROM WELL. (UNLESS OTHERWISE SPECIFIED BY A TANKED

NOTE: IF DEEP TRENCHES ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCHES.

NOTE: NO DRY WELL SHALL EXCEED 100 FEET IN LENGTH. TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO TANK MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA OR PVC OR ABS.

PERMIT VOID AFTER TWO YEARS.

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED.

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES.

***INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APROVAL ON THIS PERMIT**

*CALL 461-9933 FOR INSPECTION OF SEPTIC SYSTEMS.

EH - 2-1186

BUILDING PERMIT SIGNED
AND RETURNED


7-601 B00148874-UP TANK

8-10-87 DENIED

8-10-87 DENIED

8-10-87 DENIED

A 37202

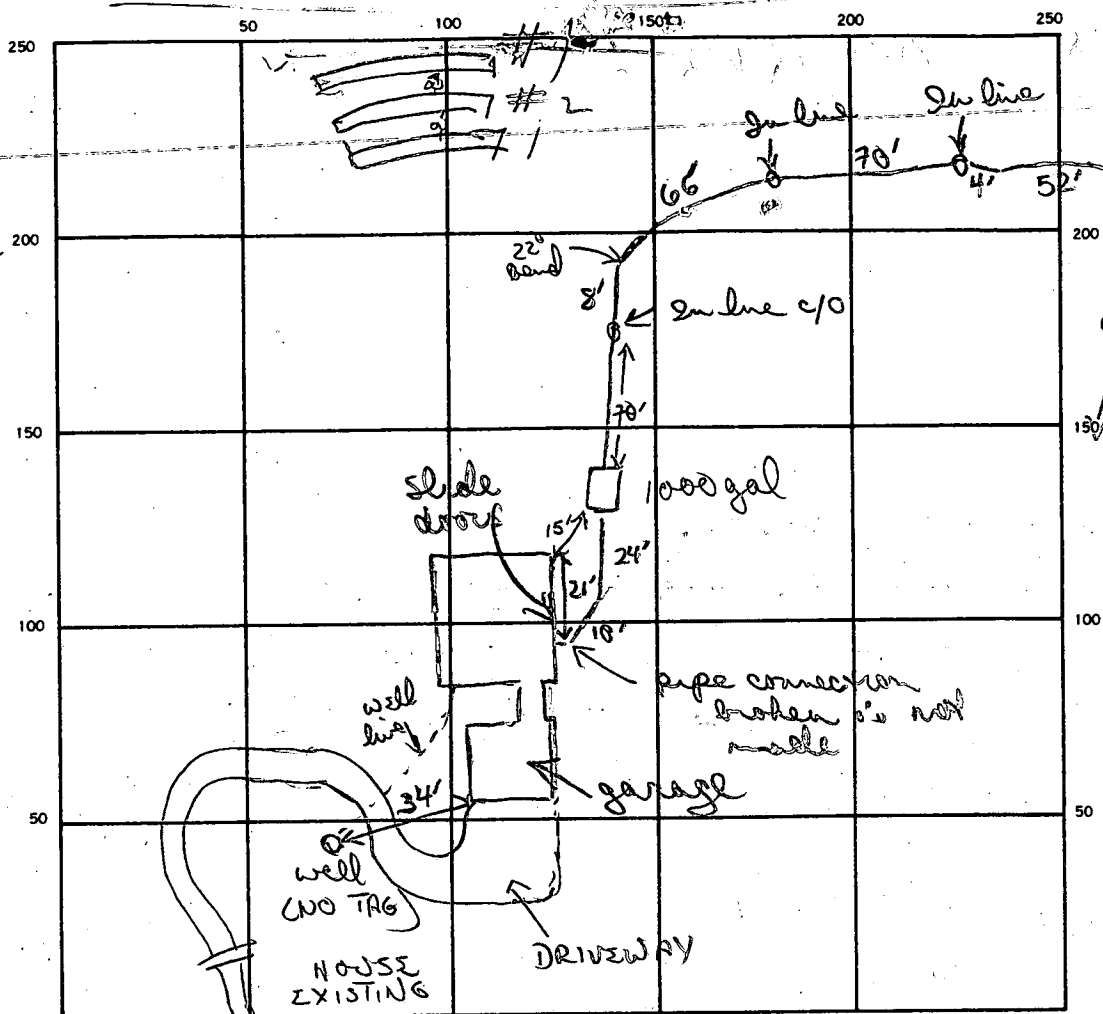

INDICATE NORTH. — NAME ADJOINING ROADWAY AS BASE LINE.

SEPTIC TANK. LEVEL 1000 gal CLEANOUTS In line 1 S.T.

DISTRIBUTION BOX. LEVEL ✓ w/ saffle

DRAIN FIELD/TILE FIELD. DEPTH 1 1/2 3 FT. TRENCH WIDTH 3 3 3 FT. INLET DEPTH 3 3 3 FT.

EFFECTIVE GRAVEL DEPTH 2 2 2 FT. TOTAL LENGTH 64 64 64 FT. 192

NUMBER OF TRENCHES 3 ONE SIDEWALL/BOTTOM AREA 192 X 3 SQ. FT.

DRYWELL INSIDE DIAMETER — FT. EFFECTIVE DEPTH BELOW INLET — FT.

ABSORBENT AREA 576 SQ. FT.

REMARKS 6/15/88 TRENCH #1 & #2 FINISH TRENCH #3

8 HOOK UP TANK & BOX R11 AND BELLOVED

6/16/88 House connection & well line OK to cover all trenches

OK to finish cementing & cover all lines

6/16/88 well line inspected - OK to cover

10/13/88 Check of system by water test - found it flowing

from house to tanks. 10/13/88 Final

DATE SYSTEM APPROVED 10/13/88 INSPECTOR Charles Bryan Theaker

DATE Received

DATE WELL COMPLETED

Depth of Well

PERMIT NO.

THIS NUMBER IS TO BE PUNCHED
IN COLS. 3-6 ON ALL CARDS)

062581

160

HE-81-2077

OWNER

STREET OR RFD

SUBDIVISION

last name

first name

TOWN

LOT

WILKINS

RIVER ROAD

SALOPHA PROPERTY

BRUCE

SYKESVILLE

3

WELL LOG

Not required for driven wells

STATE THE KIND OF FORMATIONS
PENETRATED, THEIR COLOR, DEPTH,
THICKNESS AND IF WATER BEARING

DESCRIPTION (Use
additional sheets if needed)

FEET

Check
if water
bearing

Top soil

0

2

Clay

2

3

Shaley

3

5

Sand Stone

5

15

Mica

15

40

Sand Stone

40

45

Mica

45

60

Sand Stone

60

62

Mica

62

160

GROUTING RECORD

WELL HAS BEEN GROUTED
(Circle Appropriate Box)

TYPE OF GROUTING MATERIAL

CEMENT

BENTONITE CLAY

NO. OF BAGS

NO. OF POUNDS

GALLONS OF WATER

DEPTH OF GROUT SEAL (to nearest foot)

from

ft. to

ft.

TOP

BOTTOM

CASING RECORD

casing
types
insert
appropriate
code
below

STEEL

CONCRETE

PLASTIC

OTHER

MAIN

Nominal diameter

Total depth

CASING

top (main) casing

of main casing

TYPE

(nearest inch)

(nearest foot)

OTHER CASING (if used)

diameter

depth (feet)

inch

from

to

SCREEN RECORD

screen type
or open hole

insert
appropriate
code
below

STEEL

BRASS

OPEN

BRONZE

HOLE

PLASTIC

OTHER

DEPTH (nearest ft.)

SLOT SIZE 1

2

3

DIAMETER

OF SCREEN

(NEAREST
INCH)

GRAVEL PACK

IF WELL DRILLED WAS
FLOWING WELL INSERT
F IN BOX 68

OEP USE ONLY
(NOT TO BE FILLED IN BY DRILLER)

T

(E.R.O.S.)

WQ

TELESCOPE

LOG

CASING

INDICATOR

OTHER DATA

PUMPING TEST

HOURS PUMPED (nearest hour)

PUMPING RATE (gal. per min.
to nearest gal.)

METHOD USED TO
MEASURE PUMPING RATE

WATER LEVEL (distance from land surface)

BEFORE PUMPING

WHEN PUMPING

TYPE OF PUMP USED (for test)

A

air

P

piston

T

turbine

C

centrifugal

R

rotary

O

other
(describe
below)

J

jet

S

submersible

PUMP INSTALLED

DRILLER WILL INSTALL PUMP

YES

NO

IF DRILLER INSTALLS PUMP, THIS SECTION
MUST BE COMPLETED FOR ALL WELLS
EXCEPT HOME USE

TYPE OF PUMP INSTALLED

PLACE (A,C,J,P,R,S,T,O)

IN BOX - SEE ABOVE:

CAPACITY:

GALLONS PER MINUTE

(to nearest gallon)

PUMP HORSE POWER

PUMP COLUMN LENGTH
(nearest ft.)

CASING HEIGHT (circle appropriate box
and enter casing height)

LAND SURFACE

(nearest
foot)

LOCATION OF WELL ON LOT

SHOW PERMANENT STRUCTURE SUCH AS
BUILDING, SEPTIC TANKS, AND/OR
LANDMARKS AND INDICATE NOT LESS
THAN TWO DISTANCES
(MEASUREMENTS TO WELL)

CIRCLE APPROPRIATE LETTER

A

A WELL WAS ABANDONED AND SEALED
WHEN THIS WELL WAS COMPLETED

E

ELECTRIC LOG OBTAINED

P

TEST WELL CONVERTED TO PRODUCTION
WELL

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN
ACCORDANCE WITH COMAR 10.17.13 "WELL CONSTRUCTION"
AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE
ABOVE CAPTIONED PERMIT, AND THAT THE INFORMATION
PRESENTED HEREIN IS ACCURATE AND COMPLETE TO THE BEST
OF MY KNOWLEDGE.

DRILLERS IDENT. NO.

DRILLERS SIGNATURE

(MUST MATCH SIGNATURE ON APPLICATION)

SITE SUPERVISOR (sign. of driller or journeyman
responsible for sitework if different from permittee)

well 75'

River RD

Right lot line

HEALTH

Review OK / CW

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Location of property (road)

Subdivision

Well Driller

Lot

Block

Plat

Sec.

Owner

Depth of well

Distance of measuring point (M.P.) above ground

Static water level (S.W.L.) below M.P.

I. High rate pumping -- reservoir drawdown

Time pump started 4:00

Pumping rate 12 gpm

Total time 15:00 min to reach pumping water level 29 ft. below M.P.

II. Recovery pump test data - observations to be recorded every 15 minutes

[illegible]

37202

HOWARD COUNTY HEALTH DEPARTMENT
Bureau of Environmental Health
3525-H Ellicott Mills Drive
Ellicott City, MD 21043
461-9933

APPLICATION FOR PITLESS ADAPTER, WELL PUMP AND PRESSURE TANK INSTALLATION

New Installation ☒
Replacement ☐

Receipt # 40902
Date 2/1/88

Name of Installer ROBERT L. FEELER CO., INC.

Telephone 795-1405

License Number 2121

Certified Well Pump Installer YES Well Driller ☐ Registered Plumber YES

Name of Property Owner BOB & LINDA WILKINS

Telephone 987-1100

Subdivision SALOPHA Lot # 3

Well Tag # HD-20-77

Site Address 701 RIVER ROAD

Pump

- Type
 - Deep well jet ☐
 - Shallow well jet ☐
 - Submersible ☒
- Make DOWING/ERISWOLD
- Model # 3ALN
- Capacity 7 GPM
- Pump exceeds well capacity Yes ☐ No ☒
- If Yes, is low pressure cutoff switch installed? Yes ☐ No ☐
- What methods are used to protect the pump and electrical wiring from vibrations? Torque arrestors ☐ Cable guards ☒ Other ☐

Motor

- Horsepower 1/2
- RPM 3450
- Voltage ☐
 - 110 ☐
 - 220 ☒

Pitless Adapter

- Make MCCILL
- Model # MB-10
- Depth 42"

Tank

- Capacity CAPTIVE AIR WX-250
- Pressure relief valve? YES

Piping

- Type PVC
- Size 1"
- NSF and/or BOCA Code approved YES
- Depth of supply line 42" +

Well data

- Depth 160 ft.
- Yield 40 GPM
- Static water level 24 ft.
- Will water supply be disinfected by installer? YES

I understand that it is my responsibility to notify the Howard County Health Department when the installation is ready for inspection (otherwise this permit is null and void).

All information given above is true to the best of my knowledge.

Signature of Applicant: Robert L. Feeler R.L.F. Co., Inc.

Date: 2/2/88

Note: A sticker indicating approval/status of the installation will be placed on the well casing at the time of the inspection.

July 28/86
1:30

RETEST

Bud Amodeo

8/15/86 1:30

APPLICATION

PERCOLATION TESTING

A 37202

P _____

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
P.O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 461-9933

DISTRICT _____

DATE 6/18/86

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM

Bruce H. Wilkins
6814 Columbia Rd.
Baltimore, MD 21220

PROPERTY OWNER BRUCE H. & LINDA V. WILKINS

ADDRESS 6814 COLUMBIA RD BALTO. MD. 21220 PHONE 301-335-8423

PROSPECTIVE BUYER _____

ADDRESS _____ PHONE _____

PROPERTY LOCATION: 707 RIVER ROAD SYKESVILLE MD

SUBDIVISION SALOPHA 701 RIVER ROAD LOT NO. 3

ROAD AND DESCRIPTION _____

TAX MAP 4189 PARCEL # P-101

SIZE OF LOT 5.98 ACRES TYPE BLDG. SINGLE FAMILY
(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.

Bruce H. Wilkins
(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 7/28/86. Perc unsatisfactory; Rock at shallow depths.

S. Amodeo 9/3/86 PERC OK HOLD FOR CERTIFIED HOLE

9 WELL SITE PLAT RH

BLDG. PERMIT SIGNED
AND RETURNED 6/30/87
60# 12946

THIS IS NOT A PERMIT

100870

at

① ②
SOIL PROFILE

0	4-3
4"	YELLOW BK SILTY SAND N90°00'00" 10% FRAGMENTS
2'	LIGHT BK SILTY SAND 10-20% FRAGMENTS
8'	FRAGMENTS 20-30%

9-9.5' HARD BOTTOM

⑥

CLAY
TAN
SILTY
SAND
LOAM

⑦


BROWN
SILTY
SAND

BROWN
SAND
SILTY
LOAM
10% FRAG
HARD

⑧

CLAY
TAN
SAND
SILTY
LOAM

EH-12/2079

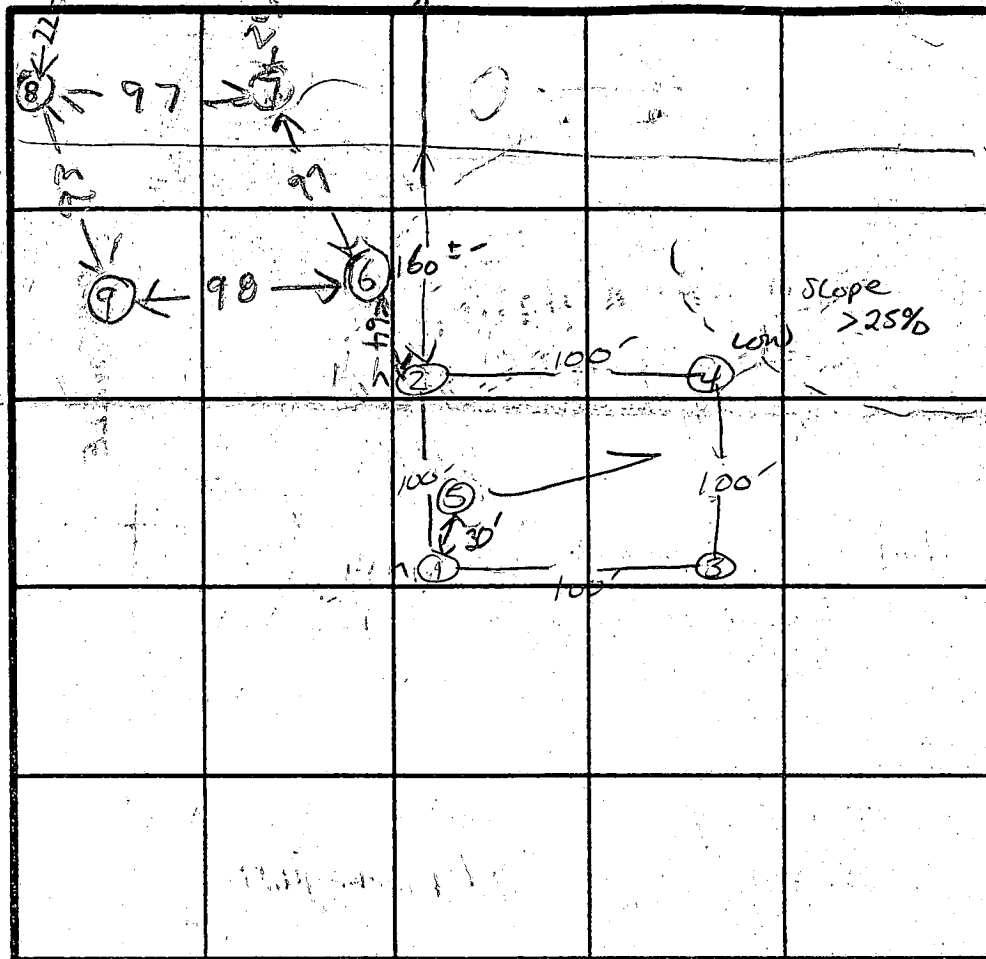

- HOLY
BLEV
① HIGHER
② NEXT
HIGHER
⑤ LOWEST
⑥ NEXT
LOWEST

X Perc
INLET 2.5'
BOTTOM 4.0'
3' WIDE
AIR

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.
River Rd.

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
7/28/86	1 S	2.5'					
	1 M	5.5'					
	1 V	9'	HARD BOTTOM - uniform soil below 2'				
	2 S	2'					
	2 V	9.5'	HARD BOTTOM - uniform soil below 18"				
	3 V	2'	HARD BOTTOM				
	4 V	6.5'	HARD BOTTOM, CLAY TO 3.5-4.0'				
	5 V	7.0'	HARD BOTTOM, CLAY TO 3.5-4.0'				
9/3/86	6 S	4'	201	202	202	204	2
	6 V	12'	OK				
9/3/86	7 S	3'	209	209	209	212	3
	7 V	10'	OK				
9/3/86	8 S	3.5'	213	214	214	216	2
	8 M	6.5'	220	221	221	222	1
9/3/86	8 V	10'	OK				
	9 S	3.5'	228	230	230	232	2
	9 V	11'	OK				


REMARKS

TYPE OF SOIL

TESTED BY S. Abel R. HODGES 9/3

7/28/86
ALSO PRESENT HAROLD SEPTK
9/3/86 BRUCE & LINA WILKES

CLAY
TAN
SAND
SILTY
LOAM

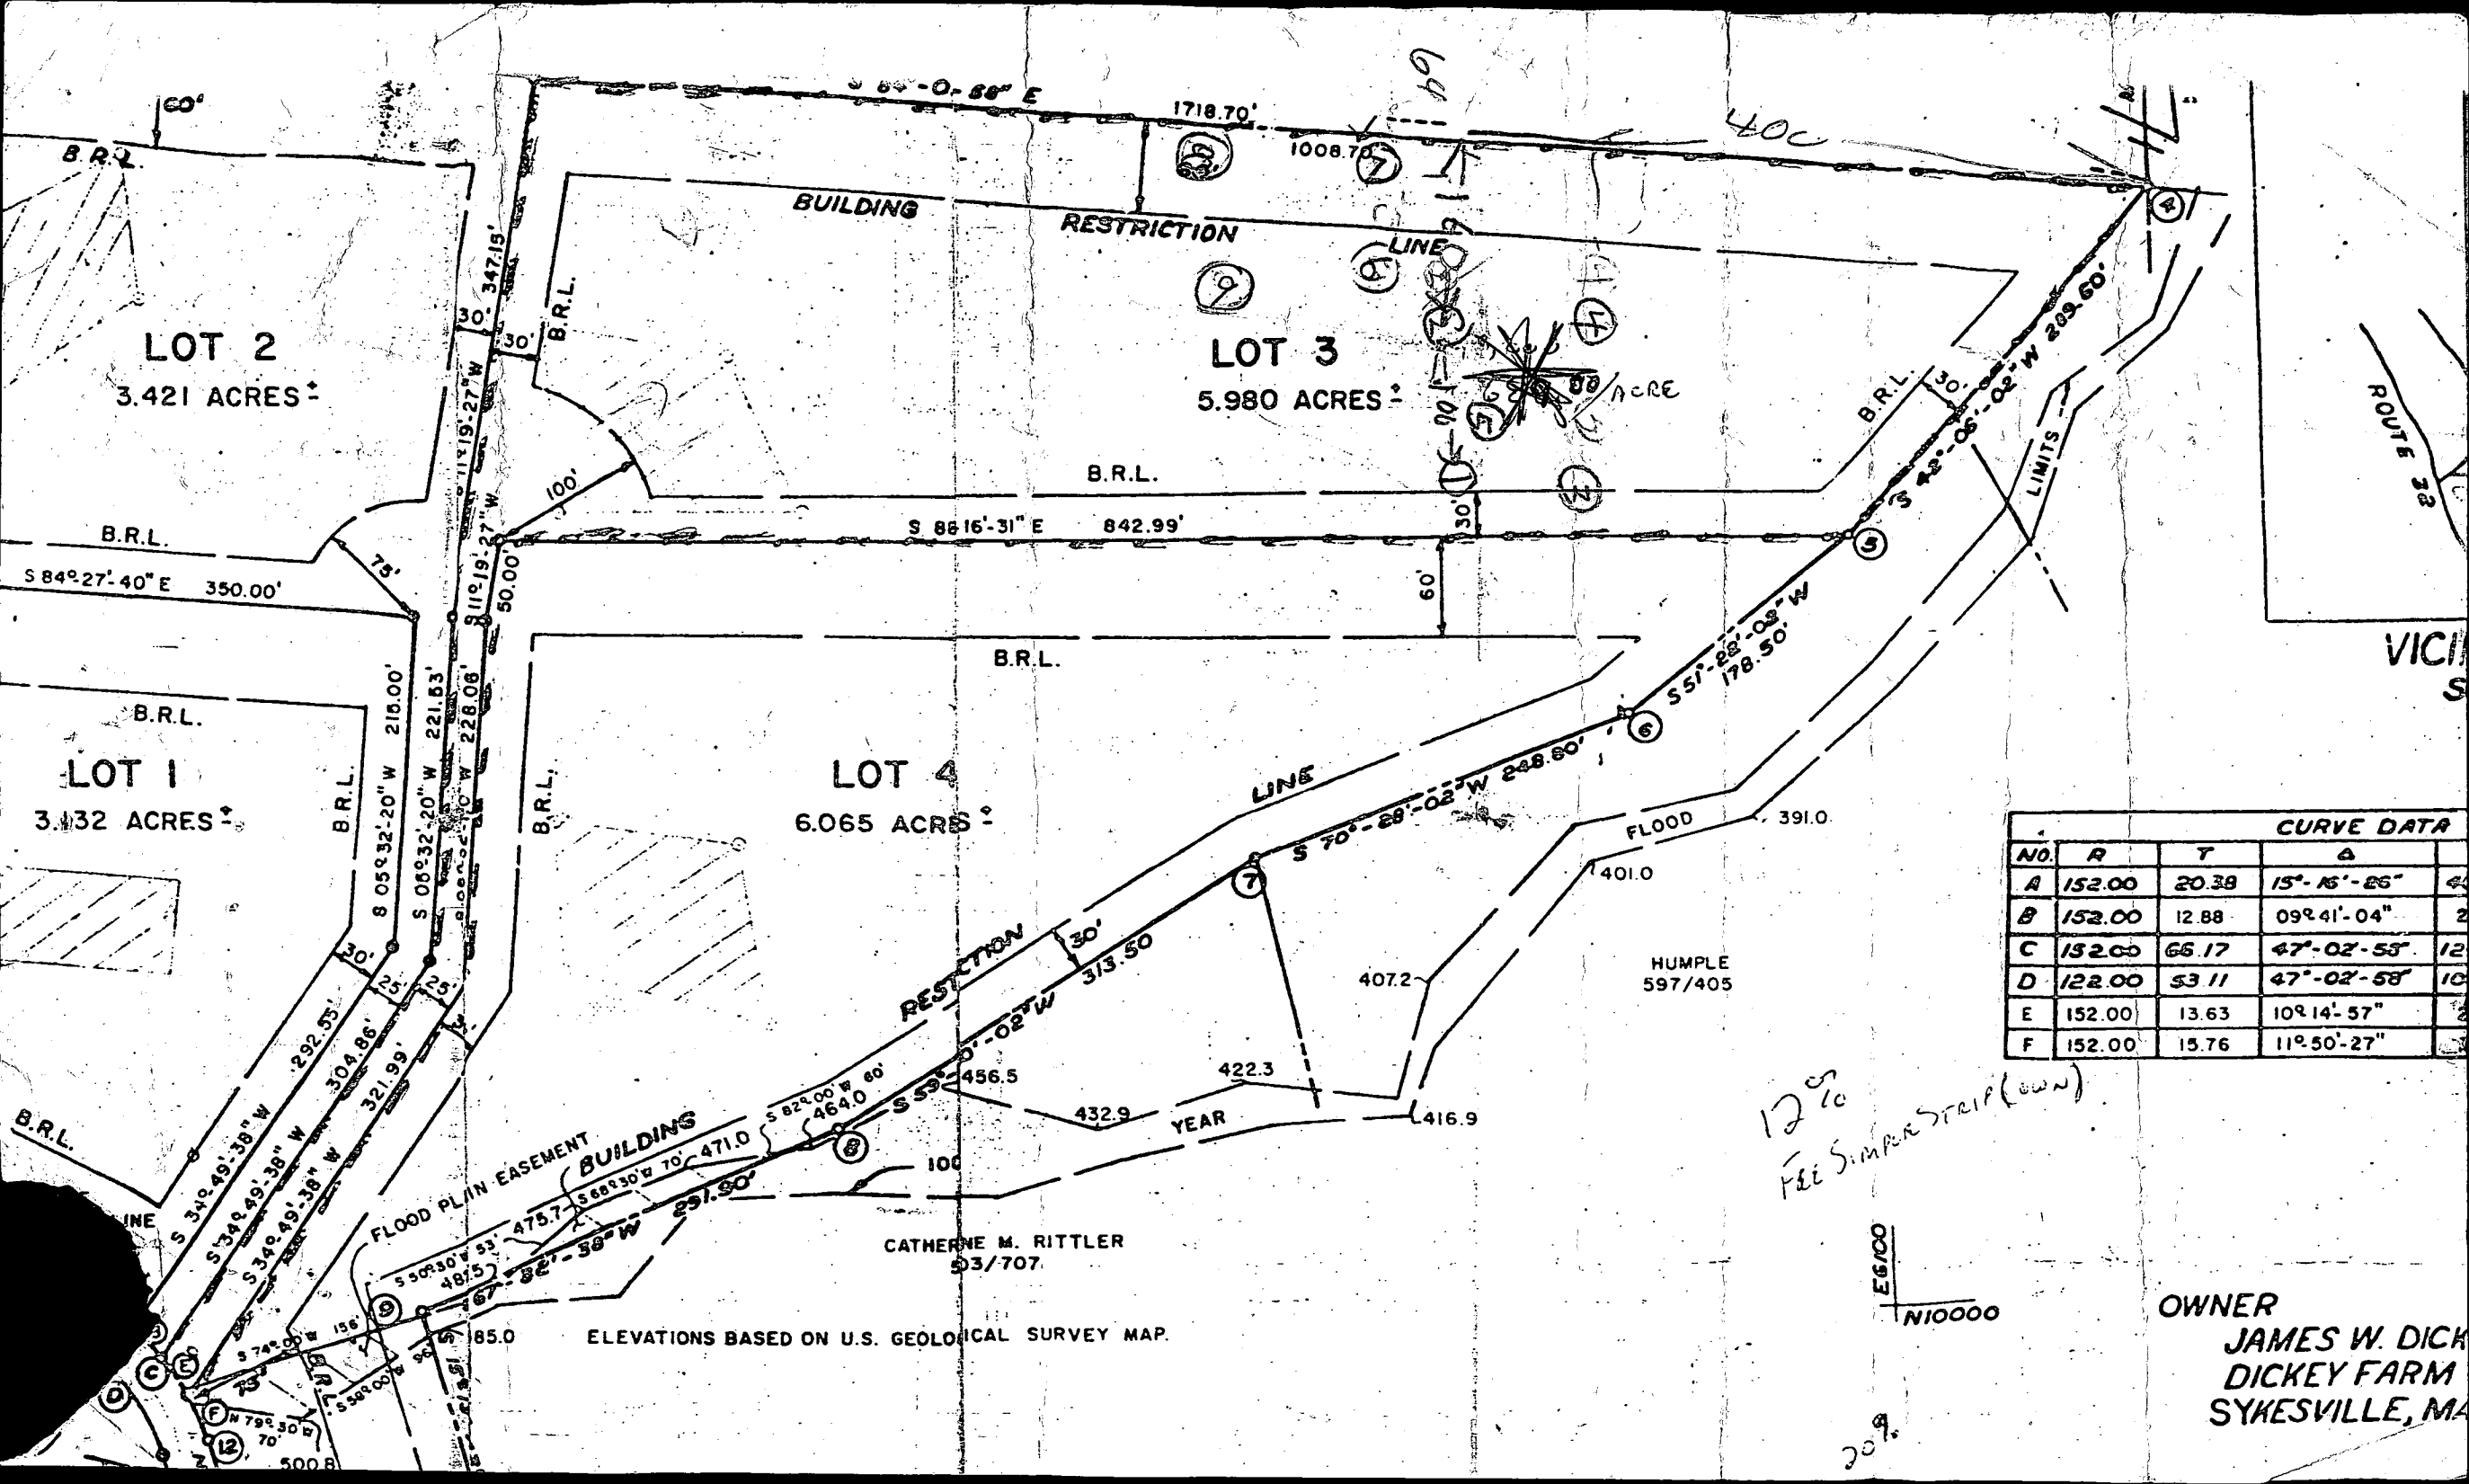

7-30-86

BRUCE A WILKINS

6814 Columbia Rd.

Baltimore, Md. 21220

RE: SALOPHA 20F3

MAX MAP 4 PANC101

DEAR MR. WILKINS!

ON 7/28/86 A STANDARD PERCOLATION TEST WAS PERFORMED ON THE ABOVE REFERENCED PROPERTY. THE TEST PERFORMED FAILED BECAUSE OF SHALLOW BEDROCK IN BOTH LOW HOLES AND BETWEEN THE HIGH HOLES AS TESTED.


IF YOU SHOULD HAVE ANY QUESTIONS CONCERNING THE RESULTS OF THIS TEST PLEASE FEEL FREE TO CONTACT ME AT THE ABOVE ADDRESS OR AT 461-9933. ~~THANK YOU FOR THE~~


U R Y

C.W. Dinc. W + S Inc.


ADDITIONAL ANAL PROPOSED
RETEST 8/15 1130

9/3/86 MORE TESTS RUN & OK NOW CERTIFIED
HOLE & WELL SITE PLAN REBID
NEED TO WRITE FORM LETTER
ABOUT HOLES & SEND TO OWNERS RH

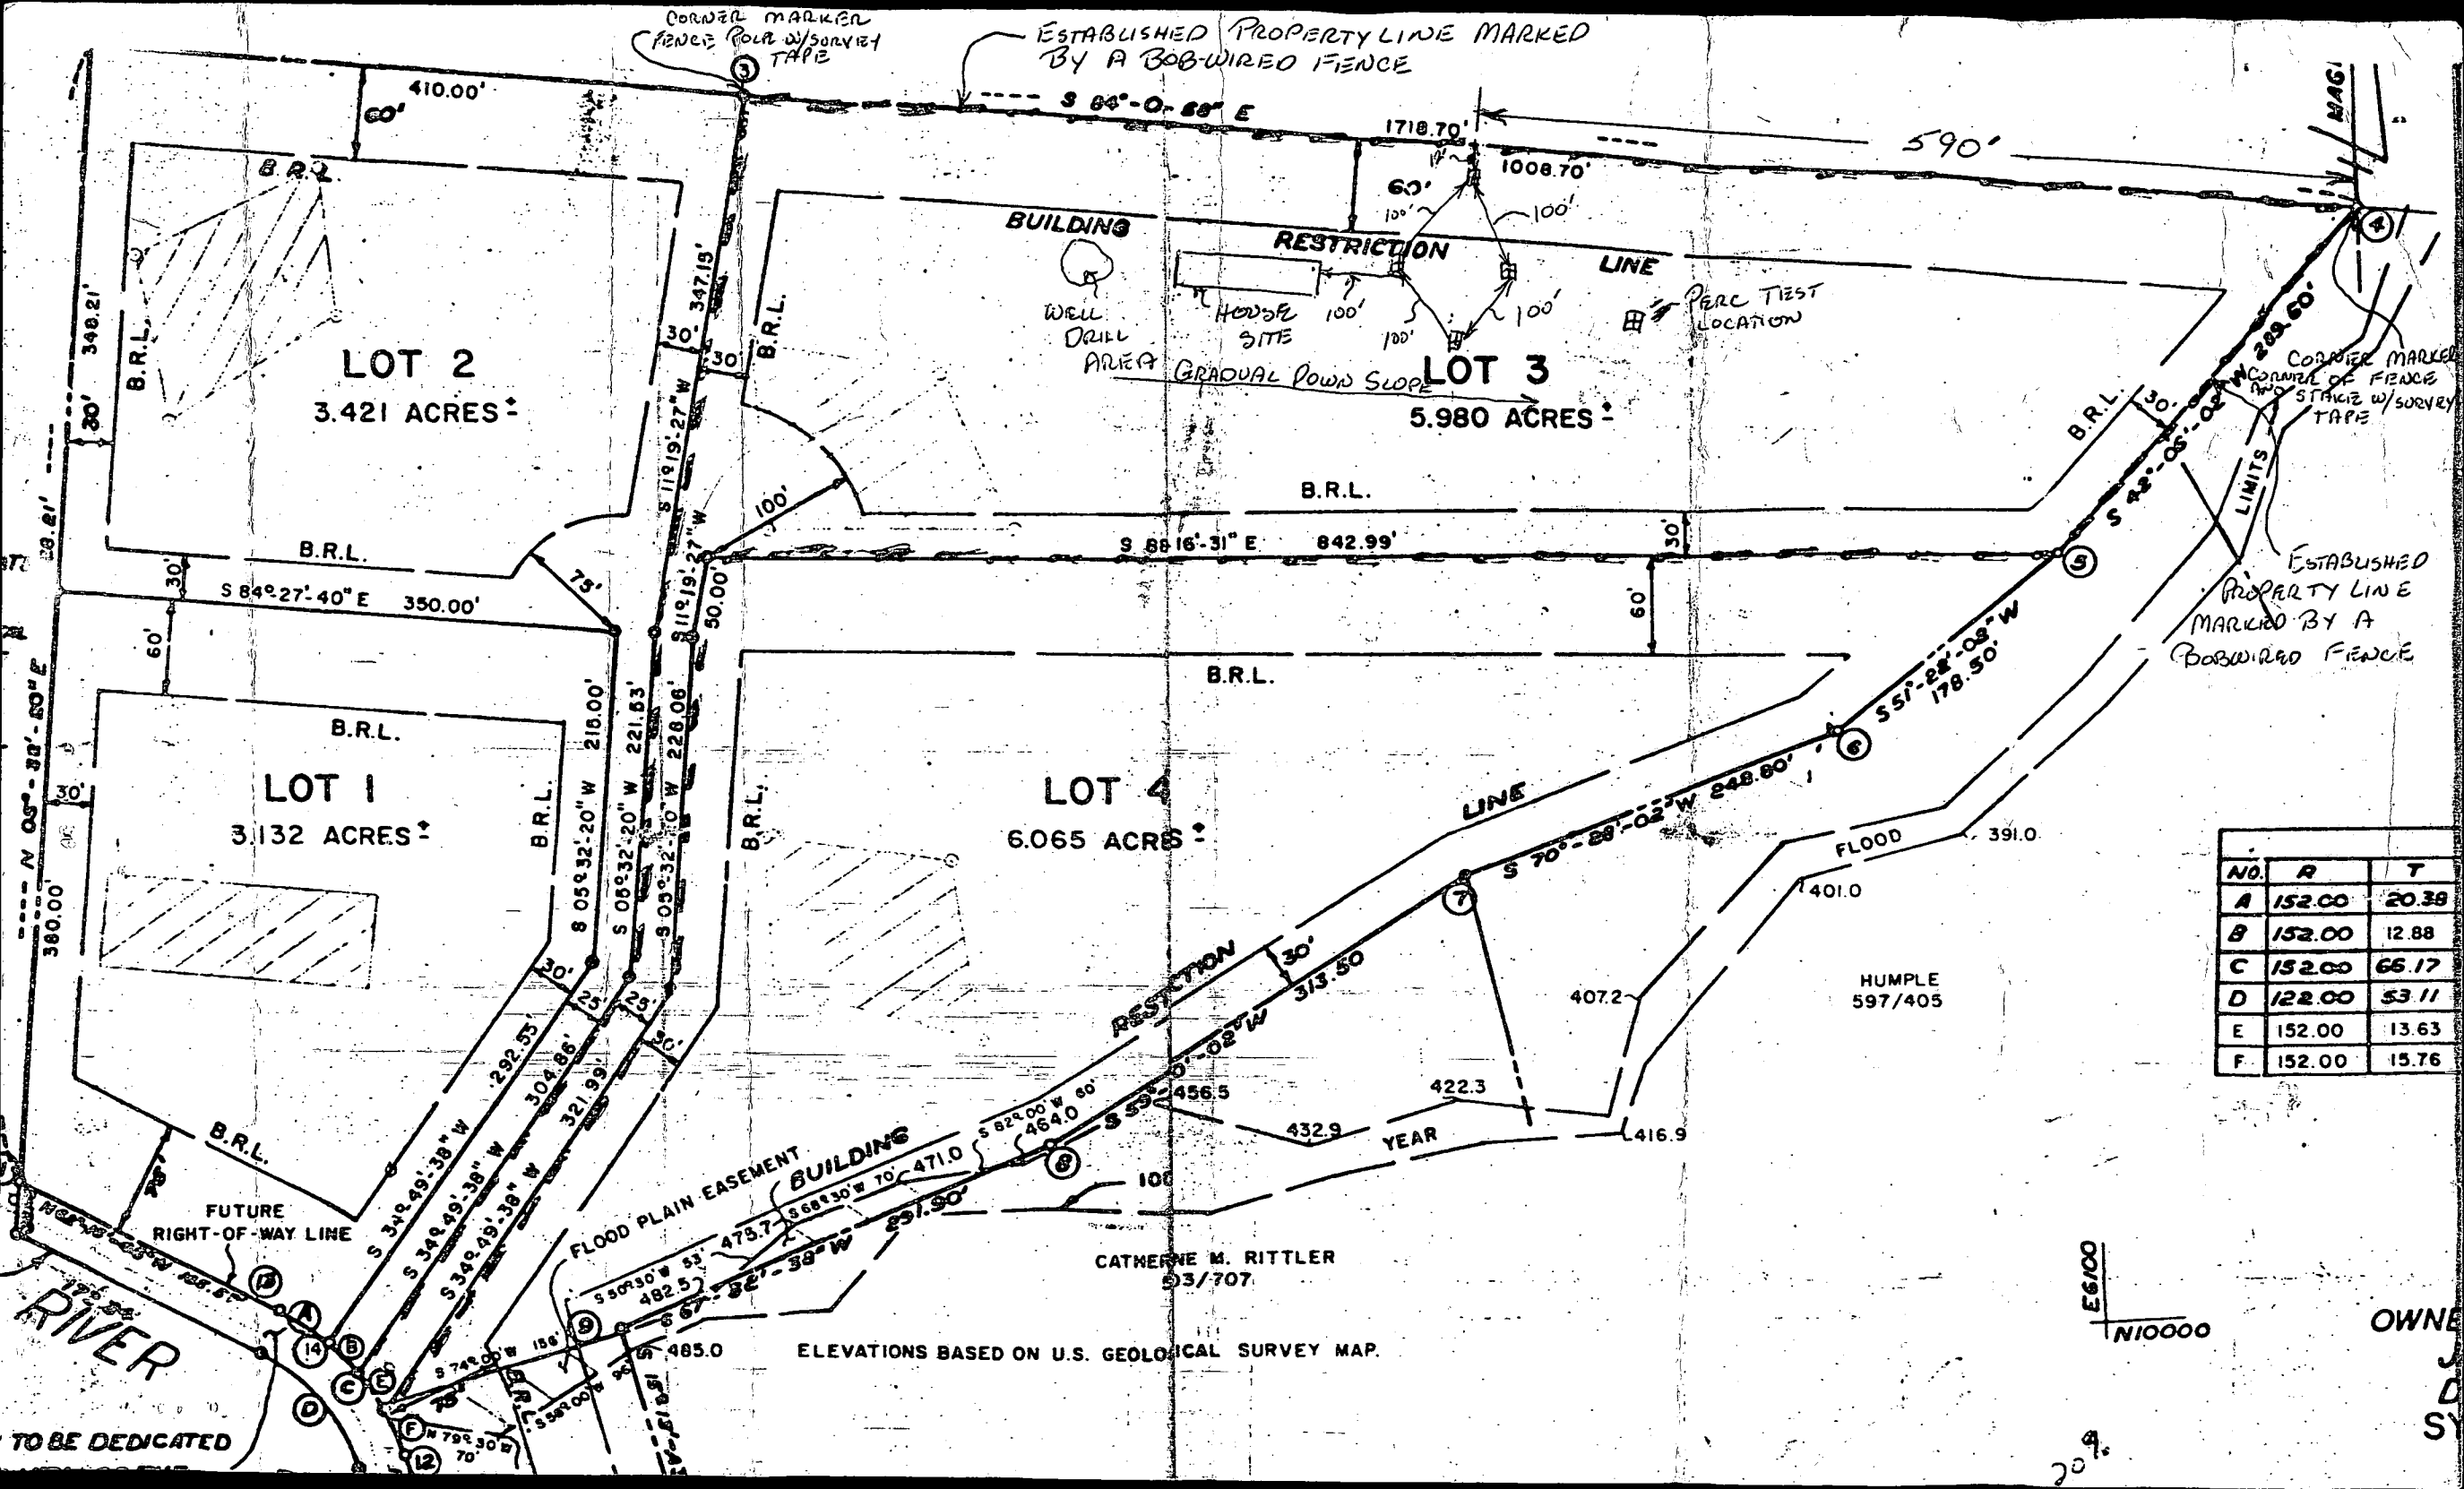


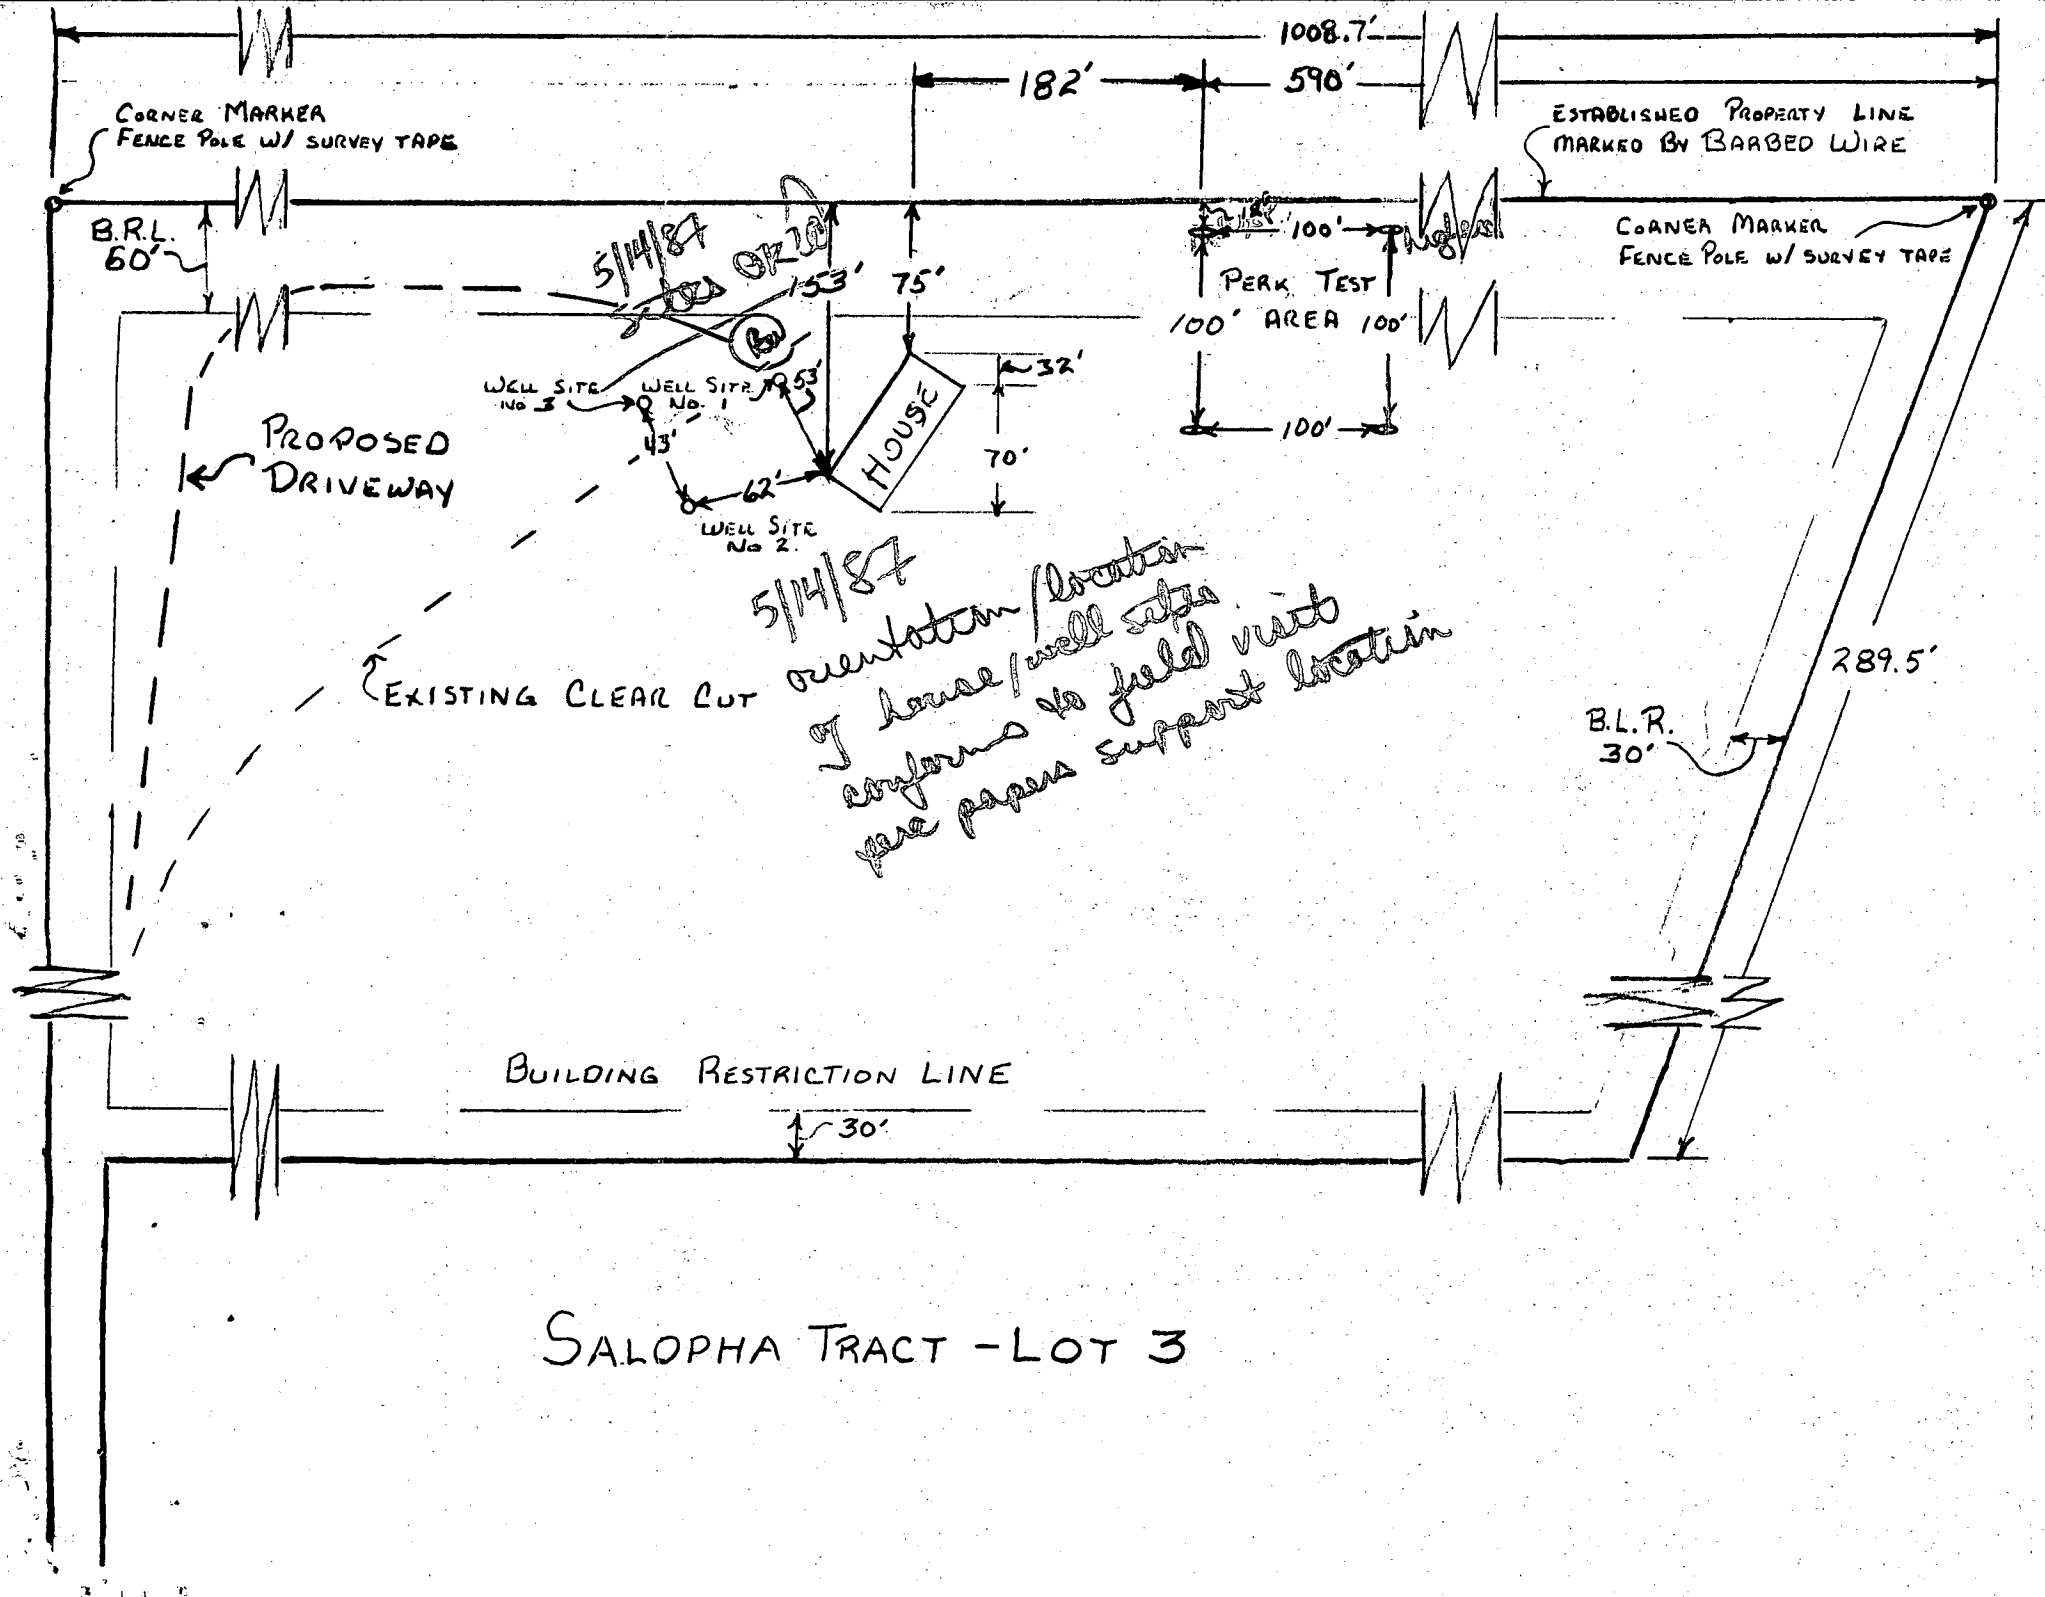

SALOPHA TRACT - LOT 3

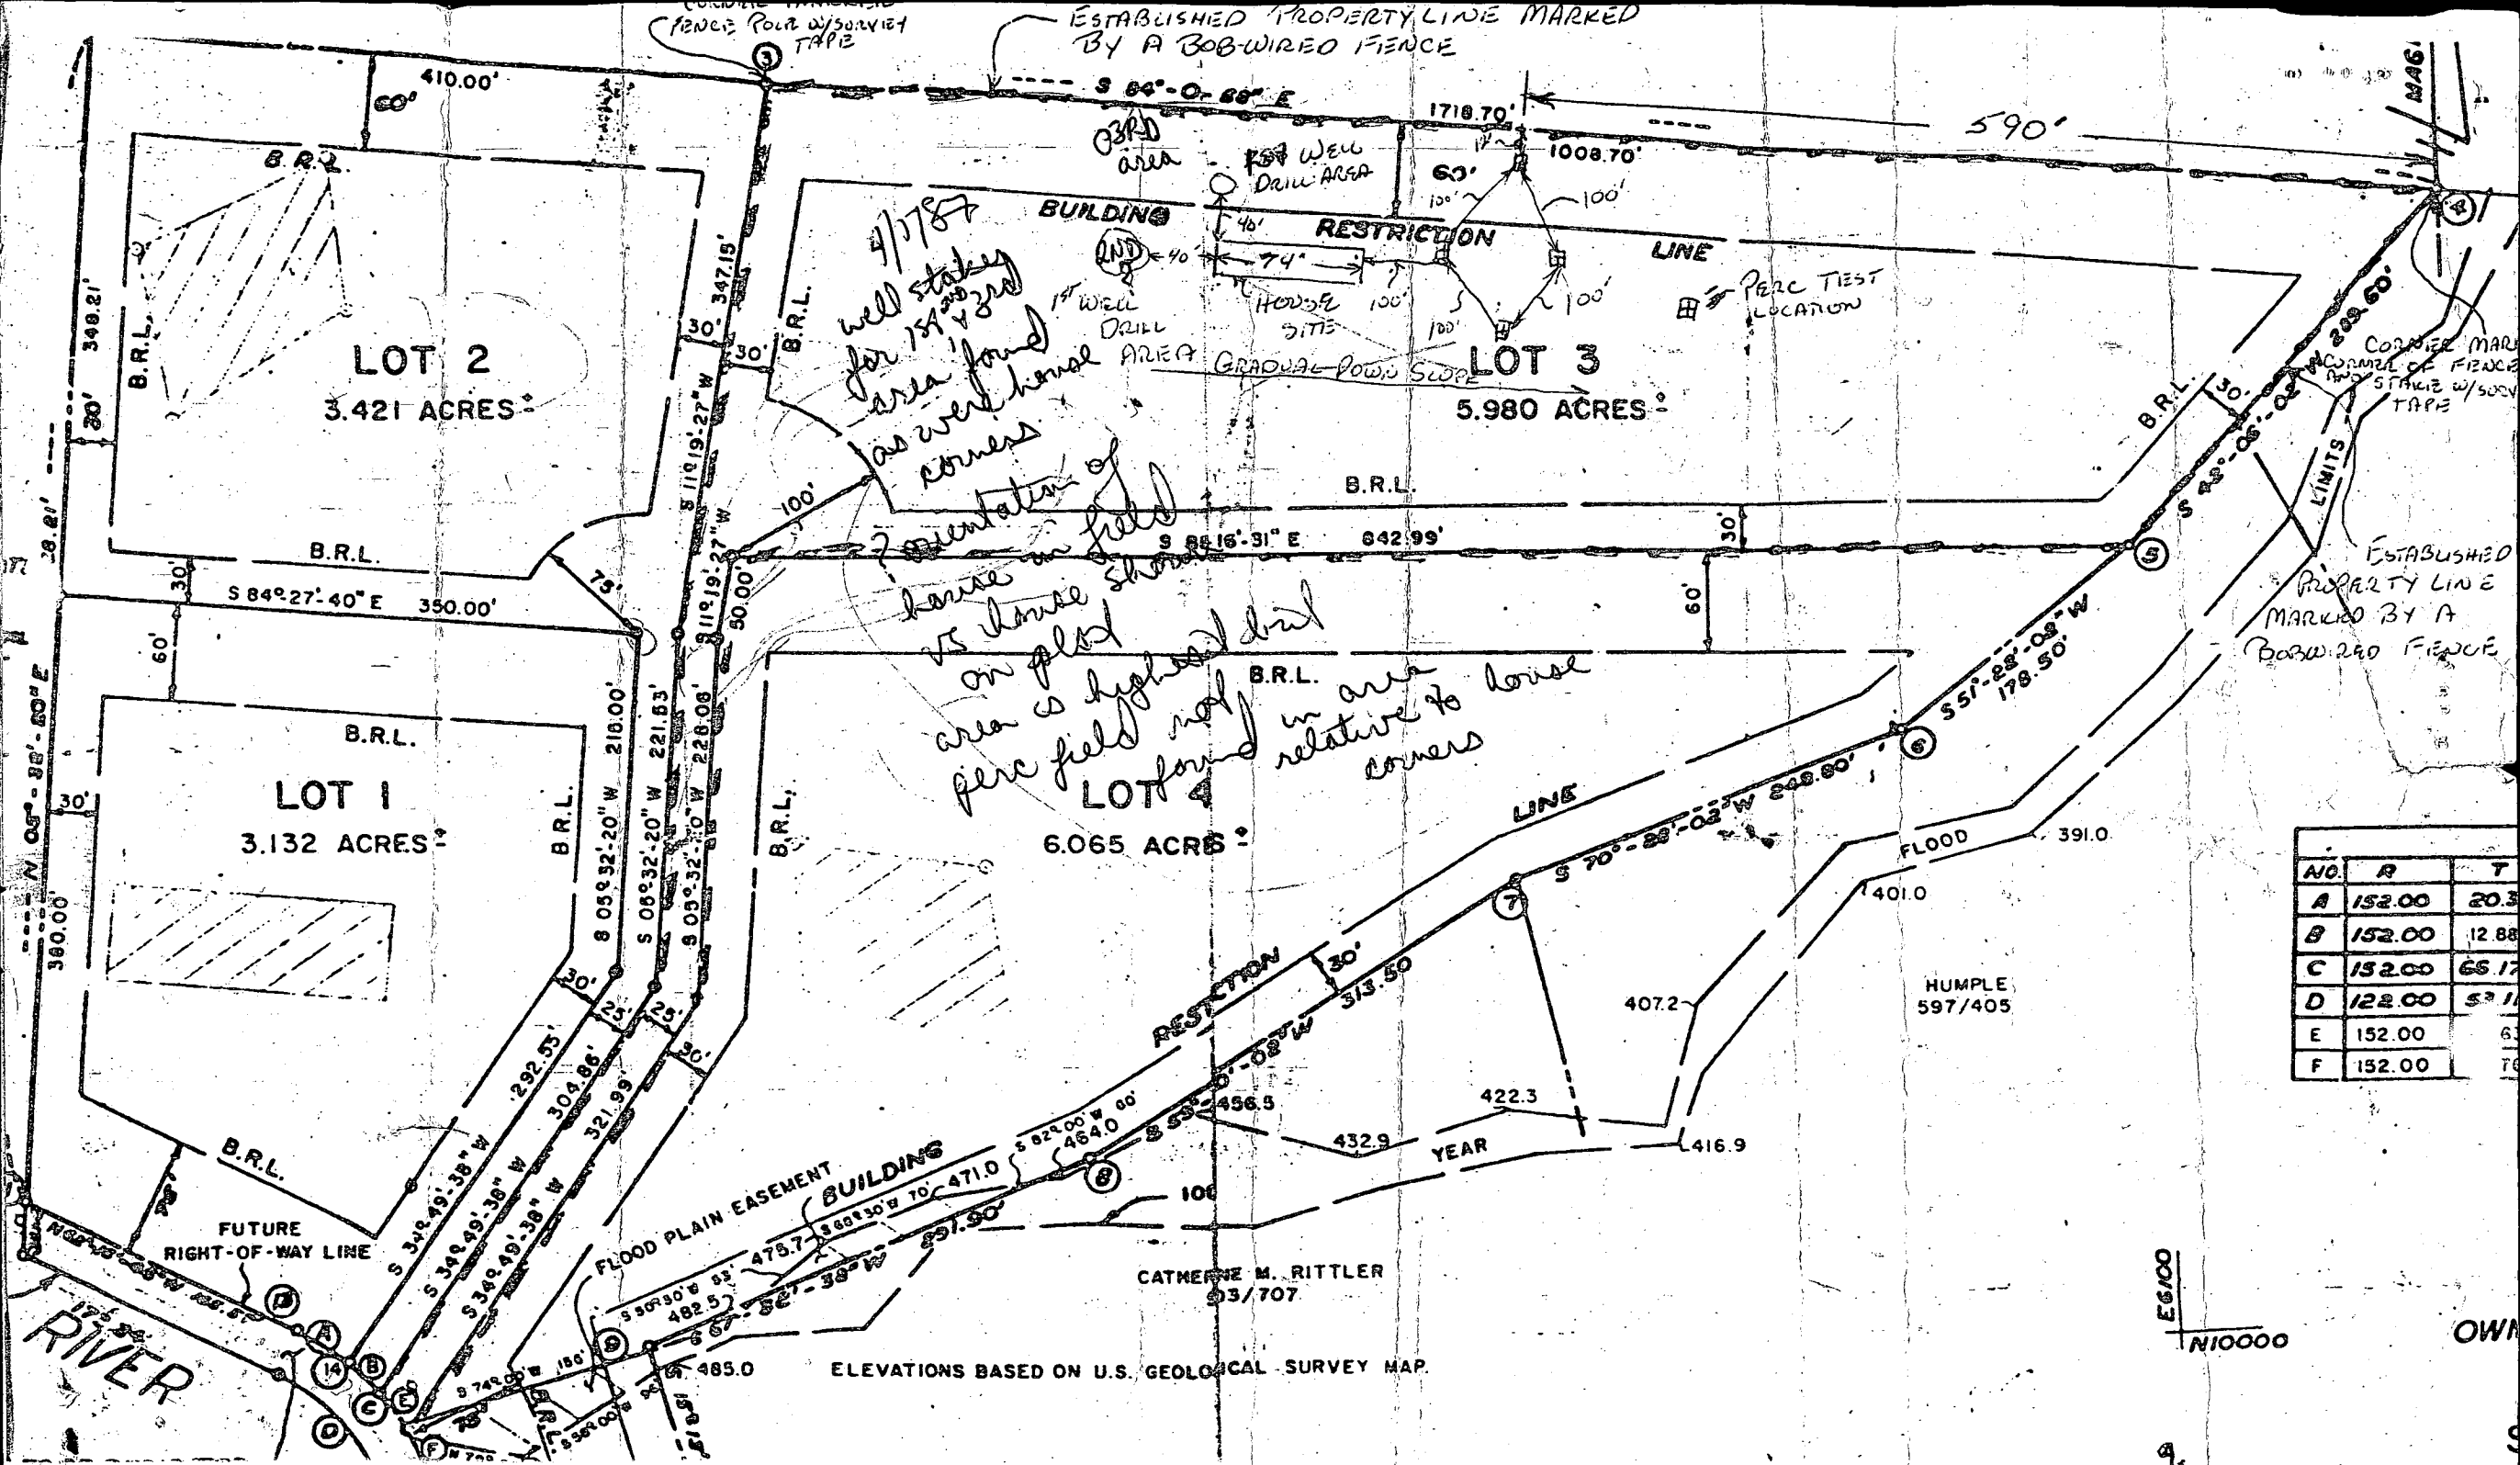

[illegible]

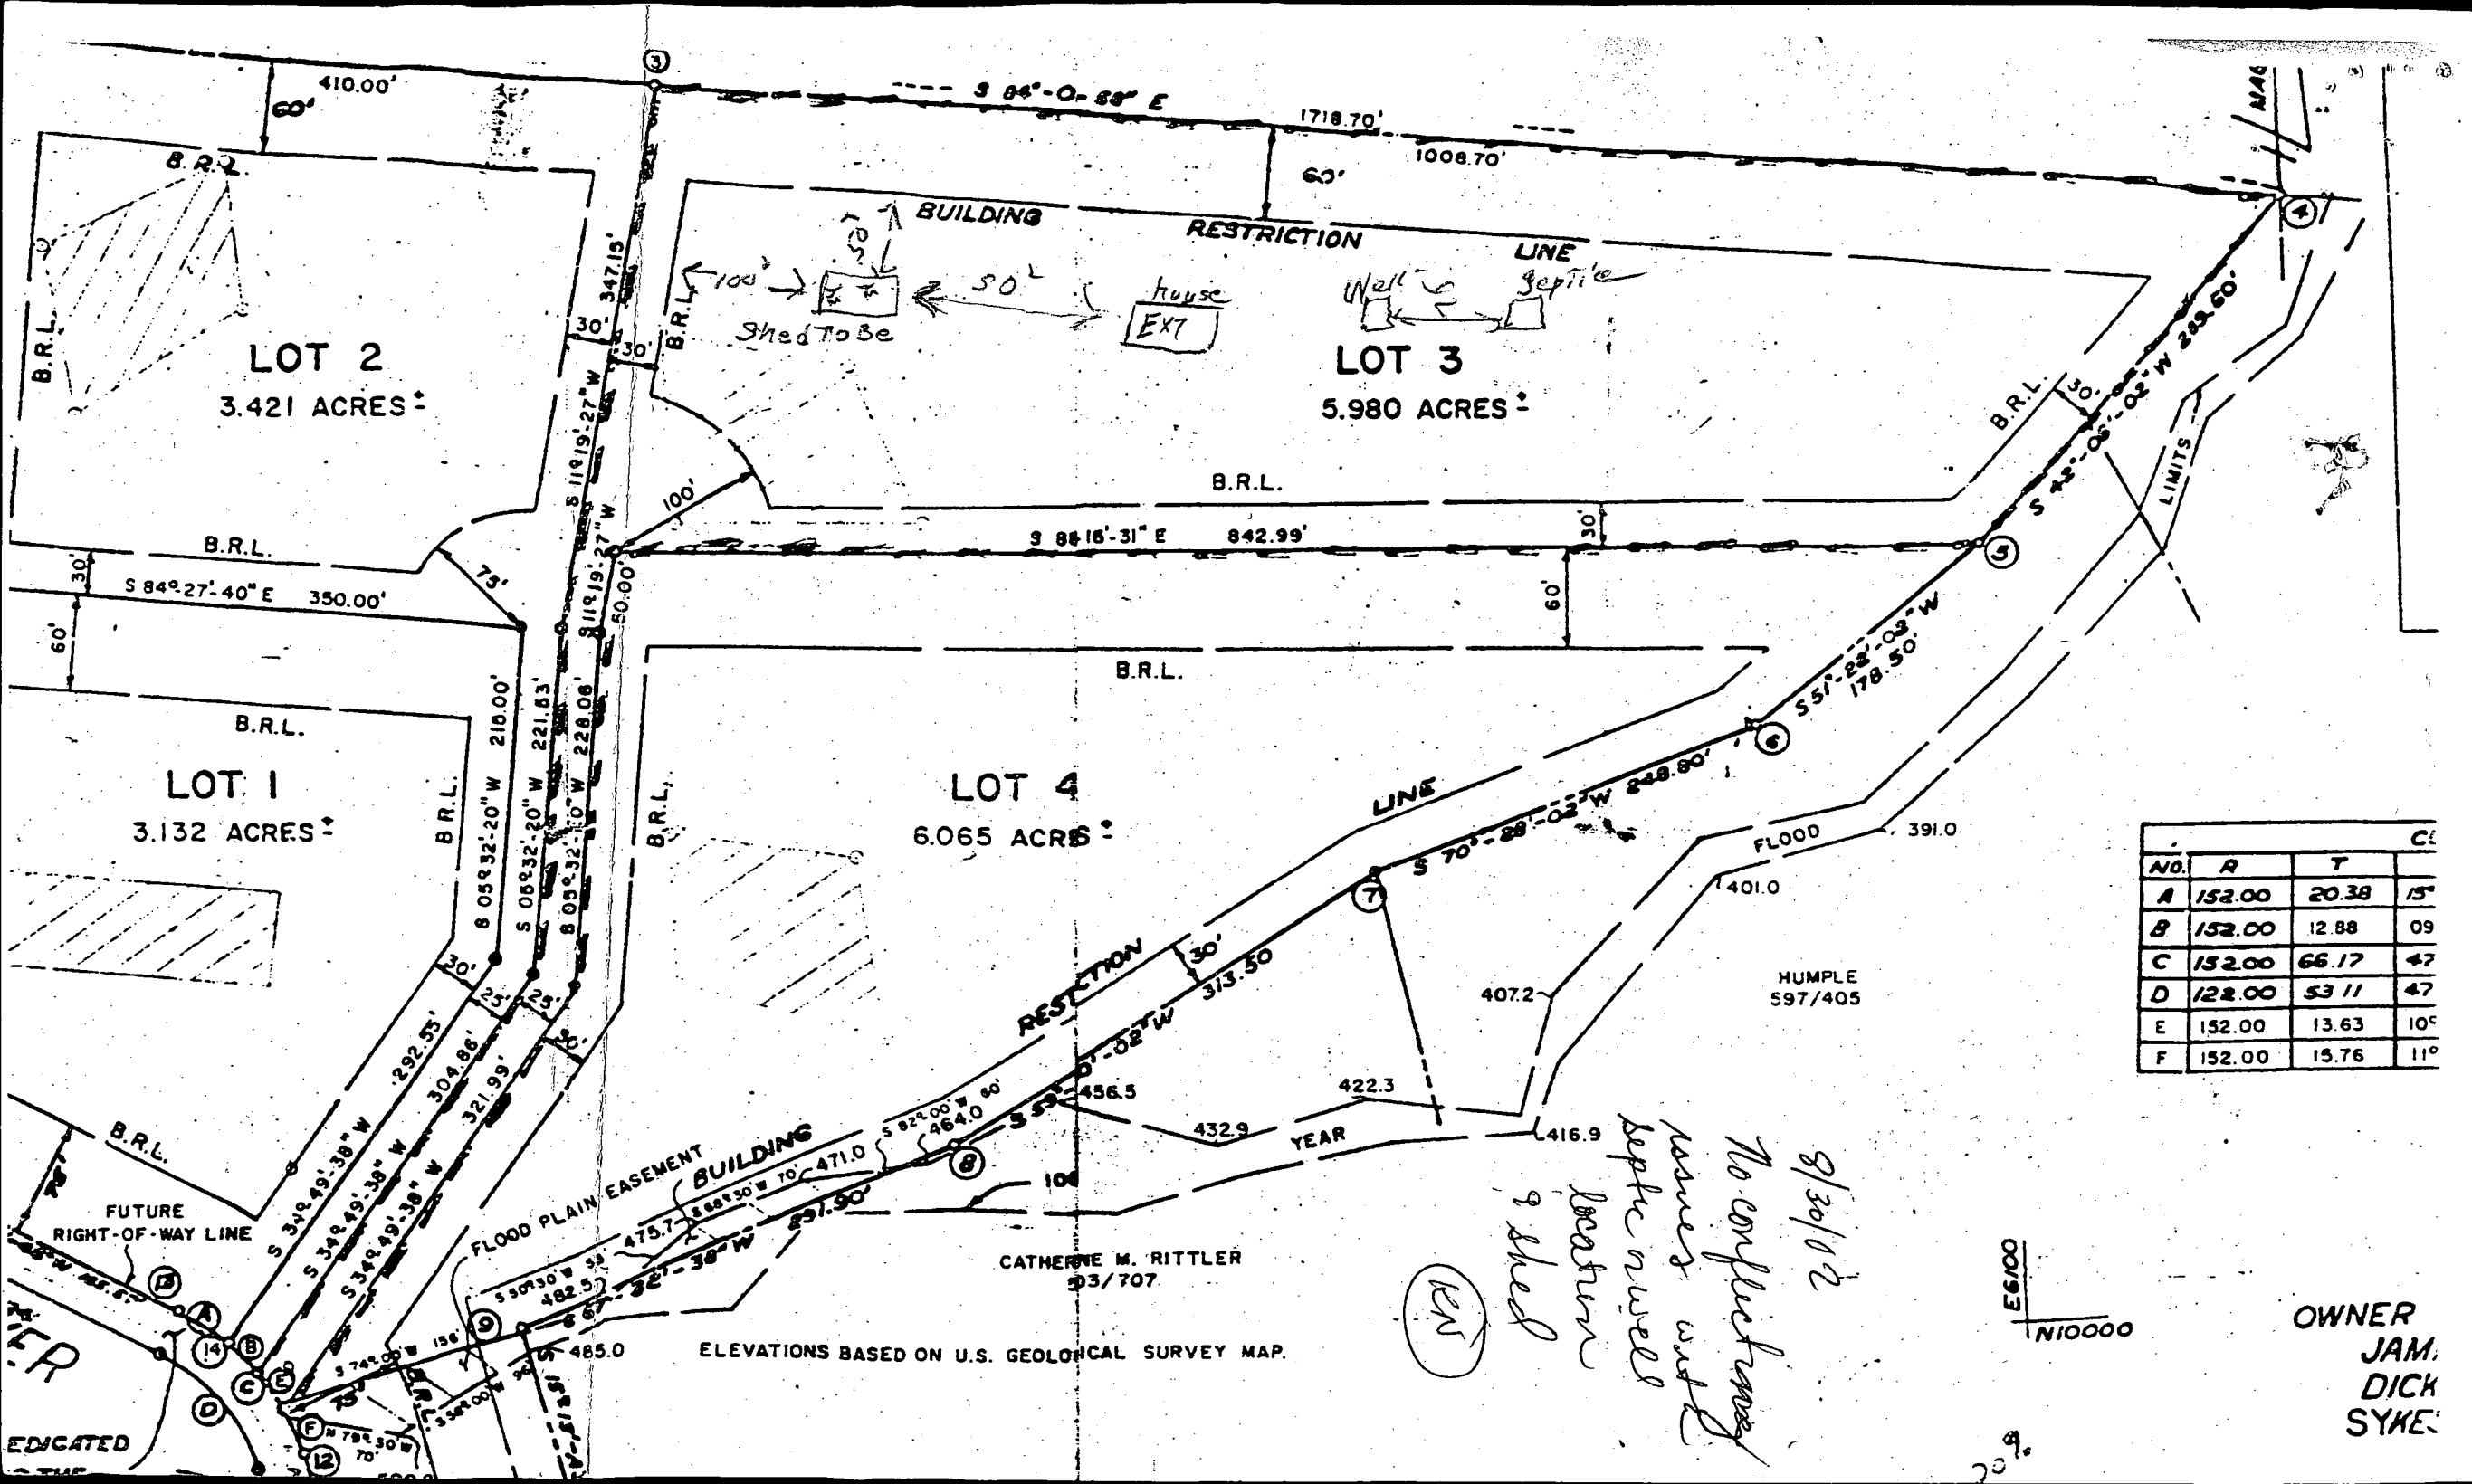

HOWARD COUNTY PERMIT APPLICATION

PERMIT NUMBER

300138157

Building Address 701 RIVER ROAD
SYKESVILLE, MD 21784

Suite/Apt. #: _____ SDP/WP/Petition #: _____

Census Tract 6030W Subdivision SALOPHA

Section _____ Area _____ Lot P 101

Tax Map 4 Parcel 10 Grid 24

Zoning RRDED Map Coordinates 5 D 7 Lot size 5.9 ACRES

Existing Use Single Family Dwelling

Proposed Use STON. TRACTOR, BARR, MOWERS

Estimated Construction Cost \$ 15,000

Description of Work BUILD A UTILITY
SHED 31x34 1 story

Occupant or Tenant N/A

Contact Name NO OCCUPANT AT PRESENT

Address _____

City _____ State _____ Zip Code _____

Phone _____ Fax _____

Property Owner's Name BRUCE WILKINS

Address 701 RIVER ROAD

City SYKESVILLE State MD Zip Code 21784

Home Phone 410 442 5791 Work Phone 410 461 5005

Applicant's Name & Mailing Address, (if other than stated hereon): _____

Phone _____ Fax _____

Contractor Company SELF EMPLOYED

Contact Person OWNER

Address 701 RIVER ROAD

City SYKESVILLE State MD Zip Code 21784

License No. _____ Fax 552-7039

Phone 552-7039

Engineer or Architect Company SELF EMPLOYED

Contact Person OWNER

Address 701 RIVER ROAD

City SYKESVILLE State MD Zip Code 21784

Phone _____ Fax _____

BUILDING DESCRIPTION - COMMERCIAL

Building Characteristics

Height: 10' 6" square truss roof

No. of stories: 1

Gross area, sq. ft. per floor: 1156

Use group: _____

Construction type:

☐ Reinforced Concrete

☐ Structural Steel

☐ Masonry

☒ Wood Frame on 8' x 12' joists

UP. SINK - SINK UNIT

☐ State Certified Modular

Utilities

Water Supply:

☐ Public

☒ Private

Sewage Disposal:

☐ Public

☒ Private

Electric Yes ☐ No ☐

Gas Yes ☐ No ☐

Heating System:

☐ Electric ☐ Oil ☐

☐ Natural Gas ☐

☐ Propane Gas ☐

Sprinkler system: N/A

☐ Full

☐ Partial

☐ Other Suppression

of Heads _____

BUILDING DESCRIPTION - RESIDENTIAL

Building Characteristics

SF Dwelling ☐ SF Townhouse ☐

Depth _____ Width _____

1st floor: _____

2nd floor: _____

Basement: _____

Finished Basement ☐ Unfinished Basement ☐

Crawl space ☐ Slab on Grade ☒

No. of Bedrooms 1

Multi-family dwellings:

No. of efficiency units: _____

No. of 1 BR units: _____

No. of 2 BR units: _____

No. of 3 BR units: _____

Other Structure: Storage Shed 12x14

Dimension: 12' x 14'

Footings: 4' x 4' concrete

Roof: 3' x 12' gable roof

State Certified Modular

Manufactured Home

Utilities

Water Supply:

☐ Public

☒ Private

Sewage Disposal:

☐ Public

☒ Private

Electric Yes ☐ No ☒

Gas Yes ☐ No ☒

Heating System:

☐ Electric ☐ Oil ☐

☐ Natural Gas ☐

☐ Propane Gas ☐

Sprinkler system: N/A

☐ NFPA #1

☐ NFPA #13

☐ Other: _____

THE UNDERSIGNED HEREBY CERTIFIES AND AGREES AS FOLLOWS: (1) THAT HE/SHE IS AUTHORIZED TO APPLY FOR THIS PERMIT; (2) THAT THE INFORMATION IS CORRECT; (3) THAT HE/SHE WILL PERFORM NO WORK ON THE PROPERTY NOT SPECIFICALLY IDENTIFIED IN THIS APPLICATION; (4) THAT HE/SHE WILL PERFORM NO WORK ON THE PROPERTY NOT SPECIFICALLY IDENTIFIED IN THIS APPLICATION; (5) THAT HE/SHE WILL MAINTAIN ACCESS TO ALL ADJACENT PROPERTIES AT ALL TIMES.

APPLICANT'S SIGNATURE: Bruce H. Wilkins

DATE: 11/26/2002

TITLE/COMPANY: _____

CHECKS PAYABLE TO: DIRECTOR OF: NAME OF HOWARD COUNTY

PLEASE WRITE NEATLY AND IN BLOCK LETTERS.

FOR OFFICE USE ONLY

AGENCY: _____ DATE: 11/26/2002 SIGNATURE: Karen Roman

☒ Land Development, DPZ

☒ State Highways

☒ Building Official

☒ Dev. Engineering, DPZ

☒ Health

☒ Fire Protection

Is Sediment Control approval required prior to issuance? YES ☐ NO ☒

CONTINGENCY CONSTRUCTION START: ☐

ONE STOP SHOP: ☐

DPZ SETBACK INFORMATION

Front: 10'

Rear: 10'

Side: 30'

Side St.: N/A

All minimum setbacks met? YES ☒ NO ☐

Is Entrance permit required? YES ☐ NO ☒

Historic District? YES ☐ NO ☒

Not Covered for New Town Zone

SDP/Red-line approval date N/A

PROPERTY ID#

Filing fee \$ 5.58

Permit fee \$ _____

Excess tax \$ _____

Subtotal paid \$ _____

1st permit fee \$ _____

TOTAL FEES \$ 5.58

Check # 1002

Validation # _____

Accepted by 111

Pink: Health

Gold: SHA

Rev. 10/15/98

Distribution of Copies:

White:

Official 11:41:41 11/26/2002 Yellow: DED, DPZ

1 permit firm

193

Application N

OWNER: Bruce W. Kews

ADDRESS 701 River Rd Sykesville, MD. 21784 (410) 442-5791

PLEASE SHOW BELOW:

- Property line dimensions and easements;
- Existing buildings;
- Existing well/septic; (show distance to nearest structure)
- Road names and location of alleys;
- If your property is in a tidal or riverine flood area, indicate elevation of floor of proposed work.
- The proposed work and the setback distances to the proposed work.


Front Setback 100' +

Left Setback 70'

Rear Setback 50'

Right Setback 100'±

NOTE: Cannot fence access easement.

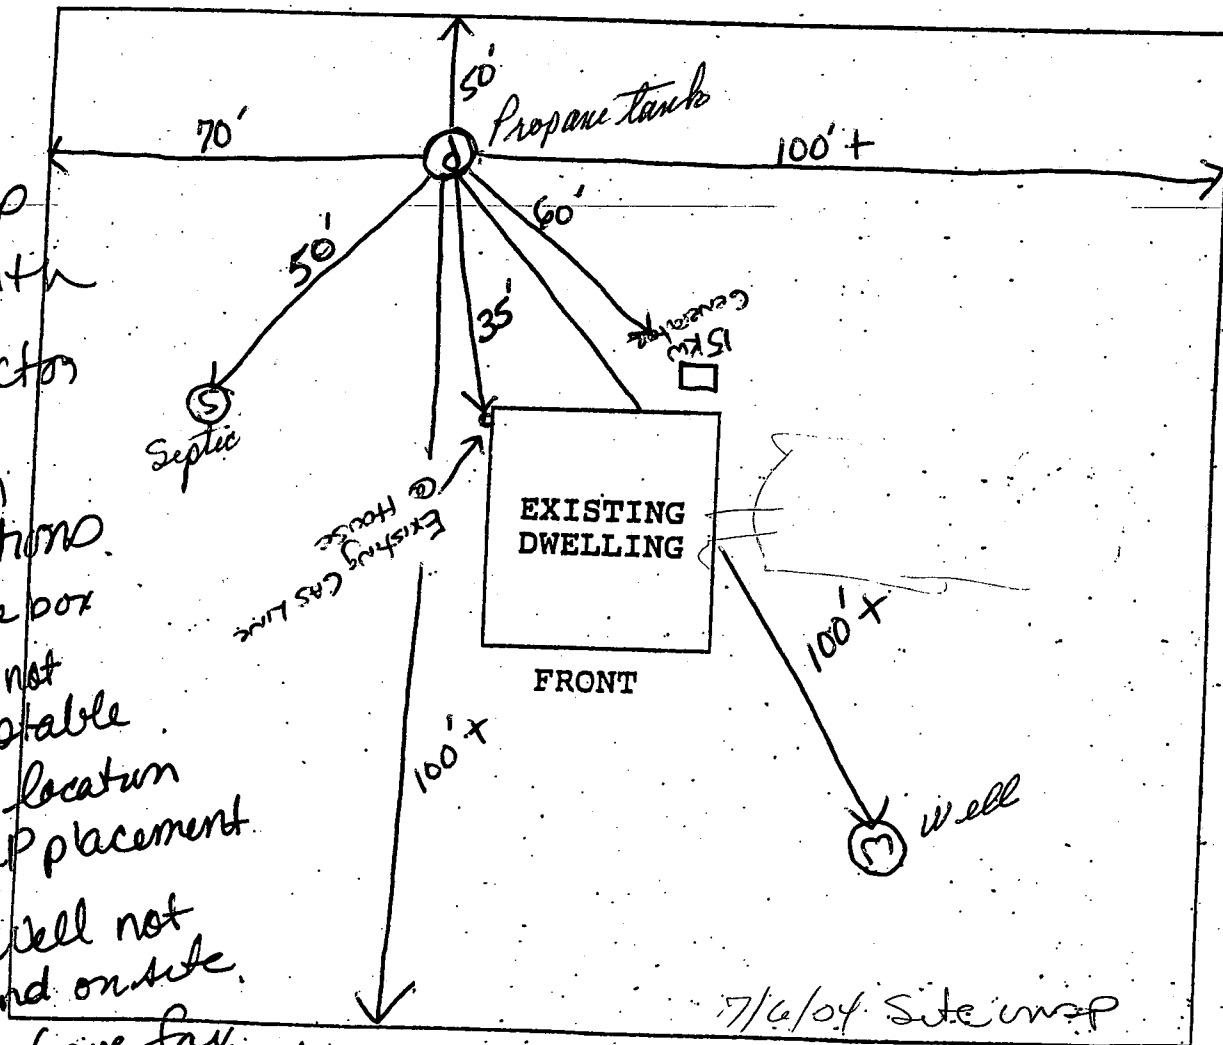

7/6/04

Site map
e Met with
LP contractor
about
Site plan
expectations
ie. square box

house not acceptable
Actual location
of LP placement
30'. Well not
found on site.
have fax.

401
 District Gave fax
 # to request scaled
 ROAD NAME
 plan to be
 mailed to
 LP Co for f


ROAD NAME

River Rd.

7/6/04 Site map

30' from LP to Septic tank. Told

to call in picture
to get scaled drawings
if needed KN

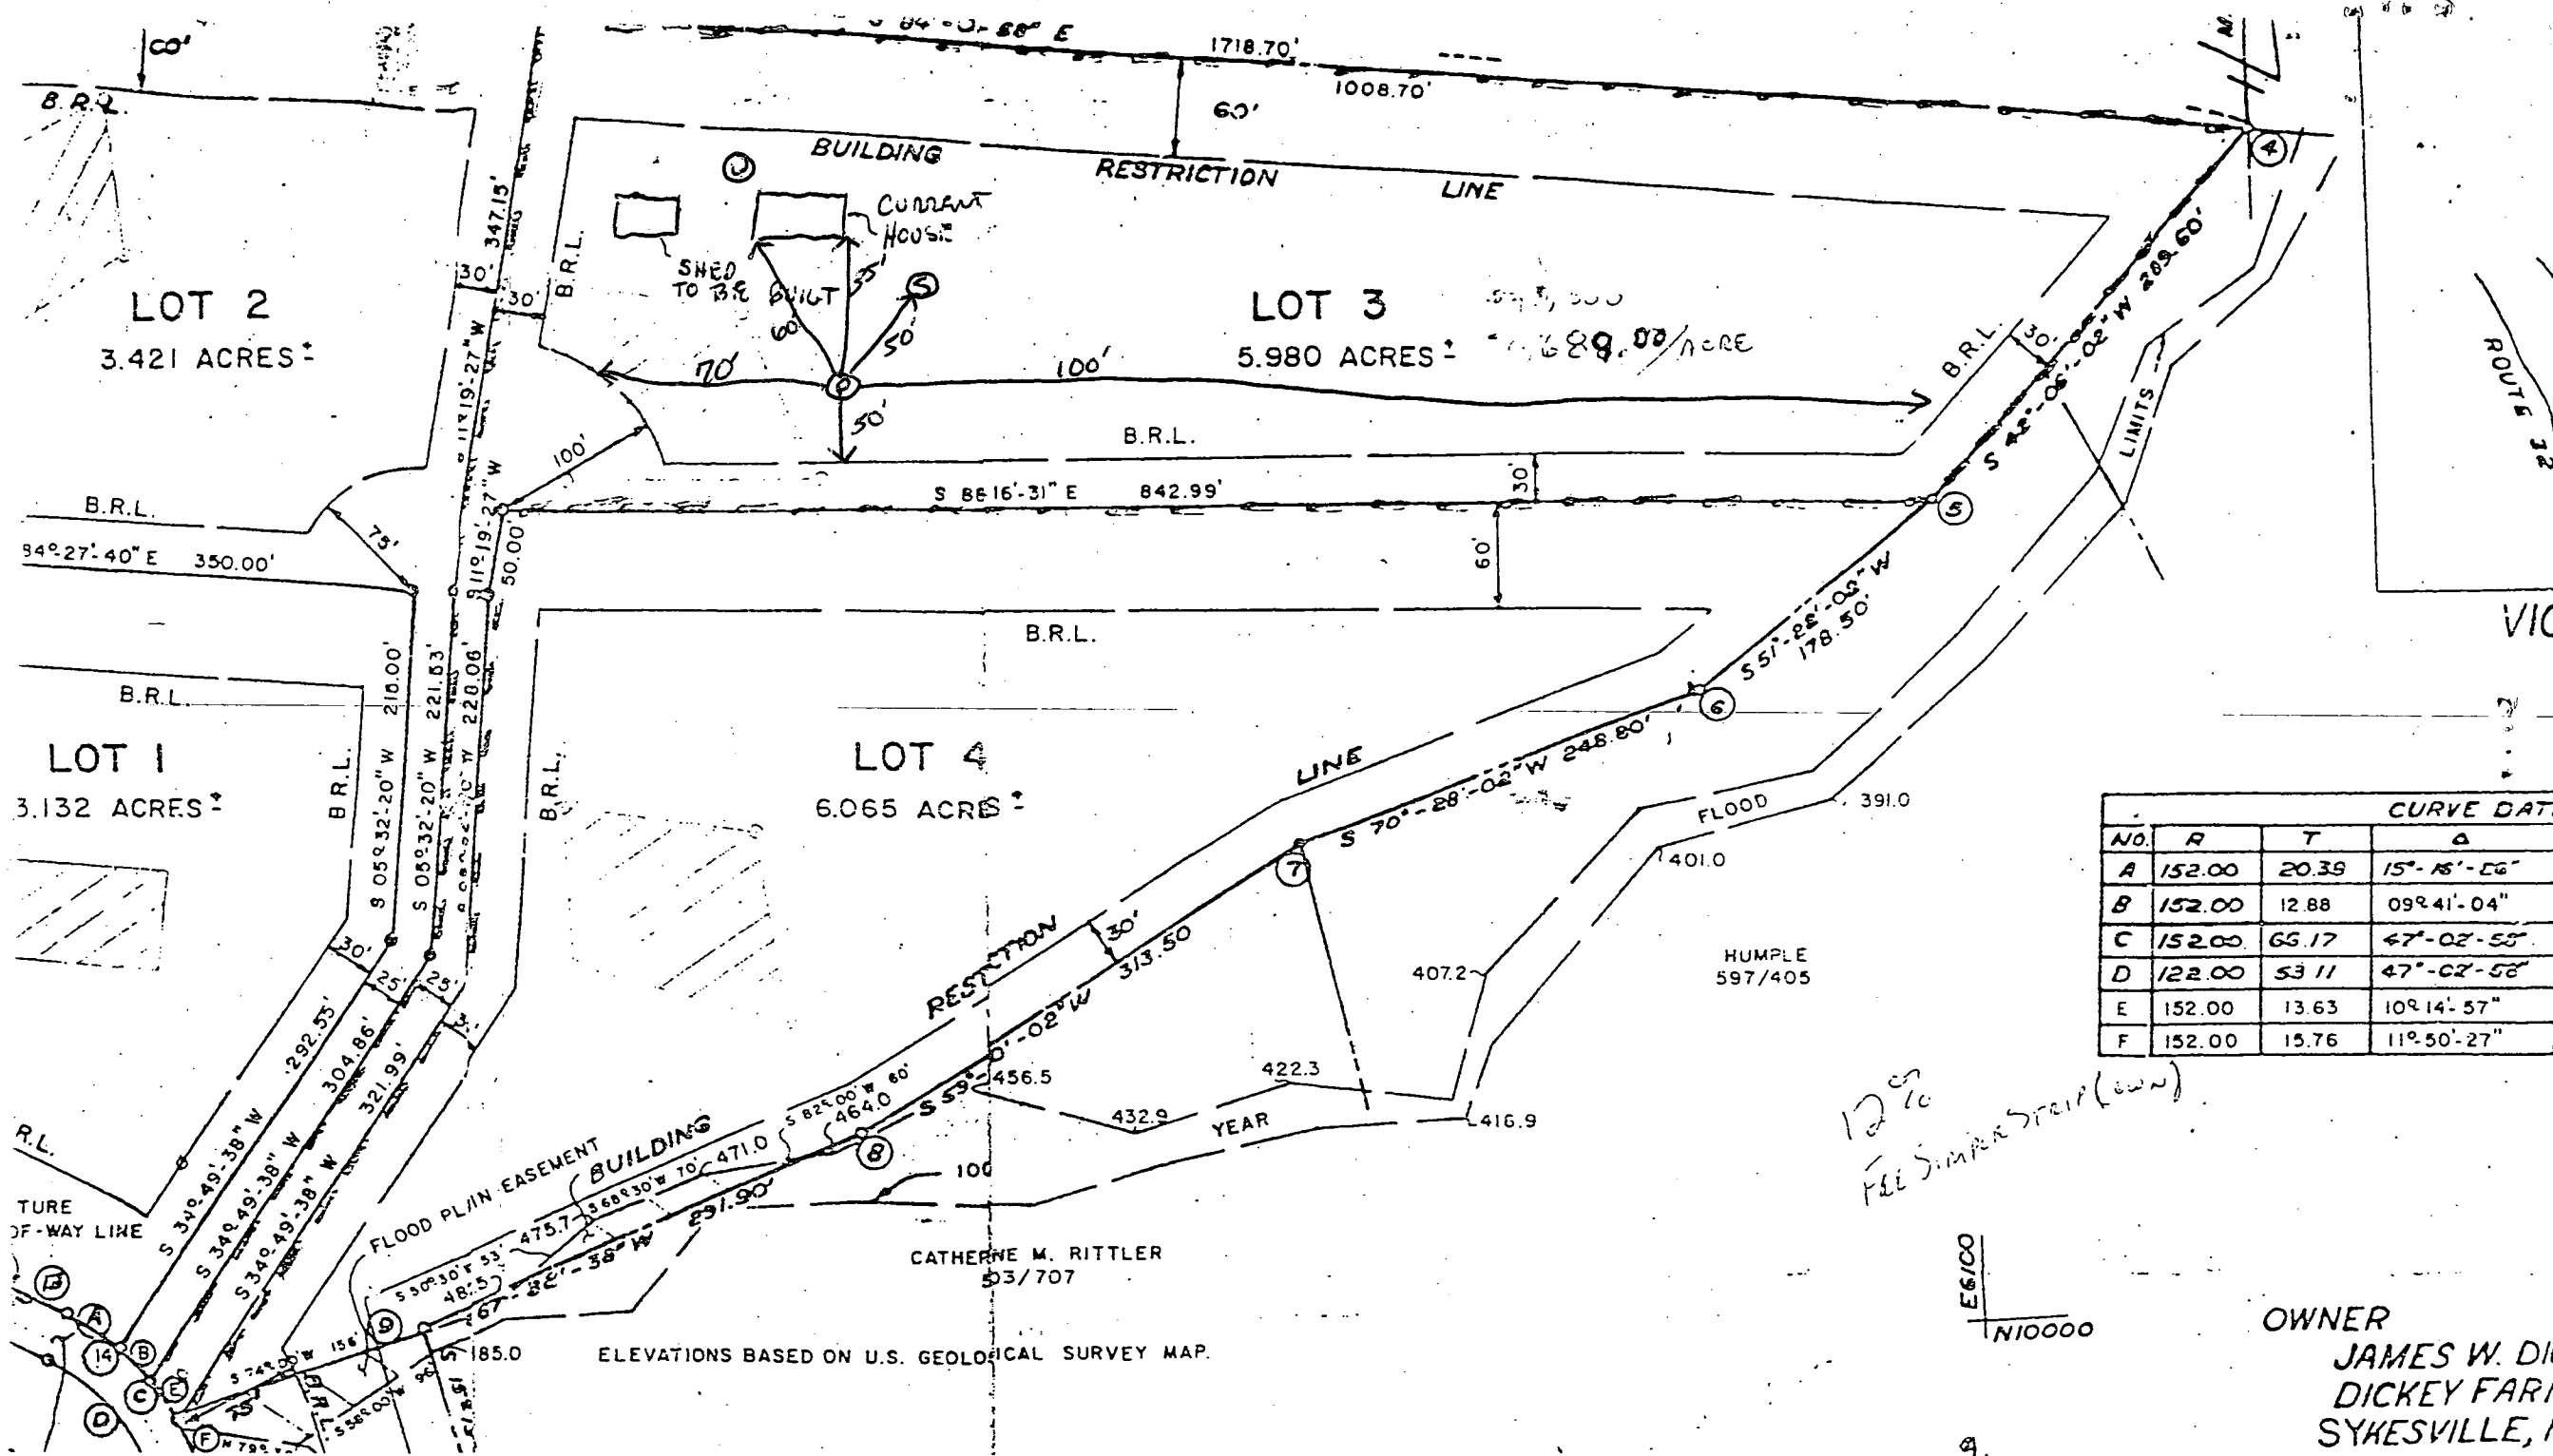

CURVE DATA			
NO.	R	T	Δ
A	152.00	20.39	15°-16'-26"
B	152.00	12.88	09°-41'-04"
C	152.00	65.17	47°-02'-55"
D	122.00	53.11	47°-02'-58"
E	152.00	13.63	10°-14'-57"
F	152.00	15.76	11°-50'-27"