

04-347153

WPI

PERMIT

P 43963

A 37903

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH • DISTRICT 4th

HOWARD COUNTY

BUREAU OF ENVIRONMENTAL HEALTH
461-9933

INDEXED

DATE 4/12/89DATE SYSTEM APPROVED 4/17/89INSPECTOR M. R. F. KinR. C. McPhail / THOMPSON & SONIS PERMITTED TO INSTALL X ALTER ADDRESS PHONE SUBDIVISION Gaither Sideling ROAD 625 Sideling Court LOT 6PROPERTY OWNER R. C. McPhailADDRESS

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES X NO SEPTIC TANK CAPACITY 2000 GALLONS NUMBER OF BEDROOMS 4TRENCHES - 244 sq. ft. per bedroom with garbage disposal. Trench to be 2 feet wide.Inlet 3 feet below original grade. Bottom maximum depth 7 feet below original grade. Effective area begins at 3 feet below original grade.4 feet of stone below distribution pipe.LOCATION - Start the first trench 100 feet from the rear (489') lot line and 250 feet from the left lot line as seen when facing the property from Sideling Court. Run trenches along contour towards rear of lot.NOTE - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank. ok/cwPLANS APPROVED BY C. WilliamsDATE 10/31/88

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX, TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCHES ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCHES

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS

PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

BLDG. PERMIT SIGNED


AND RETURNED 4/4/91Serial # 37138

BLDG. PERMIT SIGNED

AND RETURNED 7/24/89Serial # 25475 - pool

*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT

*CALL 461-9933 FOR INSPECTION OF SEPTIC SYSTEMS.

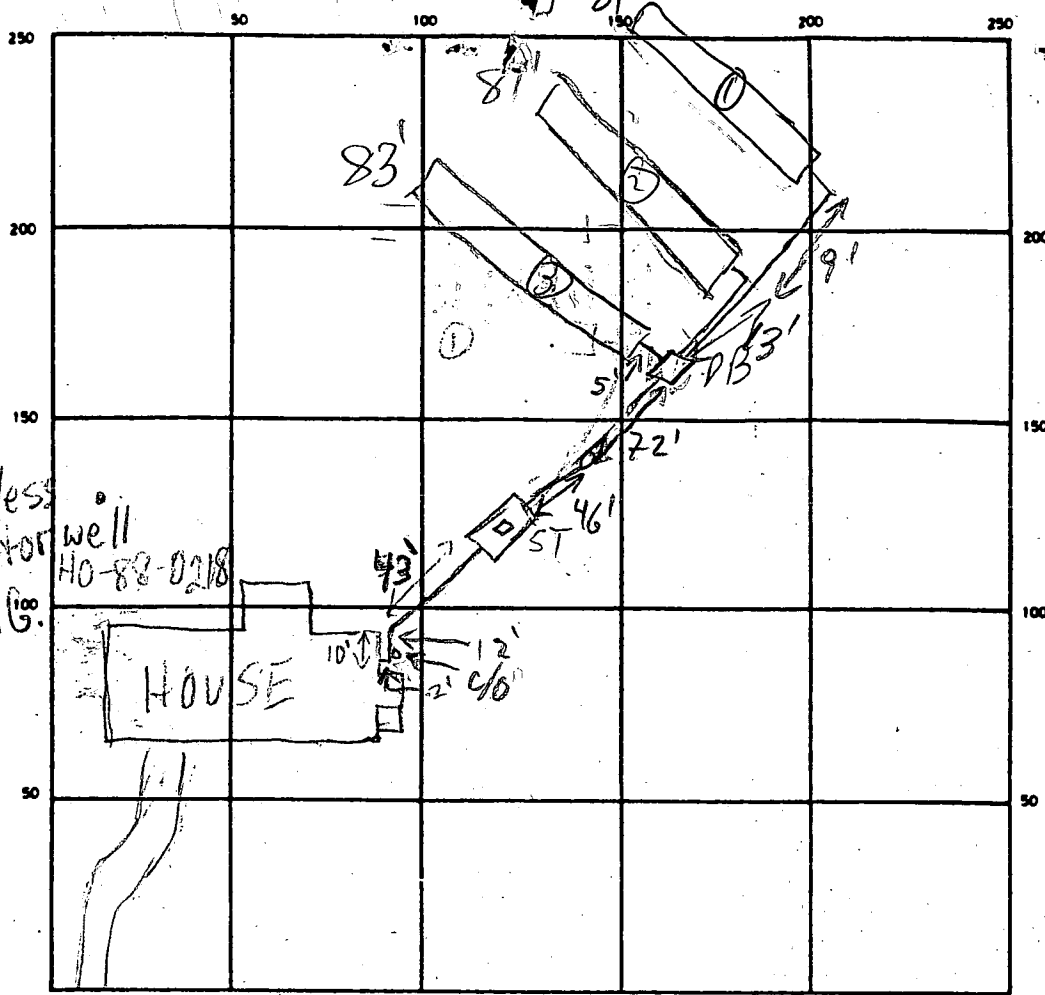

SIDELING CT

SEPTIC TANK. LEVEL OK CLEANOUTS MANHOLE-OK INLINE-OK
 DISTRIBUTION BOX. LEVEL OK BAFFLE IN
 DRAIN FIELD/TILE FIELD. DEPTH 7-8 FT. TRENCH WIDTH 2 FT. INLET DEPTH 3 1/2 FT.
 EFFECTIVE GRAVEL DEPTH 4 1/2 FT. TOTAL LENGTH 281 FT.
 NUMBER OF TRENCHES 3 ONE SIDEWALL/BOTTOM AREA 1102 SQ. FT.
 DRYWELL INSIDE DIAMETER — FT. EFFECTIVE DEPTH BELOW INLET — FT.
 ABSORBENT AREA — SQ. FT.

REMARKS 4/12/89 TANK SET TRENCH 1 BEING DUG NO LINES IN MR
4/13/89 TRENCH 1 COMPLETE TRENCH 2 IN PROCESS MR 4/14/89 ALL
TRENCHES COMPLETE LINE FROM DB TO TANK IN
PROCESS; LINE FROM HOUSE TO TANK TO BE DONE
BY PLUMBER (PER SEPTIC INSTALLER) BY 4/17/89 MR
4/17/89 HOUSE CANN + LINE TO ST OK-OK TO COVER ALL

DATE SYSTEM APPROVED 4/17/89 INSPECTOR M. Rifkin

APPLICATION

PERCOLATION TESTING

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
P.O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 461-9933

A 37903

P _____

DISTRICT 4

DATE 7/1/88

11/13/86
perc OK'd
pending approved
plot

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Arthur Dorian ALACRAIR McPhail - 774-2152

ADDRESS 1846 16th St NW Wash DC 20001 PHONE 202-332-5364

PROSPECTIVE BUYER Gaither Road Joint Venture

ADDRESS 9 Carissa Ct. Owings Mills, MD 21117 PHONE 301-356-4351

PROPERTY LOCATION: Gaither Sidelings final lot # sec 4 ✓

SUBDIVISION Gaither Sidelings LOT NO. 10 6

ROAD AND DESCRIPTION Gaither Road & Patapsco River 625 Sidelings Ct

TAX MAP 4 PARCEL # 31

SIZE OF LOT 3-5 ac TYPE BLDG. SFD

(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.

Ray M. Summel
(SIGNATURE OF APPLICANT)

APPROVED BY B. N. Wynn FOR deep/shallow DATE 7/1/84

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING for field located certified holes

BLDG. PERMIT SIGNED
AND RETURNED 11/25/88

BP 22702

THIS IS NOT A PERMIT

07

[Faint handwritten notes or bleed-through from the reverse side of the page.]

1004	1005	1006	1007	1008
1009	1010	1011	1012	1013
1014	1015	1016	1017	1018
1019	1020	1021	1022	1023
1024	1025	1026	1027	1028
1029	1030	1031	1032	1033
1034	1035	1036	1037	1038
1039	1040	1041	1042	1043
1044	1045	1046	1047	1048
1049	1050	1051	1052	1053
1054	1055	1056	1057	1058
1059	1060	1061	1062	1063
1064	1065	1066	1067	1068
1069	1070	1071	1072	1073
1074	1075	1076	1077	1078
1079	1080	1081	1082	1083
1084	1085	1086	1087	1088
1089	1090	1091	1092	1093
1094	1095	1096	1097	1098
1099	1100	1101	1102	1103
1104	1105	1106	1107	1108
1109	1110	1111	1112	1113
1114	1115	1116	1117	1118
1119	1120	1121	1122	1123
1124	1125	1126	1127	1128
1129	1130	1131	1132	1133
1134	1135	1136	1137	1138
1139	1140	1141	1142	1143
1144	1145	1146	1147	1148
1149	1150	1151	1152	1153
1154	1155	1156	1157	1158
1159	1160	1161	1162	1163
1164	1165	1166	1167	1168
1169	1170	1171	1172	1173
1174	1175	1176	1177	1178
1179	1180	1181	1182	1183
1184	1185	1186	1187	1188
1189	1190	1191	1192	1193
1194	1195	1196	1197	1198
1199	1200	1201	1202	1203
1204	1205	1206	1207	1208
1209	1210	1211	1212	1213
1214	1215	1216	1217	1218
1219	1220	1221	1222	1223
1224	1225	1226	1227	1228
1229	1230	1231	1232	1233
1234	1235	1236	1237	1238
1239	1240	1241	1242	1243
1244	1245	1246	1247	1248
1249	1250	1251	1252	1253
1254	1255	1256	1257	1258
1259	1260	1261	1262	1263
1264	1265	1266	1267	1268
1269	1270	1271	1272	1273
1274	1275	1276	1277	1278
1279	1280	1281	1282	1283
1284	1285	1286	1287	1288
1289	1290	1291	1292	1293
1294	1295	1296	1297	1298
1299	1300	1301	1302	1303
1304	1305	1306	1307	1308
1309	1310	1311	1312	1313
1314	1315	1316	1317	1318
1319	1320	1321	1322	1323
1324	1325	1326	1327	1328
1329	1330	1331	1332	1333
1334	1335	1336	1337	1338
1339	1340	1341	1342	1343
1344	1345	1346	1347	1348
1349	1350	1351	1352	1353
1354	1355	1356	1357	1358
1359	1360	1361	1362	1363
1364	1365	1366	1367	1368
1369	1370	1371	1372	1373
1374	1375	1376	1377	1378
1379	1380	1381	1382	1383
1384	1385	1386	1387	1388
1389	1390	1391	1392	1393
1394	1395	1396	13	

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

[illegible]

REMARKS _____

TYPE OF SOIL _____

TESTED BY _____ ALSO PRESENT _____

ALSO PRESENT

EH-12-1079

APPLICATION

PERCOLATION TESTING

A 37903

P _____

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
P.O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 461-9933

DISTRICT 4

DATE 7/2/81 10/7/81

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Arthur Dadian

ADDRESS 1846 16th St NW Wash DC 20009 PHONE 202-332-5364

PROSPECTIVE BUYER Garther Road Joint Venture

ADDRESS 9 Carissa Ct. Owings Mills, MD 21117 PHONE 301-356-9351

PROPERTY LOCATION:

SUBDIVISION Garther Sidelings LOT NO. 10

ROAD AND DESCRIPTION Garther Road + Patapsco River

TAX MAP 4 PARCEL # 31

SIZE OF LOT 3-5 ac TYPE BLDG. SFD
(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.

(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____

THIS IS NOT A PERMIT

A 37903

SOIL PROFILE

gummy brown
sandy chert
clay eco
3 3/4'
to gummy
powdery
yellow brown
gummy bed
w/ scattered
chunks
of chert
11 1/2 D

2

Brown gulf
orange sand
clay 2 1/2'
powdery
silty mica
iron
w/ 5-107.
small scattered
frag mica
shells

115D

③

gummy
gummy salty
meat loaf
w/ layers
10-20% meat
glue for - d
from 3.

REMARKS


TYPE OF SOIL

TESTED BY

B Nizam

ALSO PRESENT

Sony Jerry

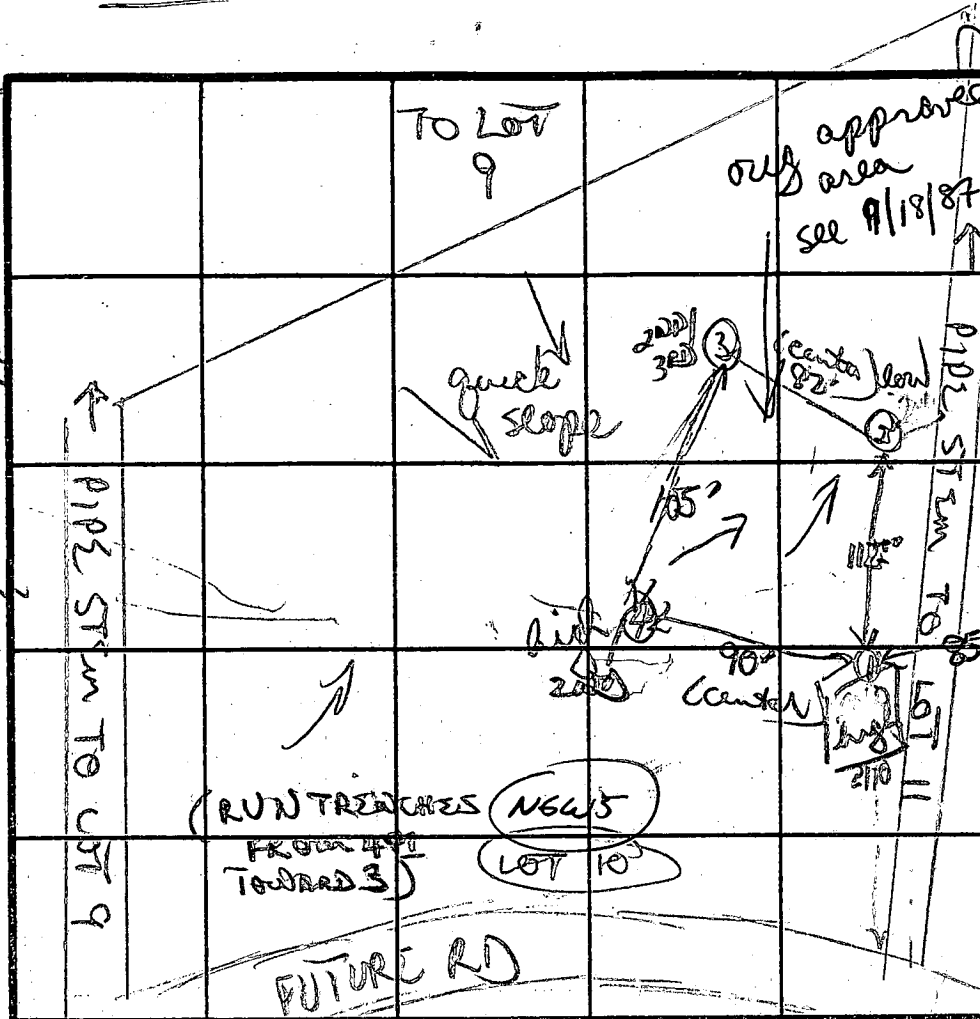

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
11/13/86	①	3 1/2	207	218	218	243	25m
		8' m	205	208	208	211	3m 1/2
		11 1/2 D	bottom	(see profile)			
	②	3 3/5	220	221	221	222	1m 1/2
		7' m	218	220	220	230	10 m
		11 1/2 D	bottom	(see profile)			
	③	3 3/5	229	230	230	232	2m 1/2
		10' D	bottom	(hard?)			see prof
	④	3 3/5	241	245	245	230	5m 1/2
		10 1/2 D	bottom	(see profile)			

pure field adj closer to east lines
orange clay sandy loam 4+'; light white silty
mud-stone

APPLICATION

37903

PERCOLATION TESTING

A _____
P _____

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
P.O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 461-9933

DISTRICT _____

DATE _____

CONTINUATION OF TESTING
FROM NOV, 1986
ORIGINAL TEST AREA ABANDONED
DUE TO LOT DESIGN.

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER _____

ADDRESS _____ PHONE _____

PROSPECTIVE BUYER _____

ADDRESS _____ PHONE _____

PROPERTY LOCATION:

SUBDIVISION GAITHERS SIDELING SECTION IV LOT NO. 6

ROAD AND DESCRIPTION SIDELING COURT

TAX MAP _____ PARCEL # _____

SIZE OF LOT _____ TYPE BLDG _____
(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.

(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____



HD-216

THIS IS NOT A PERMIT

GAITHAN SIDELING

#5, #6

SOIL PROFILE

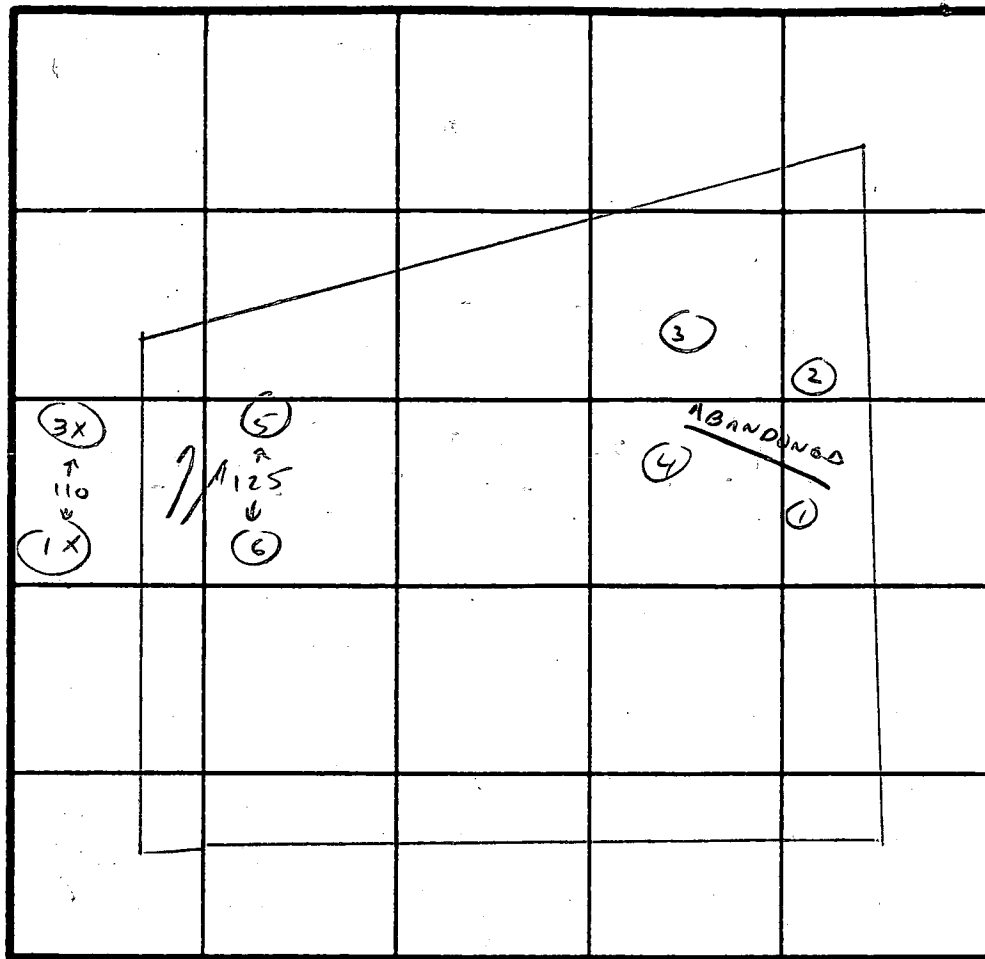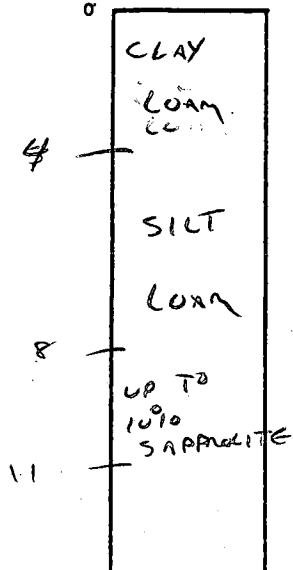

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

1X, 3X (A37904)


DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
11/13/86	1, 2, 3, 4		TESTED PREVIOUSLY - ABANDONED IN FAVOR OF TEST AREA ON OTHER PART OF LOT.				
11/1		(SATISFACTORY) SOILS FOR SHALLOW SYSTEM, BUT IMPACTED BY SURROUNDING DRAINAGE (EASEMENTS)					
11/13/86	1X, 3X	4' 8', 11½'					2-15 MIN 2 MIN
		ON LINE	HOLES FROM <u>A37904</u>				
9/18/87	5, -	4 8, 11	1:51 VIS	1:55 OK -	1:55 LOAM	2:00	5 MIN
	6	4 8, 11	VIS OK - VIS OK LOAM		LOAM		

REMARKS COMBINE WITH HOLES 183 FROM A37904

TYPE OF SOIL MICA LOAM, POWDERY

TESTED BY C. Williams 9/18/87

ALSO PRESENT MANGUTZ, C15562

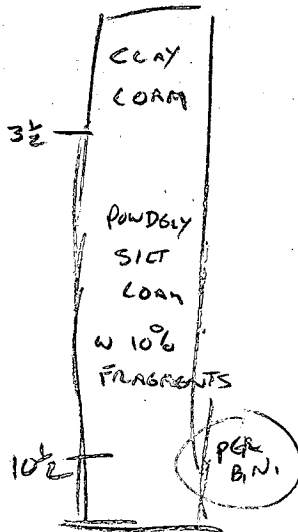

C10515SEQUENCE NO. (DENV USE ONLY)

STATE OF MARYLAND
WELL COMPLETION REPORT
FILL IN THIS FORM COMPLETELY
PLEASE PRINT OR TYPE

THIS REPORT MUST BE SUBMITTED WITHIN
45 DAYS AFTER WELL IS COMPLETED.
COUNTY NUMBERA# 37903

DATE Received

DATE WELL COMPLETED102788

Depth of Well2216026
(TO NEAREST FOOT)

PERMIT NO.
FROM "PERMIT TO DRILL WELL"
H0-88-0218

OWNERMC PRILL R.C.

STREET OR RFDlast name: SIBELION COURTfirst name:SYKESVILLE

SUBDIVISIONGAITHER SIBELIONSECTION4LOT6

WELL LOG

Not required for driven wells

STATE THE KIND OF FORMATIONS
PENETRATED, THEIR COLOR, DEPTH,
THICKNESS AND IF WATER BEARING

DESCRIPTION (Use additional sheets if needed)

FEET

Check if water bearing

Top Soil	0	2	
Gr shale	2	12	
Tan slate	12	31	
Bl slate	33	44	
Bl slate	44	45	
Bl slate	45	46	
Bl slate	46	61	
Bl slate	61	70	
Bl slate	70	71	
Bl slate	72	166	

GROUTING RECORD

WELL HAS BEEN GROUTED
(Circle Appropriate Box)

TYPE OF GROUTING MATERIAL

CEMENTCMBENTONITE CLAYBC

NO. OF BAGS8NO. OF POUNDS300

GALLONS OF WATER40

DEPTH OF GROUT SEAL (to nearest foot)

from0ft. to20ft.

CASING RECORD

casing types insert appropriate code below

STEELCONCRETE
PLASTICOTHER

MAIN CASING TYPE

Nominal diameter top (main) casing (nearest inch)

Total depth of main casing (nearest foot)

626

OTHER CASING (if used)

diameter inch

depth (feet) from to

SCREEN RECORD

screen type or open hole insert appropriate code below

STEELBRASSBRONZEPLASTIC
OPEN HOLEOTHER

DEPTH (nearest ft.)

11024160

EACH SCREEN

SLOT SIZE 123

DIAMETER OF SCREEN (NEAREST INCH)

5660

CIRCLE APPROPRIATE LETTER

A A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED

E ELECTRIC LOG OBTAINED

P TEST WELL CONVERTED TO PRODUCTION WELL

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 10.17.13 "WELL CONSTRUCTION" AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE ABOVE CAPTIONED PERMIT, AND THAT THE INFORMATION PRESENTED HEREIN IS ACCURATE AND COMPLETE TO THE BEST OF MY KNOWLEDGE.

DRILLERS IDENT. NO. 40

DRILLERS SIGNATURE

SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)

GRAVEL PACK

IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68

OEP USE ONLY (NOT TO BE FILLED IN BY DRILLER)

TELESCOPE CASING

LOG INDICATOR

OTHER DATA

PUMPING TEST

HOURS PUMPED (nearest hour)3

PUMPING RATE (gal. per min. to nearest gal.)10

METHOD USED TO MEASURE PUMPING RATEBucket

WATER LEVEL (distance from land surface)

BEFORE PUMPING36

WHEN PUMPING56

TYPE OF PUMP USED (for test)

AairPpistonTturbine
CcentrifugalRrotaryOother (describe below)
JjetSsubmersible

PUMP INSTALLED

DRILLER WILL INSTALL PUMP YESNO

IF DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS EXCEPT HOME USE

TYPE OF PUMP INSTALLED

PLACE (A,C,J,P,R,S,T,O) IN BOX-SEE ABOVE:

CAPACITY: GALLONS PER MINUTE (to nearest gallon)

PUMP HORSE POWER

PUMP COLUMN LENGTH (nearest ft.)

CASING HEIGHT (circle appropriate box and enter casing height)

LAND SURFACE (nearest foot)

LOCATION OF WELL ON LOT

SHOW PERMANENT STRUCTURE SUCH AS BUILDING, SEPTIC TANKS, AND/OR LANDMARKS AND INDICATE NOT LESS THAN TWO DISTANCES (MEASUREMENTS TO WELL)

COUNTY

_____ of _____

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Lot 6 Block - Plat - Sec. 4
Owner A.C. McHAIL

Static water level (S.W.L.) below M.P. 36'

G. P. M.

ft. below M.P.

Page 140

HD-224

Review _____

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Well Permit No. HO - 88-0218
Location of property (road) SIDELING COURT
Subdivision GAITHER SIDELING Lot 6 Block - Plat - Sec. 4
Well Driller G.F. EASTERDAY Owner A.C. Mc PHAIL

Depth of well 160 ' 12 gpm
Distance of measuring point (M.P.) above ground 2 '
Static water level (S.W.L.) below M.P. 36

I. High rate pumping -- reservoir drawdown

Time pump started 1:00 Pumping rate 10 G.P.M.
Total time to reach pumping water level ft. below M.P.

II. Recovery pump test data - observations to be recorded every 15 minutes

[illegible]

B 1 9752 (THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)	SEQUENCE NO. (DP USE ONLY)	STATE OF MARYLAND PERMIT TO DRILL WELL please print or type	STATE PERMIT NUMBER 10-11-0818 fill in this form completely
Date Received (APA) 10/28/88 - 12:30 PM 011188 OWNER INFORMATION MC PARRILL NEASTALL C 19370 MARYSON HSE ST OLNEY 1120132		B 3 LOCATION OF WELL R 42580 10000000000000000000 8 COUNTY 21 CHAFAER SIDE 41 NG 23 SUBDIVISION 42 SECTION 004 LOT 6 SVRESVILLE 52 NEAREST TOWN 71 MILES FROM TOWN (enter 0 if in town) 3 MI	
DRILLER INFORMATION George F. Easterday Driller's Name 40 L. Franklin Easterday, Inc. Firm Name 9265 Brown Church Rd., Mt. Airy, Md. 21771 Address <i>George F. Easterday</i> Signature Date 9/6/88		B 4 DIRECTION OF WELL FROM TOWN (CIRCLE BOX) TOWN NEAR WHAT ROAD SIDELING COURT ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX) WEST NORTH SOUTH EAST WEST DISTANCE FROM ROAD 3000 ENTER FT or MI FT	
B 2 WELL INFORMATION APPROX. PUMPING RATE (GAL. PER MIN.) 5 AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 500		NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL HOWARD COUNTY NAME STATE SIGNATURE Charles Bayan INSERT S DATE ISSUED 4/7/91 EXP. DATE NORTH GRID 554000 EAST GRID 001000	
USE FOR WATER (CIRCLE APPROPRIATE BOX) ☒ HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY) ☐ FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION) ☐ INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT) ☐ PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE HEALTH DEPARTMENT APPROVAL) ☐ TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)		SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X SOURCES OF DRILLING WATER 1. WELL 2. 3. WRITE THE BOX NUMBER FROM THE MAP HERE 804 1 558 4	
APPROXIMATE DEPTH OF WELL 200 FEET APPROXIMATE DIAMETER OF WELL 6 INCH METHOD OF DRILLING (circle one) ☒ BORED (or Augered) ☐ JETTED ☐ Jetted & DRIVEN ☒ AIR-ROTARY ☐ AIR-PERCussion ☐ ROTARY (Hydraulic Rotary) ☐ CABLE ☐ Reverse-ROTary ☐ Drive-POINT other _____		DRAW A SKETCH BELOW SHOWING LOCATION OF WELL IN RELATION TO NEARBY TOWNS AND ROADS AND GIVE DISTANCE FROM WELL TO NEAREST ROAD JUNCTION 	
REPLACEMENT OR DEEPEINED WELLS (CIRCLE APPROPRIATE BOX) ☒ THIS WELL WILL NOT REPLACE AN EXISTING WELL ☐ THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED ☐ THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY ☐ THIS WELL WILL DEEPEIN AN EXISTING WELL PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEINED (IF AVAILABLE) 41		Not to be filled in by driller (OEP USE ONLY) APPROP. PERMIT NUMBER 268 FORCE 00 WRITE INITIALS PERMIT NO. 10-11-0818	
SPECIAL CONDITIONS COUNTY			

10/28/88

- ① Well already grouted out
information from Joe
- ② 26 ft casing
- ③ 20 ft open hole
- ④ 8 bags

B. Hodge



ENVIRONMENTAL
HEALTH

SEP 8 3 52 PM '88

RECEIVED
HOWARD COUNTY
HEALTH DEPT


SEP 8 9 18 AM '88

RECEIVED
HOWARD COUNTY
HEALTH DEPT
ELICOTT CITY, MD

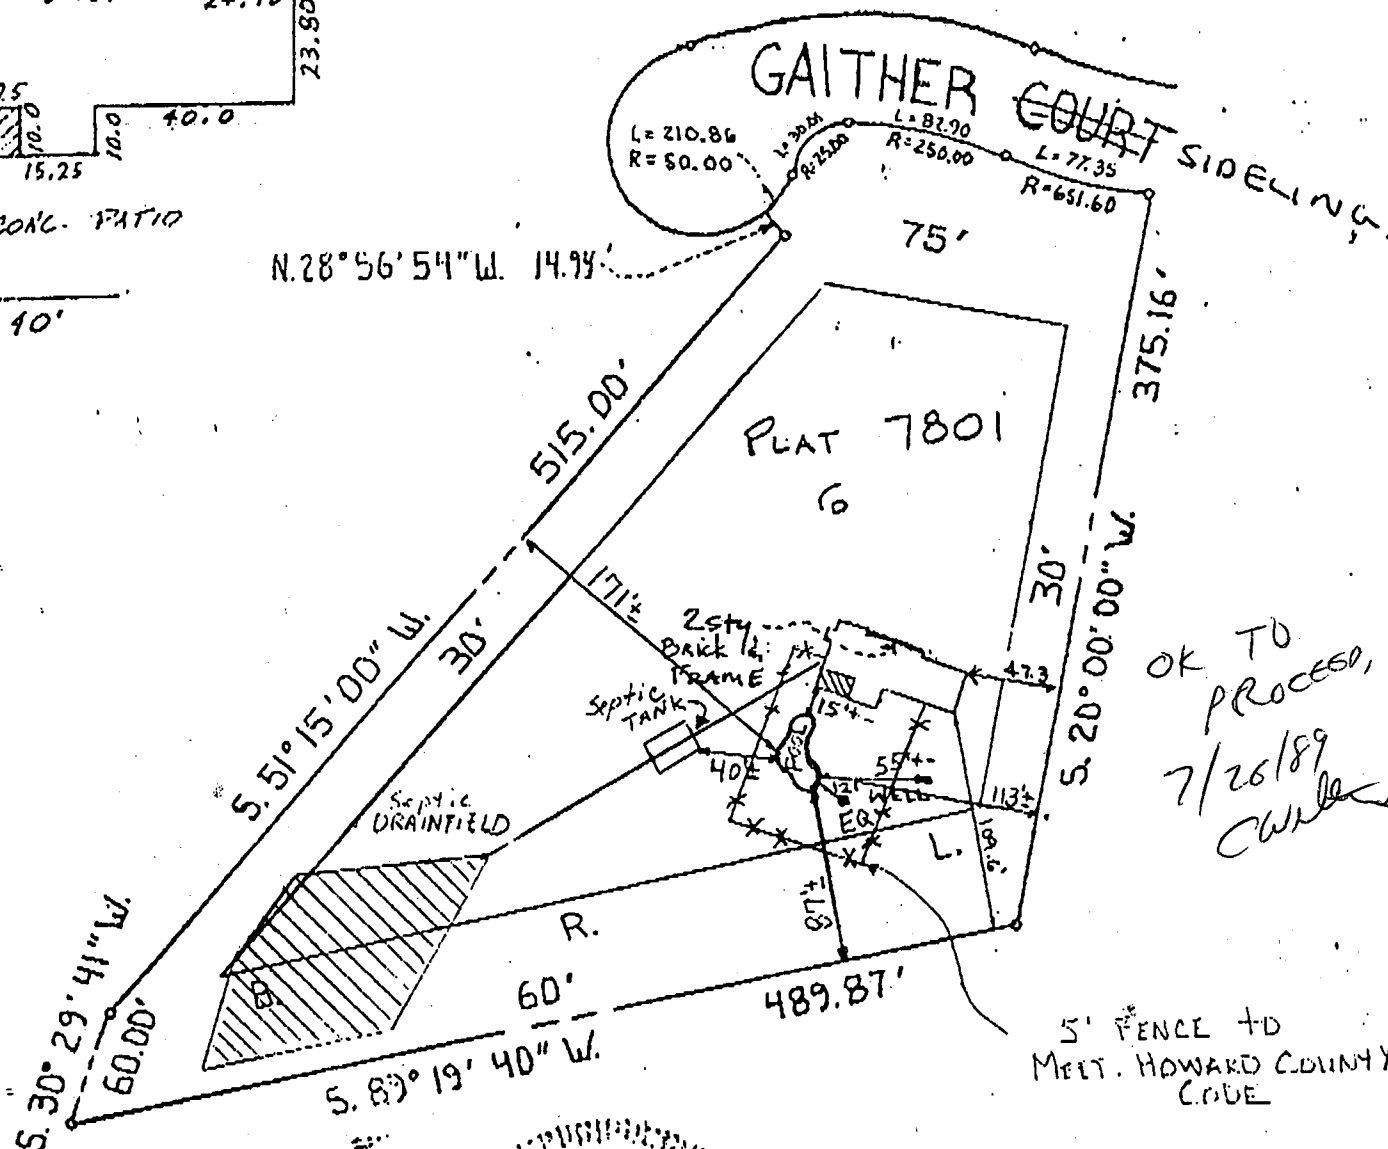

OK TO
PROCESS,
7/26/89
CWH


5' FENCE TO
MEET. HOWARD COUNTY
CODE

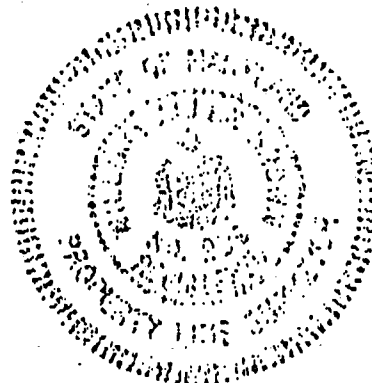


AN UP-TO-DATE TITLE REPORT
WAS NOT FURNISHED, THEREFORE
EASEMENTS AND RIGHTS OF WAY
OF RECORD ARE NOT SHOWN.

W. Allen Brown 7/3/89
W. ALLEN BROWN MD# 299

7305 MINK HOLLOW ROAD
HIGHLAND, MARYLAND 20777
REG. 301-854-0913

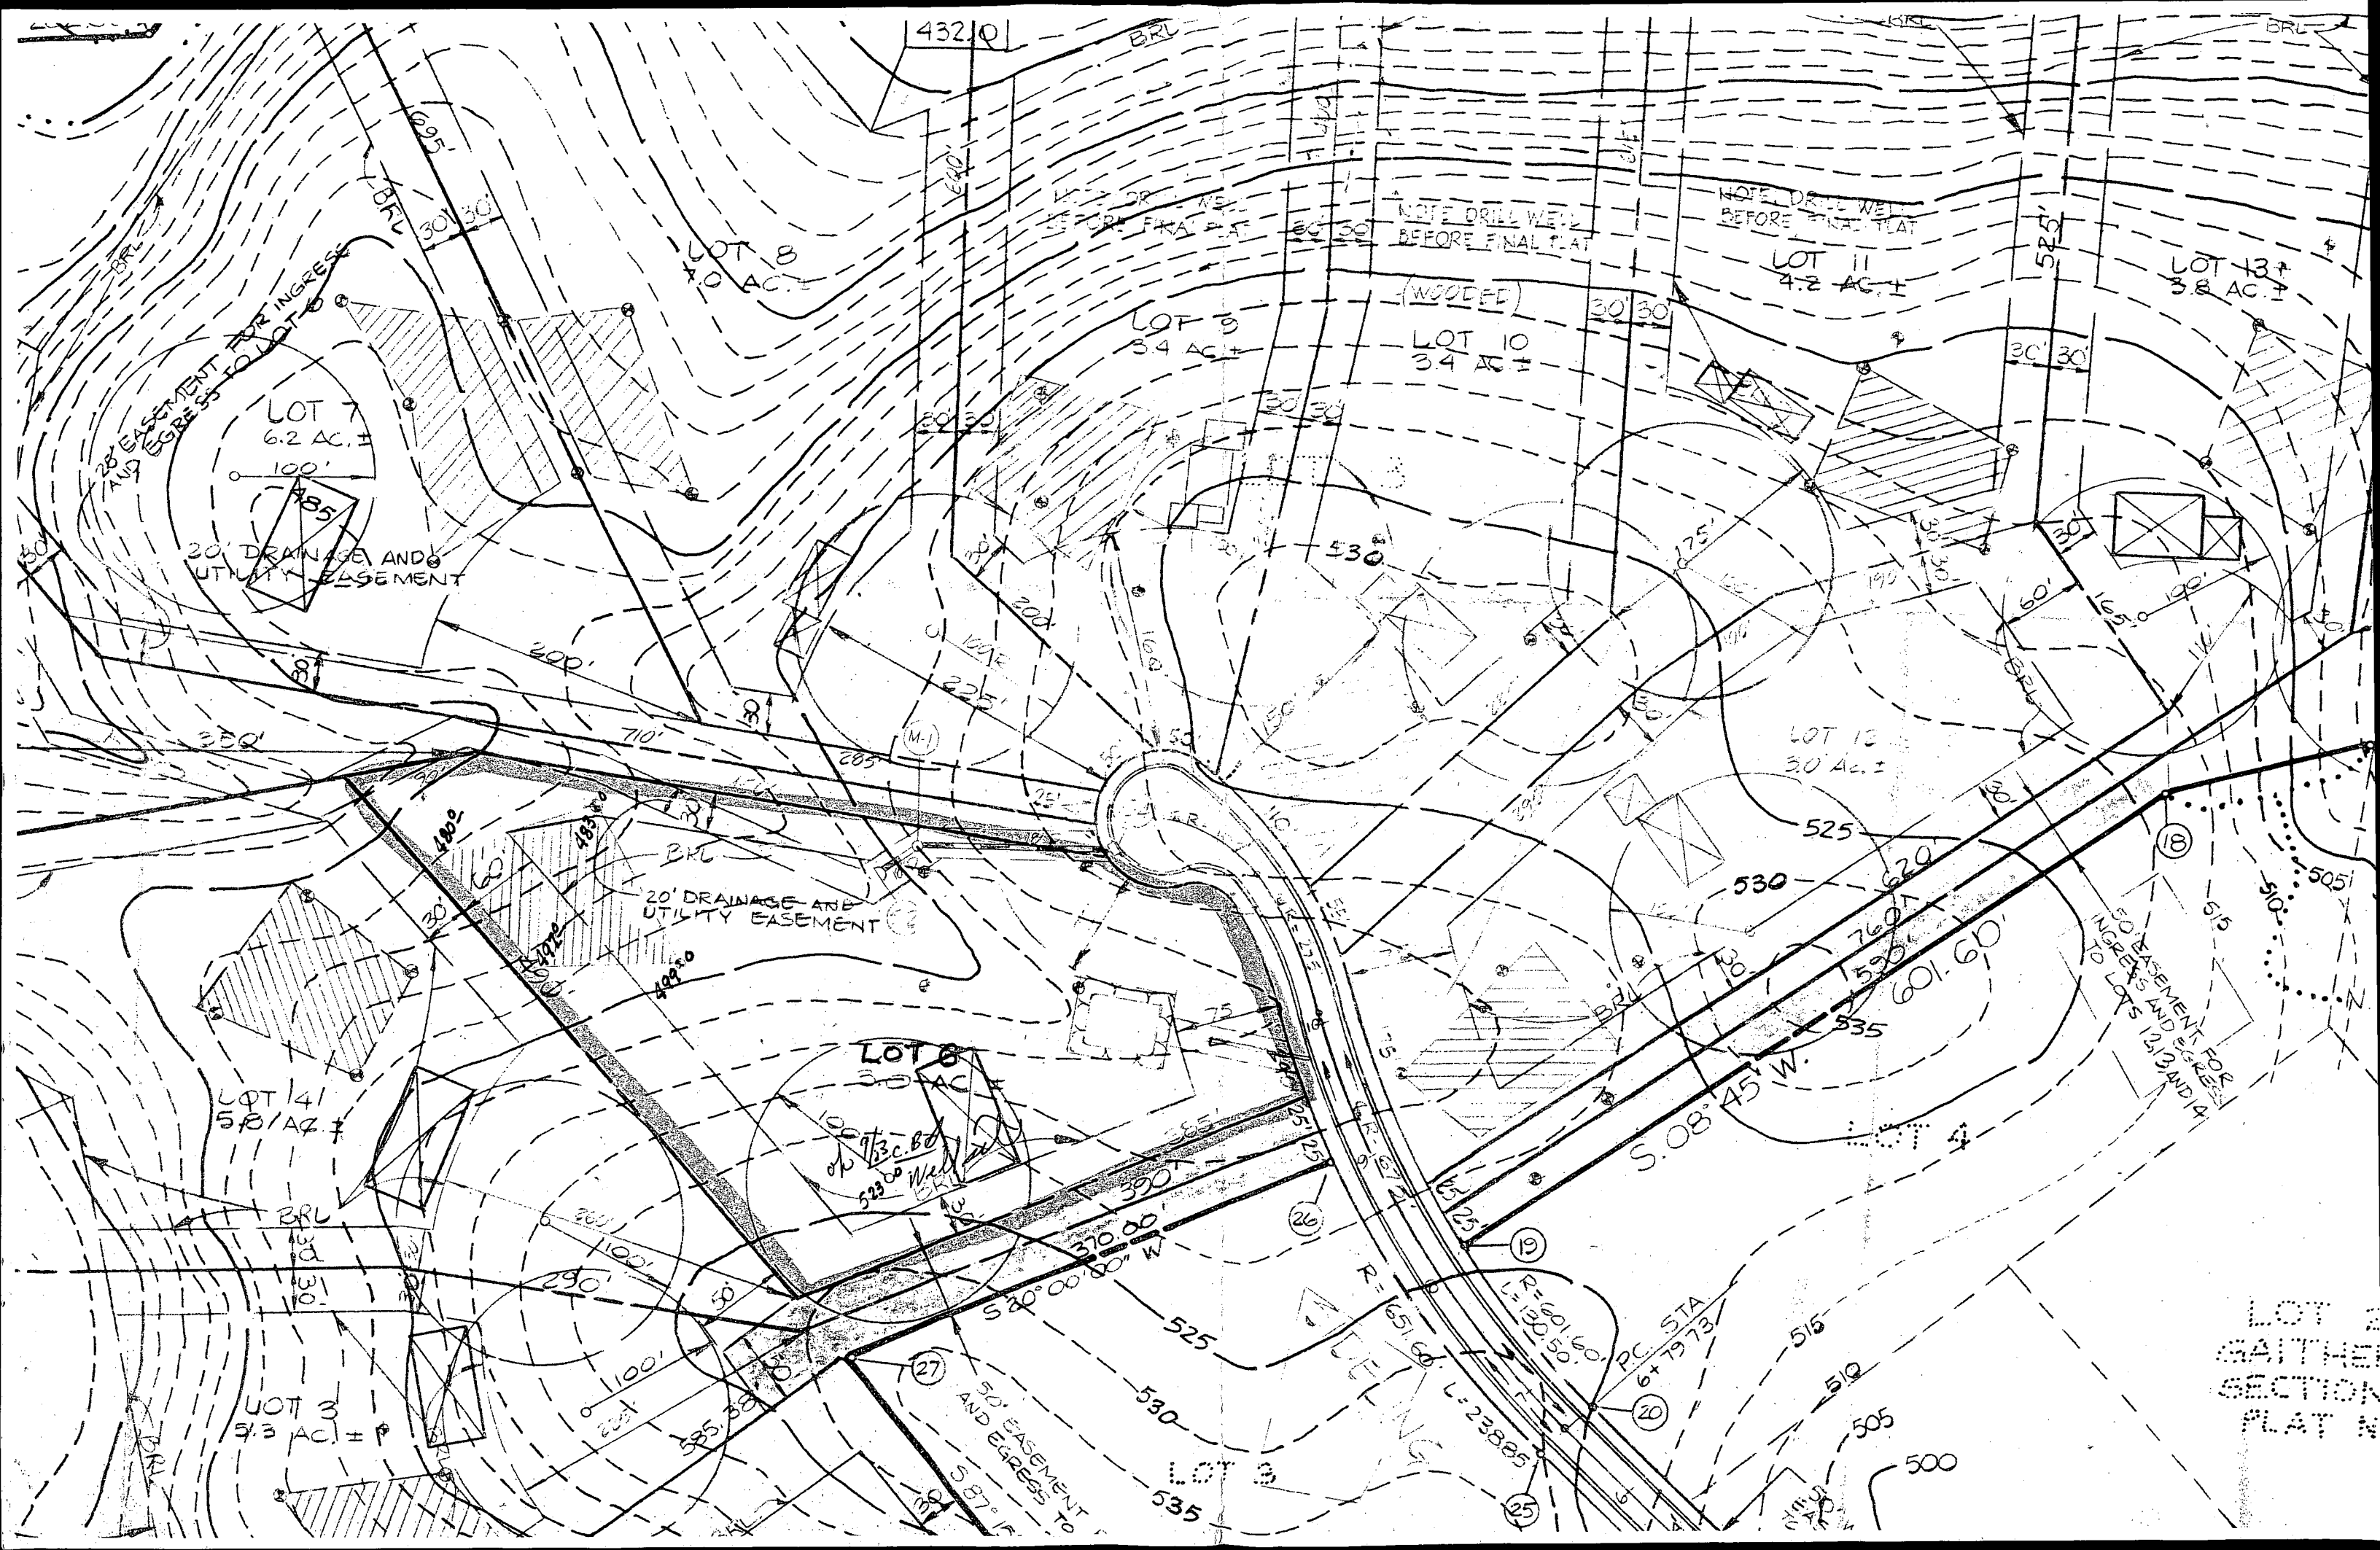

LOT 2
GATHER
SECTION
PLAT N

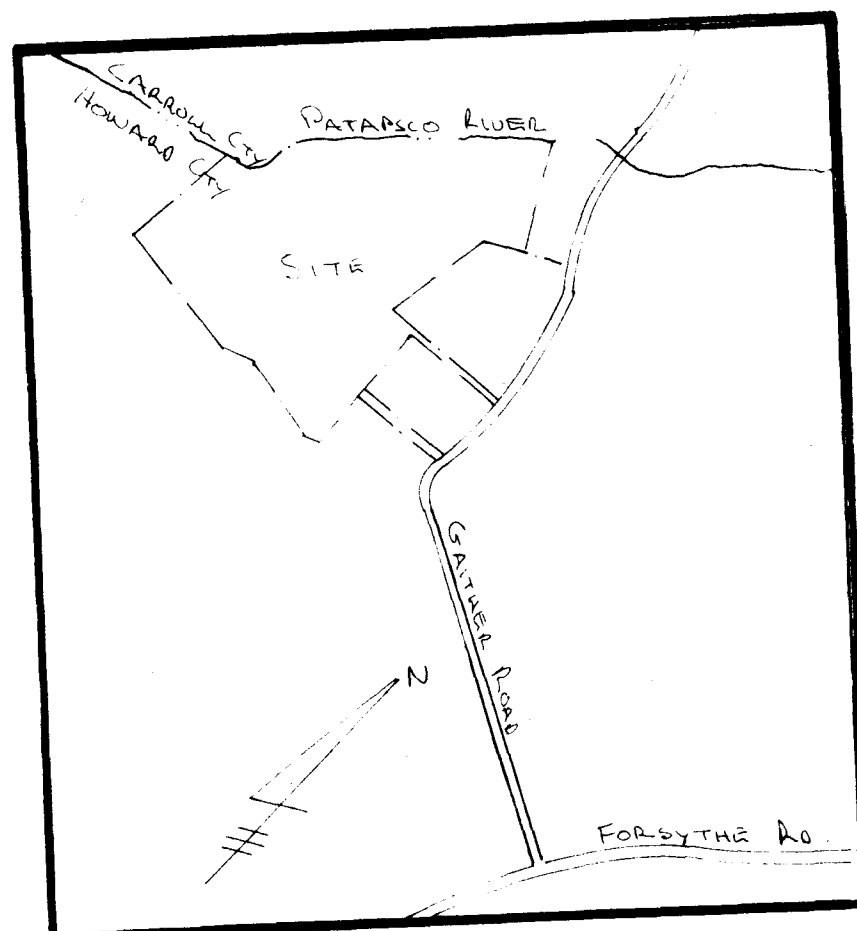



VICINITY MAP
1" = 1200'

SEPTIC TANK - 4 BEDROOM = 1250 GALL. 150%
FOR WASTE DISPOSAL = 1875 GALL. OR 2000 GALL TANK

TRENCHES 2' WIDE INLET 2' BELOW ORIGINAL GRADE
BOTTOM MAX. DEPTH 7' BELOW ORIGINAL GRADE
EFFECTIVE AREA BEGINS AT 3' BELOW GRADE
1' FEET OF STONE BELOW DISTRIBUTION PIPE

TART FULL TRENCH 90' FROM REAR (484') LOT LINE
AND 250' FROM LEFT LOT LINE (375')
RUN TRENCHES ALONG CONTOUR LINE TOWARDS
REAR OF LOT.

TRENCHES 244 SQ. FT. / BEDROOM = 976 SQ. FT.
TRENCH ACTIVE AREA 4 SQ. FT.
TOTAL TRENCH LENGTH = 243 L. FT. (30 @ 81')

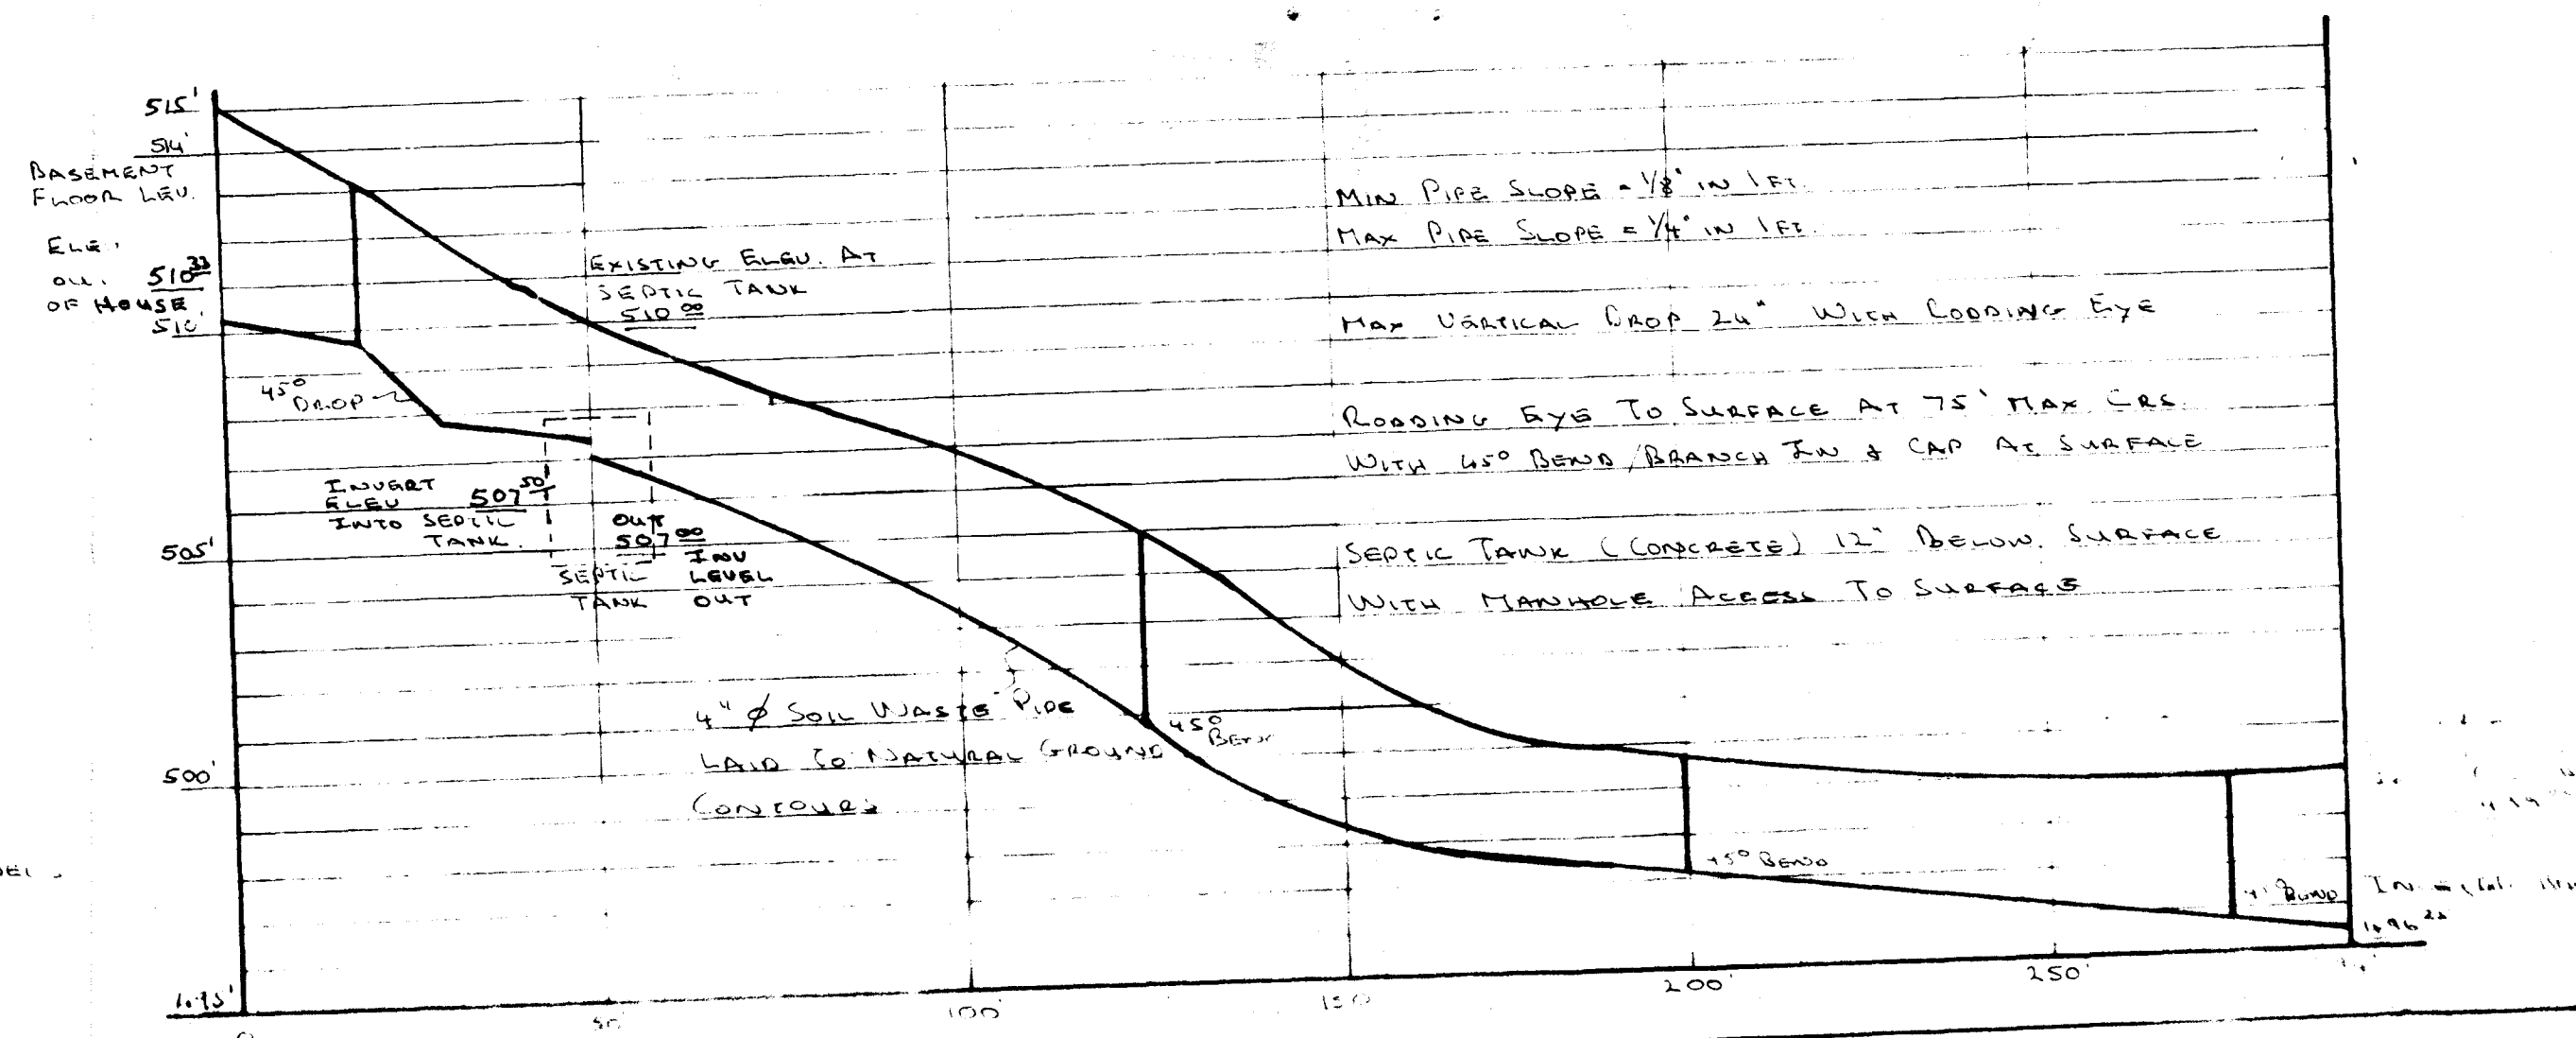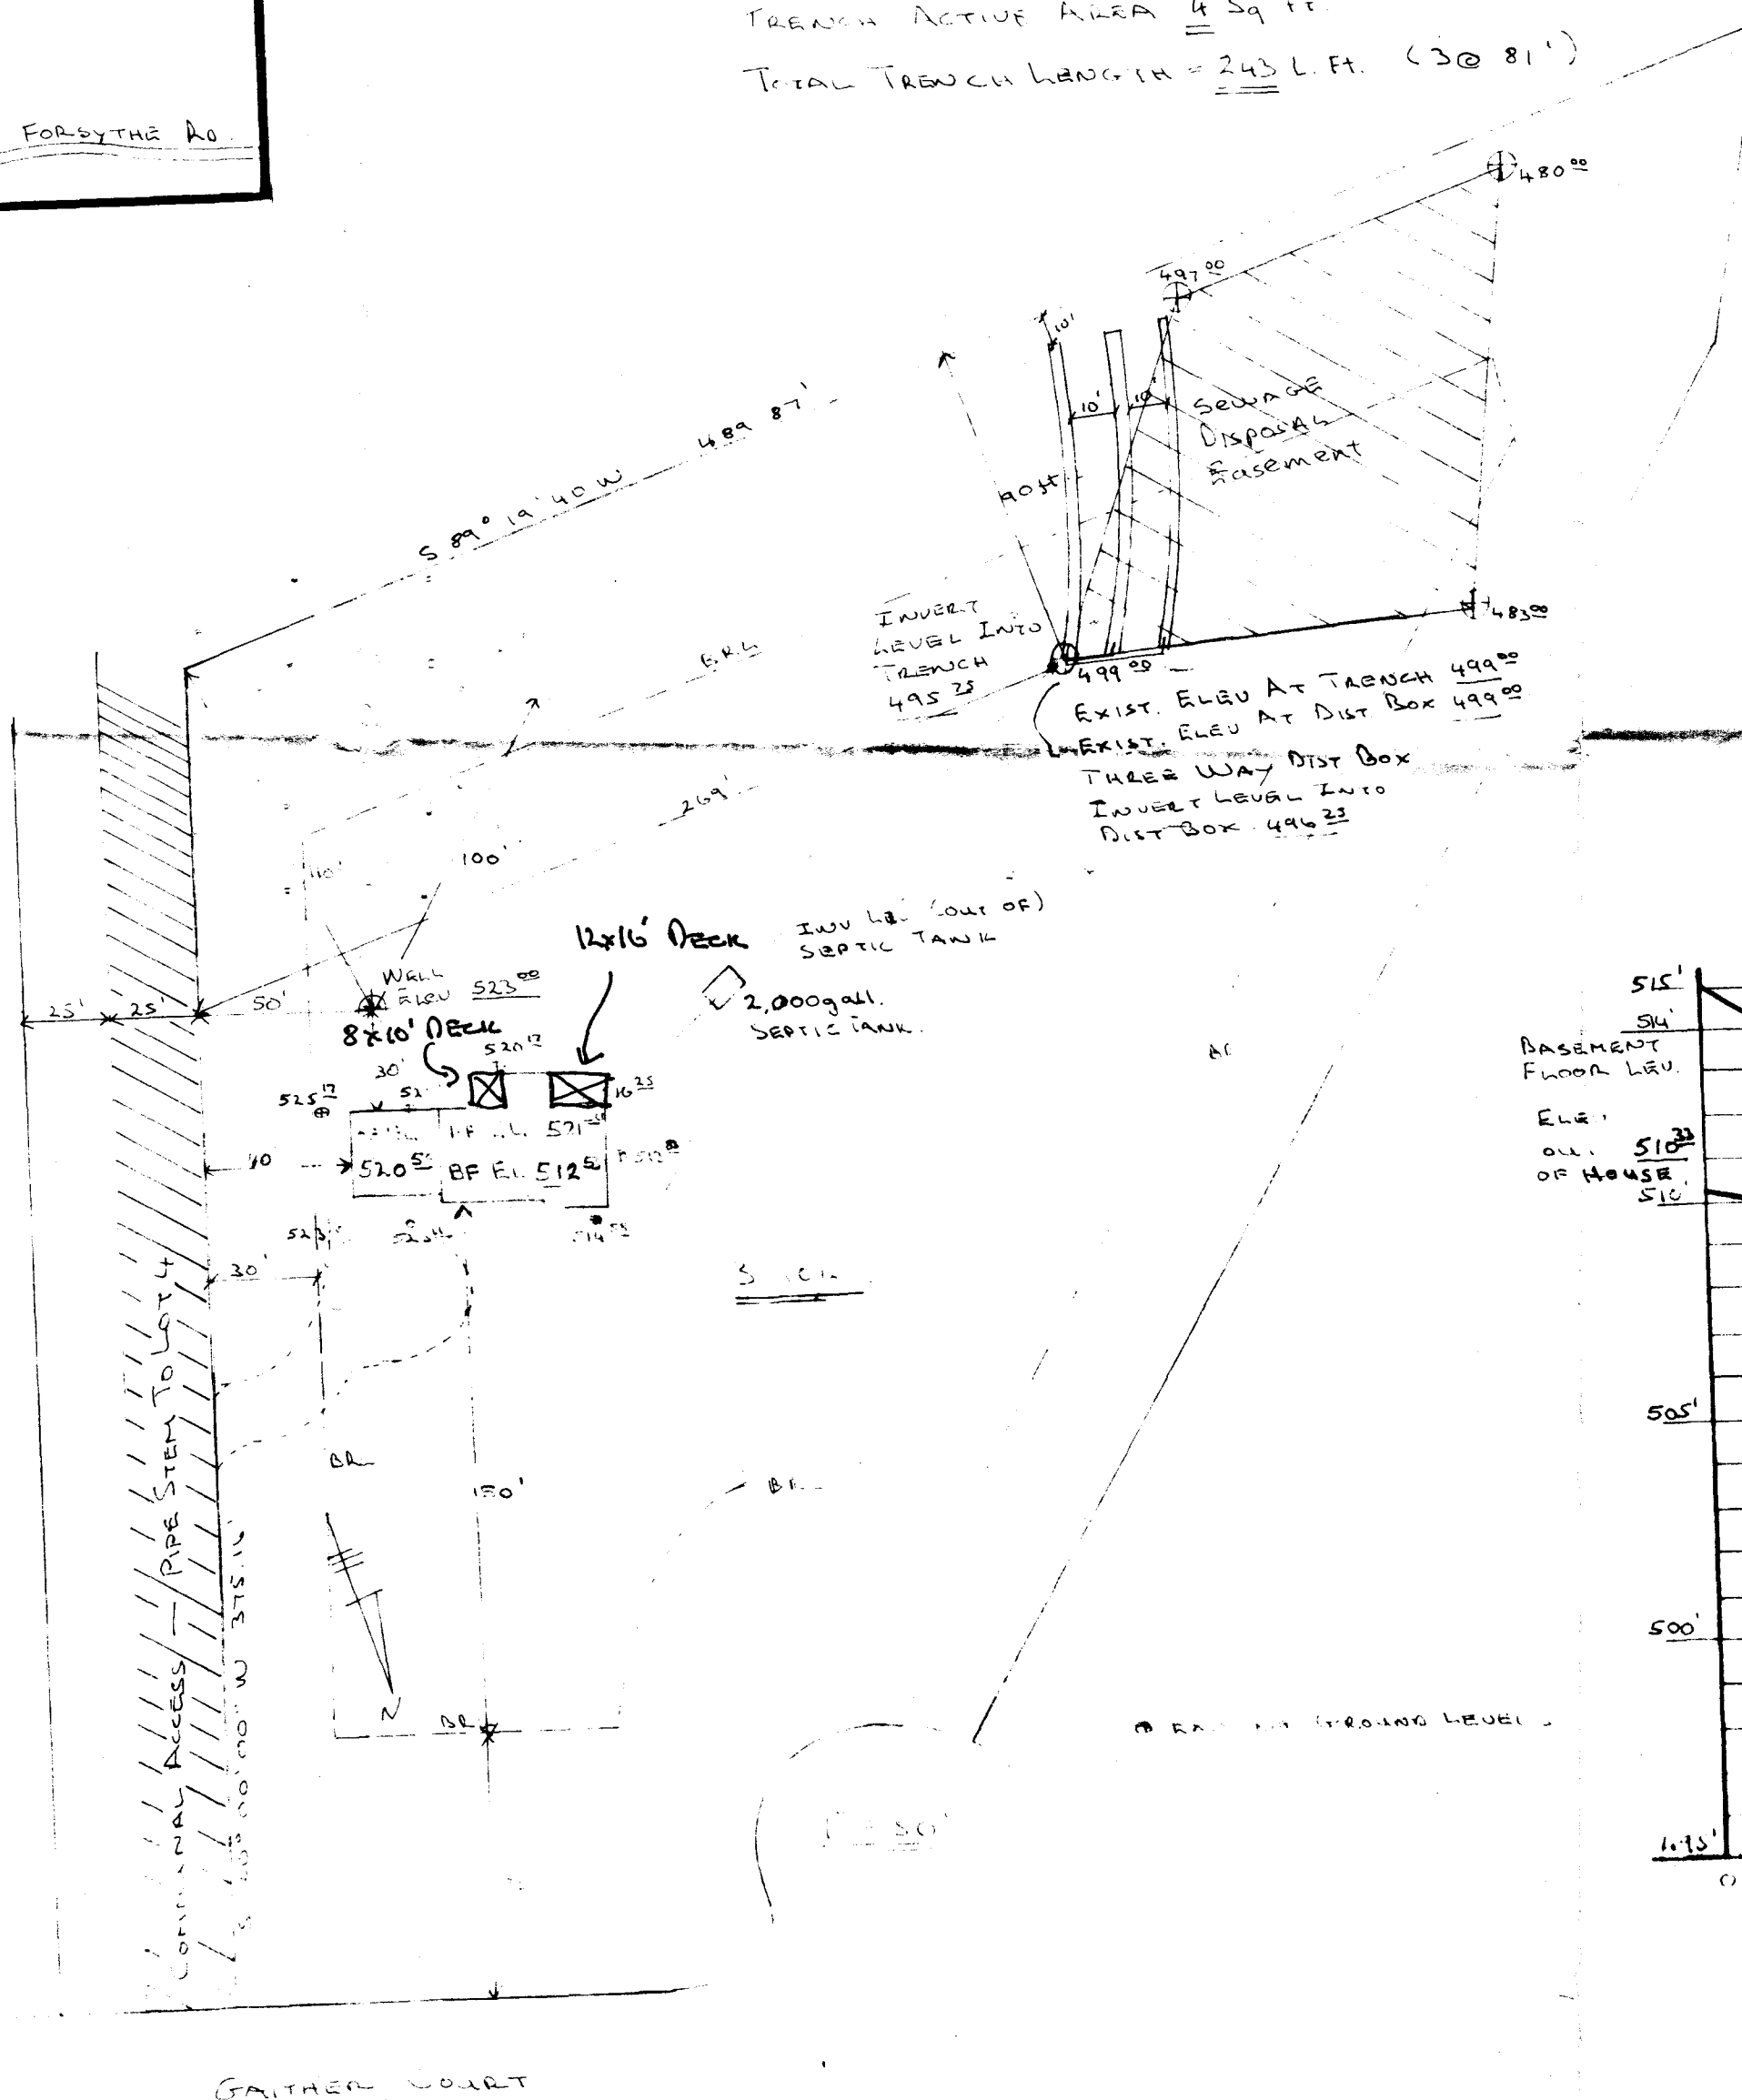

Lot 6 Gaither Siding
A. McPhail.

4/4/91
PLANS OIC
B/J

I certify that the above measurements are
actual and correct for this property A.M. McPhail