

4/27/85
2/4/85
5. Noel
approved
2-4-85
S. Noel
as per as possible
cancelled

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH*

A 33311

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH
992-2330

04-342933

INDEXED

ELLICOTT CITY

DISTRICT 4th

DATE 1/18/85

Jack Fyock

IS PERMITTED TO INSTALL X ALTER

ADDRESS _____ PHONE 988-9270

SUBDIVISION Roxbury ROAD 4095 Roxmill Court LOT 10

PROPERTY OWNER Ronald King

ADDRESS _____

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES _____ NO X

SEPTIC TANK CAPACITY 1000 GALLONS NUMBER OF BEDROOMS 3

TRENCHES - 158 sq. ft. per bedroom. Trench to be 2 feet wide. Inlet 4 feet below original grade. Bottom maximum depth 9 feet below original grade. Effective area begins at 4 feet below original grade. 5 feet of stone below distribution pipe. LOCATION: Place the distribution box 265 feet from the front lot line and 105 feet from the left lot line as seen when facing the lot from Roxmill Court. Start first trench 255 feet from the front lot line and 75 feet from the left lot line. Run the trench along level ground toward the left front of lot. NOTE: No trench to exceed 100 feet in length. If more than one trench used, a distribution box is required. Call for inspection of trench before and after gravel is installed. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank.

PLANS APPROVED BY C. Williams DATE 1/23/84

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: IF TRENCH IS USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH.

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER. NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS.

PERMIT VOID AFTER THREE YEARS.


NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA, OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET MANHOLE TO GRADE REQUIRED.

*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APROVAL ON THIS PERMIT

*CALL 992-2330 FOR INSPECTION OF SEPTIC SYSTEMS.

EH - 2-1082

A 33311

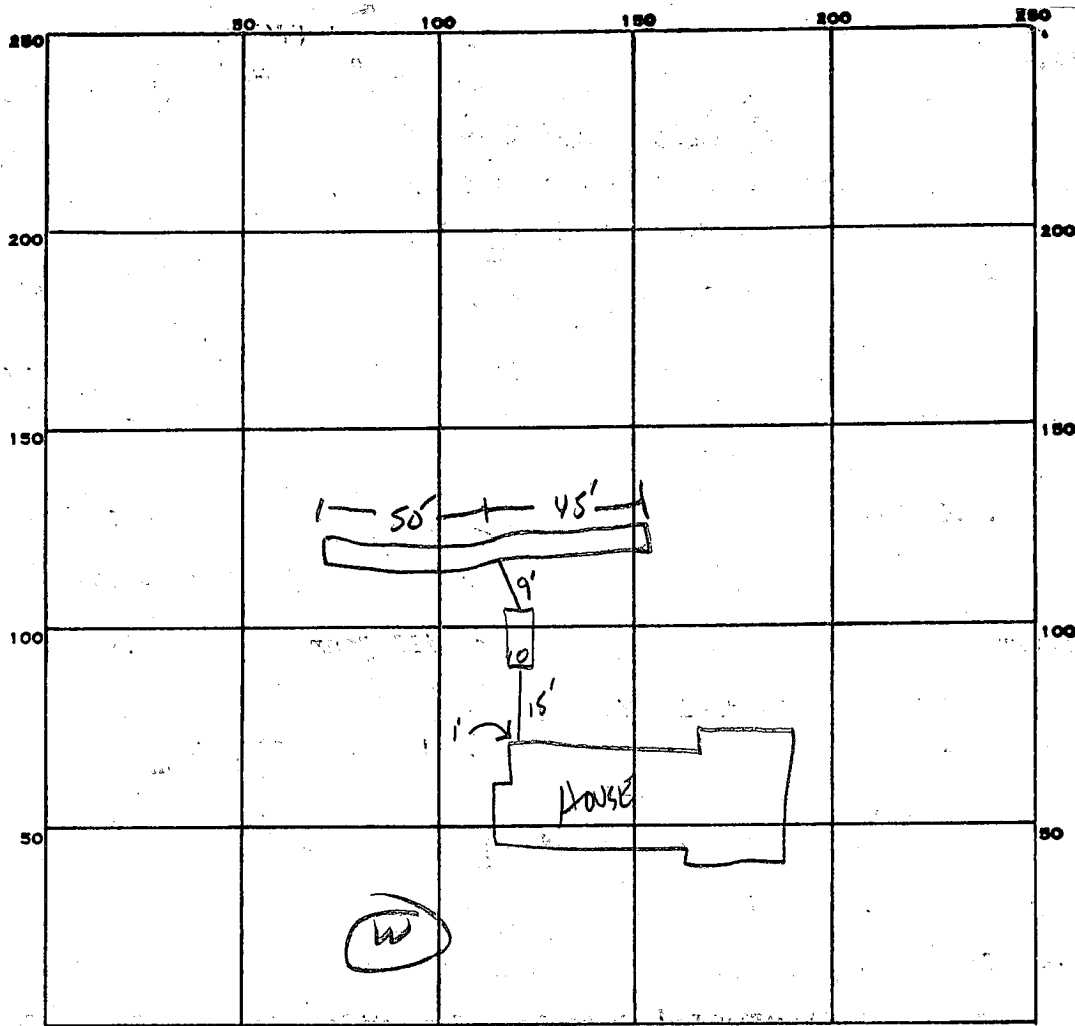

INDICATE NORTH. - NAME ADJOINING ROADWAY AS BASE LINE.

Roxmill Rd.

PERMIT CARD ☒

SEPTIC TANK, LEVEL 1000

CLEANOUTS 1ST

DISTRIBUTION BOX, LEVEL N/A

TILE FIELD, DEPTH 9 FT. TRENCH WIDTH 2 FT. inlet 4'

GRAVEL DEPTH 5 FEET IN TOTAL LENGTH 95 FT.

NUMBER OF TRENCHES 1 TOTAL BOTTOM AREA 475

SEEPAGE PITS, INSIDE DIAMETER - FT. DEPTH BELOW INLET - FT.

ABSORBENT AREA 475' SQ. FT.

REMARKS 2-4-85 - OK TO COVER ALL WORK, 8A

DATE SYSTEM APPROVED 2-4-85

INSPECTOR J. Abel

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P. O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 992-2330

A 33311

P _____

DISTRICT 4

DATE 11-7-83

FILED N QUINN
465-5500
MRS WOODACE
84-662-4488

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Otd Frederick Assoc. Ronald King

ADDRESS 241 W. PATRICK ST, FREDERICK, MD PHONE 1-831-6800 795-4817

PROPERTY LOCATION:

SUBDIVISION Roxbury LOT NO. 10

ROAD AND DESCRIPTION 4095 Roymill Court

SIZE OF LOT 3.071 AC TYPE BLDG. 3 or 4 Bedrooms
(NUMBER OF BEDROOMS)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE

FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY

WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT. James Fitzgerald
(SIGNATURE OF APPLICANT)

APPROVED BY C. Wilman FOR TRENCHES DATE 11-17-83
NEW LAYOUT APPROVED C. Wilman TRENCHES DATE 1-18-84

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING RETEST OK - NEED NEW PLOT PLAN, HOUSE SITE

BEFORE WRITING SPECS. 11-28-83 C. Wilman

BLDG. PERMIT SIGNED
AND RETURNED 5/18/84


Serial 459036 SFD

THIS IS NOT A PERMIT

#7 SOIL PROFILE

SAND
LOAM

12

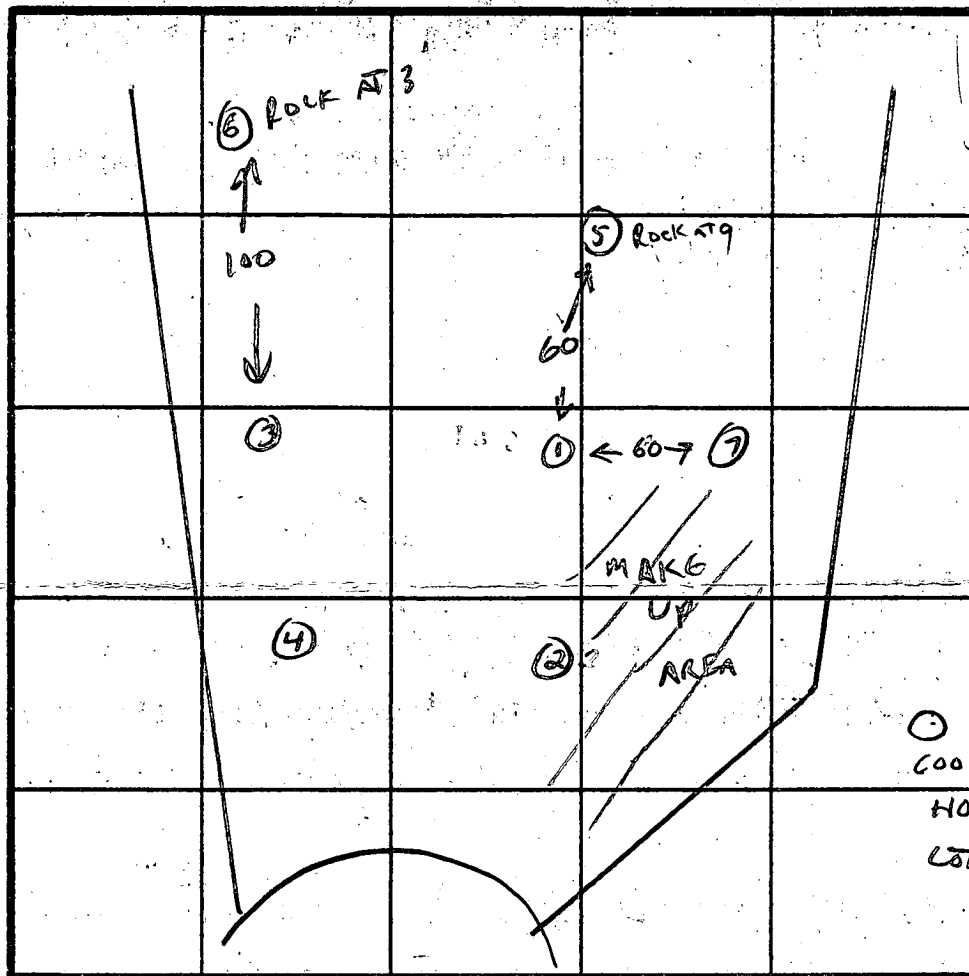

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

EH 6
MICA
SAND
LOAM
9' ROCK

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
	OLD 1-2-3-4	TESTED	11-15-79		BY RD & CBS		
11-12-83	5	MICA LOAM WITH OCCASIONAL SHALE/SANDSTONE					
		HARD AT 9'					
11-12-83	6	ROCK AT 3'					
11-17-83	7	SAND LOAM TO 12'					
		OK TO USE ANY AREA OF LOT IN FRONT					
		OF THIS HOLE					

REMARKS

TYPE OF SOIL SAND LOAM

TESTED BY C. Williams

ALSO PRESENT

OLD KETTERMAN
EILEEN QUINN

EH-12-1079

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

A 30236
P _____

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P.O. BOX 476 ELLICOTT, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT 4th.
DATE 9/28/79

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER J. Garrett Reilly

ADDRESS Roxbury Mills Rd., Glenwood, Md. 21738 PHONE 489-4481

PROPERTY LOCATION:

SUBDIVISION Roxbury LOT NO. ~~13~~ new 10

ROAD AND DESCRIPTION Route 97

SIZE OF LOT 3.06 Acres TYPE BLDG. 3 or 4 Bedrooms

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER

ANY CIRCUMSTANCES.

SIGNATURE OF APPLICANT E. Smariga /s/

APPROVED BY R.H. & D.W. M. FOR DRY WELL DATE 12/2/79
WELL LOCATION TO BE CHECKED - LOT #16 SYSTEM CHANGED FROM PLAT.

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 11/15/79 - MORE TESTS, 11/16/79 OK, HOLD FOR APPROVAL R.O.
12/4/79 - DM SAID OK RH.


THIS IS NOT A PERMIT

LOT 13

SOIL PROFILE

SANDY
CLAY

SANDY
LOAM

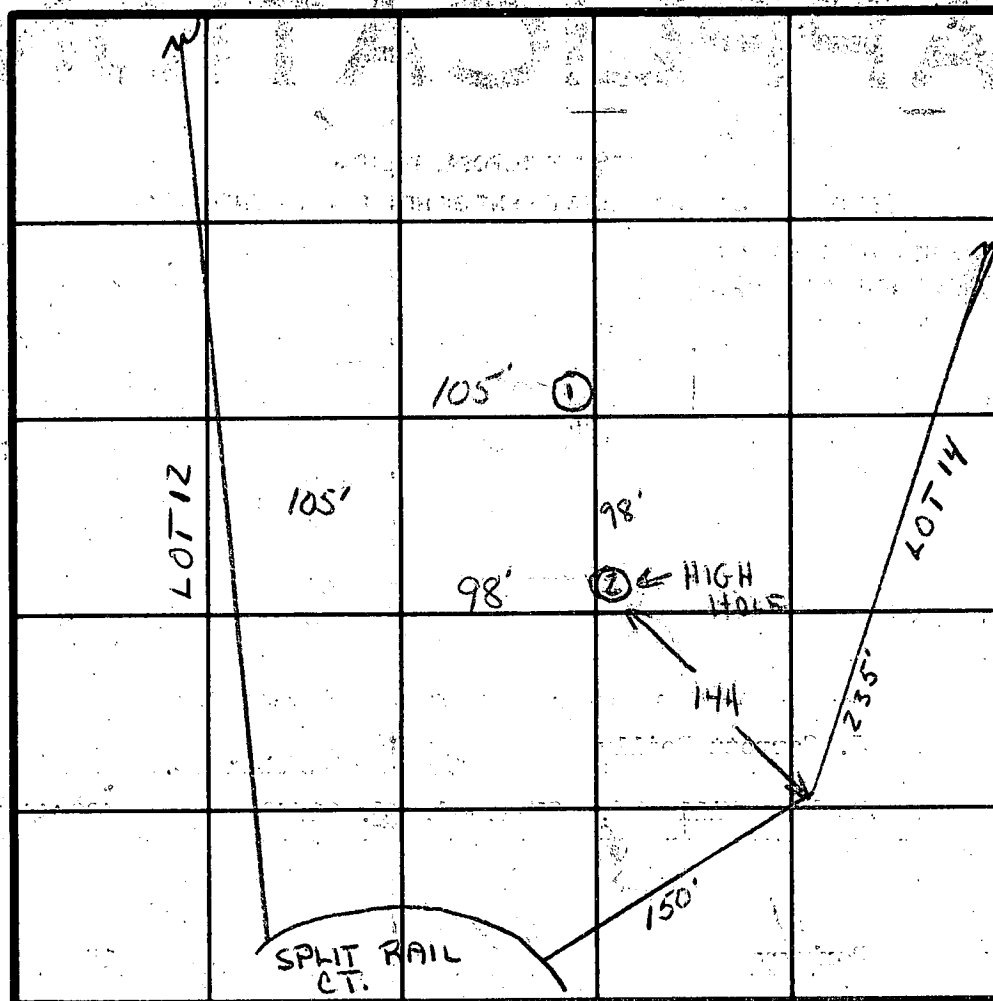

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
11/15/79	1S	4'	3:43	3:46	3:46	3:53	7
	1D	13'	3:42	3:44	3:44	3:49	5
	2S	4'	3:48	3:54	3:54	3:58	4
	2D	13 1/2'	3:47	FAILED	1 1/2" INCH - CAVE IN		✓
11/16/79	2D	13'	11:40	11:50	11:50	12:11	21
	3S	4'	11:52	11:56	11:56	12:01	5
	3D	12 1/2'	11:51	11:56	11:56	12:02	6
	4V	SAME SOIL BASICLY, MORE SAND.					

REMARKS

TYPE OF SOIL

TESTED BY

R.D. & CBS

ALSO PRESENT

KETTERMAN I, II, III

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P.O. BOX 476 ELLICOTT, MARYLAND 21043
TELEPHONE: 992-2330

A 31236

P _____

DISTRICT 4th.

DATE 9/28/79

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER J. Garrett Reilly

ADDRESS Roxbury Mills Rd., Glenwood, Md. 21738 PHONE 489-4481

PROPERTY LOCATION:

SUBDIVISION Roxbury LOT NO. 13

ROAD AND DESCRIPTION Route 97

SIZE OF LOT 3.06 Acres TYPE BLDG. 3 or 4 Bedrooms

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES.

SIGNATURE OF APPLICANT E. Smariga /s/

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____

11/17/79 - DM SAID OK - ALL


THIS IS NOT A PERMIT

LOT 13
new

SOIL PROFILE

3 1/2' - SANDY CLAY

SANDY LOAM

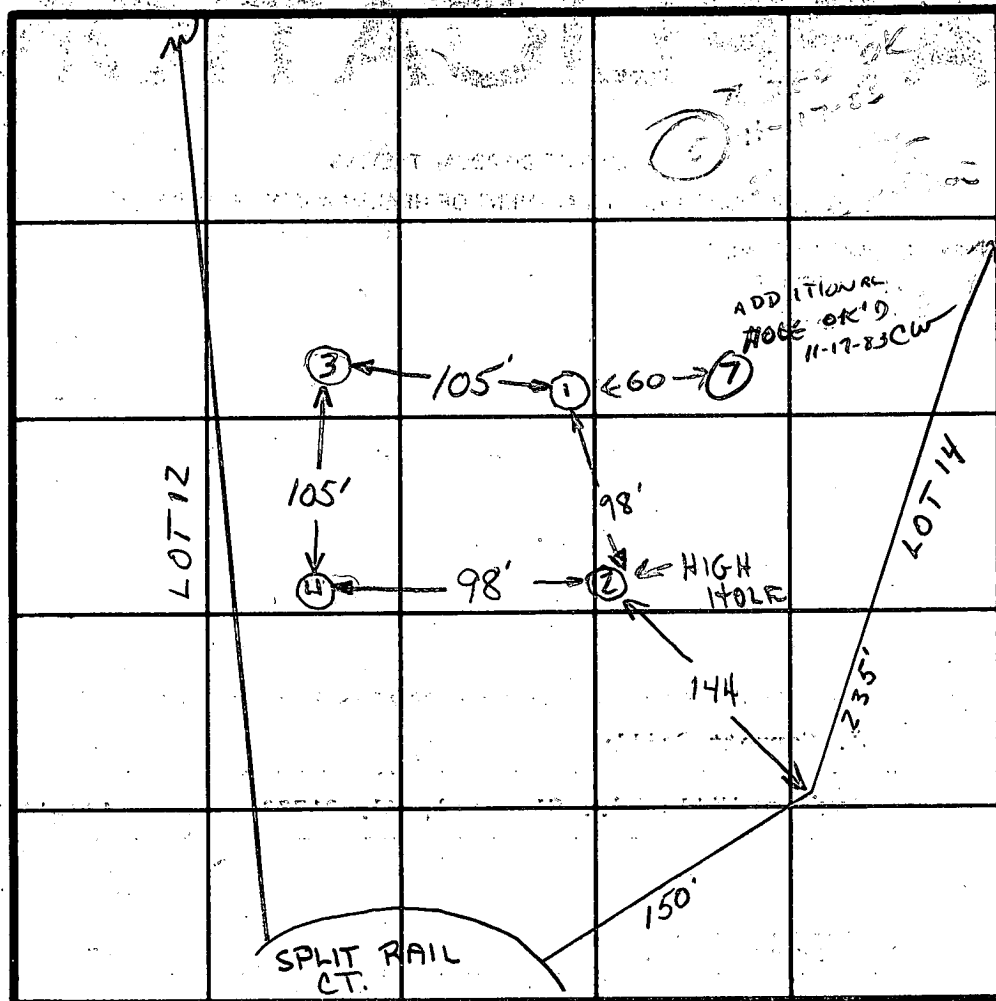

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
11/15/79	1S	4'	3:43	3:46	3:46	3:53	7
	1D	13'	3:42	3:44	3:44	3:49	5
11/15/79	2S	4'	3:48	3:54	3:54	3:58	4
	2D	13 1/2'	3:47	FAILED	1" INCH - CAVE IN		
11/16/79	2D	13'	11:40	11:50	11:50	12:11	21
	3S	4'	11:52	11:56	11:56	12:01	5
	3D	12 1/2'	11:51	11:56	11:56	12:02	6
	4V	SAME SOIL BASICLY, MORE SAND.					

13 MIN. AVG.

REMARKS


TYPE OF SOIL

TESTED BY

B.D. & CBS

ALSO PRESENT

KETTERMAN I, II, III

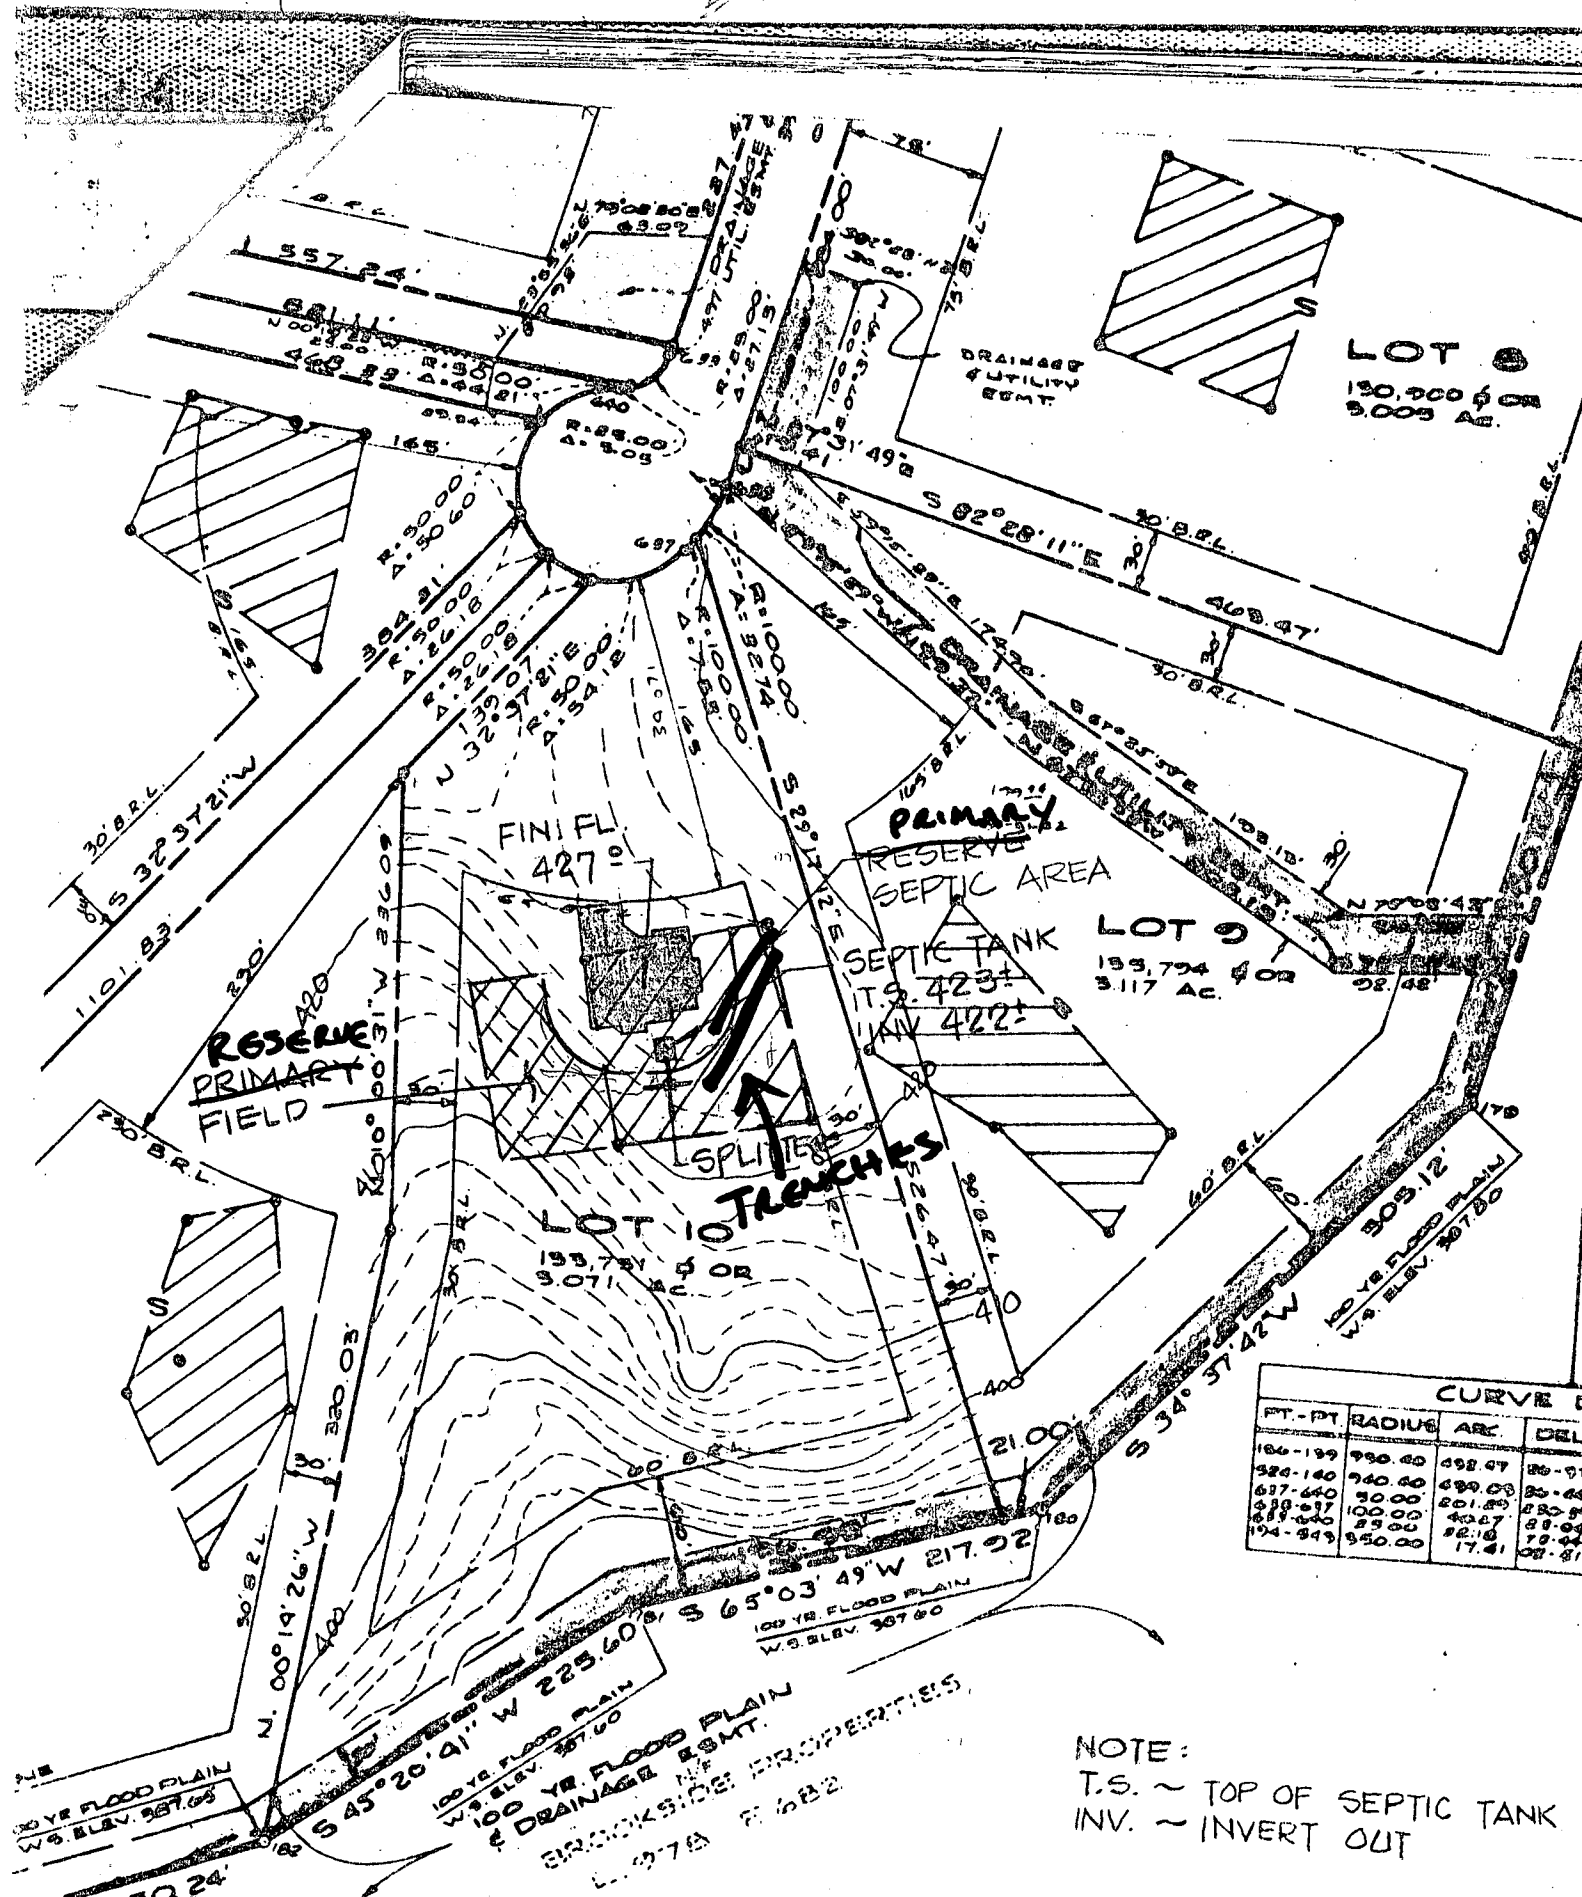


PT.-PT.	RADIUS	ARC	DEL.
186-199	930.00	498.47	86-37
324-140	940.00	499.03	85-43
637-640	90.00	201.80	83-05
638-637	100.00	40.67	88-04
639-640	89.00	82.10	79-44
194-349	950.00	17.41	08-41

NOTE:
 T.S. ~ TOP OF SEPTIC TANK
 INV. ~ INVERT OUT

DATE	REVISIONS
12-01-82	REV. LOTS 9-17, RE-MILL LOT 17, DRAINAGE & UTILITY EGMT. BY INTO HOWARD COUNTY CENTRAL SURVEY
1-27-83	

FINAL PLAT
 SECTION I LOTS 1 TO 21

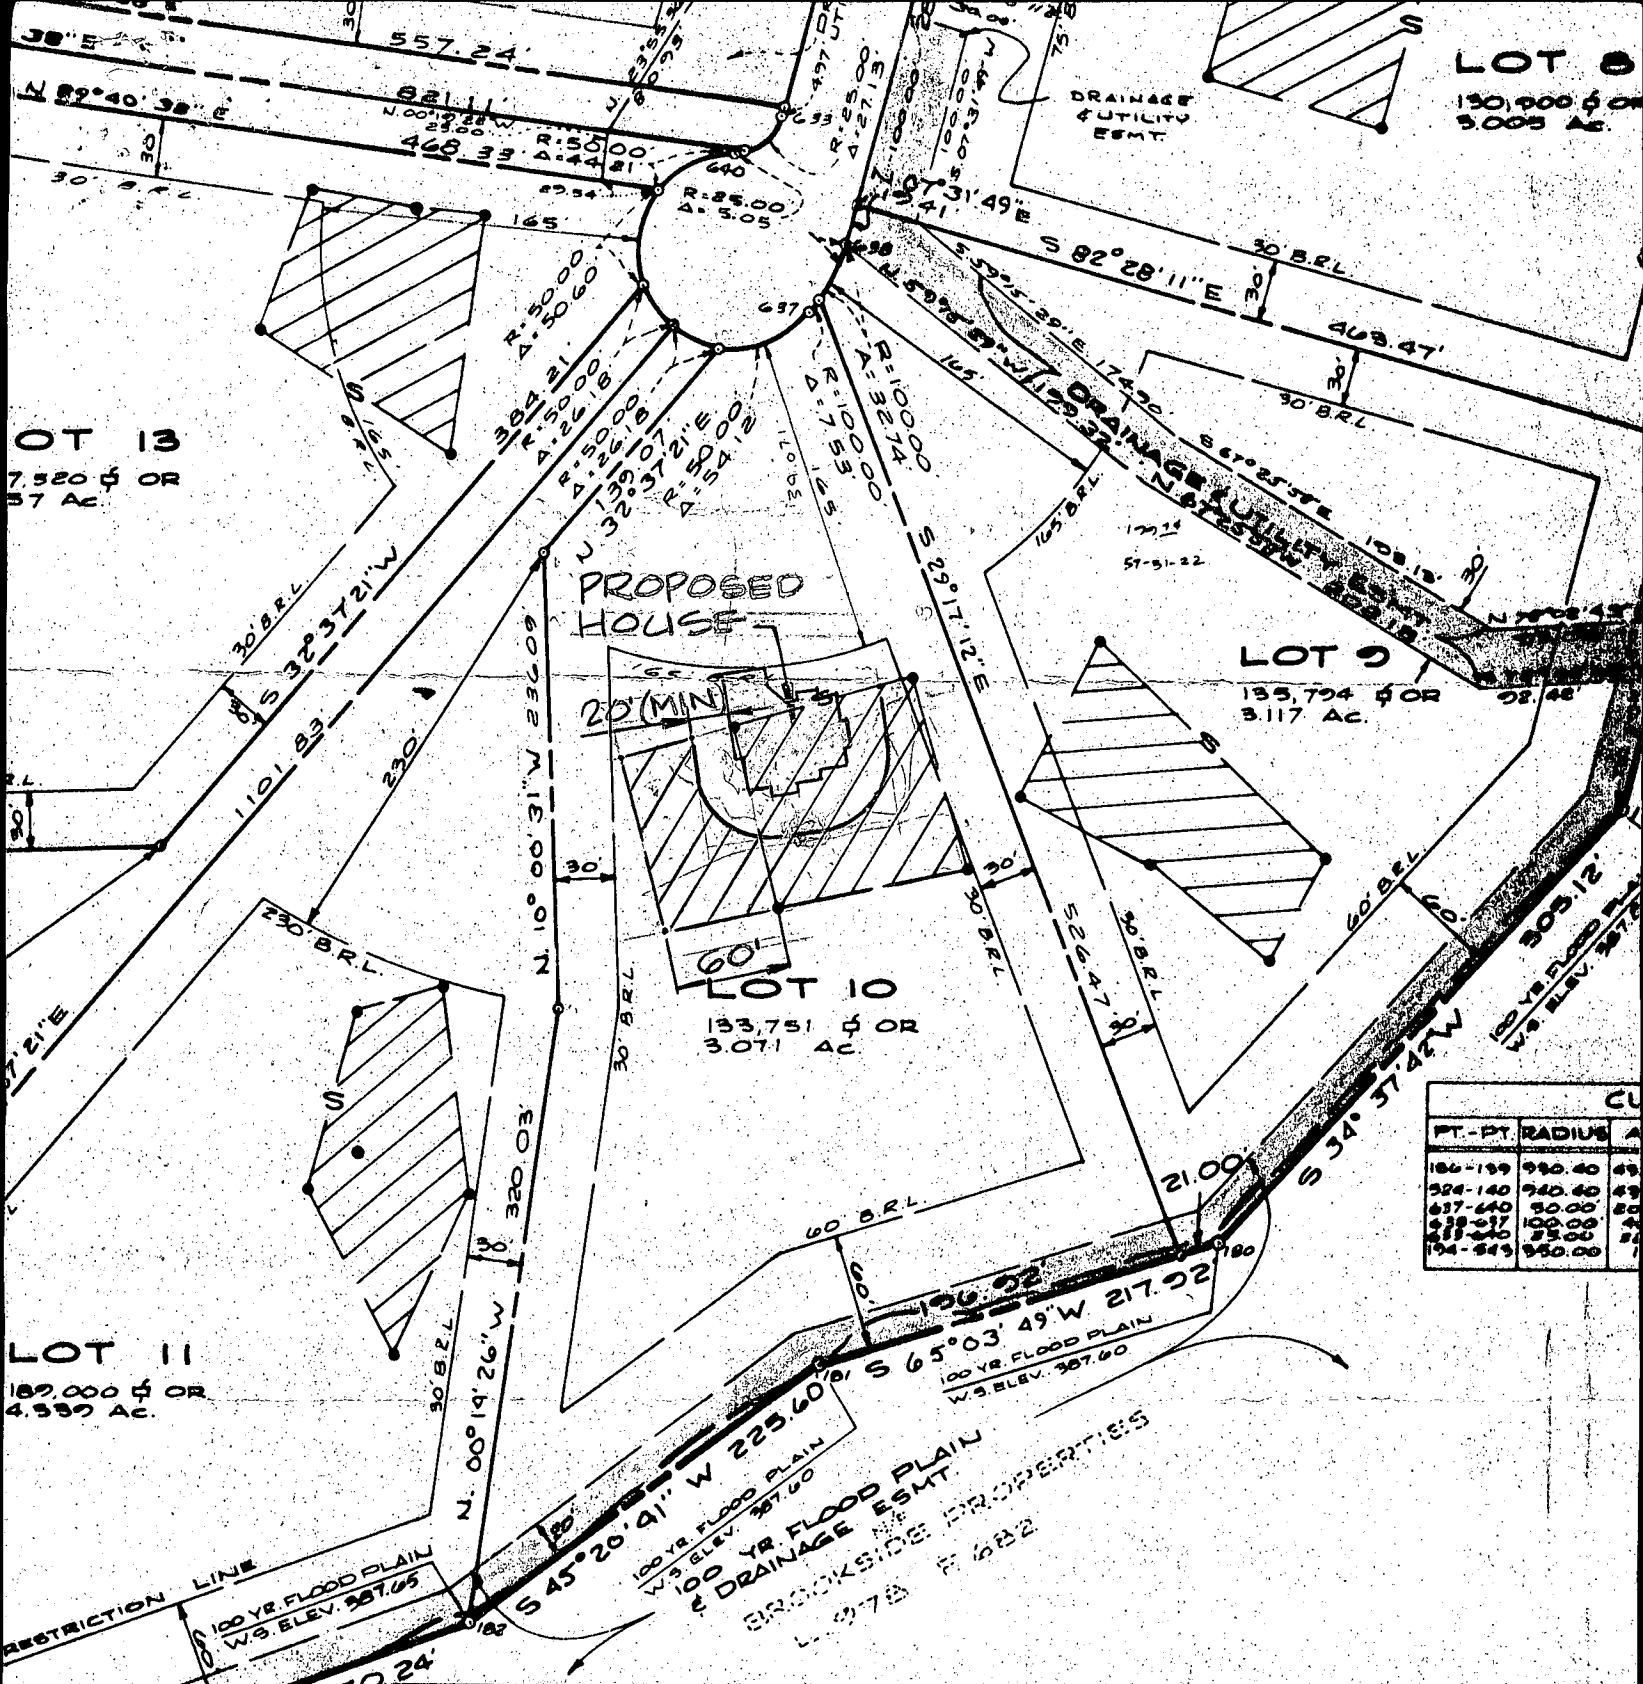

LOT 11
189,000 \$ OR
4.337 AC.

PROPOSED HOUSE

LOT 10
133,751 \$ OR
3.071 AC.

LOT 9
135,794 \$ OR
3.117 AC.

LOT 8
130,900 \$ OR
3.005 AC.

LOT 13
7,520 \$ OR
.17 AC.

100 YR. FLOOD PLAIN
W.S. ELEV. 367.70

100 YR. FLOOD PLAIN
W.S. ELEV. 367.65

100 YR. FLOOD PLAIN
W.S. ELEV. 367.60

100 YR. FLOOD PLAIN
W.S. ELEV. 367.60

DATE	REVISIONS
12-01-82	REV. LOTS 9-17, REXAMILL, CT & ADDED DRAINAGE & UTILITY ESMTS.
1-27-83	R/T INTO HOWARD COUNTY CONTROL SURVEY

FINAL PLAT
SECTION I LOTS 1 TO 17

ROXBURY

SITUATED ON MARYLAND ROAD
AT ROXBURY MILLS
FOURTH ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

SCALE: 1"=100' APRIL 1980

CERTIFICATION
LOT SHOWN HEREON IS CORRECT;
OF THE LANDS CONVEYED BY
NICK ASSOCIATES, A MARYLAND
DATED DECEMBER 17, 1979 AND
OF HOWARD COUNTY, IN LIEU
MONUMENTS ARE IN PLACE
IN THE ANNOTATED CODE OF

C14467

SEQUENCE NO.
(OEP USE ONLY)

STATE OF MARYLAND
WELL COMPLETION REPORT
FILL IN THIS FORM COMPLETELY
PLEASE PRINT OR TYPE

THIS REPORT MUST BE SUBMITTED WITHIN
45 DAYS AFTER WELL IS COMPLETED.

COUNTY
NUMBER

A33311

DATE Received

DATE WELL COMPLETED

Depth of Well

PERMIT NO.

FROM "PERMIT TO DRILL WELL"

123083

123

40-81-0383

OWNER

last name

first name

TOWN

STREET OR RFD

SUBDIVISION

SECTION

LOT

King

Roxmill Court

Ron

Glenwood

Roxbury

10

WELL LOG

Not required for driven wells

STATE THE KIND OF FORMATIONS
PENETRATED, THEIR COLOR, DEPTH,
THICKNESS AND IF WATER BEARING

DESCRIPTION (Use
additional sheets if needed)

FEET

FROM

TO

Check
if water
bearing

Brown Shale

0

33

Gray mica rock

33

123

-

GROUTING RECORD

WELL HAS BEEN GROUTED
(Circle Appropriate Box)

TYPE OF GROUTING MATERIAL

CEMENT

BENTONITE CLAY

NO. OF BAGS

NO. OF POUNDS

GALLONS OF WATER

DEPTH OF GROUT SEAL (to nearest foot)

from

ft. to

ft.

TOP

BOTTOM

(enter 0 if from surface)

CM

BC

12

1128

12

0

32

52

54

58

CASING RECORD

casing
types
insert
appropriate
code
below

ST

CO

PL

OT

STEEL

CONCRETE

PLASTIC

OTHER

MAIN CASING TYPE

Nominal diameter
top (main) casing
(nearest inch)

Total depth
of main casing
(nearest foot)

S

6

36

60

61

63

64

66

70

OTHER CASING (if used)

diameter
inch

depth (feet)
from

to

EACH CASING

screen type
or open hole

insert
appropriate
code
below

ST

BR

HO

PL

OT

STEEL

BRASS

OPEN
HOLE

PLASTIC

OTHER

C2

DEPTH (nearest ft.)

EACH SCREEN

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

31

32

33

34

35

36

37

38

39

40

41

42

43

44

45

46

47

48

49

50

51

CIRCLE APPROPRIATE LETTER
A WELL WAS ABANDONED AND SEALED
WHEN THIS WELL WAS COMPLETED

E ELECTRIC LOG OBTAINED

P TEST WELL CONVERTED TO PRODUCTION
WELL

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN
ACCORDANCE WITH COMAR 10.17.13 "WELL CONSTRUCTION"
AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE
ABOVE CAPTIONED PERMIT, AND THAT THE INFORMATION
PRESENTED HEREIN IS ACCURATE AND COMPLETE TO THE BEST
OF MY KNOWLEDGE.

DRILLERS IDENT. NO.

DRILLERS SIGNATURE

(MUST MATCH SIGNATURE ON APPLICATION)

SITE SUPERVISOR (sign. of driller or journeyman
responsible for sitework if different from permittee)

GRAVEL PACK

IF WELL DRILLED WAS
FLOWING WELL INSERT
F IN BOX 68

OEP USE ONLY
(NOT TO BE FILLED IN BY DRILLER)

T

(E.R.O.S.)

WQ

70

72

74

75

76

TELESCOPE
CASING

LOG
INDICATOR

OTHER DATA

PUMPING TEST

HOURS PUMPED (nearest hour)

PUMPING RATE (gal. per min.
to nearest gal.)

METHOD USED TO
MEASURE PUMPING RATE

WATER LEVEL (distance from land surface)

BEFORE PUMPING

WHEN PUMPING

TYPE OF PUMP USED (for test)

A air

P piston

T turbine

C centrifugal

R rotary

O other
(describe
below)

J jet

S submersible

PUMP INSTALLED

DRILLER WILL INSTALL PUMP YES NO

IF DRILLER INSTALLS PUMP, THIS SECTION
MUST BE COMPLETED FOR ALL WELLS
EXCEPT HOME USE

TYPE OF PUMP INSTALLED
PLACE (A,C,J,P,R,S,T,O)
IN BOX - SEE ABOVE:

CAPACITY:
GALLONS PER MINUTE
(to nearest gallon)

PUMP HORSE POWER

PUMP COLUMN LENGTH
(nearest ft.)

CASING HEIGHT (circle appropriate box
and enter casing height)

LAND SURFACE

(nearest
foot)

LOCATION OF WELL ON LOT

SHOW PERMANENT STRUCTURE SUCH AS
BUILDING, SEPTIC TANKS, AND/OR
LANDMARKS AND INDICATE NOT LESS
THAN TWO DISTANCES
(MEASUREMENTS TO WELL)

Front

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Well Permit No. HO - 81-0383

Location of property (road) Rockmill Cr.

Subdivision Roxbury Lot 10 Block, Plat Sec.

Well Driller Joseph Maize Owner Don Kura

Depth of well 123

Distance of measuring point (M.P.) above ground 18"

Static water level (S.W.L.) below M.P. 13'

I. High rate pumping -- reservoir drawdown

Time pump started 8:30

Pumping rate 15 gal.

Total time 15 min. to reach pumping water level 18 ft. below M.P.

II. Recovery pump test data - observations to be recorded every 15 minutes

[illegible]

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

H₂O Sample H9492
taken @ 10⁴⁵

Well Permit No. HO - 81-0383

Location of property (road) Roxmill Court

Subdivision Roxbury

Lot	10	Block	Plat	Sec.
-----	----	-------	------	------

Well Driller Joseph Mayne

Owner Ron King

Depth of well

Distance of measuring point (M.P.) above ground

Static water level (S.W.L.) below M.P.

I. High rate pumping -- reservoir drawdown


Time pump started

Pumping rate

Total time	<u> </u>	<u> </u>
	to reach pumping water level	ft. below M.P.

II. Recovery pump test data - observations to be recorded every 15 minutes

[illegible]




CURVE DATA				
PT.-PT.	RADIUS	ARC	DELTA	T
184-199	950.40	432.47	24-37-57	28
324-140	740.40	439.05	24-44-55	28
637-640	50.00	201.69	53-39-57	19
438-440	100.00	40.57	53-39-57	10
194-549	950.00	32.18	72-17-21	16
		17.41	22-51-01	

NOTE:
T.S. ~ TOP OF SEPTIC TANK
INV. ~ INVERT OUT

DATE	REVISIONS
12-01-82	REV. LOTS 9-17, ROXMILL CT. & ADDED DRAINAGE UTILITIES MTS.
1-27-83	R/T INTO HOWARD COUNTY CENTRAL SURVEY

FINAL PLAT
SECTION I LOTS 1 TO 21
ROXBURY

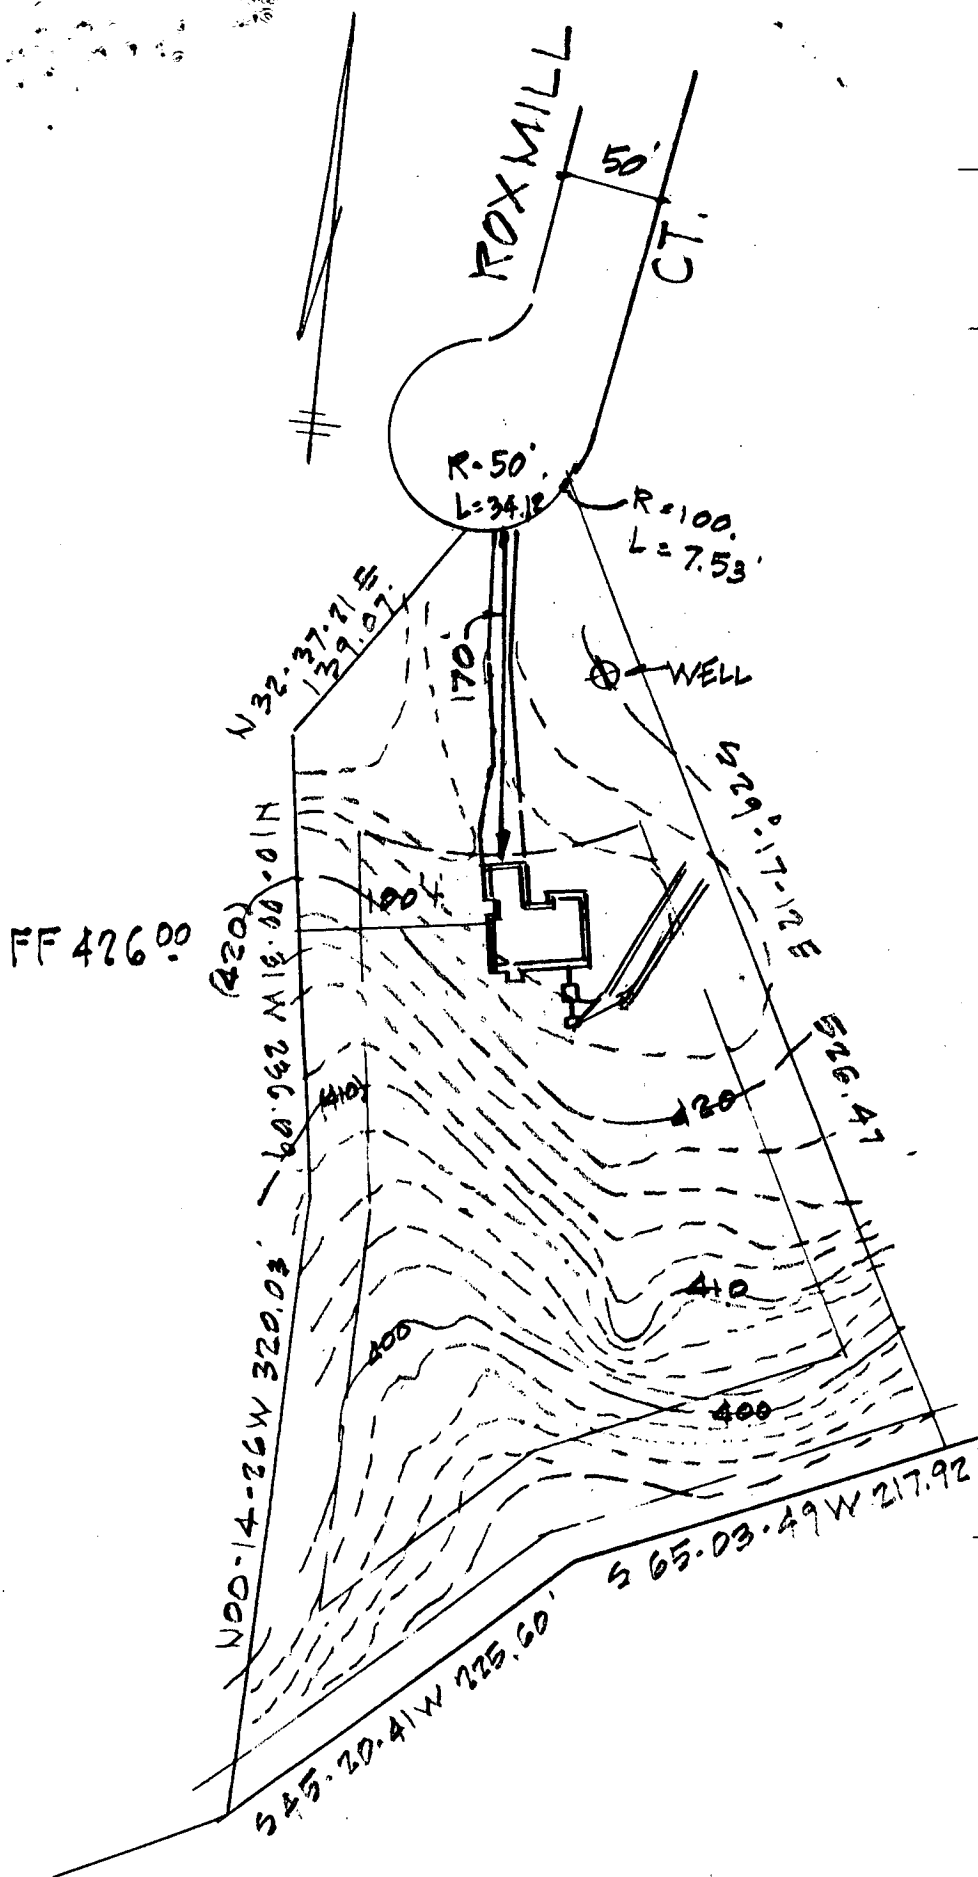

WELL DATA

EX. GR. 420.

FIN GR 420

SEPTIC SYSTEM

INV. OF SEWER FROM
HOUSE = 418.50

SEPTIC TANK

EX. GR. 424

FIN. GR. 425

INV. IN 418.30

INV. OUT 418.20

DISTRIBUTION BOX

EX. GR. 422.

FIN. GR. 422

INV. 418.0

TRENCH DATA

EX. GR. 422.0

PIPE IN @ 418.

TRENCH 2' WIDE

INLET 4' BELOW EX. GR

BOTTOM 9' BELOW EX GR

INSTALL 2 TRENCHES
10' APART 50 LF EA.

5/18/84 Sketch O.K.
but manhole on
septic tank required
J.F.

4095 ROXMILL CT

PLOT PLAN

LOT 10
ROXBURY

DISTR. 4 HO. CO. MD.
SCALE 1"=100' APR.

PLAT 5435

A33311

DEPARTMENT OF INSPECTIONS, LICENSES AND PERMITS
173430 COURT HOUSE DRIVE
ELLICOTT CITY, MD 21043
PERMITS (410) 313-2455 INSPECTIONS (410) 313-1810
AUTOMATED INFORMATION (410) 313-3800

HOWARD COUNTY PERMIT APPLICATION

PERMIT NUMBER
B00123851

Building Address 4095 ROXMILL CT
GLENWOOD MD 21038
Suite/Apt. #: _____ SDP/WP/Patition #: _____
Census Tract 6040 Subdivision Roxburg East
Section 1 Area _____ Lot 10
Tax Map 21 Parcel 201 Grid 14
Zoning RCDEP Map Coordinates 8511 Lot size _____

Property Owner's Name Chip & Nancy Thomas
Address 4095 Roxmill Ct
City Glenwood State MD Zip Code _____
Home Phone 410 442 4620 Work Phone _____
Applicant's Name & Mailing Address, (if other than stated hereon):

Phone _____ Fax _____

Existing Use SFD
Proposed Use Kitchen addition
Estimated Construction Cost \$ 50,000
Description of Work extend addition 10x40
enlarge Kitchen's Pan Rm
add 1/2 bath

Contractor Company Wiedel Home Tm
Contact Person Paul Wiedel
Address 6338 Ringier Rd
City Columbia State MD Zip Code 21045
License No. 27472
Phone 410 442 0553 Fax _____

Occupant or Tenant Chip & Nancy Thomas
Contact Name Chip Thomas
Address 4095 Roxmill Ct
City Glenwood State MD Zip Code _____
Phone 410 442 4620 Fax _____

Engineer or Architect Company SINEX Design
Contact Person Rexanne Siney
Address 9014 Blue Pool
City Columbia State MD Zip Code 21045
Phone _____ Fax _____

BUILDING DESCRIPTION - COMMERCIAL	
Building Characteristics	Utilities
Height: _____	Water Supply: _____ ☐ Public ☐ Private
No. of stories: _____	Sewage Disposal: _____ ☐ Public ☐ Private
Gross area, sq. ft. per floor: _____	Electric Yes ☐ No ☐ Gas Yes ☐ No ☐
Use group: _____	Heating System: _____ Electric ☐ Oil ☐ Natural Gas ☐ Propane Gas ☐
Construction type: _____ ☐ Reinforced Concrete ☐ Structural Steel ☐ Masonry ☐ Wood Frame ☐ State Certified Modular	Sprinkler system: N/A ☐ ☐ Full ☐ Partial ☐ Other Suppression # of Heads _____

BUILDING DESCRIPTION - RESIDENTIAL	
Building Characteristics	Utilities
SF Dwelling ☒ SF Townhouse ☐ Depth _____ Width _____	Water Supply: _____ ☐ Public ☒ Private
1st floor: _____	Sewage Disposal: _____ ☐ Public ☒ Private
2nd floor: _____	Electric Yes ☒ No ☐ Gas Yes ☐ No ☒
Basement: _____	Heating System: _____ Electric ☐ Oil ☐ Natural Gas ☐ Propane Gas ☐
Finished Basement ☐ Unfinished Basement ☒ Crawl space ☒ Slab on Grade ☐ No. of Bedrooms _____	Sprinkler system: N/A ☒ ☐ NFPA #13D ☐ NFPA #13R ☐ Other: _____
Multi-family dwellings: _____ No. of efficiency units: _____ No. of 1 BR units: _____ No. of 2 BR units: _____ No. of 3 BR units: _____	
Other Structure: _____ Dimensions: _____ Footings: _____ Roof: _____	
☐ State Certified Modular ☐ Manufactured Home	

THE UNDERSIGNED HEREBY CERTIFIES AND AGREES AS FOLLOWS: (1) THAT HE/SHE IS AUTHORIZED TO MAKE THIS APPLICATION; (2) THAT THE INFORMATION IS CORRECT; (3) THAT HE/SHE WILL COMPLY WITH ALL REGULATIONS OF HOWARD COUNTY WHICH ARE APPLICABLE THEREON; (4) THAT HE/SHE WILL PERFORM NO WORK ON THE ABOVE REFERENCED PROPERTY NOT SPECIFICALLY DESCRIBED IN THIS APPLICATION; (5) THAT HE/SHE GRANTS COUNTY OFFICIALS THE RIGHT TO ENTER ONTO THIS PROPERTY FOR THE PURPOSE OF INSPECTING THE WORK PERMITTED AND POSTING NOTICES.

Applicant's Signature _____
Title/Company _____

Print Name Paul Wiedel
Date 4/27/00

Checks payable to: DIRECTOR OF FINANCE OF HOWARD COUNTY
** PLEASE WRITE NEATLY AND LEGIBLY. **
FOR OFFICE USE ONLY


AGENCY	DATE	SIGNATURE APPROVAL
Land Development DPZ		
State Highways		
Building Official		
Dev. Engineering DPZ		
Health		
Fire Protection		
Is Sediment Control approval required prior to issuance? YES ☐ NO ☐		
CONTINGENCY CONSTRUCTION START: ☐		
ONE STOP SHOP: ☐		

DPZ SETBACK INFORMATION
Front: _____
Rear: _____
Side: _____
Side St. _____
All minimum setbacks met? YES ☐ NO ☐
Is Entrance Permit required? YES ☐ NO ☐
Historic District? YES ☐ NO ☐
Lot Coverage for New Town Zone _____
SDP/Red-line approval date _____

PROPERTY ID#	
45228	
Filing fee	\$ _____
Permit fee	\$ _____
Excise tax	\$ _____
Sub-total paid	\$ _____
Add'l permit fee	\$ _____
TOTAL FEES	\$ <u>280</u>
Balance due	\$ _____
Check	\$ <u>175.22</u>
Validation	\$ <u>21.02</u>
Accepted by	<u>RD</u>

Distribution of Copies: White: Building Official Green: LDD, DPZ Yellow: DED, DPZ Pink: Health Gold: SHA

000/27851
 LOT IS SUBJECT TO
 10,000 SECTION
 DETAIL NOT SHOWN IN THIS EXHIBIT
 BUT CAN BE DISCOVERED FROM OTHER
 PAGES IN FILE
 PROPOSED ADDITION IS WITHIN
 THE FOOTPRINT OF THE ORIGINAL
 APPLICANT'S 1958 PLAN
 50 NO ADDITIONAL CONSTRUCTION
 TO 56' ATIC



EXISTG.
2ND. FLR

920.03'

WALL
 10' TRIM
 0 MATCH
 IN TRUCK
 DR ON
 15' SHTG
 TIDS

100 YR FLOOD PLAIN &
 DRAINAGE BASIN

245° 20' 41" W 225.60'

LOT 10
 3.07 AC. ±

EXISTG.
RESIDENCE

10x40

NEW
ADDITION

30 BRL

529° 17' 12" E

196.22'

526.47'

COURT
 R=50
 L=54.12'

R=100
 L=7.95'

ADDITIONS AND ALTERATIONS FOR

CHIP & NANCY THOMAS

4095 ROXBURY COURT, GLENWOOD, MARYLAND

990882

SHEET

2
3

4.14.00

SITE INFORMATION

LOT 10 - ROXBURY
 SECTION I LOTS 1 TO 21
 SHEET 2 OF 2 PLATE 485
 4TH ELECTION DISTRICT
 HOWARD CO. MD.
 BY: LDE INC.
 9250 RUMSEY ROAD #106
 COLUMBIA, MD. 21045
 410-715-1070

SITE PLAN

NO SCALE

990882

SHEET

2
3

ADDITIONS AND ALTERATIONS FOR

CHIP & NANCY THOMAS

4095 ROXBURY COURT, GLENWOOD, MARYLAND

990882

SHEET

2
3

4.14.00