

7/10/89 1-2 PM
7/11/89 AM

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH
461-9933

01-185264
INDEXED

P 44577

A 31085

DISTRICT 1st

DATE 6/14/89

DATE SYSTEM APPROVED 7/11/89

INSPECTOR C. Williams

Fogle's Refuse & Septic Service, Inc.

IS PERMITTED TO INSTALL ☒ ALTER ☐

ADDRESS 558 R. Obrecht Road, Sykesville, Maryland 21784 PHONE 795-5870

SUBDIVISION Talbot's Last Shift ROAD 5219 Talbot's Landing Road 13B

PROPERTY OWNER Ralph W. Geuder

5219 Talot's Landing Road

ADDRESS _____

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES ☐ NO ☒

SEPTIC TANK CAPACITY 1000 GALLONS NUMBER OF BEDROOMS 3

TRENCHES - 180 sq. ft. per bedroom. Trench to be 3 feet wide. Inlet 4 feet below original grade. Bottom maximum depth 6 feet below original grade. Effective area begins at 4 feet below original grade. 2 feet of stone below distribution pipe.

LOCATION - Start the first trench 80 feet from the ^{WEST} lot line that borders Lots 14B and 14C; and 90 feet from the ^{SOUTH} lot line that borders Lot 13A. Run trenches along contour toward Lot 13A.

NOTE - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank. OK/CW

PLANS APPROVED BY C. Williams

REVISED

DATE 9/22/86

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX, TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(IES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(IES)

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS

PERMIT VOID AFTER TWO YEARS


NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APROVAL ON THIS PERMIT

*CALL 461-9933 FOR INSPECTION OF SEPTIC SYSTEMS.

A 31085

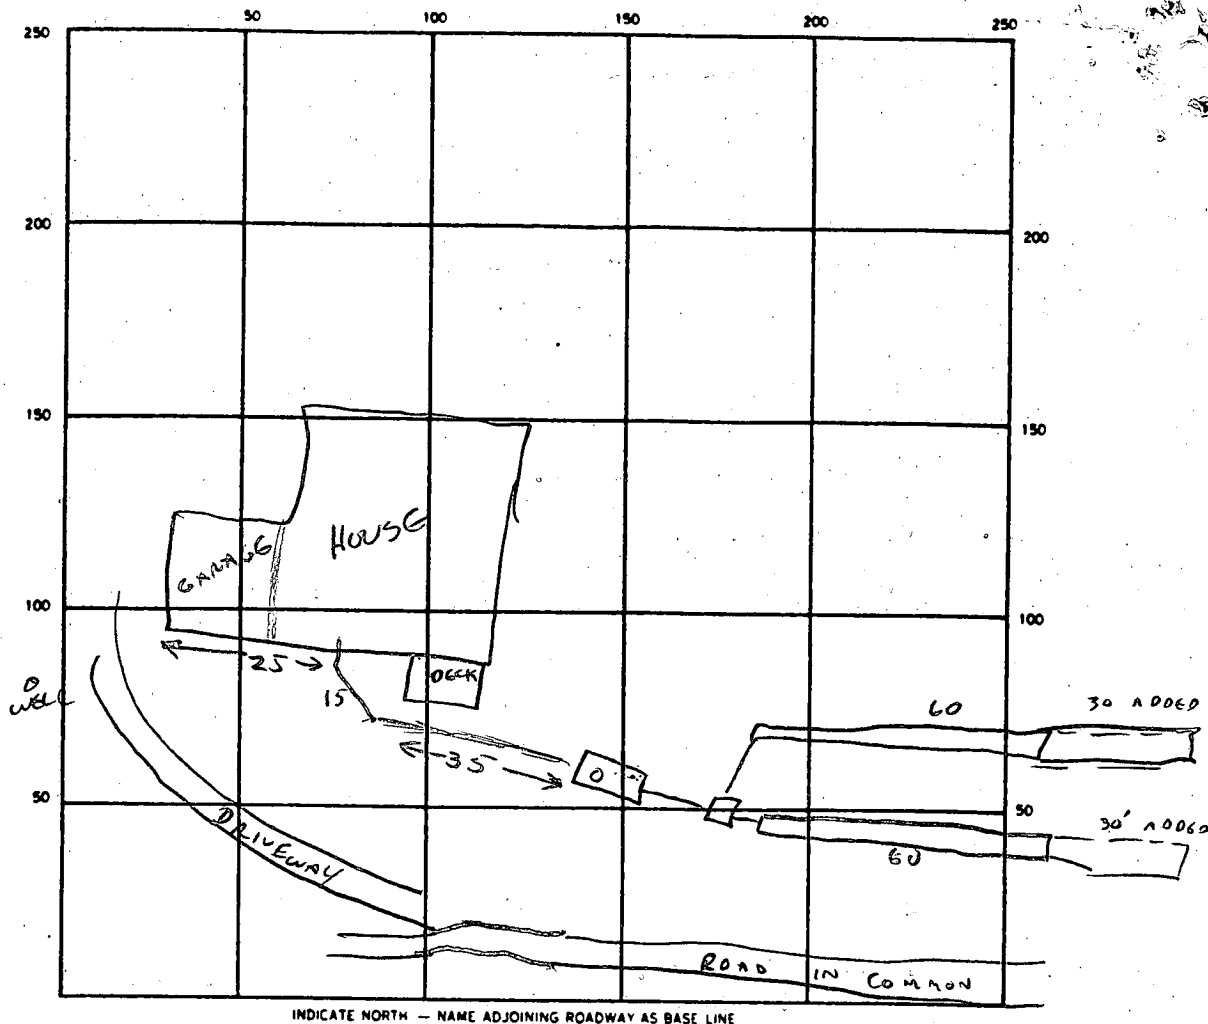

INDICATE NORTH — NAME ADJOINING ROADWAY AS BASE LINE

SEPTIC TANK LEVEL ✓

CLEANOUTS ST✓

DISTRIBUTION BOX LEVEL ✓

DRAIN FIELD/TILE FIELD DEPTH 6 FT. TRENCH WIDTH 3 FT. INLET DEPTH 4 FT.

EFFECTIVE GRAVEL DEPTH 2 FT. TOTAL LENGTH 180 FT.

NUMBER OF TRENCHES 2 - 90' EACH ONE SIDEWALL/BOTTOM AREA 540 SQ. FT.

DRYWELL INSIDE DIAMETER — FT. EFFECTIVE DEPTH BELOW INLET — FT.

ABSORBENT AREA 540 SQ. FT.

REMARKS 120' TRENCH INSTALLED, ADDITIONAL 60' REQUIRED 7/10/89 C.W.
1 CONTINUED TO ADD ADDITIONAL 30' TO EACH TRENCH AND COVER 7/11/89 C.W.
WORK COVERED 7/11/89 M.R.

DATE SYSTEM APPROVED 7/11/89

INSPECTOR C. Williams

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

A 31085

P _____

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P.O. BOX 476 ELLICOTT, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT 1st.

DATE 12/18/80

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Howard Associates Ralph Groden - 730-4925

ADDRESS _____ PHONE Don Reuwer 465-4920

PROPERTY LOCATION:

SUBDIVISION Talbots Last Shift LOT NO. 13B

ROAD AND DESCRIPTION Ilchester Road 5219 Talbots Landing Rd.

SIZE OF LOT (?) TYPE BLDG. 3 or 4 Bedrooms

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER

ANY CIRCUMSTANCES.

SIGNATURE OF APPLICANT [Signature]

☒ HOLD APPROVED BY S. Abner FOR Shallow trenches only DATE 2-3-89

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

☒ REASONS FOR REJECTION OR HOLDING 1/14/81 for certified holes, houses siting well.

sites in an approved area and in relation with
other lots adjacent to this lot.

BLDG. PERMIT SIGNED

AND RETURNED 8-3-89

C.B.S.

BP23324


THIS IS NOT A PERMIT

138

SOIL PROFILE



FIELD SHEET

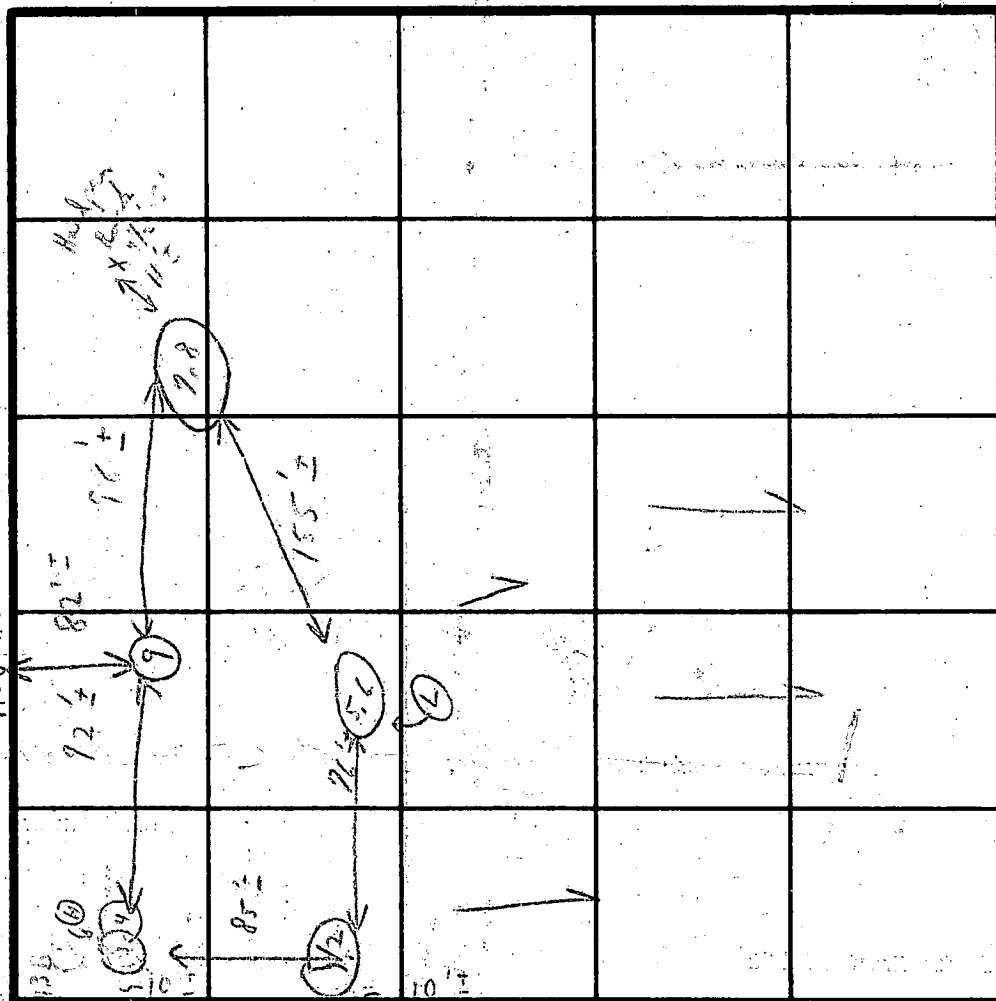

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

SOIL PROFILE

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
12/1/80	1	3'	10:49	10	10	10:50	1/2
3-1 SANDY	2	8'	10:50	10	10	10:52	1 1/2
4' clay	3	4'	11:02	11	11:04	11:04	1
(H) 4	4	8'	11:02	11:03	11:03	11:05	2
4' clay	5	5'	10:54	11	10:55	11	1
SANDY	(D) 6	1'	11:03	(5:9' cannot)	11:03	11:05	2
1'-3 1/2' clay	7	3 1/2'	12:26	12:28	12:28	12:30	4
3 1/2'-8 1/2'	8	8 1/2'	12:26	12:27	12:27	12:29	2
1'-5' clay	9	12 1/2'	12:26	12:28	12:28	12:30	4
5'-12 1/2'							

REMARKS

(TESTS IN BRUSH & TREES)

TYPE OF SOIL

TESTED BY

C. B. S. + S. K.

ALSO PRESENT

Hold

for different holes, loose sites, will be
and check adjacent to (2) Kithman
+ 1 Helon

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P.O. BOX 476 ELLICOTT, MARYLAND 21043
TELEPHONE: 992-2330

A 31085

P _____

DISTRICT 1st.

DATE 12/18/80

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Howard Associates

ADDRESS _____ PHONE Don Reuwer 465-4920

PROPERTY LOCATION:

SUBDIVISION Talbots Last Shift LOT NO. _____

ROAD AND DESCRIPTION Ilchester Road

SIZE OF LOT (?) TYPE BLDG. 3 or 4 Bedrooms

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER

ANY CIRCUMSTANCES.

SIGNATURE OF APPLICANT _____

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____


THIS IS NOT A PERMIT

SOIL PROFILE

SEE
EACH
HOLE
BELOW.



FIELD SHEET



13A 13B

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

REMARKS

(TESTS IN BRUSH & TREES)

Hold

TYPE OF SOIL

for certified poles, house site, well site
and check adjacent lots.

C.B. 2 Referrals

TESTED BY

C.B. ✓ + S.K.

ALSO PRESENT

41 Heiden

B 1 4588	SEQUENCE NO. (OEP USE ONLY)	STATE OF MARYLAND PERMIT TO DRILL WELL please print or type	OEP PERMIT NUMBER WE-81-1761
Date Received 8 13		B 3 LOCATION OF WELL 8 COUNTY HOWARD	
OWNER INFORMATION 15 Last Name Owner First Name 34		23 SUBDIVISION 42	
36 Street or RFD 55		SECTION 44 46 LOT 48 50 P.709	
57 Town 70 State 72 Zip 76		52 NEAREST TOWN 71	
DRILLER INFORMATION Driller's Name 77 License No. 80		MILES FROM TOWN (enter 0 if in town) 73 76 77 78	
Firm Name		B 4 DIRECTION OF WELL FROM TOWN (CIRCLE BOX)	
Address		11 NEAR WHAT ROAD 30	
Signature Date		ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX)	
B 2 WELL INFORMATION		APPROX. PUMPING RATE (GAL. PER MIN.) 8 12	
AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 14 20		34 37 DISTANCE FROM ROAD ENTER FT or MI 38 39	
USE FOR WATER (CIRCLE APPROPRIATE BOX) D HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY)			
F FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION)			
I INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT)			
P PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE HEALTH DEPARTMENT APPROVAL)			
T TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)			
APPROXIMATE DEPTH OF WELL 24 28 FEET			
APPROXIMATE DIAMETER OF WELL 6 NEAREST INCH			
METHOD OF DRILLING (circle one) BORED (or Augered) JETTED Jetted & DRIVEN			
AIR-ROTARY AIR-PERCussion ROTARY (Hydraulic Rotary)			
CABLE REVERSE-ROTARY Drive-POINT			
other			
REPLACEMENT OR DEEPEINED WELLS (CIRCLE APPROPRIATE BOX) N THIS WELL WILL NOT REPLACE AN EXISTING WELL			
Y THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED			
S THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY			
D THIS WELL WILL DEEPEIN AN EXISTING WELL			
PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEINED (IF AVAILABLE) 41 52			
Not to be filled in by driller (OEP USE ONLY)			
APPROP. PERMIT NUMBER 54 63			
FORCE 67 68 WRITE INITIALS IN BOX PERMIT No. 70 71 72 73 74 75 76 77 78 79			
SPECIAL CONDITIONS			

DRILLER

C1 5396

SEQUENCE NO.
(OEP USE ONLY)STATE OF MARYLAND
WELL COMPLETION REPORTFILL IN THIS FORM COMPLETELY
PLEASE PRINT OR TYPETHIS REPORT MUST BE SUBMITTED WITHIN
45 DAYS AFTER WELL IS COMPLETED.COUNTY
NUMBER

A-31085

(THIS NUMBER IS TO BE PUNCHED
IN COLS. 3-6 ON ALL CARDS)

DATE Received

8 1 13

DATE WELL COMPLETED

12 17 86

Depth of Well

22 360 26
(TO NEAREST FOOT)PERMIT NO.
FROM "PERMIT TO DRILL WELL"

MD-81-1761

OWNER

GAUDER

RALPH

STREET OR RFD

last name first name
CHESTER RD.

TOWN

ELICOTT CITY

SUBDIVISION

TALBOTS LAST SHIFT

SECTION

P. 709

LOT

13 B

WELL LOG

Not required for driven wells

STATE THE KIND OF FORMATIONS
PENETRATED, THEIR COLOR, DEPTH,
THICKNESS AND IF WATER BEARINGDESCRIPTION (Use
additional sheets if needed)

FEET

FROM TO

Check
if water
bearing

Top soil
orange clay
sand and
gravel
gray clay
gray mica
sandstone
gray mica
gray mica
w/ flint
gray mica

0 1
1 2
5 30
30 45
45 70
70 85
75 90
90 280
280 360

OR
C

GROUTING RECORD

WELL HAS BEEN GROUTED
(Circle Appropriate Box)yes no
Y N
44 44

TYPE OF GROUTING MATERIAL

CEMENT CM BENTONITE CLAY BC

NO. OF BAGS

NO. OF POUNDS

GALLONS OF WATER

DEPTH OF GROUT SEAL (to nearest foot)

from 0 48 TOP 52 ft. to 48 54 BOTTOM 58 ft.
(enter 0 if from surface)casing
types
insert
appropriate
code
below

CASING RECORD

ST CO
STEEL CONCRETE
PL OT
PLASTIC OTHERMAIN Nominal diameter Total depth
CASING top (main) casing of main casing
TYPE (nearest inch) (nearest foot)

S T 60 61 63 64 52 66 70

EACH
CASING

OTHER CASING (if used)

diameter depth (feet)
inch from to

inch from to
inch from to

screen type
or open hole
insert
appropriate
code
below

SCREEN RECORD

ST BR HO
STEEL BRASS OPEN
HOLE
PL PL OT
PLASTIC OTHER

C 2

EACH
SCREEN

DEPTH (nearest ft.)

8 9 11 15 17 21
23 24 26 30 32 36
38 39 41 45 47 51

SLOT SIZE 1 2 3

DIAMETER OF SCREEN (NEAREST INCH)
56 60

GRAVEL PACK

IF WELL DRILLED WAS
FLOWING WELL INSERT
F IN BOX 68

OEP USE ONLY

(NOT TO BE FILLED IN BY DRILLER)

T (E.R.O.S.) WQ
70 72 74 75 76
TELESCOPE LOG OTHER DATA
CASING INDICATOR

C 3

PUMPING TEST

HOURS PUMPED (nearest hour)

PUMPING RATE (gal. per min. to nearest gal.)

METHOD USED TO MEASURE PUMPING RATE

WATER LEVEL (distance from land surface)

BEFORE PUMPING

WHEN PUMPING

TYPE OF PUMP USED (for test)

A air P piston T turbine
C centrifugal R rotary O other (describe below)
J jet S submersible

PUMP INSTALLED

DRILLER WILL INSTALL PUMP YES NO
(CIRCLE) (YES OR NO)
IF DRILLER INSTALLS PUMP, THIS SECTION
MUST BE COMPLETED FOR ALL WELLS
EXCEPT HOME USE
TYPE OF PUMP INSTALLED
PLACE (A,C,J,P,R,S,T,O)
IN BOX - SEE ABOVE:

CAPACITY:
GALLONS PER MINUTE (to nearest gallon)

PUMP HORSE POWER

PUMP COLUMN LENGTH (nearest ft.)

CASING HEIGHT (circle appropriate box and enter casing height)

above LAND SURFACE (nearest foot)
below

LOCATION OF WELL ON LOT

SHOW PERMANENT STRUCTURE SUCH AS
BUILDING, SEPTIC TANKS, AND/OR
LANDMARKS AND INDICATE NOT LESS
THAN TWO DISTANCES
(MEASUREMENTS TO WELL)

50' well
100' 150' 200'

Well Permit No. HO - 81-1761
Location of property (road) ELLCHESTER RD
Subdivision TALBOTS LAST SHIFT Lot 13 Block Plat Sec. B
Well Driller GEORGE SASTERDAY Owner GEUNER RALPH

I. High rate pumping -- reservoir drawdown

Time pump started 12:45 Pumping rate 12 G.P.M.
Total time 15 min to reach pumping water level 107 ft. below M.P.

II. Recovery pump test data - observations to be recorded every 15 minutes

[illegible]

DISTR. BOX @ HIGH HOLE
 EXIST. EL. 404.30 ✓
 INVERT 400.30 ✓


TANK
 EXIST. EL. 403.0 ✓
 INV. OUT 400.6 ✓
 INV. IN 400.9 ✓

IN AT HOUSE 401.4 ✓ - BSMT

GR. EL. 404.0 ✓
 FIRST FLOOR 403.0 ✓
 BSMT 401.2 ✓

NO SEWER CONNECTION
 IN BASEMENT ✓

BMDG. PERMIT SIGNED
 AND RETURNED ~~28332~~ *JAM 2/3/89*
BP23324
SA

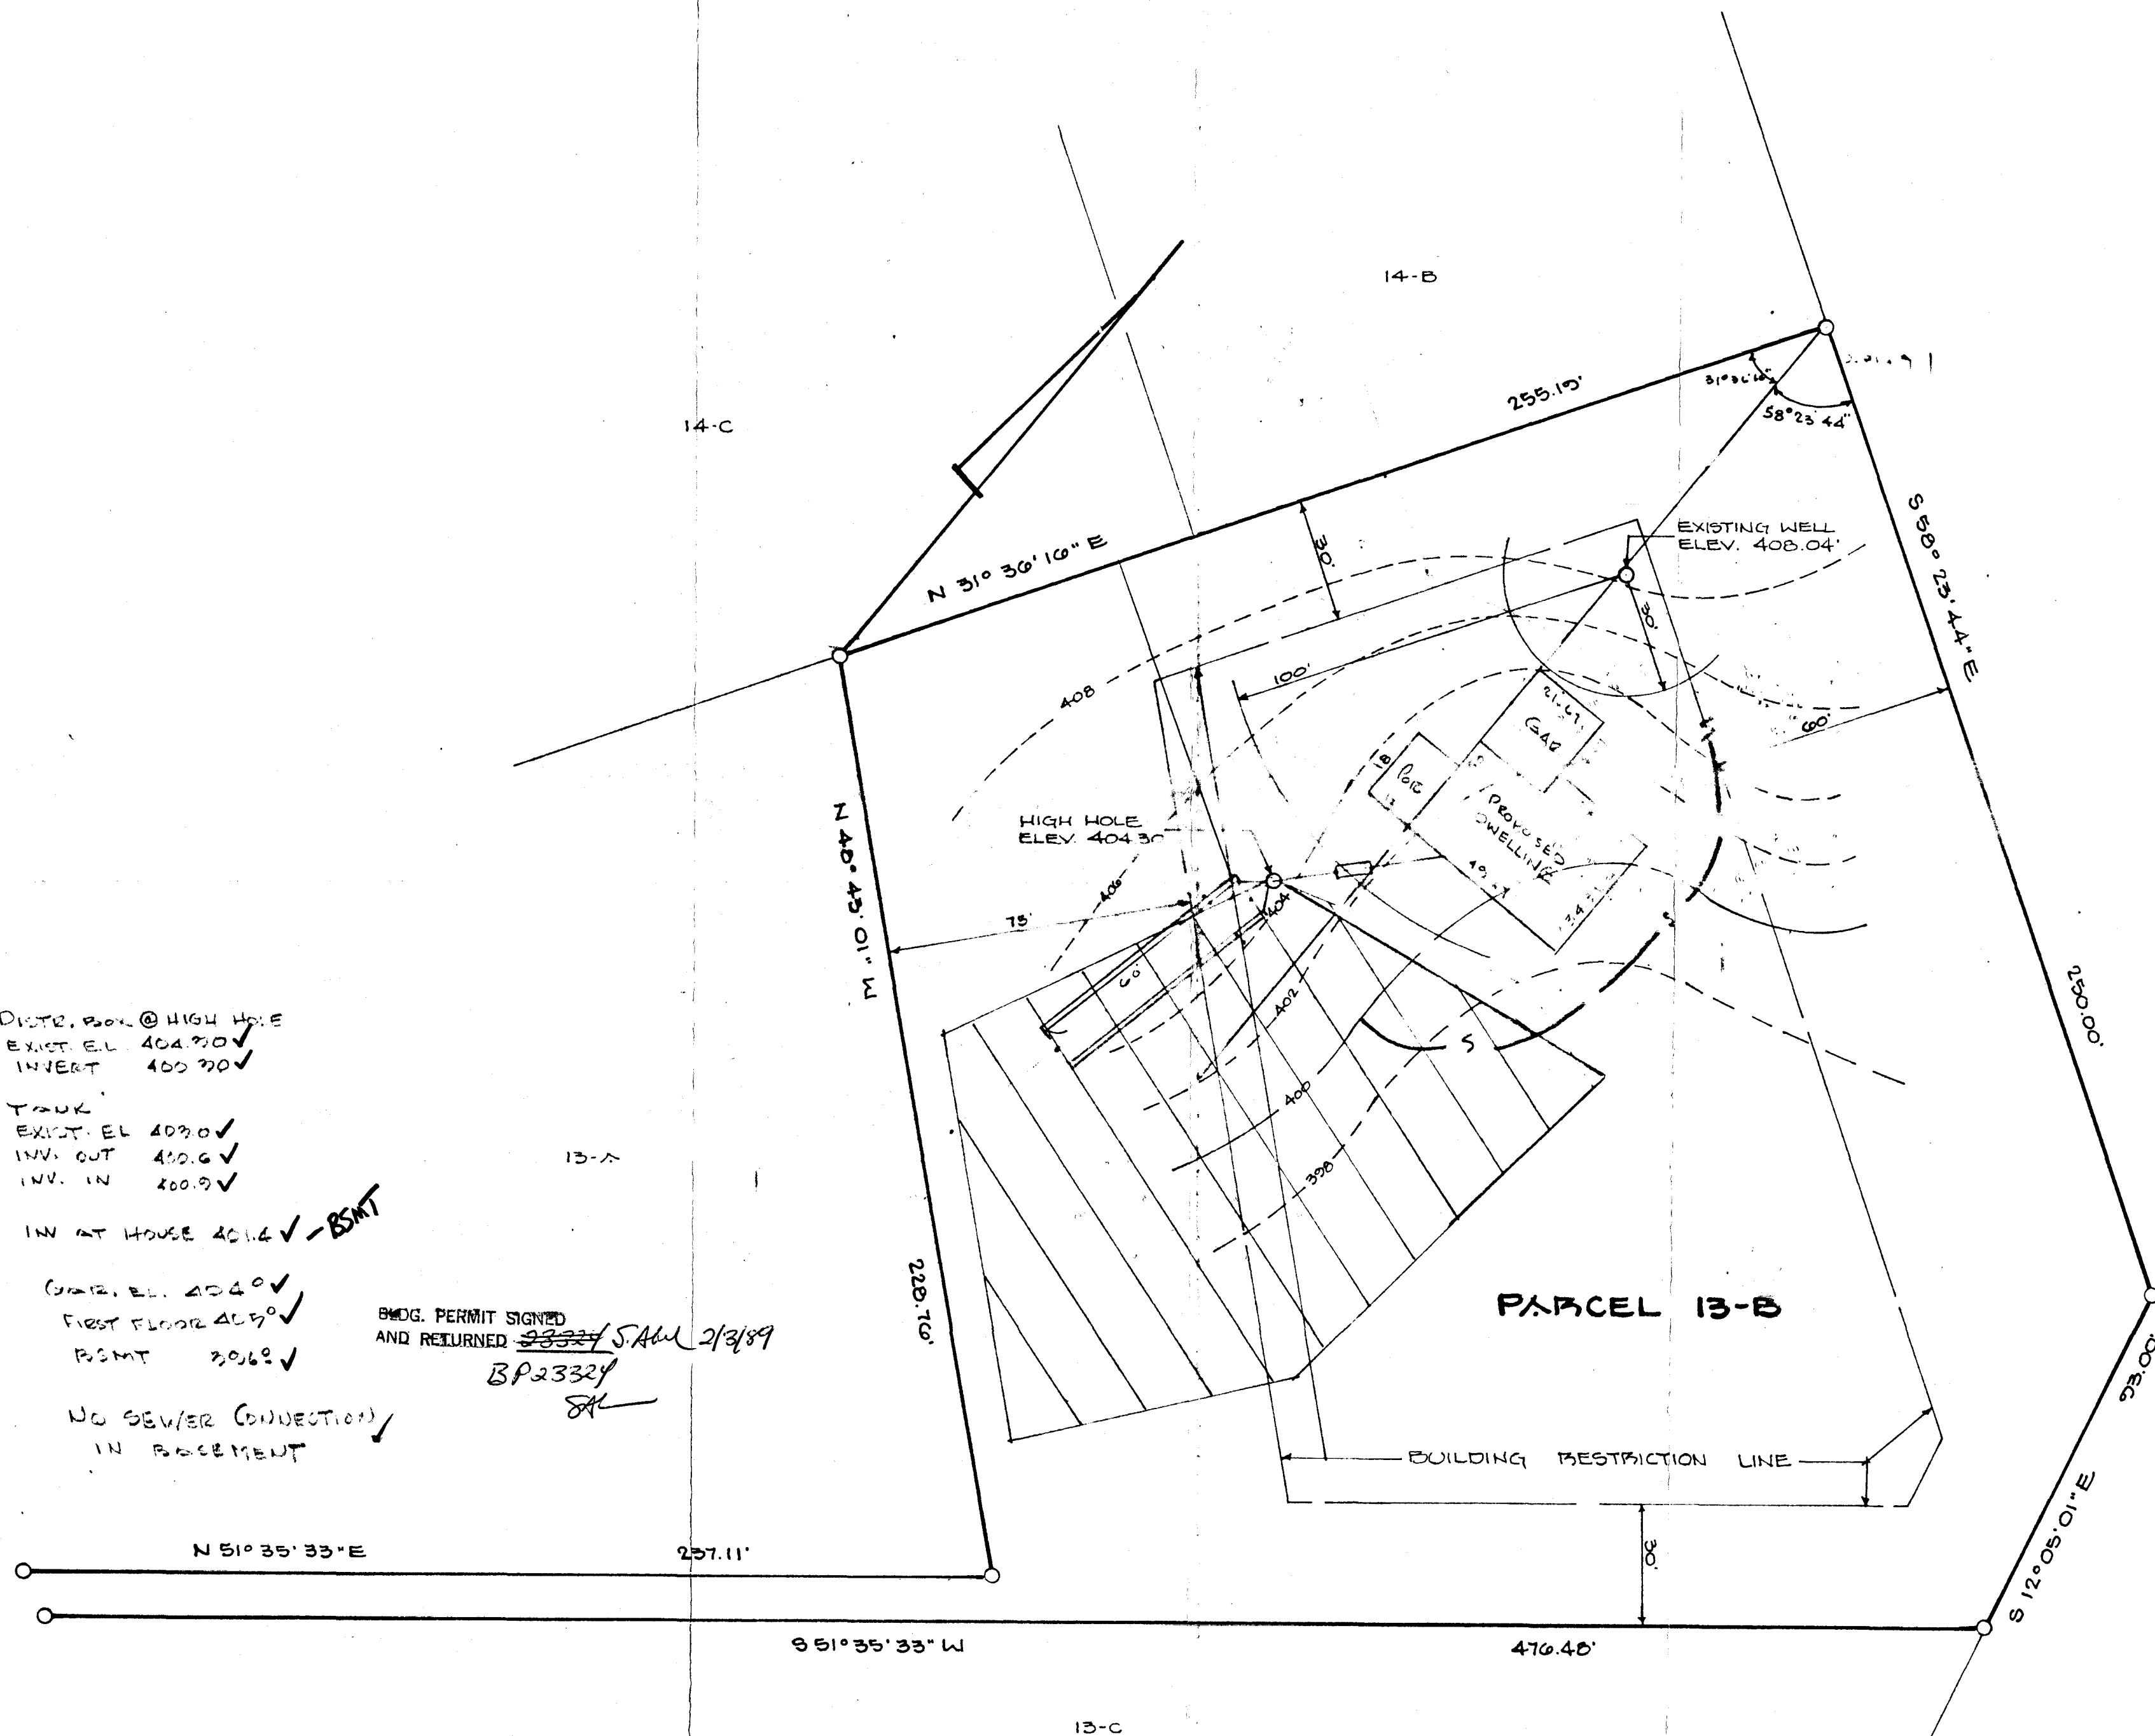

OWNER
 MR & MRS RALPH GEUDER
 9182 SERRANO HILLS ROAD
 COLUMBIA MD 21045
 730-4915


GEUDER RESIDENCE

PARCEL 13-B
 TAXPLOT'S LAST SHIFT
 TAX MAP 31, PARCEL 104
 FIRST ELECTION DISTRICT
 HOWARD COUNTY, MARYLAND

SCALE: 1"=30'
 DATE: 12.16.1988
 1-10.1989

M. & H. DEVELOPMENT ENGINEERS INC

SUITE 231, HARRIS CHOICE VIL. CTY.
 8485 HARRIS FARM ROAD
 COLUMBIA, MARYLAND 21044
 PHONE: 730-3000

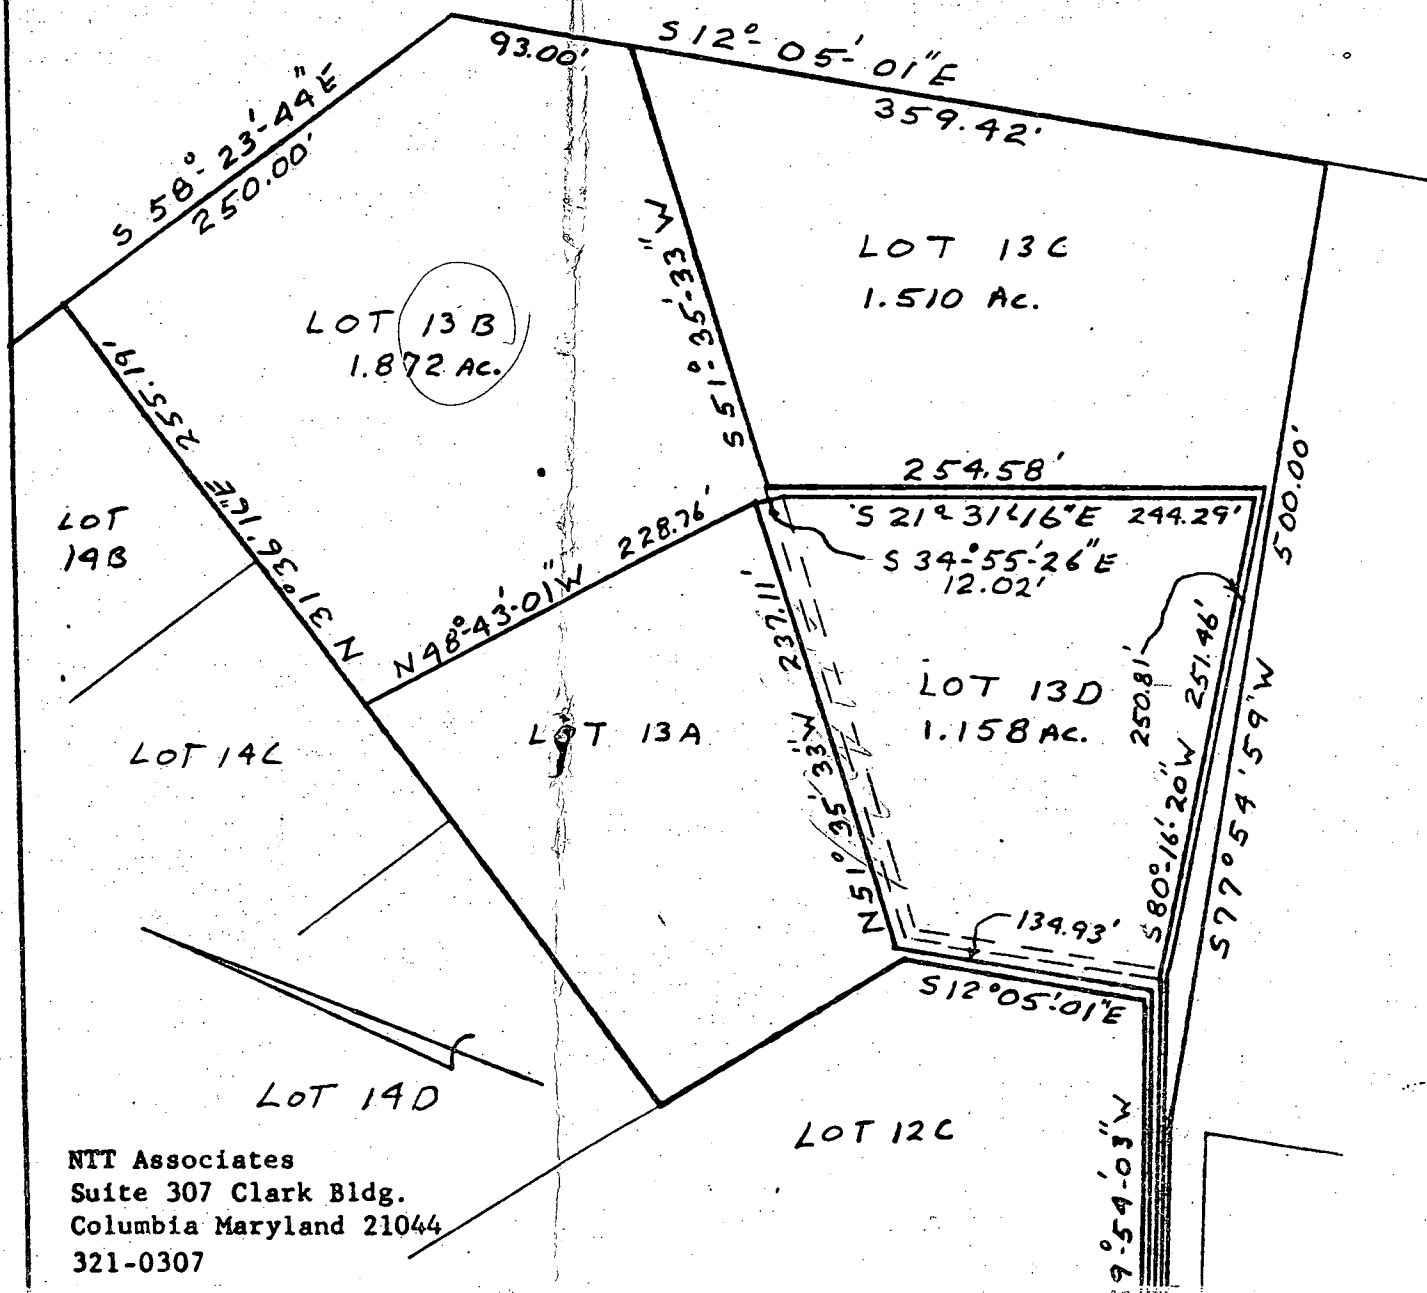


PLAT TO ACCOMPANY
 CONFIRMATORY DESCRIPTIONS
 OF LOTS
 13B, 13C, & 13D
 PROPERTY OF
 HOWARD ASSOCIATES
 1st ELECTION DISTRICT
 HOWARD COUNTY MARYLAND
 SCALE 1"=100'
 DATE 1/26/81

NTT Associates
 Suite 307 Clark Bldg.
 Columbia Maryland 21044
 321-0307

1-23-97 Met owner of property
Not eligible for perc testing

- insufficient area for septic installation which meets minimum setback requirement
- extremely limited soil conditions - maximum elevation change from stream to highest portion stream is approx. 5'
- No potential well site which could be maintained 100' and uphill from any septic
- Soil classifications are soft - bad severe for septic installation

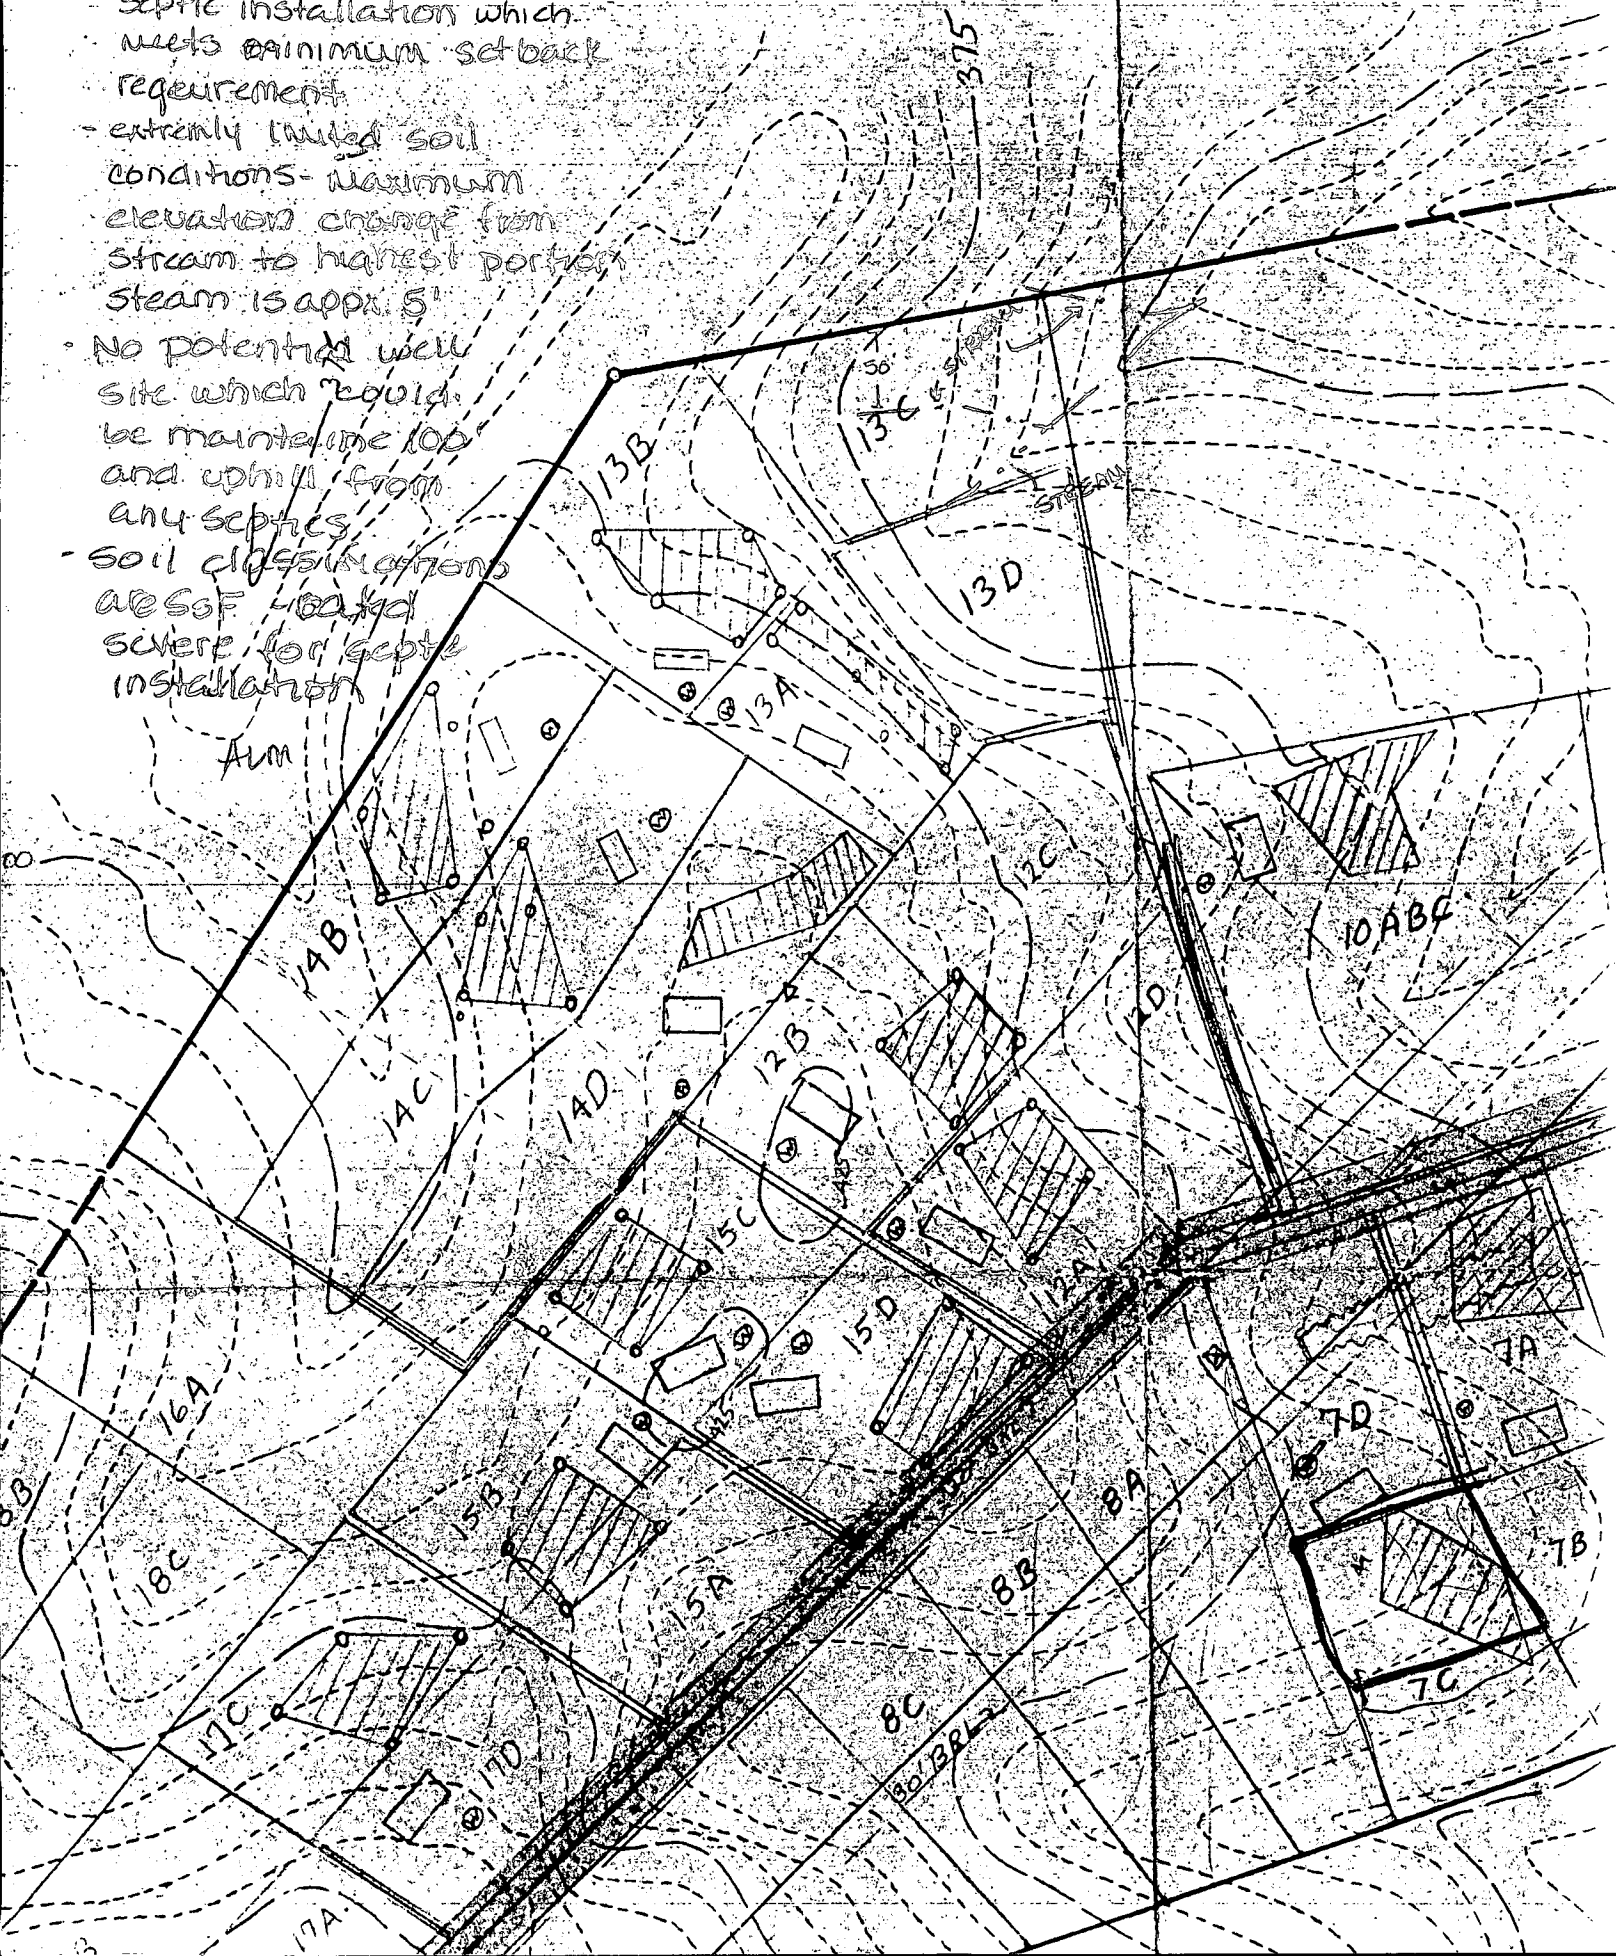

5/20/81

10D Enlarged
by C. Hudgins
See below
(Hudgins
City)



NOTES:


- 1) Perc test holes shown hereon have been field located.
- 2) Topography shown hereon is from the Howard County Topographic survey 1976, and has been field checked where pertinent.
- 3) Contours shown at 5' intervals.
- 4) Perc holes shown thus: O
- 5) Proposed water wells shown thus: W

6) This area indicates a private easement of approximately 10,000 square feet as required by the Maryland State Department of Health and Mental Hygiene for individual disposal. Improvements of any kind in this area are restricted until public sewage is available and servicing any residential structures constructed on this site. This easement shall become null and void upon connection to a public sewage system.

MASTER PERCOLATION TEST PLAT
TALBOT'S LAST SHIFT

Property of
Howard Associates
1st Election District
Howard County Md.
Scale 1"=200' Date 9-9-80

NTT Associates
SUITE 307
CLARK BLDG.
COLUMBIA Md. 21044

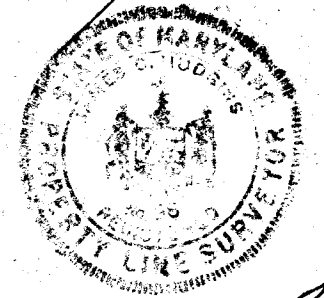

J. Carl Hudgins PLS 296

APPLICATION

PERCOLATION TESTING

A _____

P _____

HOWARD COUNTY HEALTH DEPARTMENT

BUREAU OF ENVIRONMENTAL HEALTH

3525-H ELLICOTT MILLS DRIVE/ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 313-2640

DISTRICT _____

DATE _____

*No fee-
site inspection
will be done to assess
the potential for
buildable lot status
AUM*

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST PRIOR TO APPLICATION FOR PERMIT TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Ralph W Gender

ADDRESS 5219 Talbots, Lndg. E.C. MD 21043 PHONE (410) 788-3764

AGENT OR PROSPECTIVE BUYER _____

ADDRESS _____ PHONE _____

PROPERTY LOCATION:

SUBDIVISION Talbot's Last Shift LOT NO. 13C

ROAD AND DESCRIPTION _____

TAX MAP 31 PARCEL # _____

SIZE OF LOT 1.5 A TYPE BLDG. _____
(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE

FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO

COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT. Ralph W Gender
(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

DISAPPROVED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____

REASONS FOR REJECTION OR HOLDING _____

PERCOLATION TEST PLAT/PRELIMINARY PLAT - TITLE OR I.D. # _____ DATE _____

SITE DEVELOPMENT PLAN/FINAL PLAT - TITLE OR I.D. # _____ DATE _____


THIS IS NOT A PERMIT

SOIL PROFILE

0'

SOIL PROFILE

C

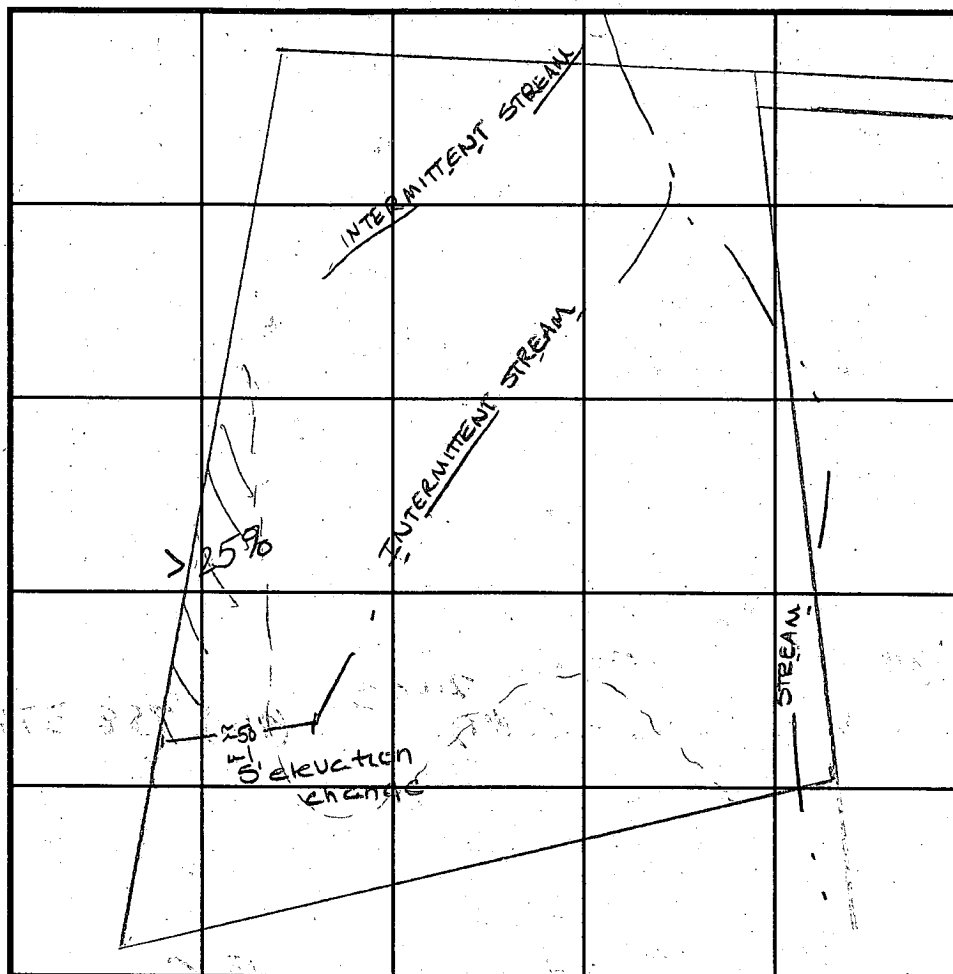

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

[illegible]

REMARKS No place to test w/ sufficient distance from stream &
leave an acceptable well site

TYPE OF SOIL _____

TESTED BY A. McMillen ALSO PRESENT _____

TRENCH DESIGN DATA: AVERAGE PERCOLATION TIME _____ TRENCH WIDTH _____

INLET DEPTH _____ MAXIMUM BOTTOM DEPTH _____ SQ. FT./BEDROOM _____

OWNER: RALPH GOODEN
 ADDRESS: 5219 TALBOTT LANDING
788-3764

DATE REQUESTED: 1/23/97 ANYTIME
 DRILLER: _____
 WELL TAG # _____
 COUNTY # _____

PROPOSAL: LEFT AT "GANGED" MAILBOXES - PRIVATE DRIVE
ALL THE WAY BACK - LOOK FOR FENCE & GARAGE.

LOCATION DIAGRAM

REQUESTS PERC POTENTIAL
 ASSESSMENT TO
 EITHER APPLY FOR TESTING
 OR TO PETITION FOR
 TAX RELIEF AS NON-BUILDABLE,
 HAS QUESTIONS WHETHER SITE CONDITIONS
 ALLOW FOR ANY OPPORTUNITY
 (IF AN ADEQUATE TEST PLAN
 CANNOT BE ACCOMPLISHED.
 THEN THERE WOULD BE
 GROUNDS FOR A DISAPPROVAL
 LETTER).

COMMENTS: _____

 DATE: _____ INSPECTOR: _____

6/21/89
noon
6/21/89
into pm

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

INDEX

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH
992-2330

ELLICOTT CITY

DISTRICT 1st

DATE 6/21/84

Approved 6/21/84
Stanger
P 34016
A 31084

R.L.O. Contractors

IS PERMITTED TO INSTALL X ALTER

ADDRESS 7469 Flamewood Drive, Clarksville, MD PHONE

SUBDIVISION Talbot's Last Shift ROAD 5053 5215 Talbot's Landing LOT 13A

PROPERTY OWNER Donald G & Livinas Brugman

ADDRESS 45 Bernadotte Court
Baltimore, MD 21234

7/10/89 1-2 PM
7/11/89 AM

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

INDEXED

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH
461-9933

DISTRICT 1st

DATE 6/14/89

DATE SYSTEM APPROVED 7/11/89

INSPECTOR C. Willan

P 44577
A 31085

Fogle's Refuse & Septic Service, Inc.

IS PERMITTED TO INSTALL X ALTER

ADDRESS 558 R. Obrecht Road, Sykesville, Maryland 21784 PHONE 795-5870

SUBDIVISION Talbot's Last Shift ROAD 5219 Talbot's Landing Road LOT 13B

PROPERTY OWNER Ralph W. Geuder

ADDRESS 5219 Talot's Landing Road

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES NO X

SEPTIC TANK CAPACITY 1000 GALLONS NUMBER OF BEDROOMS 3

TRENCHES - 180 sq. ft. per bedroom. Trench to be 3 feet wide. Inlet 4 feet below original grade. Bottom maximum depth 6 feet below original grade. Effective area begins at 4 feet below original grade. 2 feet of stone below distribution pipe.

LOCATION - Start the first trench 80 feet from the ^{WEST} lot line that borders Lots 14B and 14C; and 90 feet from the lot line that borders Lot 13A. Run trenches along