

4/12/89 noon

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH
461-9933

INDEXED

P 4361P

A 28626

DISTRICT 5th

DATE 2/17/89

DATE SYSTEM APPROVED 4/12/89

INSPECTOR R17

Wayde Souder/Wesmar Corporation

IS PERMITTED TO INSTALL X ALTER

ADDRESS 13990 Triadelphia Mill Road, Dayton, Maryland 21036 PHONE 531-2166

SUBDIVISION Cox Property ROAD 13945 Clarksville Pike LOT 8

PROPERTY OWNER John Belgard Souder Builders, Inc.

ADDRESS

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES NO X

SEPTIC TANK CAPACITY 1000 GALLONS NUMBER OF BEDROOMS #3

TRENCHES - 180 sq. ft. per bedroom. Trench to be 3 feet wide. Inlet 3.5 feet below original grade. Bottom maximum depth 5.5 feet below original grade. Effective area begins at 3.5 feet below original grade. 2 feet of stone below distribution pipe.

LOCATION - Place the distribution box 350 feet up the left (606.09') lot line and 95 feet off the same lot line as seen when facing the lot from 4-Wheel Drive. Run trenches on contour toward the left and right lot lines.

NOTE - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank. OK/CW

PLANS APPROVED BY Sid Abel

DATE 9/08/87

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX, TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCHES ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCHES

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS

PERMIT VOID AFTER TWO YEARS


NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT

*CALL 461-9933 FOR INSPECTION OF SEPTIC SYSTEMS.

SEE
PLAN
FOR
COMPLETE
LOT SKETCH

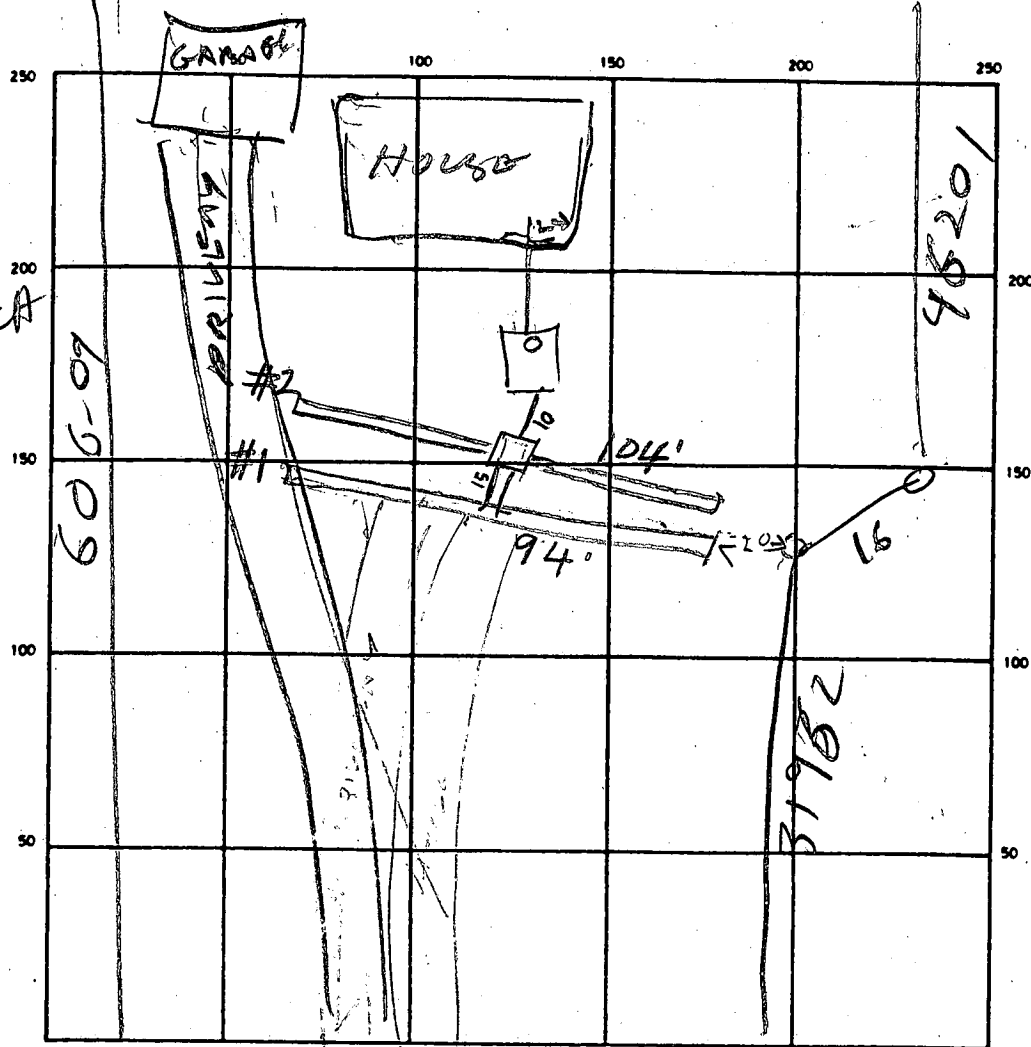

INDICATE NORTH — NAME ADJOINING ROADWAY AS BASE LINE

SEPTIC TANK. LEVEL OK 1000

CLEANOUTS OK

DISTRIBUTION BOX. LEVEL OK

DRAIN FIELD/TILE FIELD. DEPTH 5.5 FT. TRENCH WIDTH 3 FT. INLET DEPTH 1 FT.

EFFECTIVE GRAVEL DEPTH 2 FT. TOTAL LENGTH 94 FT. 104 FT. 198 FT.

NUMBER OF TRENCHES 2 ~~ONE SIDE WALL~~/BOTTOM AREA 594 SQ. FT.

DRYWELL INSIDE DIAMETER FT. EFFECTIVE DEPTH BELOW INLET FT.

ABSORBENT AREA SQ. FT.

REMARKS 4/12/89 LOCATION OK TRENCHES OK WATER
WELL NEAR ROAD (4 WHEEL DRIVE)

DATE SYSTEM APPROVED 4/12/89

INSPECTOR Raymond Hodges

APPLICATION

A 28626

SEWAGE DISPOSAL TESTING

P _____

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICESP. O. BOX 476, ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 465-5000, EXT. 356SYSTEM ^{1st} DISTRICT 5th
DATE 7/1/78TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER E. E. Cox Saunders Builders, Inc.ADDRESS 13951 Clarksville Pike, Highland, Md. PHONE 924-2541

PROPERTY LOCATION:

SUBDIVISION _____ LOT NO. part of lot 8ROAD AND DESCRIPTION 13945 Clarksville Pike, behind existing property aboveSIZE OF LOT 2.505 acres TYPE BLDG. 3 or 4

NUMBER OF BEDROOMS _____

IF NOT SINGLE RESIDENCE DESCRIBE _____

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

SIGNATURE OF APPLICANT Geraldine CoxAPPROVED BY G. Keller FOR shallow DATE 7 Sept 78
(KIND OF SYSTEM)REJECTED BY _____ FOR _____ DATE _____
(KIND OF SYSTEM)HOLD PENDING FURTHER TESTS G. Keller DATE 22 Aug 78REASONS FOR REJECTION OR HOLDING Recommend shallow test. GLK 22 Aug 78Hold for plot GLK 25 Sept 78

BDDG. PERMIT SIGNED

AND RETURNED 2-15-81BP 23573
SL

THIS IS NOT A PERMIT

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

DATE	TEST NO.	DEPTH	PRE-WET		TEST		TIME
			START	STOP	START	STOP	
8/17/78	4S	2	256	258	258	301	3
	4D	10 1/2	hard packed -		visual		
	1 - 3	Visuals					
8/29/78	5S	3	202	204	204	208	4
	5D	13	201	203	203	207	4
	6S	2	223	225	225	230	5
	6D	10	220	223	223	226	3
	7S	3'	239	240	240	244	4
	7D	12'	234	237	237	240	3
	8S	3	306	308	308	311	3
	8D	10	304	307	307	315	8
	9S	3	good	soil at	3'		
	9D	12	251	254	254	258	4
	10S	2'	320	322	322	325	3
	10D	12'	322	325	325	330	5

Aug time = 4

= 120/BR

max = 8'

3 → 9 = 5

REMARKS Heavy woods 3 underbrush, sloping steep in some areas

TYPE OF SOIL _____

TESTED BY


GLK

ALSO PRESENT: E Cox

Cox Prop - Sub. of
lot 8

18 Aug 78 ① → ④

29 Aug 78

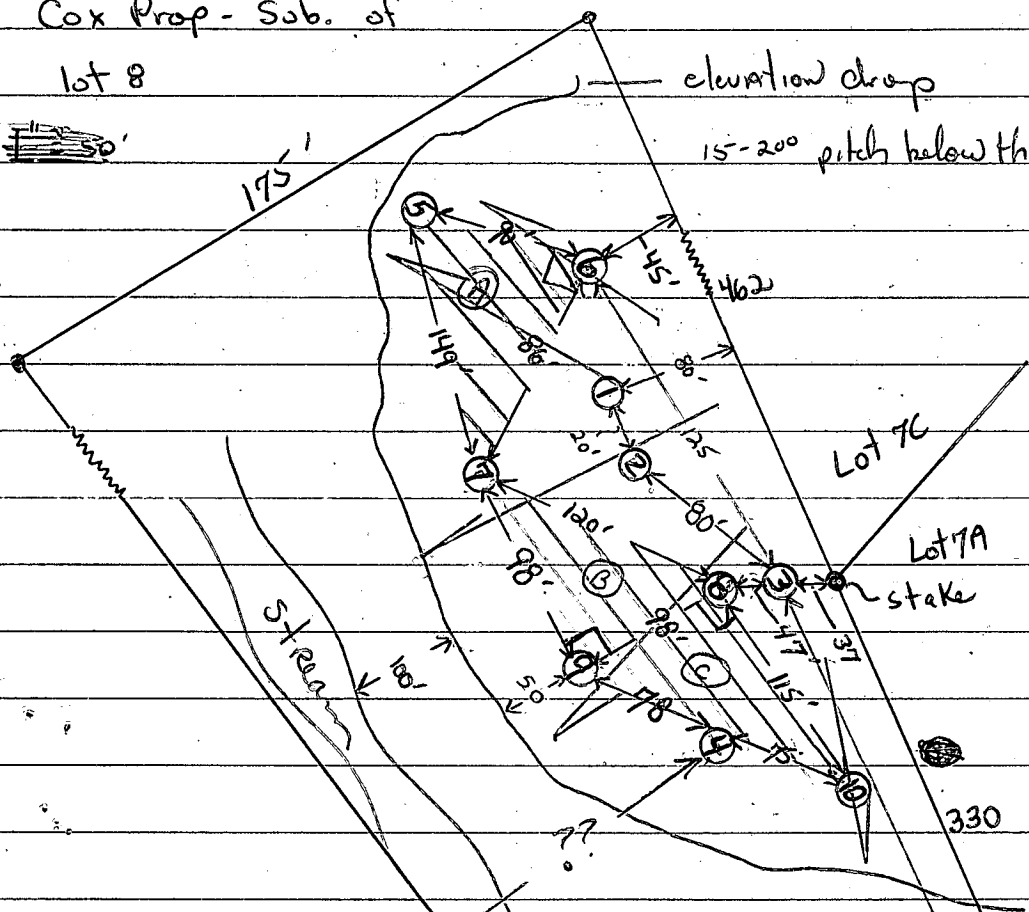

$$\text{Area A} = \frac{1}{2}(90)(86) = 3870$$

$$\text{Area B} = \frac{1}{2}(98)(98) = 4802$$

$$\text{Area C} = \frac{1}{2}(98)(115) = 5635$$

$$\text{Total} = \pm 14,307 \text{ ft}^2$$

Hole ① → ③

OG
CLAYEY
LOAM
4'
WEATHERED
SHALE -

Hole ④ + ⑥ → ⑨

OG
CLAYEY
LOAM
3'
SHALY
SAND

8'
HARD
BOTTOM

10-12' HARD BOTTOM

Hole ⑤ + ⑩

OG
CLAYEY
LOAM
2'
SANDY
LOAM
10'

Elevation:

⑧ is high

⑥ is next high


④ is low

Mr. Cox stated that he was not
going to build on lot in near future

Recommendations: Shallow system using
perc hole ⑧ for system

Area (triangle ③⑥⑦) could probably be
use for repair.

65
R/W TO RT 108

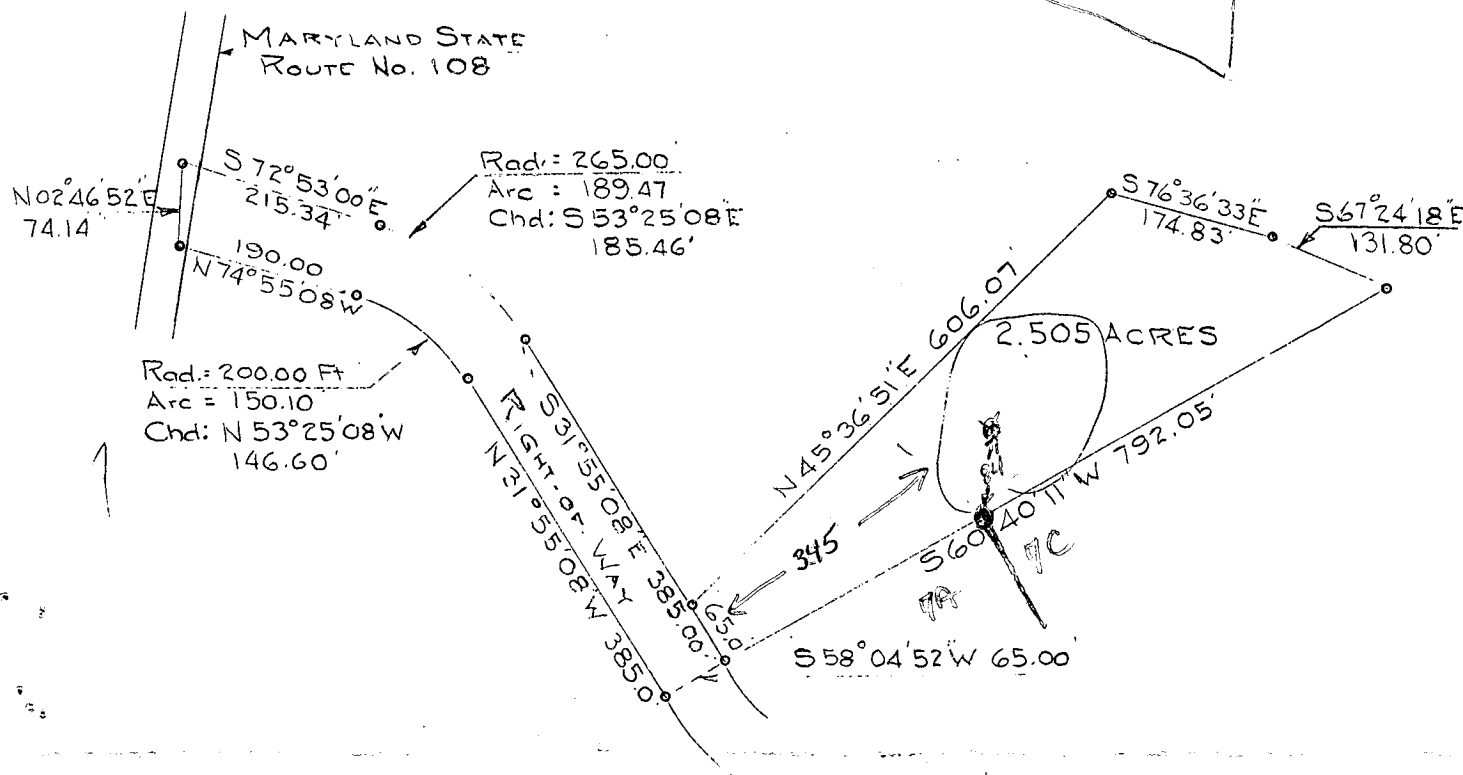

PLAT OF SURVEY
 FOR
 E. F. COX
 FIFTH ELECTION DIST. HOWARD COUNTY,
 HIGHLAND, MARYLAND.
 SCALE: 1 IN. = 200 FT. OCT. 10, 1973.

e: The lot shown hereon complies with the
 minimum ownership and lot area as required
 the Maryland State Health Department.

proved: Private Water & Private Sewer

Claude M. Stirling



ward County Health Officer

Date

A-3704

$$\begin{array}{r}
 70 \quad 10,000 \\
 \underline{143} \\
 7 \mid 1000 \\
 \underline{7} \\
 30 \\
 \underline{28} \\
 20
 \end{array}$$

© 70 E

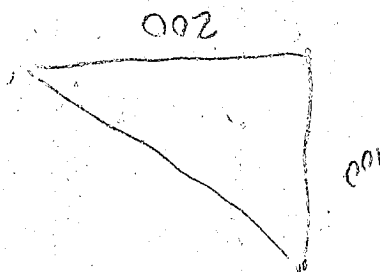


SITE PLAN
#13951 ROUTE 108
5TH ELECTION DIST. HOWARD CO. MD
SCALE 1"=50'
MAY 1987



JOHN C. MELLEMA SR. INC.
LAND SURVEYORS
6100 BALTO NATL PIKE BALTIMORE MD 21228
301-744-8860

PREPARED BY:

NOTE: 1 ELEVATIONS SHOWN HEREON ARE BASED ON ASSUMED DATUM.

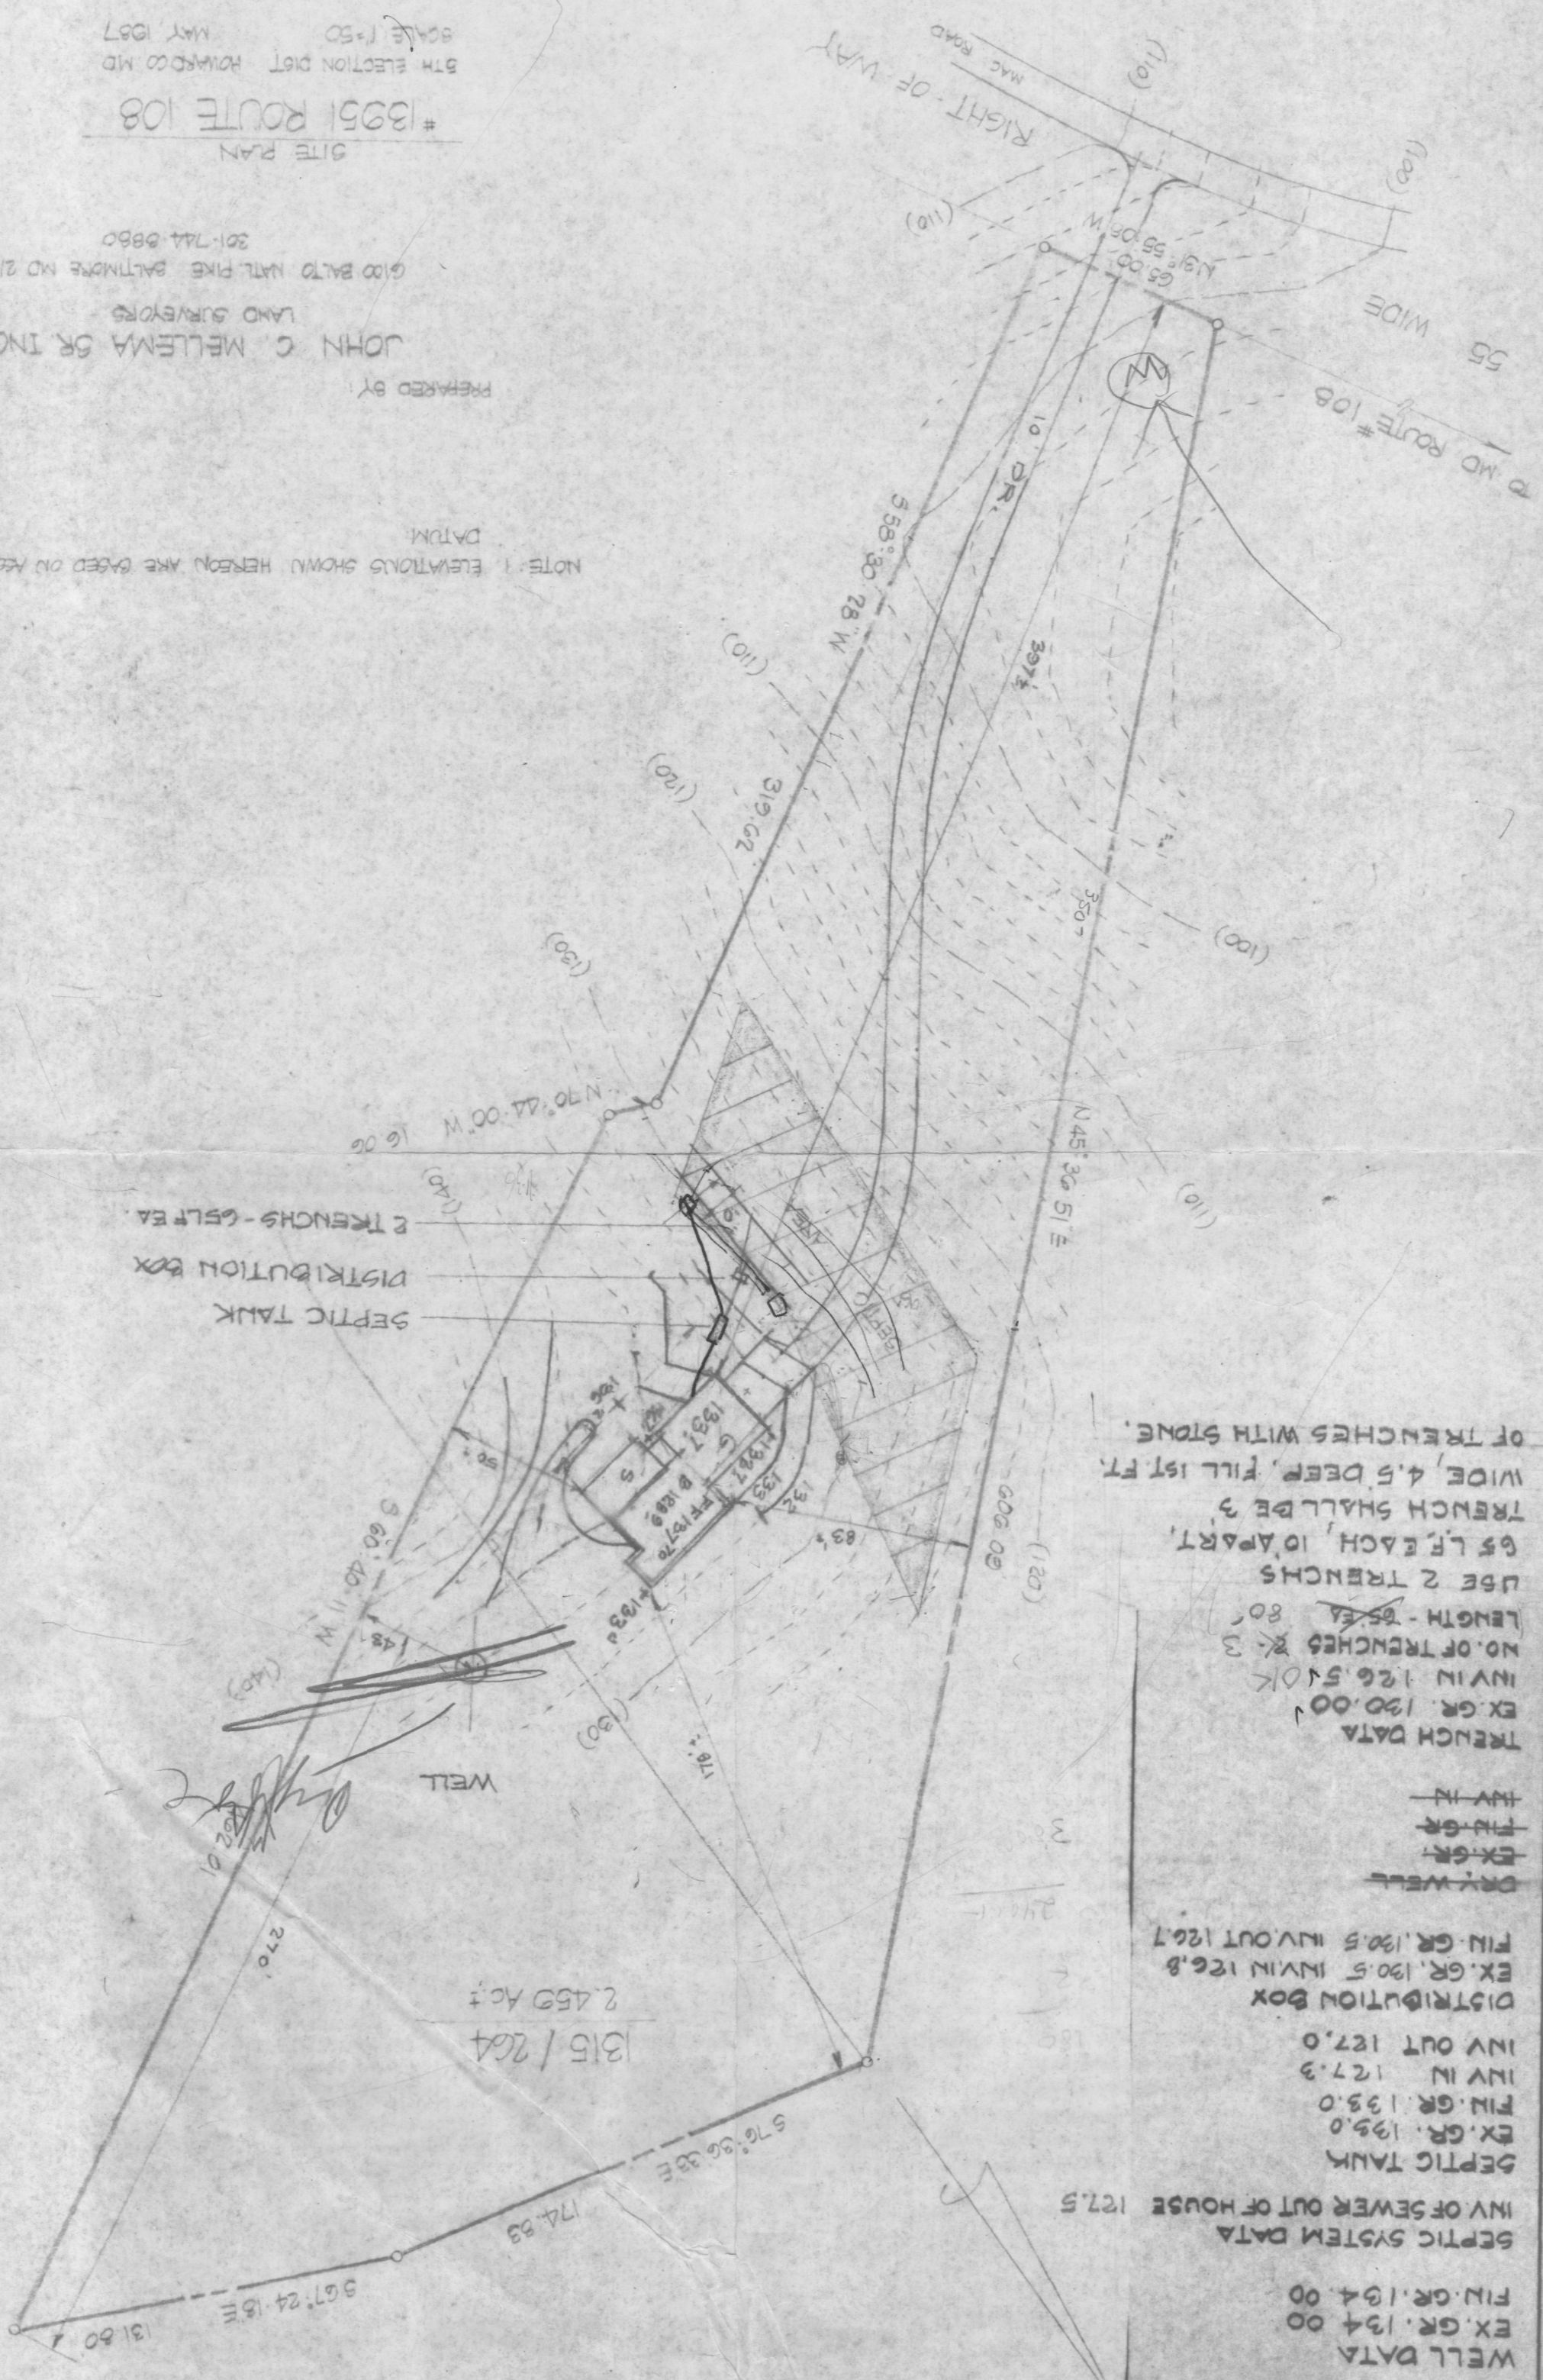

WELL DATA
EX. GR. 134.00
FIN. GR. 134.00
SEPTIC SYSTEM DATA
INV. OF SEWER OUT OF HOUSE 127.5
SEPTIC TANK
EX. GR. 133.0
FIN. GR. 133.0
INV. IN 127.3
INV. OUT 127.0
DISTRIBUTION BOX
EX. GR. 130.5 INV. IN 126.8
FIN. GR. 130.5 INV. OUT 126.7
DRY WELL
EX. GR.
FIN. GR.
INV. IN
TRENCH DATA
EX. GR. 130.00
INV. IN 126.51 OK
NO. OF TRENCHES 2-3
LENGTH - 65' EA 80'
USE 2 TRENCHES
65' EACH, 10' APART,
TRENCH SHALL BE 3'
WIDE, 4.5' DEEP, FILL 1ST FT.
OF TRENCHES WITH STONE.

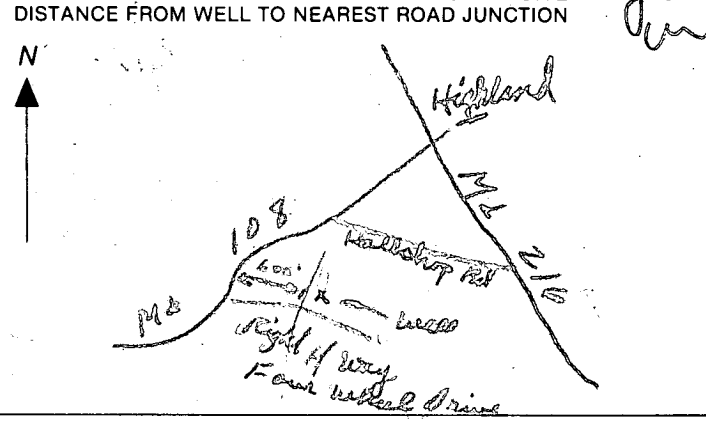B 1 3335	SEQUENCE NO. (OEP USE ONLY)	STATE OF MARYLAND PERMIT TO DRILL WELL please print or type	OEP PERMIT NUMBER H0-81-2291
(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)		fill in this form completely	
Date Received 082587		B 3 LOCATION OF WELL	
OWNER INFORMATION 15 Last Name PAUL 34 Owner First Name ERIC 36 Street or RFD 10057 CAPE ANN DR 55 57 Town COLUMBIA 70 State 72 MD 74 Zip 76 21146		8 COUNTY H0-452 21 23 SUBDIVISION COX PROPERTY 42 SECTION A 44 46 LOT 8 48 50 52 NEAREST TOWN HICKLHND 71 MILES FROM TOWN (enter 0 if in town) 1 3/4 MI 73 76 77 78	
DRILLER INFORMATION Driller's Name Joseph B. Wayne 77 License No. 80 238 Firm Name Wayne Well Drilling Address 5512 Ridge Rd. Mt. Airy Md. 21771 Signature Joseph B. Wayne Date 8/14/87		B 4 1 2 DIRECTION OF WELL FROM TOWN (CIRCLE BOX)  11 NEAR WHAT ROAD CLARKSVILLE PIKE (Hwy 6) 30 ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX) NORTH N WEST W EAST E SOUTH S 34 DISTANCE FROM ROAD 0900 37 ENTER FT or MI FT 38 39	
B 2 WELL INFORMATION APPROX. PUMPING RATE (GAL. PER MIN.) 5 8 12 AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 500 14 20		NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL COUNTY NAME H0-452 COUNTY NO. A-28626 OEP SIGNATURE _____ STATE HEALTH INSERT S _____ DATE ISSUED 090887 CO SIGNATURE S. Wayne EXP. DATE 03-07-88 NORTH GRID 484000 50 55 EAST GRID 0808000 57 63	
USE FOR WATER (CIRCLE APPROPRIATE BOX) ☒ HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY) ☐ FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION) ☐ INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT) ☐ PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE HEALTH DEPARTMENT APPROVAL) ☐ TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)		SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X SOURCES OF DRILLING WATER 1. WELL 2. 3. WRITE THE BOX NUMBER FROM THE MAP HERE E 8068 N 4804 000 000 DRAW A SKETCH BELOW SHOWING LOCATION OF WELL IN RELATION TO NEARBY TOWNS AND ROADS AND GIVE DISTANCE FROM WELL TO NEAREST ROAD JUNCTION 	
APPROXIMATE DEPTH OF WELL 200 24 28 FEET APPROXIMATE DIAMETER OF WELL 6 INCH NEAREST INCH		METHOD OF DRILLING (circle one) BORED (or Augered) ☒ JETTED ☐ Jetted & DRIVEN ☐ 30 AIR-ROTARY ☐ AIR-PERCussion ☐ ROTARY (Hydraulic Rotary) ☐ 37 CABLE ☐ REVERSE-ROTary ☐ Drive-POINT ☐ other _____	
REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX) ☒ THIS WELL WILL NOT REPLACE AN EXISTING WELL ☐ THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED 39 ☐ THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY ☐ THIS WELL WILL DEEPEMED AN EXISTING WELL PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEMED (IF AVAILABLE) 41 _____ 52		Not to be filled in by driller (OEP USE ONLY) APPROP. PERMIT NUMBER _____ 54 GAP _____ 63 FORCE SA WRITE INITIALS IN BOX PERMIT No. H0-81-2291 70 71 72 73 74 75 76 77 78 79	
SPECIAL CONDITIONS			

WELL DATA
EX. GR. 138.00
FIN. GR. 138.00


SEPTIC SYSTEM DATA
INV. OF SEWER OUT OF HOUSE 127.5

SEPTIC TANK
EX. GR. 133.0
FIN. GR. 133.0
INV. IN 127.3
INV. OUT 127.0

DISTRIBUTION BOX
EX. GR. 130.5 INV. IN 126.8
FIN. GR. 130.5 INV. OUT 126.7

DRY WELL
EX. GR.
FIN. GR.
INV. IN

TRENCH DATA
EX. GR. 130.00
INV. IN 126.5
NO. OF TRENCHES 2
LENGTH - 65' EA
USE 2 TRENCHES
65' LF EACH, 10' APART,
TRENCH SHALL BE 3'
WIDE, 4.5' DEEP, FILL 1ST FT.
OF TRENCHES WITH STONE.

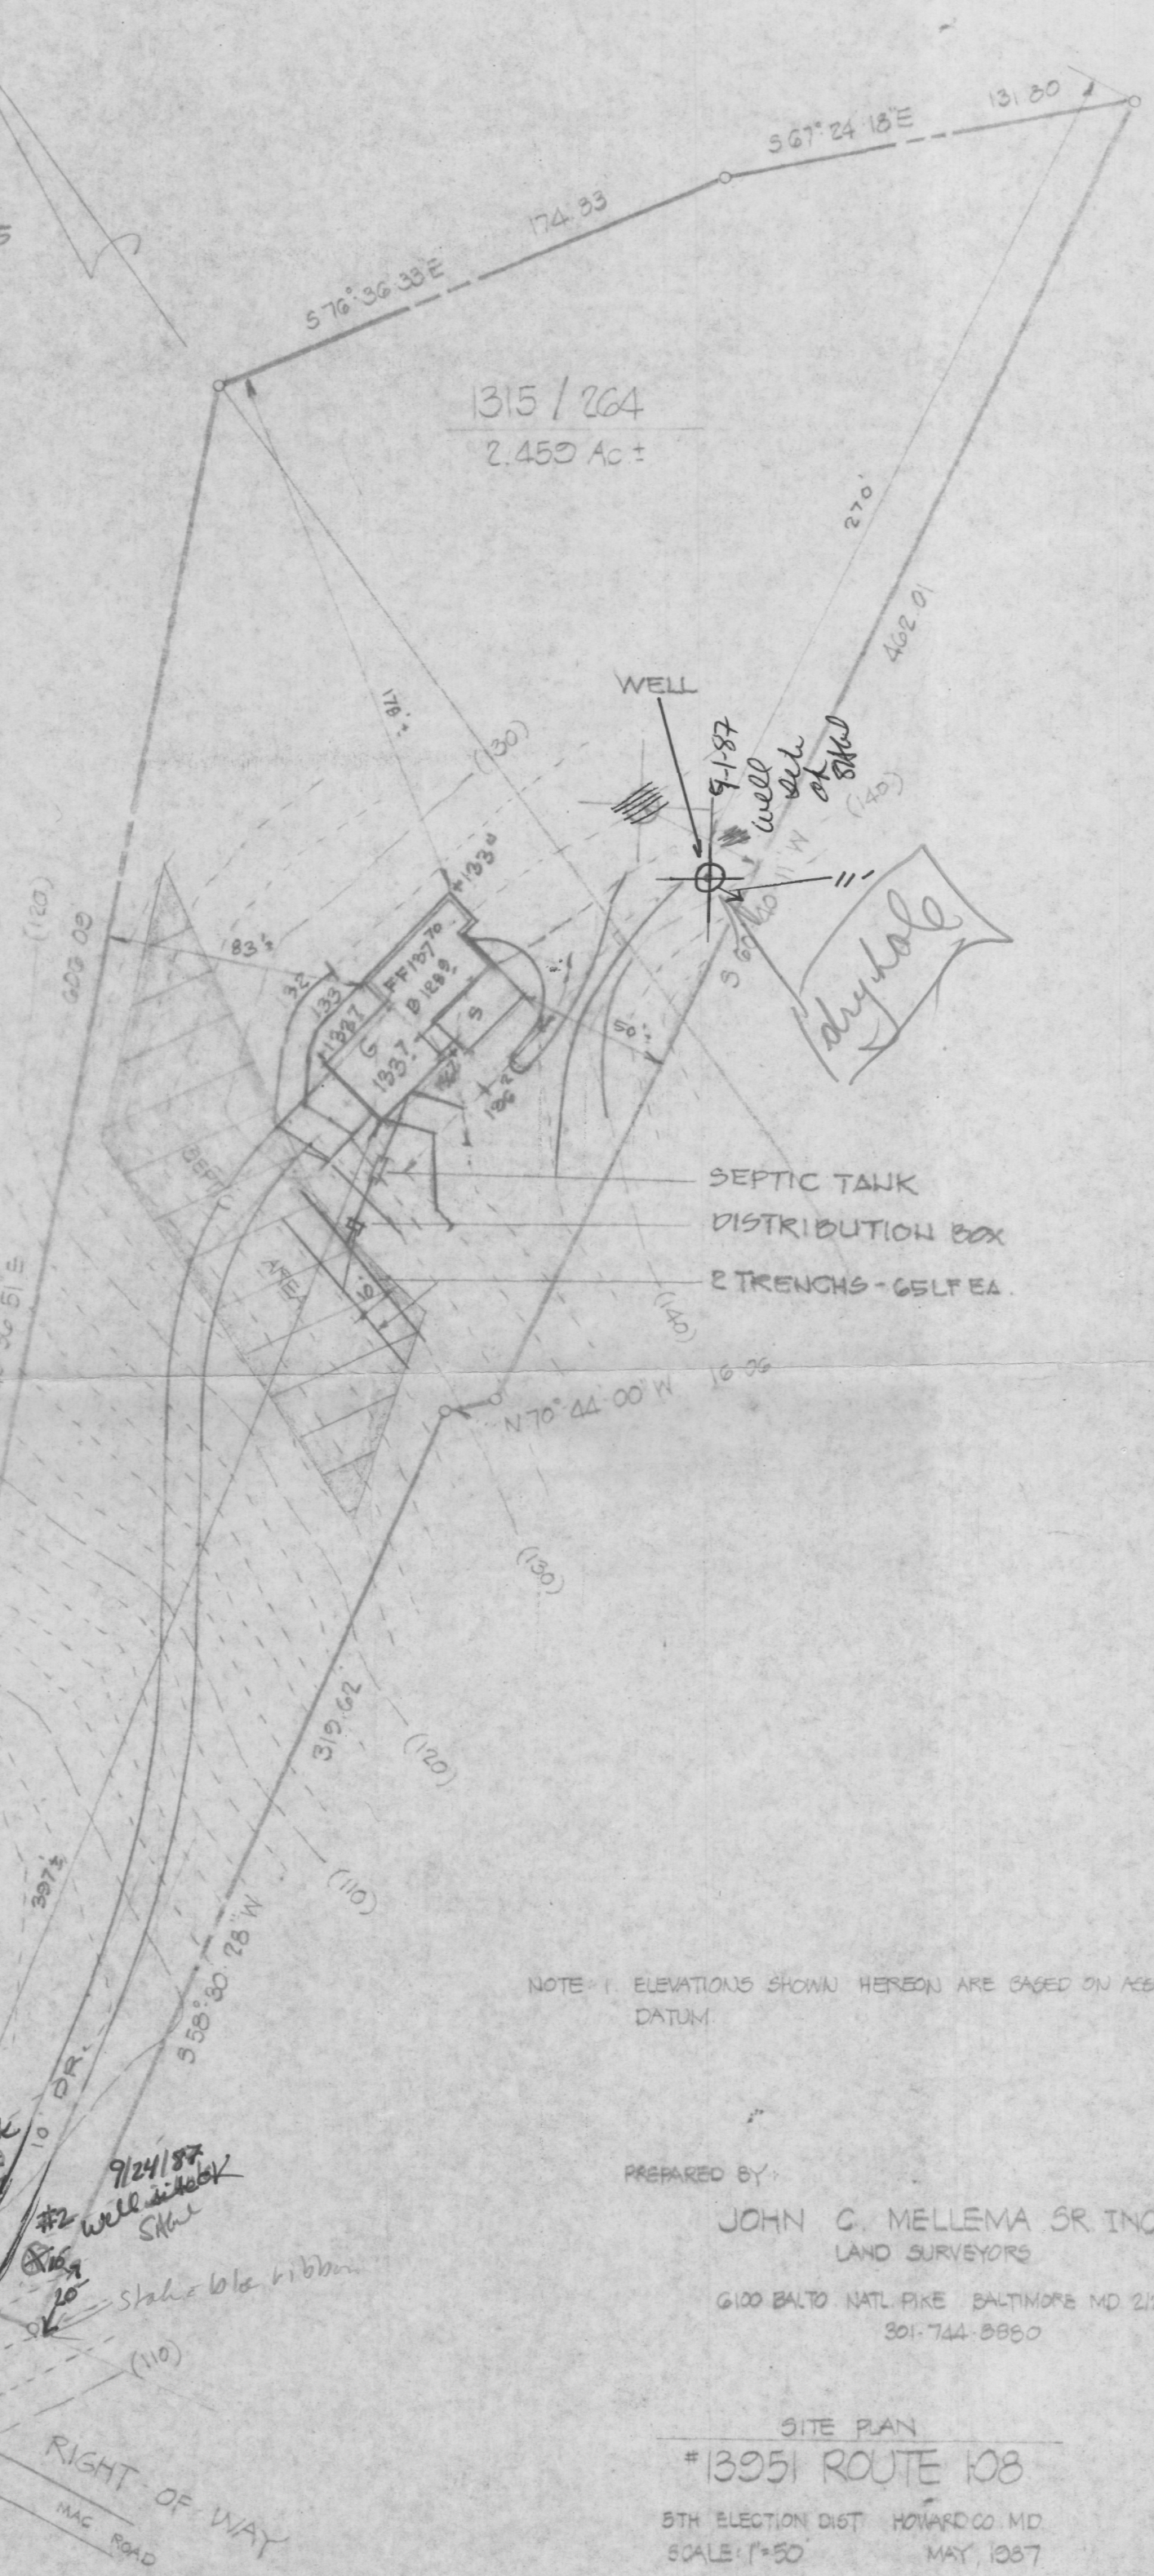

Eric Paul
730 2515

NOTE: ELEVATIONS SHOWN HEREON ARE BASED ON ASSUMED DATUM.

PREPARED BY:

JOHN C. MELLEMA SR. INC.
LAND SURVEYORS

6100 BALTO. NATL. PIKE BALTIMORE MD 21228
301-744-8860

SITE PLAN

#13951 ROUTE 108

5TH ELECTION DIST HOWARD CO. MD
SCALE: 1"=50' MAY, 1987

JOB # 87671

Review

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Well Permit No. HO - 81-2291
Location of property (road) CCARKSVILLE PIKE (KE108)
Subdivision COX PROPERTY Lot 8 Block Plat Sec. A
Well Driller JOE MAYNE Owner PAUL, ERIC

Depth of well 145
Distance of measuring point (M.P.) above ground 1'
Static water level (S.W.L.) below M.P. 7

I. High rate pumping -- reservoir drawdown

Time pump started 10⁴⁵ Pumping rate 12 gpm
Total time to reach pumping water level ft. below M.P.

II. Recovery pump test data - observations to be recorded every 15 minutes

[illegible]

HO sample
faber - 1130 R
H1197

C1	6097	SEQUENCE NO. (OEP USE ONLY)	STATE OF MARYLAND WELL COMPLETION REPORT FILL IN THIS FORM COMPLETELY PLEASE PRINT OR TYPE	THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED.	
				COUNTY NUMBER	A-28626

DATE Received	DATE WELL COMPLETED	Depth of Well	PERMIT NO.
	192887	115	40-81-2291
		(TO NEAREST FOOT)	
OWNER	PAUL ERIC		
STREET OR RFD	CLARKSVILLE PINE first name		
SUBDIVISION	COX PROPERTY SECTION A LOT 8		

WELL LOG		GROUTING RECORD		C3
Not required for driven wells		WELL HAS BEEN GROUTED		
STATE THE KIND OF FORMATIONS PENETRATED, THEIR COLOR, DEPTH, THICKNESS AND IF WATER BEARING		(Circle Appropriate Box)		
DESCRIPTION (Use additional sheets if needed)	FEET		TYPE OF GROUTING MATERIAL	
	FROM	TO	CEMENT	
SAND Stone	0	25	BENTONITE CLAY	
Grny Micaceous	25	165	NO. OF BAGS	
			NO. OF POUNDS	
			GALLONS OF WATER	
			DEPTH OF GROUT SEAL (to nearest foot)	
			from	
			ft. to	
			(enter 0 if from surface)	
casing types insert appropriate code below		CASING RECORD		
		STEEL CONCRETE		
MAIN CASING TYPE		Nominal diameter top (main) casing (nearest inch)		
		Total depth of main casing (nearest foot)		
OTHER CASING (if used)		diameter inch		
		depth (feet) from to		
screen type or open hole		SCREEN RECORD		
		STEEL BRASS BRONZE PLASTIC OTHER		
C2		DEPTH (nearest ft.)		
		1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100		

PUMPING TEST		C3
HOURS PUMPED (nearest hour)		
PUMPING RATE (gal. per min. to nearest gal.)		
METHOD USED TO MEASURE PUMPING RATE		
WATER LEVEL (distance from land surface)		
BEFORE PUMPING		
WHEN PUMPING		
TYPE OF PUMP USED (for test)		
A air P piston T turbine		
C centrifugal R rotary O other (describe below)		
J jet S submersible		
PUMP INSTALLED		
DRILLER WILL INSTALL PUMP YES NO		
IF DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS EXCEPT HOME USE		
TYPE OF PUMP INSTALLED		
PLACE (A,C,J,P,R,S,T,O) IN BOX - SEE ABOVE:		
CAPACITY: GALLONS PER MINUTE (to nearest gallon)		
PUMP HORSEPOWER		
PUMP COLUMN LENGTH (nearest ft.)		
CASING HEIGHT (circle appropriate box and enter casing height)		
LAND SURFACE (nearest foot)		
LOCATION OF WELL ON LOT		
SHOW PERMANENT STRUCTURE SUCH AS BUILDING, SEPTIC TANKS, AND/OR LANDMARKS AND INDICATE NOT LESS THAN TWO DISTANCES (MEASUREMENTS TO WELL)		
DRILLERS IDENT. NO.		
DRILLERS SIGNATURE		
SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)		
HEALTH		

FIELD DATA SHEET
HOWARD COUNTY WELL YIELD TEST

Well Permit No. HO - 81-2291
Location of property (road) CLARKSVILLE PIKE (RT108)
Subdivision COX PROPERTY Lot 8 Block Plat Sec. A
Well Driller JOE MAYNE Owner PAUL, ERIC

Depth of well 16.5
Distance of measuring point (M.P.) above ground 1'
Static water level (S.W.L.) below M.P. 7'

I. High rate pumping -- reservoir drawdown

Time pump started 10:45 Pumping rate 12 gal.
Total time 15 min to reach pumping water level 29 /ft. below M.P.

II. Recovery pump test data - observations to be recorded every 15 minutes

[illegible]

Howard County Health Department
Bureau of Environmental Health
3525-H Ellicott Mills Drive
Court House Square
Ellicott City, Md. 21043
461-9933

Receipt # 24442
Date 5/3/67

License number 1862
 Certified Well Pump Installer Well Driller Registered Plumber ☒

Tank 1. Capacity <u>42</u> 2. Pressure relief valve? <u>Yes</u>		Piping 1. Type <u>160 LB.</u> 2. Size <u>1"</u> 3. NSF and/or BOCA Code approved <u>Yes</u> 4. Depth of supply line <u>3 ft</u>		Well data 1. Depth <u>160 ft.</u> 2. Yield <u> </u> GPM 3. Static water level <u> </u> ft. 4. Will water supply be disinfected by installer? <u>no</u>	
---	--	--	--	--	--

I understand that it is my responsibility to notify the Howard County Health Department when the installation is ready for inspection (otherwise this permit is null and void).

All information given above is true to the best of my knowledge.

Signature of Applicant: _____

Date: April 27, 1989

Note: A sticker indicating approval/status of the installation will be placed on the well casing at the time of the inspection.

WELL DATA
EX. GR. 134.00
FIN. GR. 134.00

SEPTIC SYSTEM DATA
INV. OF SEWER OUT OF HOUSE 127.5


SEPTIC TANK
EX. GR. 133.0
FIN. GR. 133.0
INV. IN 127.3
INV. OUT 127.0

DISTRIBUTION BOX
EX. GR. 130.5 INV. IN 126.8
FIN. GR. 130.5 INV. OUT 126.7

~~DRY WELL~~
~~EX. GR.~~
~~FIN. GR.~~
~~INV. IN~~

TRENCH DATA
EX. GR. 130.00
INV. IN 126.5
NO. OF TRENCHES 3
LENGTH - 80 LF
USE 3 TRENCHES
80' LF. EACH, 10' APART,
TRENCH SHALL BE 3'
WIDE, 4.5' DEEP, FILL 1ST. FT.
OF TRENCHES WITH STONE.

SOUDER BUILDERS, INC.
9335 Old Scaggsville Rd.
LAUREL, Md 20707
725-5772

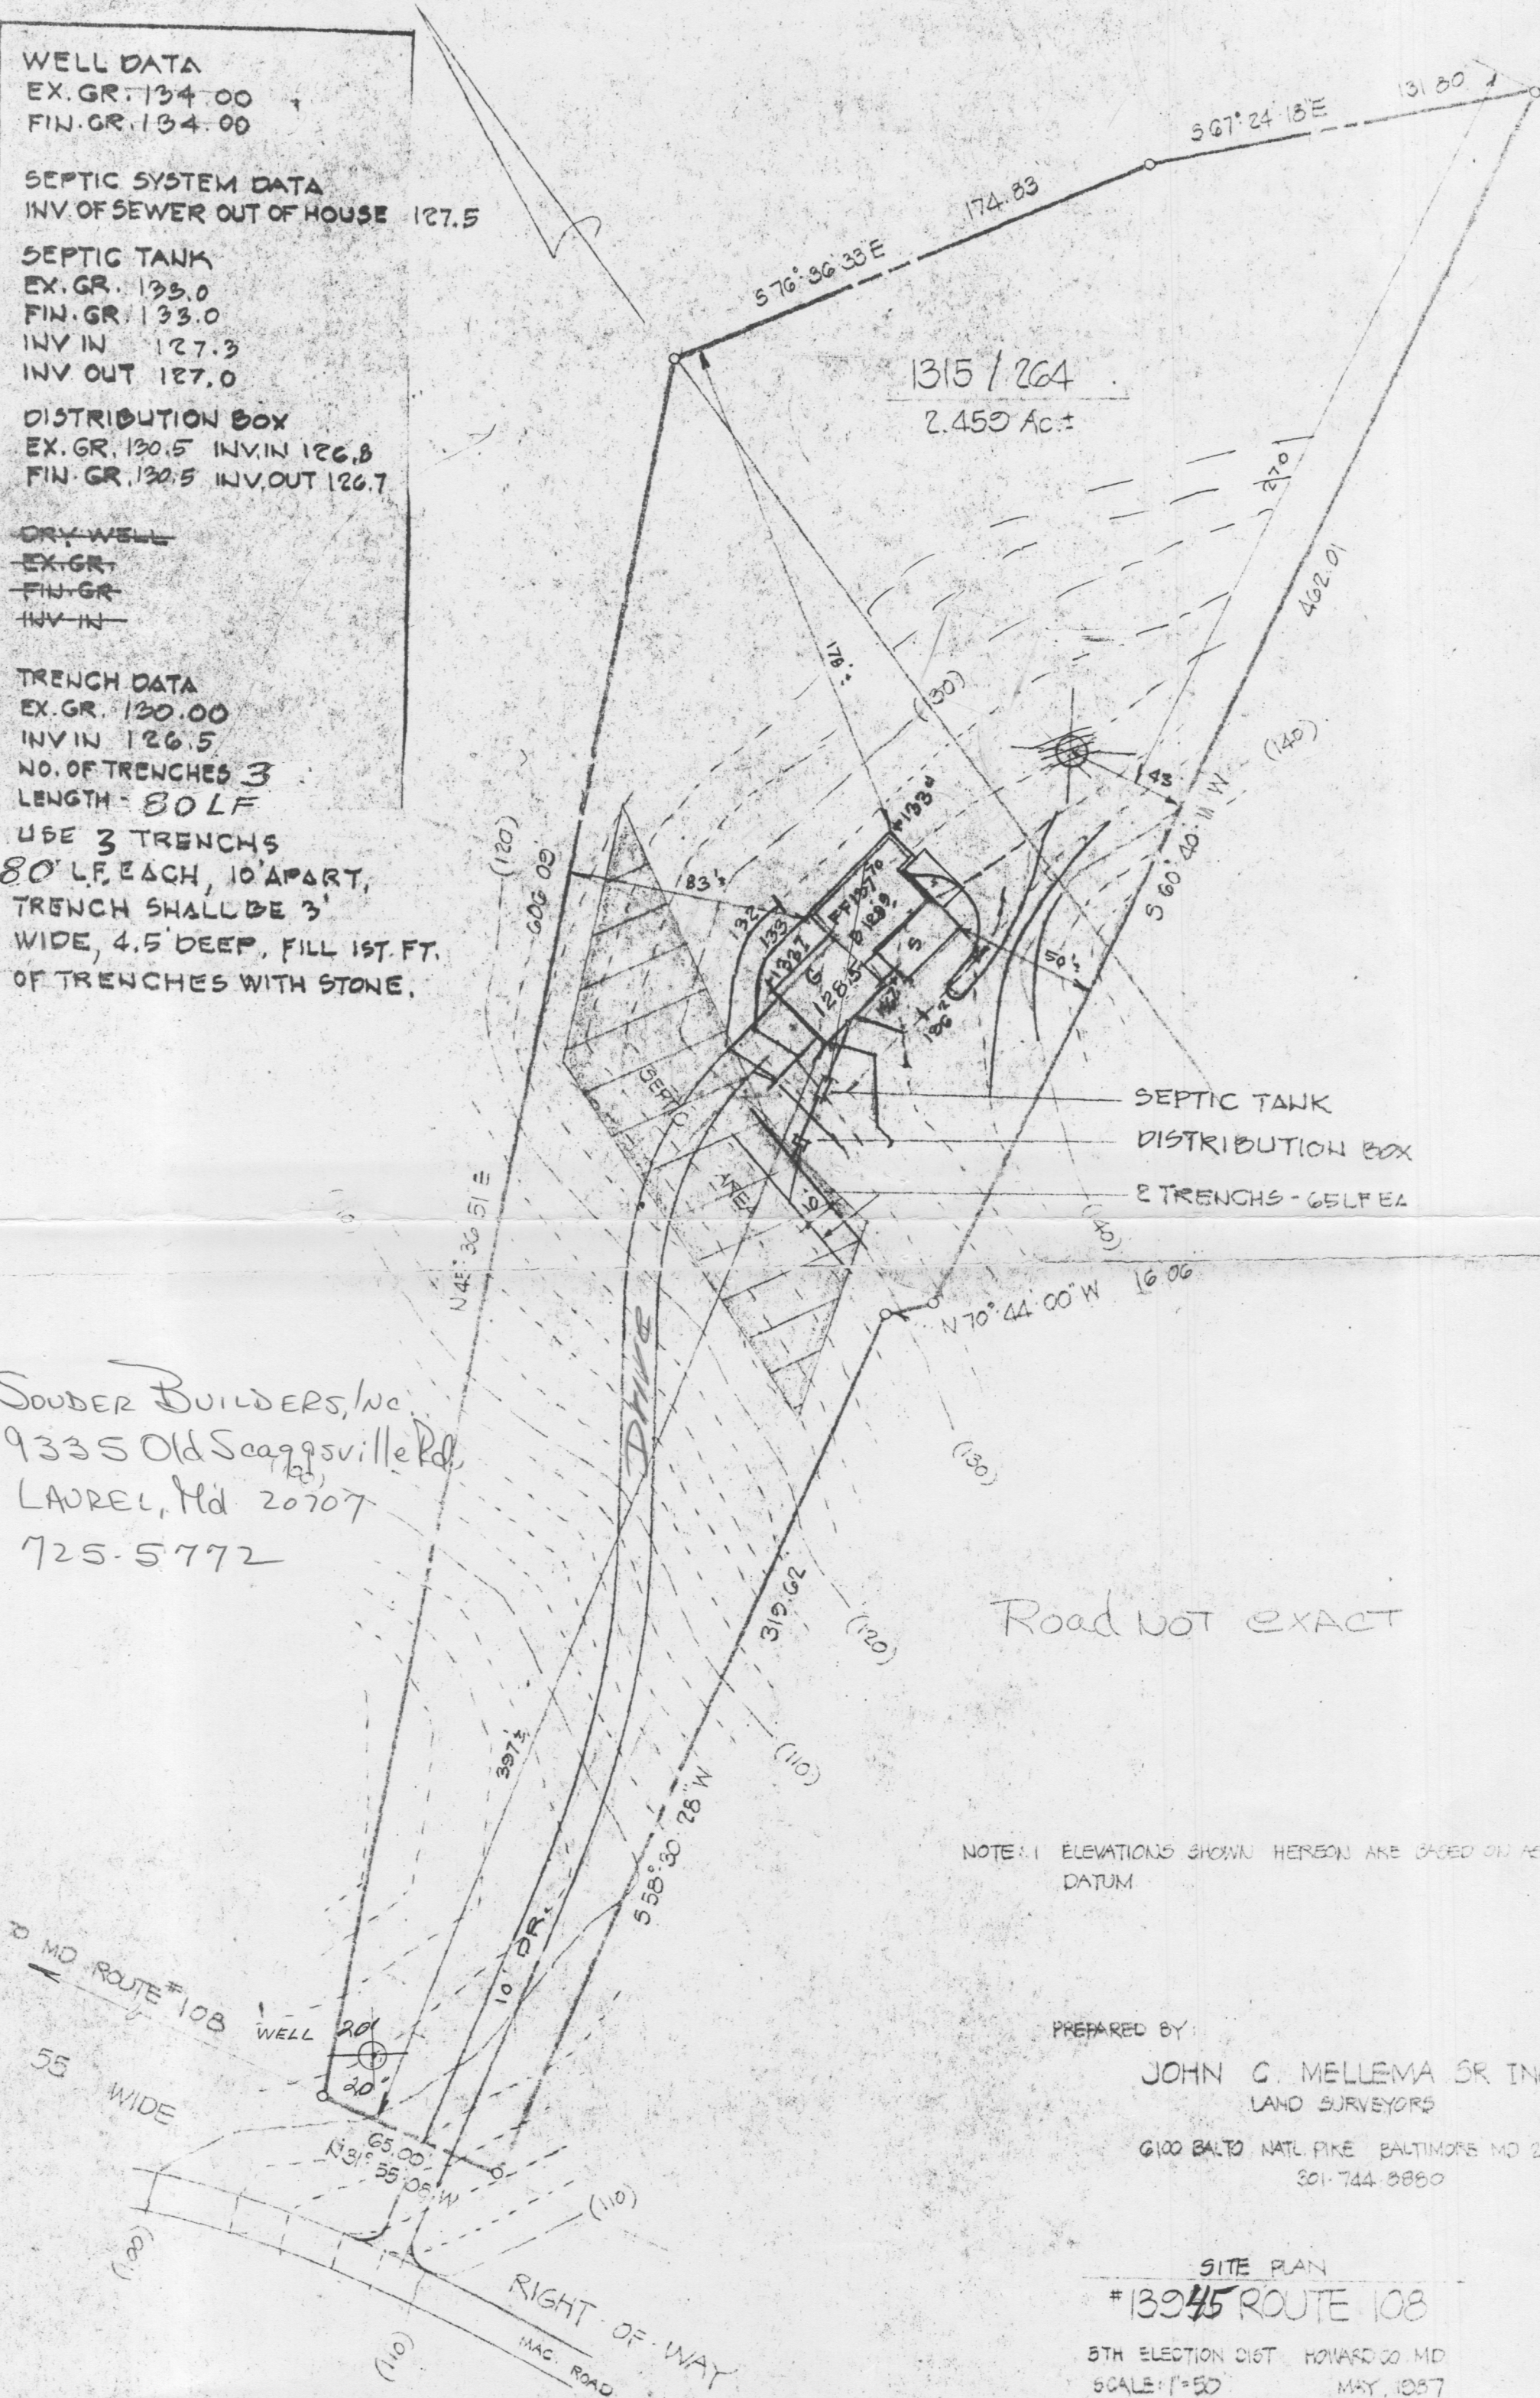

NOTE: 1 ELEVATIONS SHOWN HEREON ARE BASED ON AEGUS DATUM

PREPARED BY:

JOHN C. MELLEMA SR. INC.
LAND SURVEYORS

6100 BALTO. NATL. PIKE BALTIMORE MD 21206
301-744-3880

SITE PLAN

#13945 ROUTE 108

5TH ELECTION DIST. HOWARD CO. MD
SCALE: 1"=50' MAY, 1987