

PUB. SEWER STATUS VERIFIED BY \_\_\_\_\_

ISSUE DATE: 8/29/2008

P 529545

APPROVAL DATE: 9/4/08

# PERMIT

A REPAIR

Tax ID # 03-282066

## ON-SITE SEWAGE DISPOSAL SYSTEM HOWARD COUNTY HEALTH DEPARTMENT BUREAU OF ENVIRONMENTAL HEALTH

Fogles Septic Clean, Inc IS PERMITTED TO INSTALL  ALTER

ADDRESS: 580 Obrecht Road, Sykesville PHONE NUMBER: 410-795-5670

SUBDIVISION: \_\_\_\_\_ LOT NUMBER: 1

ADDRESS: 691 River Road PROPERTY OWNER: Raymond Greenwald

SEPTIC TANK CAPACITY (GALLONS): 1500 Minimum

PUMP CHAMBER CAPACITY (GALLONS): N/A

NUMBER OF BEDROOMS: 3

SQUARE FEET PER BEDROOM: \_\_\_\_\_

LINEAR FEET OF TRENCH REQUIRED: 85'

*32'+53' Long Trenches  
Inlet 3.5', Bottom 8'  
Trenches 2' Wide*

TRENCHES:	
LOCATION:	Existing septic tank to be replaced. Please call for layout inspection
ADDITIONAL NOTES:	

PLANS APPROVED: B. Baber DATE: 9/3/08

- NOTE: PERMIT VOID AFTER 2 YEARS
- NOTE: CONTRACTOR RESPONSIBLE FOR SCHEDULING A PRE-CONSTRUCTION INSPECTION FOR ALL INSTALLATIONS
- NOTE: WATERTIGHT SEPTIC TANKS REQUIRED
- NOTE: ALL PARTS OF SEPTIC SYSTEM SHALL BE 100 FEET FROM ANY WATER WELL
- NOTE: MANHOLE RISERS REQUIRED ON ALL SEPTIC TANKS AND PUMP CHAMBERS

**NEITHER THE HOWARD COUNTY COUNCIL OR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM PERMITTEE RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT CALL 410-313-2640 FOR INSPECTION OF SEPTIC SYSTEM**


NOT TO SCALE

TRENCH/DRAINFIELD DATA		
WIDTH	INLET	BOTTOM
2	3.5'	8'
NUMBER OF TRENCHES		2
TOTAL LENGTH		84'
ABSORPTION AREA		252
DISTRIBUTION BOX LEVEL		Leyclers
DISTRIBUTION BOX BAFFLE		Yes
DISTRIBUTION BOX PORT		Yes

SEPTIC TANK DATA	
SEPTIC TANK 1 LEVEL	Yes
MANUFACTURER	Babylon
CAPACITY	1500 GAL
SEAM LOC	Top
TANK LID DEPTH	1-1.5'
BAFFLES	Yes
BAFFLE FILTER	No
MANHOLE LOC	Front+Rear
6" PORT LOC	None
WATERTIGHT TEST	No
SLOTTED	Yes
<del>PUMP/SEPTIC TANK LEVEL</del> N/A	
<del>MANUFACTURER</del>	
<del>CAPACITY</del> _____ GAL	
<del>SEAM LOC</del>	
<del>TANK LID DEPTH</del>	
<del>BAFFLES</del>	
<del>BAFFLE FILTER</del>	
<del>MANHOLE LOC</del>	
<del>6" PORT LOC</del>	
<del>WATERTIGHT TEST</del>	
<del>SLOTTED</del>	

PRE-CONSTRUCTION  
 9/2/08 New tank  
 set. Old metal tank  
 abandoned. (BB)

4" Cleanout  
 House Connections

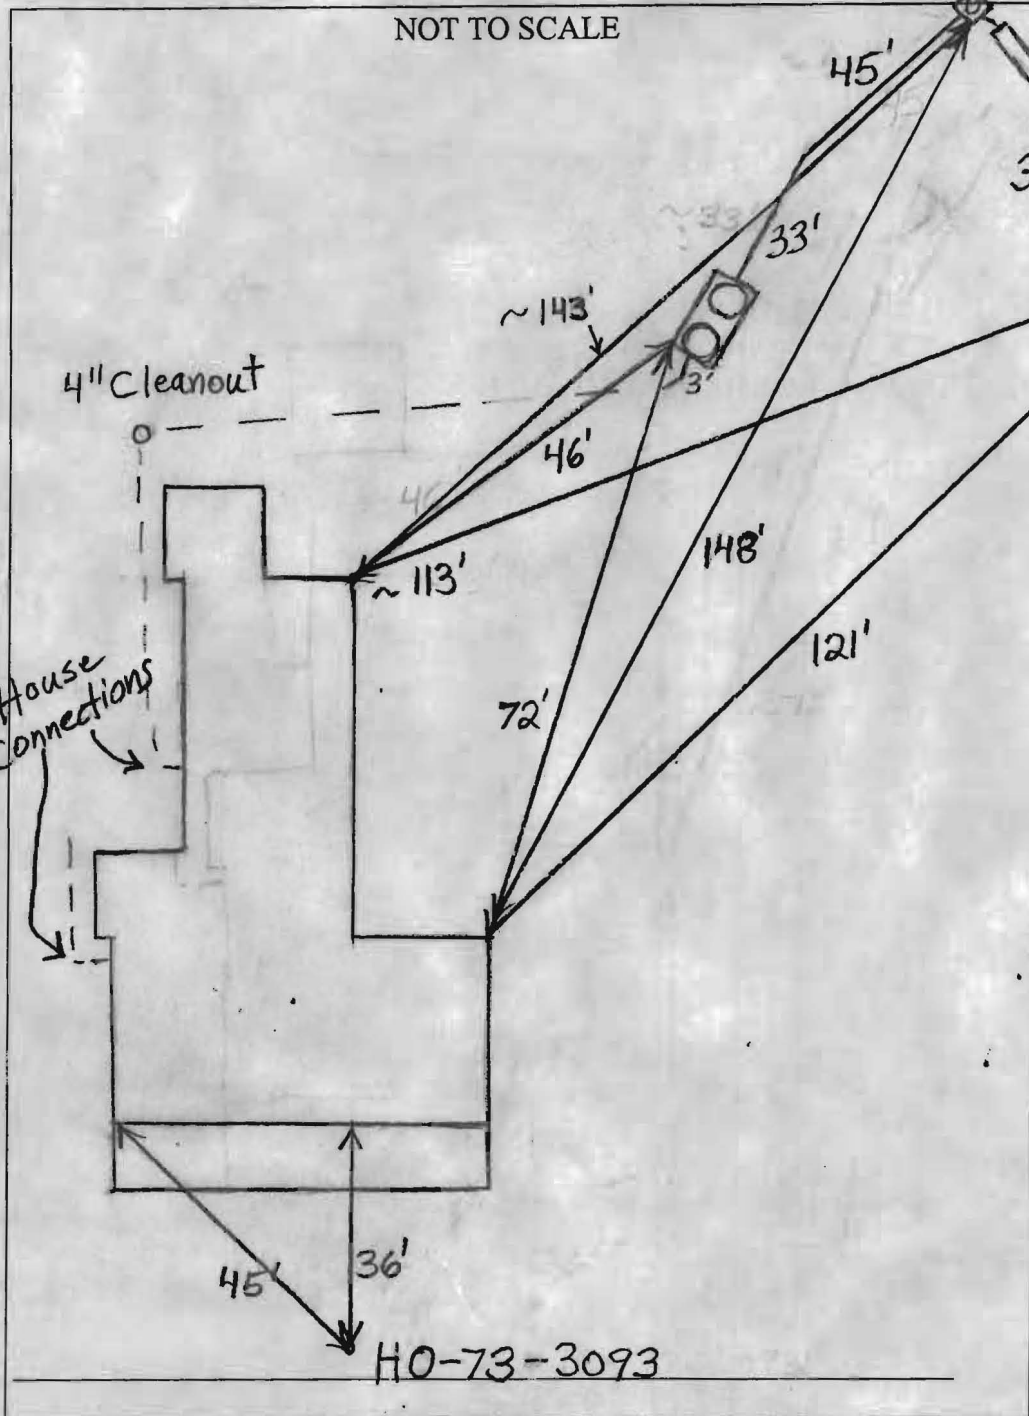

HO-73-3093

9/3/08 Install 2 short trenches on contour between 2 good test holes. (BB)

INSTALLATION 9/4/08 System finished. O.K. to backfill. (BB)

FINAL INSPECTOR B. Baker DATE OF APPROVAL 9/4/08



# HOWARD COUNTY HEALTH DEPARTMENT

PS 29545

DATE  
8 / 29 / 08

Received From

Fogles Septic Clean, Inc.

PHONE # 410-795-5670

For Septic Permit - Repair (Tank replacement)

691 River Road

(P) ✓

- CASH
- CHECK

NO.

25853

One hundred sixty-five and 00/100 Dollars

\$ 165 00

Received By Mary L Briggs



-76°56'40"



39°21'13"



39°21'13"

Disclaimer: Howard County, Maryland assumes no responsibility for the accuracy of this report or the information contained herein or derived therefrom. The user assumes all risks and liabilities whatsoever resulting from or arising out of the use of this information. There are no oral agreements or warranties relating to the use of this report.

-76°56'40"



 **Howard County**  
M A R Y L A N D

By:  
Office:  
Map Width: 910.00 ft.  
Print Date: 9/2/2008  
Scale: 1 in. = 100 ft.

