

GENERAL NOTES

1. THE LOT SHOWN HEREON COMPLIES WITH THE MINIMUM OWNERSHIP WIDTH AND LOT AREA AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT.
2. THIS AREA DESIGNATES A PRIVATE SEWAGE DISPOSAL AREA OF AT LEAST 10,000 S.F. AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT FOR INDIVIDUAL SEWERAGE DISPOSAL. IMPROVEMENTS OF ANY NATURE IN THIS AREA ARE RESTRICTED UNTIL PUBLIC SEWER IS AVAILABLE. THIS EASEMENT SHALL BECOME NULL AND VOID UPON CONNECTION TO A PUBLIC SEWER SYSTEM. THE COUNTY HEALTH OFFICER SHALL HAVE THE AUTHORITY TO GRANT ADJUSTMENTS TO THE PRIVATE SEWERAGE EASEMENT. RECORDATION OF A MODIFIED SEWERAGE EASEMENT PLAT SHALL NOT BE REQUIRED.
3. TOPOGRAPHY SHOWN WITHIN THE LIMIT OF DISTURBANCE IS BASED ON HOWARD COUNTY GIS, 2 FOOT CONTOURS, AND VERIFIED WITH FIELD RUN TOPOGRAPHY BY BENCHMARK ENGINEERING, INC. IN JULY, 2017.
4. TO THE BEST OF OUR KNOWLEDGE, ALL WELLS AND SEPTIC SYSTEMS LOCATED WITHIN 100' OF THE PROPERTY BOUNDARIES AND 200' DOWN GRADIENT OF ANY WELL AND/OR SEPTIC HAVE BEEN SHOWN.
5. ANY CHANGES TO A PRIVATE SEWAGE EASEMENT SHALL REQUIRE A REVISED PERCOLATION CERTIFICATION PLAN.
6. STORMWATER MANAGEMENT FOR THIS LOT COMPLIES WITH THE "MARYLAND DEPARTMENT OF THE ENVIRONMENT STORMWATER MANAGEMENT ACT OF 2007" AND THE "HOWARD COUNTY DESIGN MANUAL VOLUME I, CHAPTER 5". STORMWATER MANAGEMENT IS PROVIDED BY NON-ROOFTOP DISCONNECTION (N-2), TWO (M-6) MICRO BIO-RETENTIONS AND TWO (M-5) DRY WELLS. THEY ARE PRIVATELY OWNED AND PRIVATELY MAINTAINED.
7. A DECLARATION OF INTENT FOR SINGLE FAMILY RESIDENTIAL LOT EXEMPTION (CLEARING LESS THAN 20,000 SQUARE FEET OF FOREST) SHALL BE FILED WITH DPZ.
8. PROPERTY ACREAGE: (LOT 2) 3.04 AC., ZONED RR-DEO.
9. PROPOSED LIMIT OF DISTURBANCE: 3.0 AC.
10. FOREST STAND DELINEATION HAS BEEN PERFORMED BY BENCHMARK ENGINEERING, INC. IN FEBRUARY, 2017, AND IS PROVIDED AS PART OF THE SIMPLIFIED ENVIRONMENTAL CONCEPT PLAN SUBMISSION.
11. SPECIMEN TREES HAVE BEEN FIELD LOCATED BY BENCHMARK ENGINEERING, INC. AND ARE DEPICTED ON THIS PLAN.
12. THE EXISTING WELL SHOWN (TAG #HO-17-0197) SHOWN ON THIS PLAN HAS BEEN FIELD LOCATED BY BENCHMARK ENGINEERING, INC. DECEMBER, 2017 AND IS ACCURATELY SHOWN.
13. EXACT LENGTH OF SEPTIC TRENCHES IS TO BE DETERMINED BY THE HEALTH DEPARTMENT AT THE TIME OF TRENCH LAYOUT AND INSPECTION.
14. ANY CHANGES TO THE LOCATION OR DEPTHS TO ANY COMPONENTS MUST BE APPROVED BY THE ENGINEER AND THE HOWARD COUNTY HEALTH DEPARTMENT PRIOR TO INSTALLATION. A REVISED SITE PLAN MAY BE REQUIRED.
15. THE MAXIMUM EARTH COVER OVER THE SEPTIC TANK IS 3 FEET. GREATER EARTH COVER WILL REQUIRE A HEAVY LOAD BEARING TANK.

REQUIRED BAT SITE PLAN NOTES


1. ANY CHANGE TO THE LOCATIONS OR DEPTHS TO ANY COMPONENTS MUST BE APPROVED BY THE ENGINEER AND THE HOWARD COUNTY HEALTH DEPARTMENT PRIOR TO INSTALLATION. A REVISED SIT PLAN MAY BE REQUIRED.
2. THE MAXIMUM DEPTH OF THE BAT SHALL BE PER THE MANUFACTURER'S SPECIFICATION.
3. THE BLOWER MAY NOT BE LOCATED FURTHER FROM THE TANK THAN THE MANUFACTURER'S SPECIFICATIONS.
4. THE BAT SYSTEM SHALL BE MAINTAINED AND OPERATED FOR THE LIFE OF THE SYSTEM.
5. THE BAT SHALL BE OPERATED BY AND MAINTAINED BY A CERTIFIED SERVICE PROVIDER.
6. WITHIN ONE MONTH OF INSTALLATION, A PERSON INSTALLING THE BAT SYSTEM SHALL REPORT TO THE MARYLAND DEPARTMENT OF THE ENVIRONMENT (MDE) IN A MANNER ACCEPTABLE TO MDE, THE ADDRESS AND DATE OF COMPLETION OF THE BAT INSTALLATION AND THE TYPE OF BAT INSTALLED.
7. ELECTRICAL WORK FOR THE BAT INSTALLATION MUST BE PERFORMED BY A LICENSED ELECTRICIAN.
8. AN AGREEMENT AND EASEMENT MUST BE COMPLETED AND SIGNED BY ALL APPLICABLE PARTIES, AND RECORDED IN LAND RECORDS OF HOWARD COUNTY.
9. THE HEALTH DEPARTMENT REQUIRES DOCUMENTATION FOR THE START-UP CERTIFICATION FROM THE MANUFACTURER PRIOR TO FINAL APPROVAL OF THE INSTALLATION.

INITIAL SYSTEM		
Number of Bedrooms	6	
Application Rate	1.2	gpd/sf
Effective Area Beginning Depth	2	ft
Bottom Max Depth	6	ft
Design Flow	900	gpd
Drainage Field square footage	750	sf
Sidewall reduction credit	0.417	
Trench width	3	
Effective Area Depth	4	
Linear Length of trench Required	104	lf

1st REPLACEMENT SYSTEM		
Number of Bedrooms	6	
Application Rate	1.2	gpd/sf
Effective Area Beginning Depth	2	ft
Bottom Max Depth	6	ft
Design Flow	900	gpd
Drainage Field square footage	750	sf
Sidewall reduction credit	0.417	
Trench width	3	
Effective Area Depth	4	
Linear Length of trench Required	104	lf


2nd REPLACEMENT SYSTEM		
Number of Bedrooms	6	
Application Rate	1.2	gpd/sf
Effective Area Beginning Depth	2	ft
Bottom Max Depth	6	ft
Design Flow	900	gpd
Drainage Field square footage	750	sf
Sidewall reduction credit	0.417	
Trench width	3	
Effective Area Depth	4	
Linear Length of trench Required	104	lf

SOILS LEGEND			
SYMBOL	TYPE	K _f FACTOR	NAME
Co*	C	.37**	CODORUS AND HATBORO SILT LOAM, 0 TO 3 PERCENT SLOPES
GgC	B	.28	GLENELG LOAM, 3 TO 8 PERCENT SLOPES
MoC	B	.32	MANOR LOAM, 8 TO 15 PERCENT SLOPES
MoD	B	.32**	MANOR LOAM, 15 TO 25 PERCENT SLOPES
* INDICATES HYDRIC SOILS			
** HIGHLY ERODIBLE, K>0.35, AND/OR 15% OR GREATER SLOPES			
TAKEN FROM THE NRCS WEB SOIL SURVEY, APRIL 2016. PAGE 15			

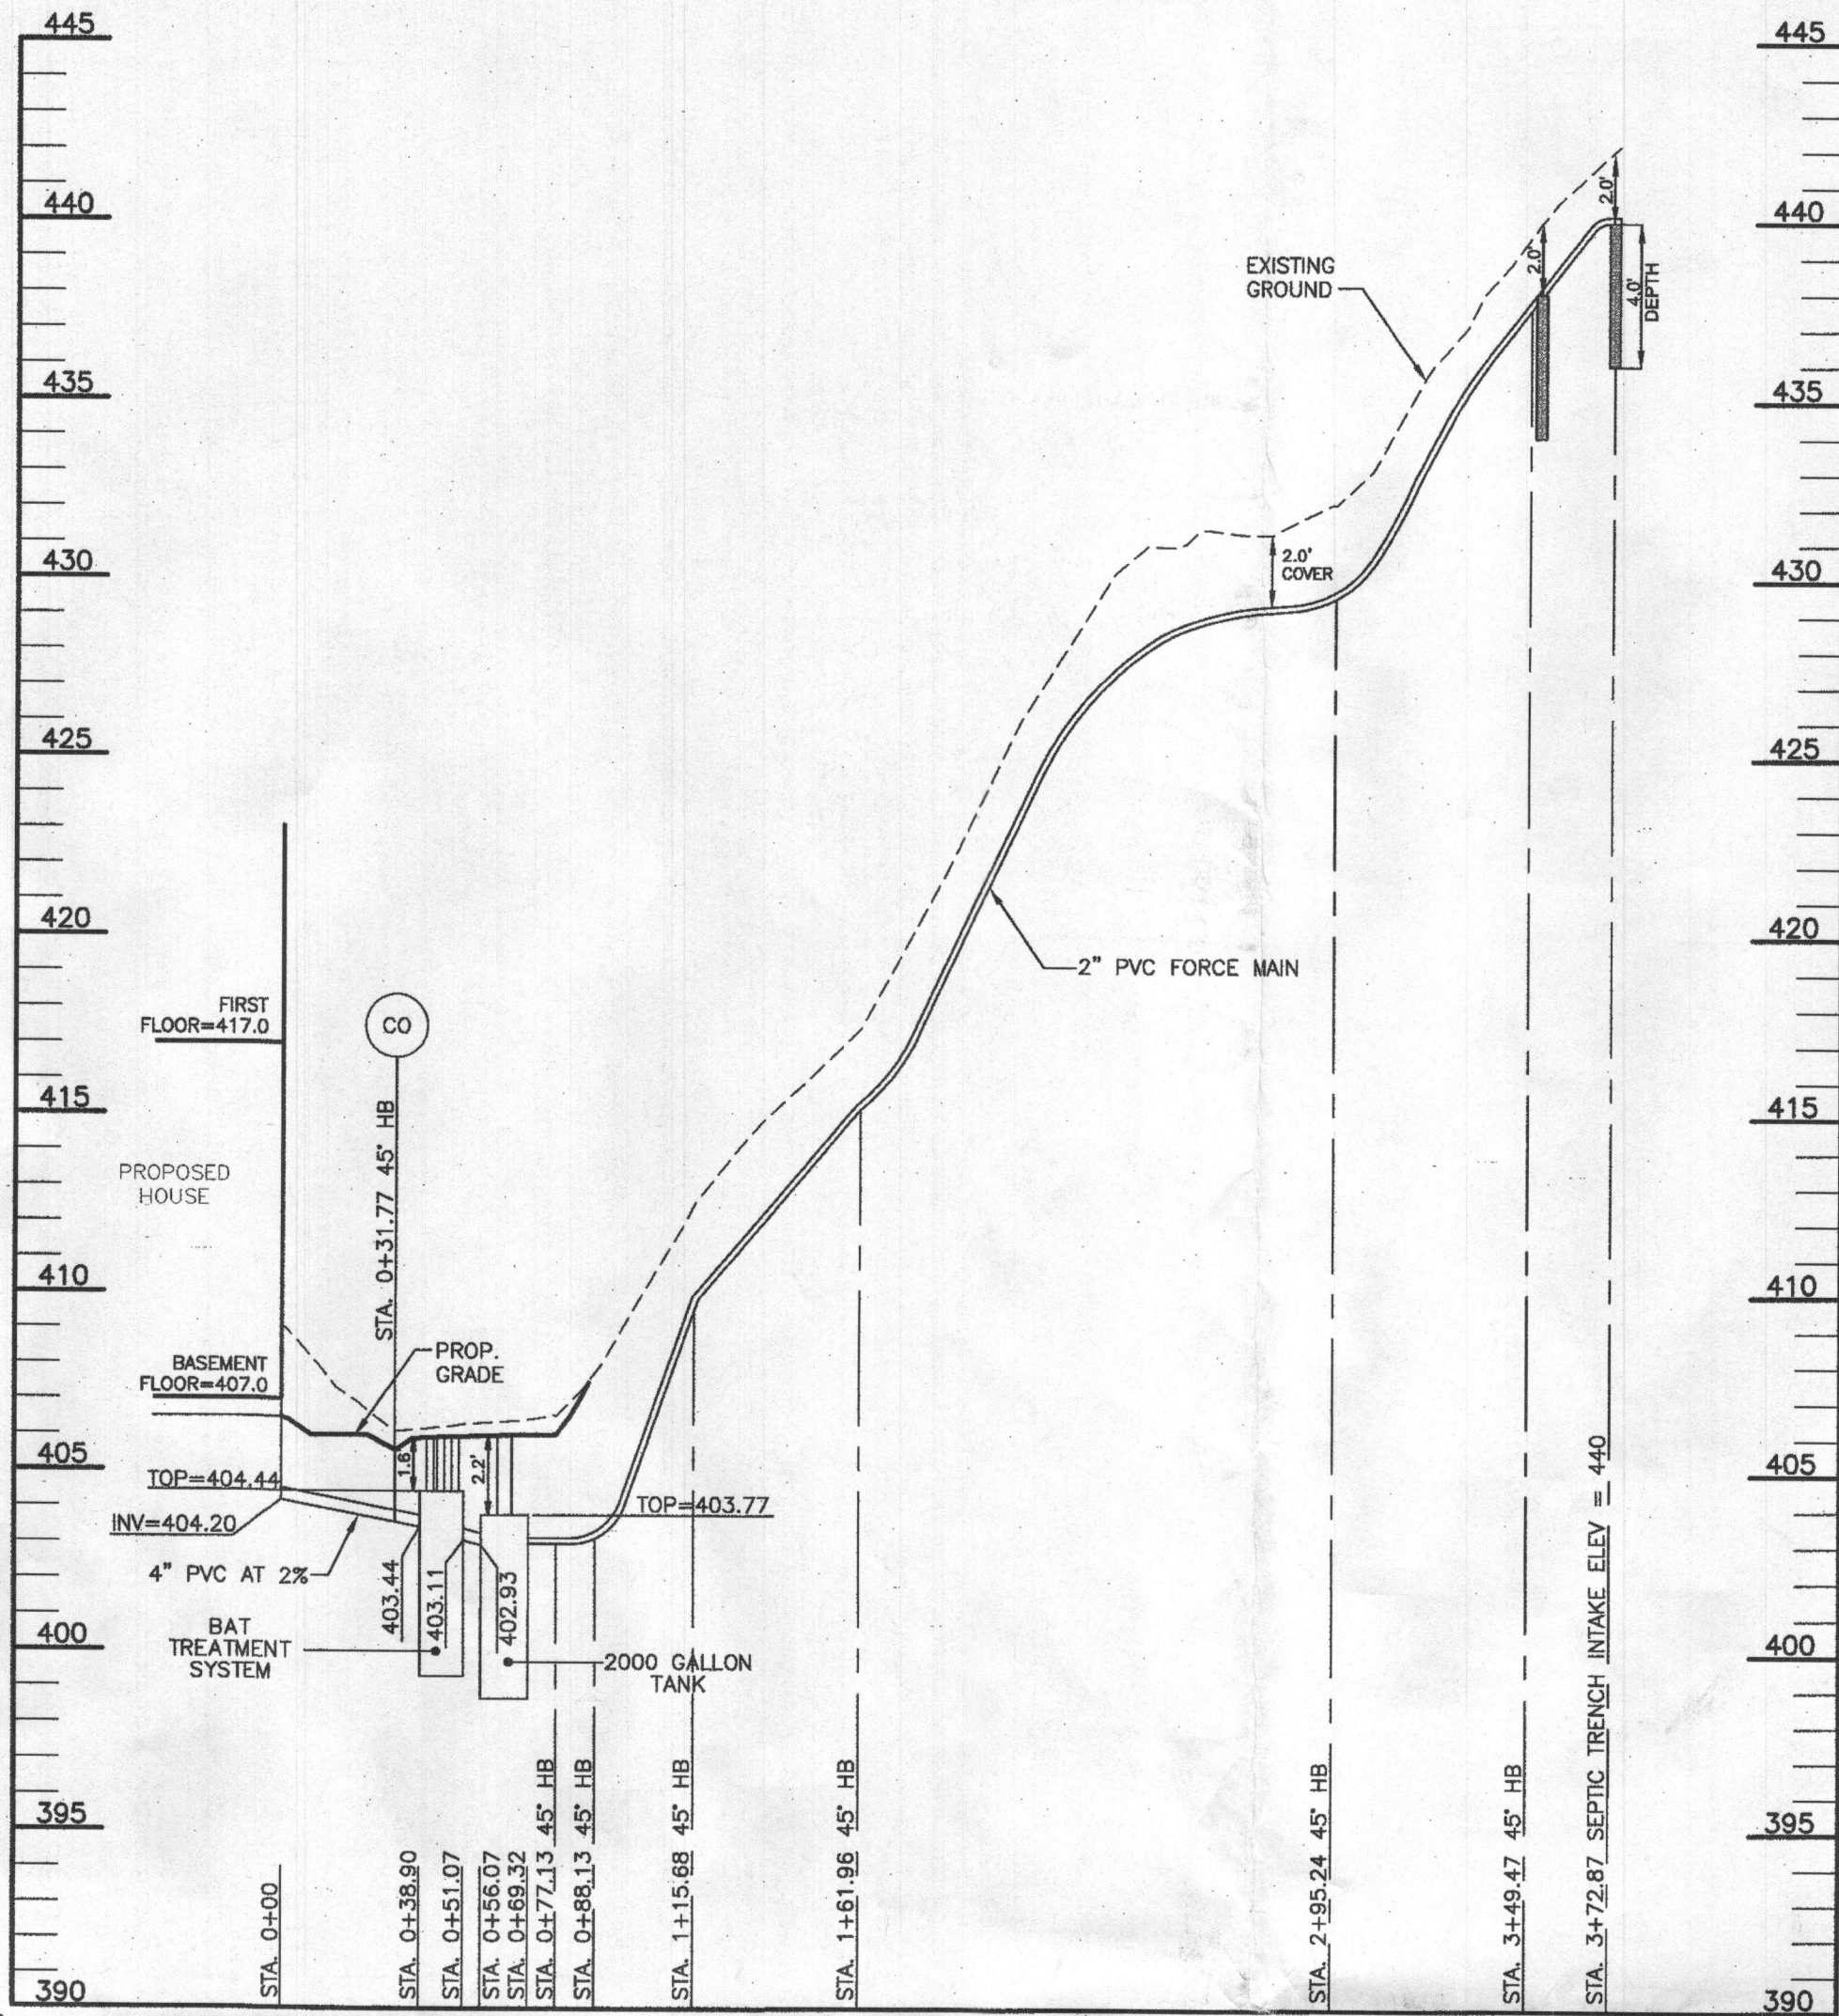


LOT 2 SEPTIC PROFILE
SCALE: 1"=50' HORIZ., 1"=5' VERT.

TRENCH INFORMATION		
TRENCH 1-1	TRENCH LENGTH	52 LF
	TRENCH LENGTH	52 LF
	GROUND ELEVATION	442.0
	INVERT ELEVATION	440.0
	MAX. BOTTOM ELEV.	436.0
TRENCH 2-1	TRENCH LENGTH	52 LF
	TRENCH LENGTH	52 LF
	GROUND ELEVATION	439.5
	INVERT ELEVATION	437.5
	MAX. BOTTOM ELEV.	433.5
TRENCH 3-1	TRENCH LENGTH	52 LF
	TRENCH LENGTH	52 LF
	GROUND ELEVATION	434.0
	INVERT ELEVATION	432.0
	MAX. BOTTOM ELEV.	428.0

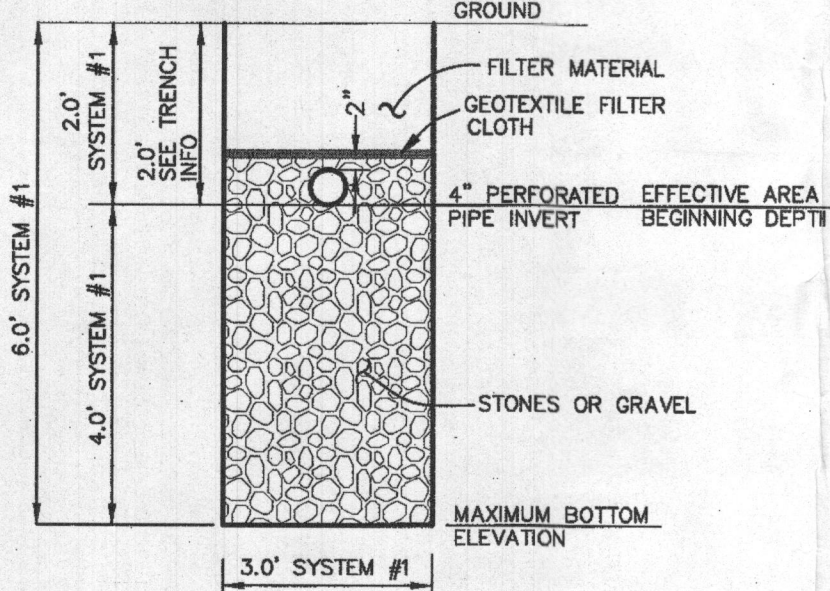

TYPICAL TRENCH DETAIL
NOT TO SCALE

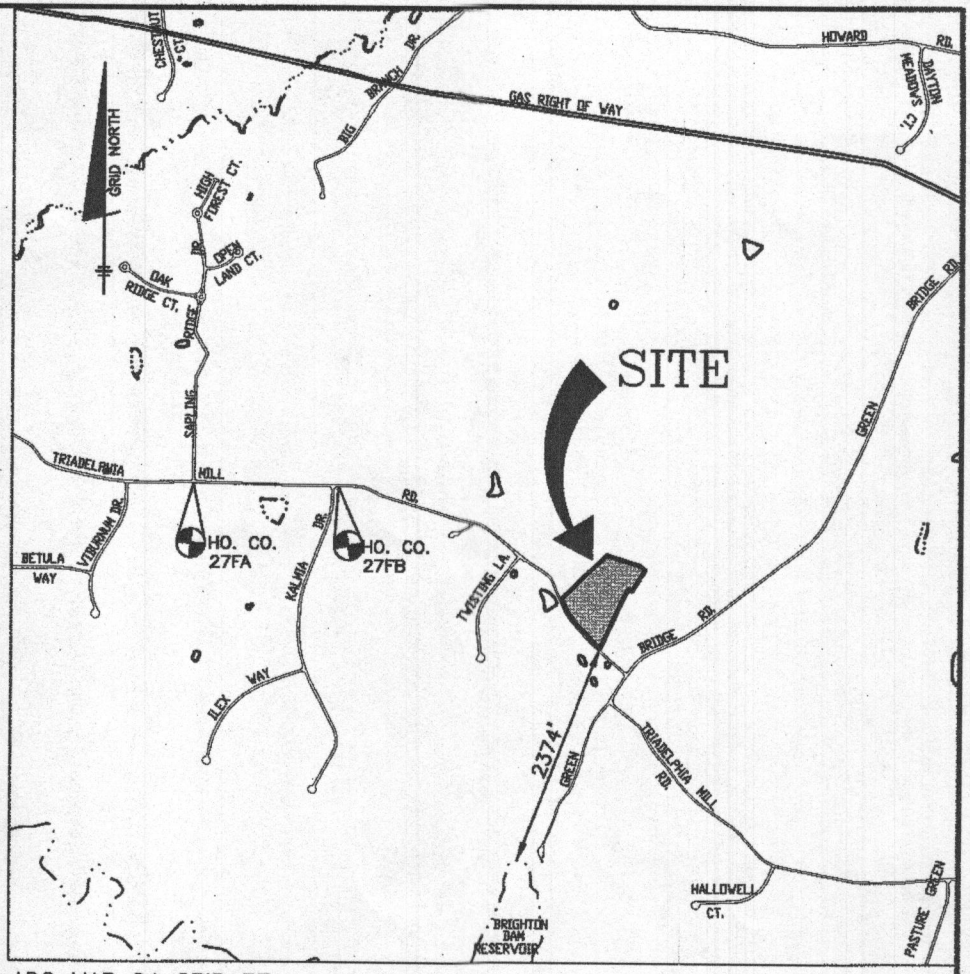

VICINITY MAP
SCALE: 1"=200'

BENCHMARKS (NAD83)	
HO. CO. No. 27FA	ELEV. 496.35
18.2' SOUTH OF THE CENTERLINE OF TRIADELPHIA MILL RD AT THE INTERSECTION OF SAPLING RIDGE DR.	
N 569002.176	E 1306892.586
HO. CO. No. 27FB	ELEV. 512.22
3.2' SOUTH OF THE EDGE OF PAVING OF TRIADELPHIA MILL RD 61' EAST OF THE CENTERLINE OF KALMIA DR.	
N 568975.151	E 1308421.369

LEGEND

SOILS CLASSIFICATION	GrB3
SOILS DELINEATION	---
EXISTING CONTOURS	---
EXISTING WOODS LINE	---
EXISTING WELL	W
PROPOSED WELL	PROPOSED WELL BOX
PASSING PERCOLATION TEST	○
FAILING PERCOLATION TEST	●
EXISTING STRUCTURE	---
PROPOSED STRUCTURE	---
PROPOSED SEWAGE DISPOSAL AREA	---
BETWEEN 20% AND 24.99% SLOPES	---
EX. 100 YEAR FLOODPLAIN	---

Howard County Health Department
NORWECO TNT 960 LP
w/ Mayer Bros. 2000 Gallon Pump Tank
& Zoeller D165 (1HP) Pump
1/12/2018
Signature: [Signature]
BAT-LPD system

THE CONTRACTOR SHALL NOTIFY THE DEPARTMENT OF PUBLIC WORKS/BUREAU OF ENGINEERING/CONSTRUCTION INSPECTION DIVISION AT 410-313-1880 AT LEAST FIVE (5) WORKING DAYS PRIOR TO THE START OF ANY WORK.

THE CONTRACTOR SHALL NOTIFY "MISS UTILITY" AT 1-800-257-7777 AT LEAST 48 HOURS PRIOR TO ANY EXCAVATION WORK BEING DONE.

BENCHMARK ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE SUITE 315 ELLICOTT CITY, MARYLAND 21043
(P) 410-465-6105 (F) 410-465-6644
WWW.BE-CIVILENGINEERING.COM

Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 45577, Expiration Date: 06-08-2018.

OWNER/DEVELOPERS:
ELLEN M. VAWTER,
MICHAEL A. VAWTER,
NANCY J. VAWTER,
LAURA J. LEONARD,
DREW S. LEONARD
14170 TRIADELPHIA MILL ROAD
DAYTON, MARYLAND 21036
301-706-6044

PROJECT:
VAWTER PROPERTY
LOT 2
LOCATION: 14174 TRIADELPHIA MILL ROAD
TAX MAP: 27 - GRID: 24 - PARCEL: 68
ZONED: RR-DEO RURAL RESIDENTIAL
ELECTION DISTRICT NO. 5 - HOWARD COUNTY, MARYLAND
TITLE: SEPTIC SYSTEM DESIGN PLAN
DATE: DECEMBER, 2017 PROJECT NO. 2766
SCALE: AS SHOWN SHEET 1 OF 3

DESIGN: LDD DRAFT: LDD CHECK: AAM

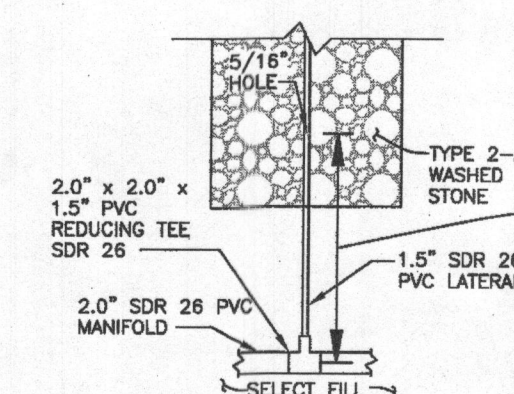
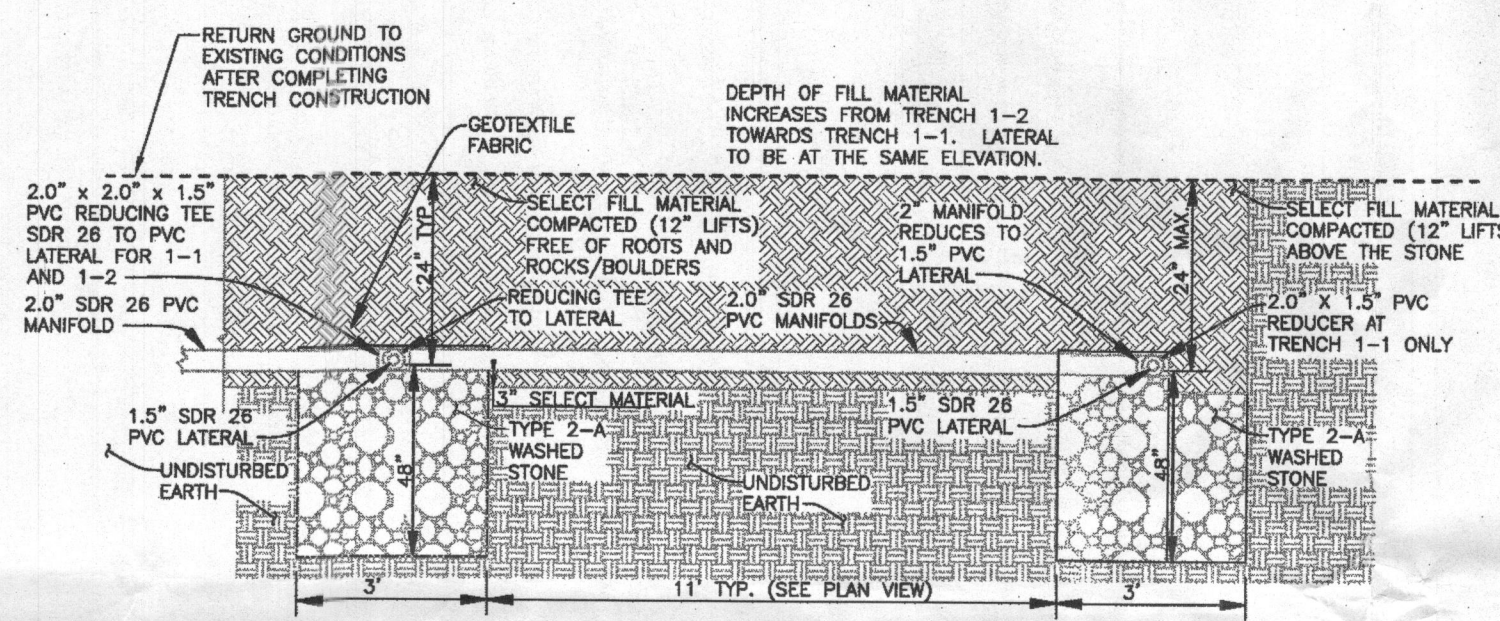
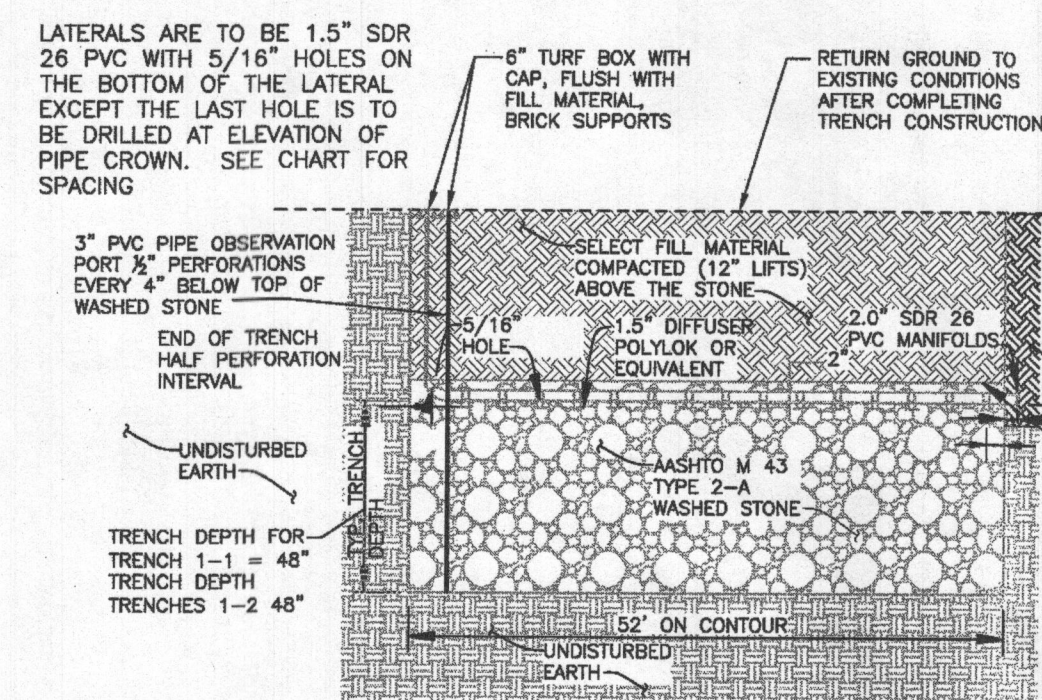


Diagram illustrating the vertical septic trench installation, showing the trench structure, perforation design, and dimensions.

Key components and dimensions shown:

- END OF TRENCH
- VERTICAL PIPE TO TURF BOX
- 5/16" HOLE
- SEE CHART "PERFORATION DESIGN", COLUMN "DIST. LAST PERF. TO TRENCH EDGE" FOR DIMENSION
- SEE CHART "PERFORATION DESIGN", COLUMN "PERFORATION SPACING (FT)" FOR DIMENSION
- SEE CHART "PERFORATION DESIGN", COLUMN "PERFORATION SPACING (FT)" FOR DIMENSION
- 1.5" SDR 26 PVC LATERAL
- SEE CHART "PERFORATION DESIGN", COLUMN "PERFORATION SPACING (FT)" FOR DIMENSION
- 10.0' MINIMUM
- EDGE OF NEXT SEPTIC TRENCH
- SEE CHART "PERFORATION DESIGN", COLUMN "PERFORATION SPACING (FT)" FOR DIMENSION
- SEPTIC TRENCH FILL: 2-A WASHED STONE
- SEE CHART "PERFORATION DESIGN", COLUMN "DIST. MANIFOLD TO FIRST PERF. (FT)" FOR DIMENSION
- 1.5" SDR 26 PVC LATERAL
- 2.0" SDR 26 PVC MANIFOLD
- 1.5" PVC TEE SDR 26
- 1-2. USE 2.0" X REDUCER SDR 26 AT 1" ONLY
- SEPTIC TRENCH

NOTE: NUMBER OF PERFORATION VARIES. SEE CHART "PERFORATION DESIGN", COLUMN "PERFORATION SPACING (FT)" FOR NUMBER OF PERFORATIONS

Trench and Lateral Design											
Cell	Trench	Pipe Inv.	Trench	Highest	Lowest	Total Depth	Approx. Lateral	Number of	Flow per	Flow per	Flow
		Elev.	Bottom Elev.	Ground Over	Ground Over	Head (ft)	Length (ft)	Perforations	Perforation (gpm)	Lateral (gpm)	Differentia
1	1	440.0	436.0	442.0	442.0	49.0	50.5	12	1.63	19.54	0.0%
	2	438.0	434.0	440.0	440.0	47.0	55.0	9	2.30	20.70	5.9%

Depth To Effective Sidewall	Deep Trench Depth	Depth to Inlet
Trench 1 2 ft	4 ft	2 ft
Trench 2 2 ft	4 ft	2 ft

Perforation Design								
Cell	Trench	Number of Perforations	Manifold to Trench (ft)	Trench Length (ft)	Perforation Spacing (ft)	Dist. Manifold to First Perf. (ft)	Dist. Last Perf. to Trench Edge (ft)	Lateral Length (ft)
1	1	12	1.4	52	4.33	3.57	2.17	51.23
	2	9	6.7	52	5.78	9.59	2.89	55.81

Lateral Pressure Calculations																		
Cell	Trench	Pipe Elev.	Beginning Manifold Loss	Gate Valve	Manifold Bends 45D	Manifold Length	Manifold velocity	Manifold Thru Tees	Delta Loss	Total Manifold Loss	Lateral 90 degree side tee loss	Sudden Reduction Loss	Lateral Bends 45 deg. Loss	Lateral Length to first perf. Loss	Lateral Loss Summation	Total Loss to First Perf.	Total Design Head (ft)	Flow per Lateral (gpm)
1	1	438.0	0.00	0	6	284	39.1	0	7.20	7.20	0.06	0.01	0.00	0.21	0.28	7.48	48.95	20.70
1	1	440.0	7.20			20	19.5	1	0.12	7.32	0.06	0.01	0.00	0.08	0.15	7.47	48.94	19.54
Perforation Diameter =		5/16 inches		Distal Head		2 feet												

Tank and Float Design:			
Ground over Tank =	406.00 ft	Inside Tank Dimensions	
Top of Tank =	403.77 ft	Height =	4.67 ft
Invert of Tank =	398.68 ft	Width =	5.58 ft
Pump Block =	0.50 ft	Length =	13.06 ft
Water End and Motor =	1.34 ft	Number of Tanks =	1
per Mayer Brothers Precast			
minimum Pump off =	400.52 ft		
Pump Off Float =	400.53 ft		
Dose =	27.89 cf		
Area of Pit	72.99 sf	Use one 2,000 gallon pump tank	
Pump on dist. =	0.38 ft		
Pump on Elev. =	400.91 ft		
Distance between Pump on and Highwater Alarm =			0.5 ft
Highwater Alarm Elevation =			401.41 ft
High Water Alarm to inlet =	1.52		
Volume Above Alarm to Inlet =	110.78 cf or		828.66 gallons
One Day Flow =	800.00 gallons		not okay
90% One Day Flow =	910.00 gallons		okay

BENCHMARK
ENGINEERS LAND SURVEYORS PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE SUITE 315A ELLICOTT CITY, MARYLAND 21043
(P) 410-465-6105 (F) 410-465-6944
WWW.BE-CIVILENGINEERING.COM

OWNER/DEVELOPERS:			PROJECT:		
ELLEN M. VAWTER, MICHAEL A. VAWTER, NANCY J. VAWTER, LAURA J. LEONARD, DREW B. LEONARD 14170 TRIADELPHIA MILL ROAD DAYTON, MARYLAND 21036 301-706-6044			VAWTER PROPERTY LOT 2		
			LOCATION: 14174 TRIADELPHIA MILL ROAD		
			TAX MAP: 27 - GRID 24 PARCEL: 68		
			ZONED: RR-DEO RURAL RESIDENTIAL ELECTION DISTRICT NO. 5 - HOWARD COUNTY, MARYLAND		
			TITLE:		
			SEPTIC SYSTEM DESIGN DETAILS		
			DATE:	NOVEMBER, 2017	PROJECT NO. 2766
DESIGN: LDD	DRAFT: LDD	CHECK: AAM	SCALE:	NONE	SHEET 3 OF 3

Approved: *[Signature]* **ITC System Plan**
Howard County Health Department
NORWECO INT. PUMP
17 Hayer Sts., 2000 gal Pump Tank
17 Zacher Dues (4th) Pump
R. Bricker 1/12/2018
Signature Date
BIT-LPD system

Friction Head			
main			
Friction Head = Head loss due to pipe friction			
2" pipe =	304 feet		
Lateral	48.00 feet		
45° bends	6 loss for manifold bend	24.0 feet	per table 4.3
Str. Coupling	1 loss for straight tee	2.0 feet	per table 4.3
90 deg. Side tee	1 loss for tee bend	10.0 feet	per table 4.3 for smaller pipe
Sudden reduction	1 loss for reduction	1.0 feet	per Crane Co. technical paper
45° bends	1 loss for lateral bend	3.0 feet	per table 4.3
Gate Valve	0 loss for valve	0.0 feet	per table 4.3
Equivalent Manifold Length =	330.0	Friction loss =	7.72 feet
1.5" lateral	62.00 feet	Friction loss =	1.37 feet
Total Friction Head =	90.00		

GENERAL NOTES


1. THE LOT SHOWN HEREON COMPLIES WITH THE MINIMUM OWNERSHIP WIDTH AND LOT AREA AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT.
2. THIS AREA DESIGNATES A PRIVATE SEWAGE DISPOSAL AREA OF AT LEAST 10,000 S.F. AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT FOR INDIVIDUAL SEWAGE DISPOSAL IMPROVEMENTS OF ANY NATURE IN THIS AREA ARE RESTRICTED UNTIL PUBLIC SEWER IS AVAILABLE. THIS EASEMENT SHALL BECOME NULL AND VOID UPON CONNECTION TO A PUBLIC SEWER SYSTEM. THE COUNTY HEALTH OFFICER SHALL HAVE THE AUTHORITY TO GRANT ADJUSTMENTS TO THE PRIVATE SEWAGE EASEMENT. RECORDATION OF A MODIFIED SEWAGE EASEMENT PLAT SHALL NOT BE REQUIRED.
3. TOPOGRAPHY SHOWN WITHIN THE LIMIT OF DISTURBANCE IS BASED ON HOWARD COUNTY GIS, 2 FOOT CONTOURS, AND VERIFIED WITH FIELD RUN TOPOGRAPHY BY BENCHMARK ENGINEERING, INC. IN JULY, 2017.
4. TO THE BEST OF OUR KNOWLEDGE, ALL WELLS AND SEPTIC SYSTEMS LOCATED WITHIN 100' OF THE PROPERTY BOUNDARIES AND 200' DOWN GRADIENT OF ANY WELL AND/OR SEPTIC HAVE BEEN SHOWN.
5. ANY CHANGES TO A PRIVATE SEWAGE EASEMENT SHALL REQUIRE A REVISED PERCOLATION CERTIFICATION PLAN.
6. STORMWATER MANAGEMENT FOR THIS LOT COMPLIES WITH THE "MARYLAND DEPARTMENT OF THE ENVIRONMENT STORMWATER MANAGEMENT ACT OF 2007" AND THE "HOWARD COUNTY DESIGN MANUAL VOLUME I, CHAPTER 5". STORMWATER MANAGEMENT IS PROVIDED BY NON-ROOFTOP DISCONNECTION (N-2), TWO (M-6) MICRO BIO-RETENTIONS AND TWO (M-5) DRY WELLS. THEY ARE PRIVATELY OWNED AND PRIVATELY MAINTAINED.
7. A DECLARATION OF INTENT FOR SINGLE FAMILY RESIDENTIAL LOT EXEMPTION (CLEARING LESS THAN 20,000 SQUARE FEET OF FOREST) SHALL BE FILED WITH DPZ.
8. PROPERTY ACREAGE: (LOT 2) 3.04 AC., ZONED RR-DEO.
9. PROPOSED LIMIT OF DISTURBANCE: 3.0 AC.
10. FOREST STAND DELINEATION HAS BEEN PERFORMED BY BENCHMARK ENGINEERING, INC. IN FEBRUARY, 2017, AND IS PROVIDED AS PART OF THE SIMPLIFIED ENVIRONMENTAL CONCEPT PLAN SUBMISSION.
11. SPECIMEN TREES HAVE BEEN FIELD LOCATED BY BENCHMARK ENGINEERING, INC. AND ARE DEPICTED ON THIS PLAN.
12. THE EXISTING WELL SHOWN (TAG #HO-17-0197) SHOWN ON THIS PLAN HAS BEEN FIELD LOCATED BY BENCHMARK ENGINEERING, INC. DECEMBER, 2017 AND IS ACCURATELY SHOWN.
13. EXACT LENGTH OF SEPTIC TRENCHES IS TO BE DETERMINED BY THE HEALTH DEPARTMENT AT THE TIME OF TRENCH LAYOUT AND INSPECTION.
14. ANY CHANGES TO THE LOCATION OR DEPTHS TO ANY COMPONENTS MUST BE APPROVED BY THE ENGINEER AND THE HOWARD COUNTY HEALTH DEPARTMENT PRIOR TO INSTALLATION. A REVISED SITE PLAN MAY BE REQUIRED.
15. THE MAXIMUM EARTH COVER OVER THE SEPTIC TANK IS 3 FEET. GREATER EARTH COVER WILL REQUIRE A HEAVY LOAD BEARING TANK.

REQUIRED BAT SITE PLAN NOTES



1. ANY CHANGE TO THE LOCATIONS OR DEPTHS TO ANY COMPONENTS MUST BE APPROVED BY THE ENGINEER AND THE HOWARD COUNTY HEALTH DEPARTMENT PRIOR TO INSTALLATION. A REVISED SIT PLAN MAY BE REQUIRED.
2. THE MAXIMUM DEPTH OF THE BAT SHALL BE PER THE MANUFACTURER'S SPECIFICATION.
3. THE BLOWER MAY NOT BE LOCATED FURTHER FROM THE TANK THAN THE MANUFACTURER'S SPECIFICATIONS.
4. THE BAT SYSTEM SHALL BE MAINTAINED AND OPERATED FOR THE LIFE OF THE SYSTEM.
5. THE BAT SHALL BE OPERATED BY AND MAINTAINED BY A CERTIFIED SERVICE PROVIDER.
6. WITHIN ONE MONTH OF INSTALLATION, A PERSON INSTALLING THE BAT SYSTEM SHALL REPORT TO THE MARYLAND DEPARTMENT OF THE ENVIRONMENT (MDE) IN A MANNER ACCEPTABLE TO MDE, THE ADDRESS AND DATE OF COMPLETION OF THE BAT INSTALLATION AND THE TYPE OF BAT INSTALLED.
7. ELECTRICAL WORK FOR THE BAT INSTALLATION MUST BE PERFORMED BY A LICENSED ELECTRICIAN.
8. AN AGREEMENT AND EASEMENT MUST BE COMPLETED AND SIGNED BY ALL APPLICABLE PARTIES, AND RECORDED IN LAND RECORDS OF HOWARD COUNTY.
9. THE HEALTH DEPARTMENT REQUIRES DOCUMENTATION FOR THE START-UP CERTIFICATION FROM THE MANUFACTURER PRIOR TO FINAL APPROVAL OF THE INSTALLATION.

INITIAL SYSTEM		
Number of Bedrooms	6	
Application Rate	1.2	gpd/sf
Effective Area Beginning Depth	2	ft
Bottom Max Depth	6	ft
Design Flow	900	gpd
Drainage Field square footage	750	sf
Sidewall reduction credit	0.417	
Trench width	3	
Effective Area Depth	4	
Linear Length of trench Required	104	lf
1st REPLACEMENT SYSTEM		
Number of Bedrooms	6	
Application Rate	1.2	gpd/sf
Effective Area Beginning Depth	2	ft
Bottom Max Depth	6	ft
Design Flow	900	gpd
Drainage Field square footage	750	sf
Sidewall reduction credit	0.417	
Trench width	3	
Effective Area Depth	4	
Linear Length of trench Required	104	lf
2nd REPLACEMENT SYSTEM		
Number of Bedrooms	6	
Application Rate	1.2	gpd/sf
Effective Area Beginning Depth	2	ft
Bottom Max Depth	6	ft
Design Flow	900	gpd
Drainage Field square footage	750	sf
Sidewall reduction credit	0.417	
Trench width	3	
Effective Area Depth	4	
Linear Length of trench Required	104	lf

SOILS LEGEND		
SYMBOL	TYPE	NAME
Co*	C	CODORUS AND HATBORO SILT LOAM, 0 TO 3 PERCENT SLOPES
GcC	B	GLENELG LOAM, 3 TO 8 PERCENT SLOPES
McC	B	MANOR LOAM, 8 TO 15 PERCENT SLOPES
MoD	B	MANOR LOAM, 15 TO 25 PERCENT SLOPES
* INDICATES HYDRIC SOILS		
** HIGHLY ERODIBLE, K>0.35, AND/OR 15% OR GREATER SLOPES		
TAKEN FROM THE NRCS WEB SOIL SURVEY, APRIL 2016. PAGE 15		

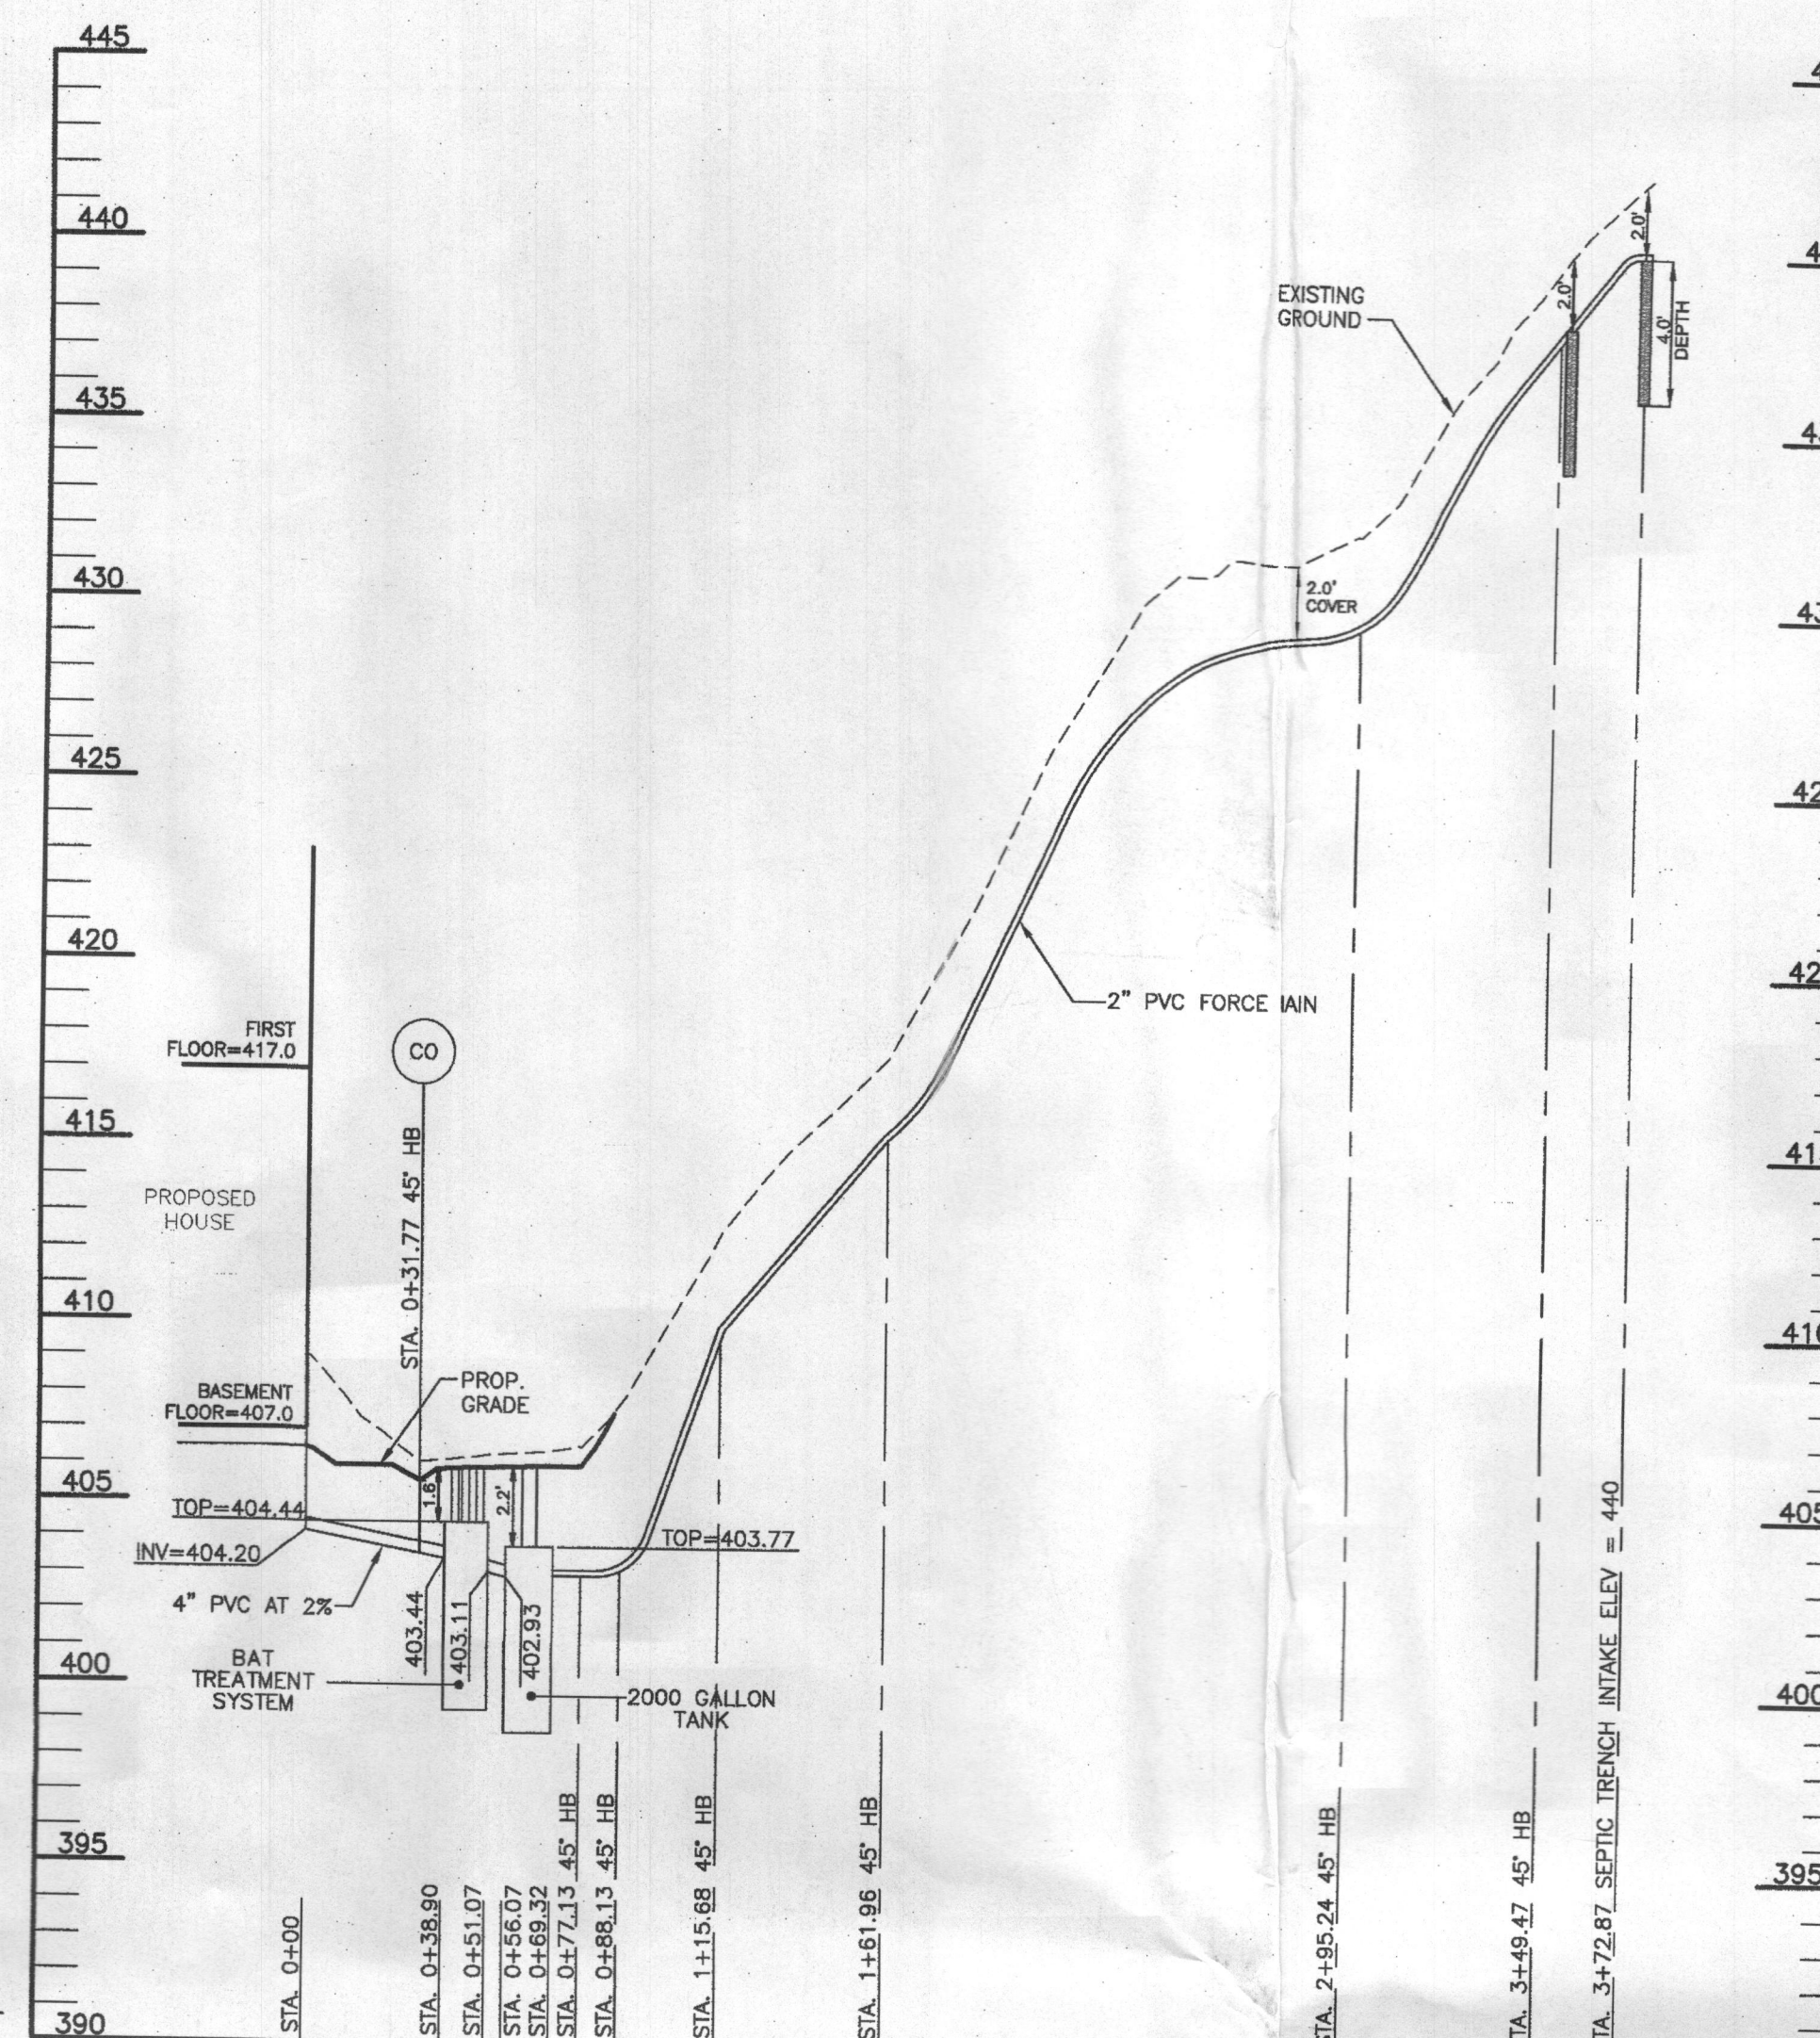

TRENCH INFORMATION		
TRENCH 1-1	TRENCH 2-1	TRENCH 3-1
TRENCH LENGTH 52 LF	TRENCH LENGTH 51 LF	TRENCH LENGTH 52 LF
GROUND ELEVATION 442.0	GROUND ELEVATION 439.5	GROUND ELEVATION 436.9
INVERT ELEVATION 440.0	INVERT ELEVATION 437.5	INVERT ELEVATION 434.9
MAX. BOTTOM ELEV. 436.0	MAX. BOTTOM ELEV. 435.5	MAX. BOTTOM ELEV. 430.5
TRENCH 1-2	TRENCH 2-2	TRENCH 3-2
TRENCH LENGTH 52 LF	TRENCH LENGTH 52 LF	TRENCH LENGTH 52 LF
GROUND ELEVATION 440.0	GROUND ELEVATION 438.0	GROUND ELEVATION 434.0
INVERT ELEVATION 438.0	INVERT ELEVATION 436.0	INVERT ELEVATION 432.0
MAX. BOTTOM ELEV. 434.0	MAX. BOTTOM ELEV. 432.1	MAX. BOTTOM ELEV. 428.0

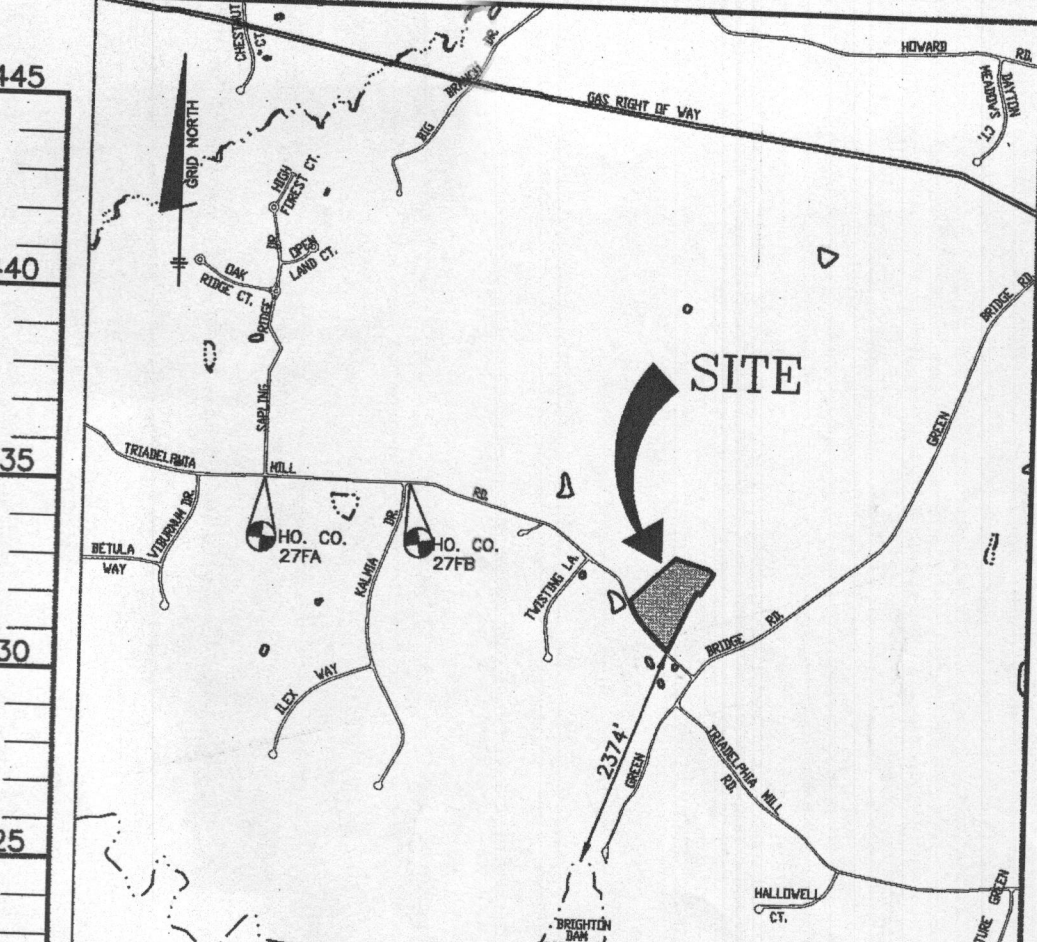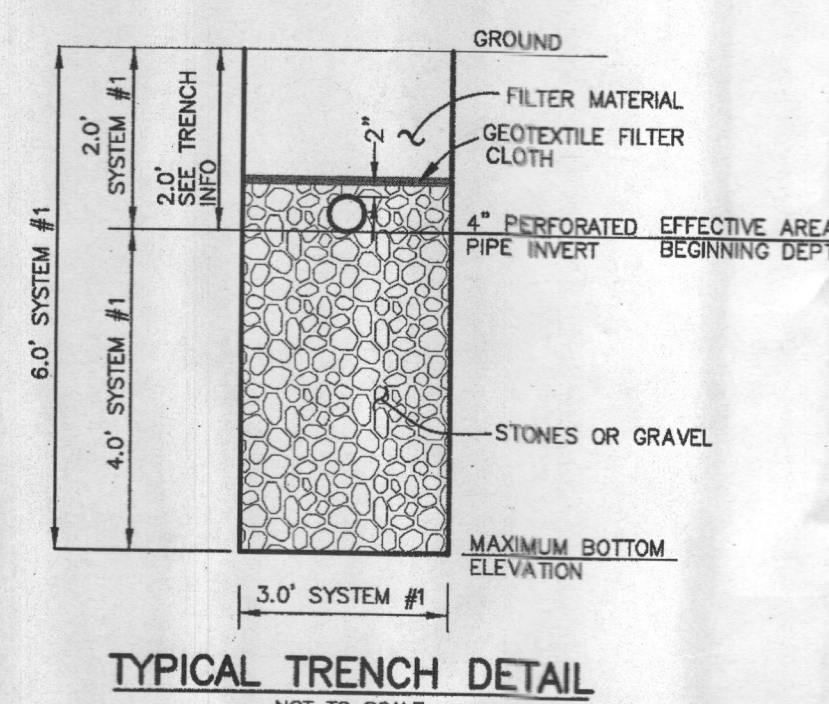

VICINITY MAP		
SCALE: 1"=2000'		
BENCHMARKS (NAD83)		
HO. CO. No. 277A	ELEV. 496.35	
18.2' SOUTH OF THE CENTERLINE OF TRIADAPLHIA MILL RD AT THE INTERSECTION OF SARDING RIDGE DR.		
N 569002.176	E 1306892.586	
HO. CO. No. 277B	ELEV. 512.22	
3.2' SOUTH OF THE EDGE OF PAVING OF TRIADAPLHIA MILL RD 61' EAST OF THE CENTERLINE OF KALMA DR.		
N 568975.151	E 1308421.369	

LEGEND	
SOILS CLASSIFICATION	GrB
SOILS DELINEATION	---
EXISTING CONTOURS	---
EXISTING WOODS LINE	---
EXISTING WELL	W
PROPOSED WELL	PROPOSED WELL BOX
PASSING PERCOLATION TEST	○
FAILING PERCOLATION TEST	●
EXISTING STRUCTURE	---
PROPOSED STRUCTURE	---
PROPOSED SEWAGE DISPOSAL AREA	---
BETWEEN 20% AND 24.99% SLOPES	---
EX. 100 YEAR FLOODPLAIN	---

Approved Septic System Plan
Howard County Health Department
NORWECO TST 9604P
w/ Mayer Bros. 2000-gal Pump Tank
3 Zoeller D105 (1hp) Pump
R. Bueker 1/2/2018
Signature: R. Bueker Date

THE CONTRACTOR SHALL NOTIFY THE DEPARTMENT OF PUBLIC WORKS/BUREAU OF ENGINEERING/CONSTRUCTION INSPECTION DIVISION AT 410-313-1880 AT LEAST FIVE (5) WORKING DAYS PRIOR TO THE START OF ANY WORK.

THE CONTRACTOR SHALL NOTIFY "MISS UTILITY" AT 1-800-257-7777 AT LEAST 48 HOURS PRIOR TO ANY EXCAVATION WORK BEING DONE.

BENCHMARK ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE & SUITE 315 & ELLICOTT CITY, MARYLAND 21043
(P) 410-465-8105 (F) 410-465-8644
WWW.BE-ENGINEERING.COM

Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 45577, Expiration Date: 06-08-2018.

Signature: R. Bueker

OWNER/DEVELOPERS:
ELLEN M. VAWTER,
MICHAEL A. VAWTER,
NANCY J. VAWTER,
LAURA J. LEONARD,
DREW B. LEONARD
14174 TRIADAPLHIA MILL ROAD
DAYTON, MARYLAND 21036
301-706-8044

PROJECT:
VAWTER PROPERTY
LOT 2

LOCATION:
14174 TRIADAPLHIA MILL ROAD
TAX MAP: 27 - GRID: 24 - PARCEL: 68
ZONED: RR-DEO RURAL RESIDENTIAL
ELECTION DISTRICT NO. 5 - HOWARD COUNTY, MARYLAND

TITLE:
SEPTIC SYSTEM DESIGN PLAN

DATE: DECEMBER, 2017 PROJECT NO. 2766
SCALE: AS SHOWN SHEET 1 OF 3