

GENERAL NOTES

- ALL WORK SHALL COMPLY TO ALL APPLICABLE LOCAL CODES.
- All construction shall be classified as One- and Two-Family Dwellings and comply to the 2018 INTERNATIONAL RESIDENTIAL CODE w/ AMENDMENTS.
- All construction shall comply to the 2018 INTERNATIONAL ENERGY CONSERVATION CODE (or as required by local code).
- These plans and notes are the property of Architecture Collaborative, Inc. Use of these plans without the written consent of Architecture Collaborative, Inc. is prohibited.
- These are conceptual plans and schematic in nature. Their purpose is to develop a proto-type house.
- These plans are subject to modification as necessary to meet code requirements or to facilitate mechanical/plumbing installations or to incorporate design improvements. The Architect reserves the right to make any changes, for any reason, at any time.
- The Owner shall defend, indemnify and save harmless the Architect and Architecture Collaborative, Inc. from and against all suits, actions, claims, liabilities, losses and/or expenses, including attorney's fees, arising out of or resulting from the performance of any work by the Owner or its employees, subcontractors, agents or representatives, caused in whole or in part by any act or omission, whether negligent or otherwise, on the part of the Owner or its employees, subcontractors, agents or representatives.
- The Contractor shall compare and coordinate all drawings. When a discrepancy or an error/omission exists, he shall comply with the code and contact the Architect and Owner in writing for proper adjustment.
- These plans are NOT to be scaled for construction purposes. Written dimensions and notes supersede all scale references. Contact the Architect and Owner prior to work when any discrepancy arises.
- In the event certain features of construction are not fully shown on the drawings, their construction shall be of the same character as for similar conditions that are shown or noted.
- Habitable space, hallways, and portions of basements containing these spaces shall have a ceiling height of not less than 7'-0", except as required by code.
- Beams, girders, ducts or other obstructions in basements containing habitable space shall be permitted to project to within 6'-4" of the finish floor.
- Integral garages in dwelling units shall be separated from all adjacent living space w/ fire separation as required by local code.
- These drawings do not include structural details.

DESIGN LIVE LOADS

- RECOMMENDED MINIMUMS:

Roof	30 PSF	(40 PSF per JURISDICTION)
Sleeping Floors	30 PSF	
Living Floors	40 PSF	
Attic Floors	30 PSF	
Exterior Decks	40 PSF	
Garage Slabs	50 PSF	
Exterior Balconies	40 PSF	

 - Beams
 - Slabs
 - Individual tracks designed for uniformly distributed live load or 300-pound concentrated load over a 4 square inch area, whichever produces greatest stress.
 - Guard Rails 200 LB
 - A single concentrated load applied in any direction at any point along the top.

SITE

- GENERAL: These drawings do NOT cover sitework, grading, landscaping or zoning.
- Building foundations have been designed based on an assumed soil bearing capacity of 2,000 PSF (or as noted). Additional engineering may be required if soil bearing capacity is less than 2,000 PSF (or as noted), or if there is no Geotechnical report available.
- In lieu of a complete geotechnical evaluation, load-bearing values per Table R402(4) shall be assumed.
- Provide continuous perimeter foundation drainage in accordance with local code requirements. Where both interior and exterior drains are required, provide minimum 1-1/2" dia. bleeder pipes through mid-line of footing at 8' o.c. (max.). Typically, drains shall be lead to sump pits or to positive daylight discharge points.
- Slope all stoops, porches, walks and garage slabs away from building 1/8" minimum per foot.
- All work shall comply with local codes.

STAIR NOTES

- INTERIOR and EXTERIOR STAIRS:
- All stairs shall comply with the code and all local amendments.
 - Minimum finished width: 36"
 - Minimum finished headroom height: 6'-8"
 - Maximum riser height to be 7-3/4" or per local code.
 - Minimum tread depth to be 10" or per local code.
 - Maximum space between balusters to be 4" or per local code.
 - Handrail height shall NOT be less than 34" or greater than 38" and may not project more than 3 1/2" into stair string.
- Stair nosings shall have a minimum inside width of 6" and a minimum tread (10") or as per code, when measured 12" from the inside corner.
- Stair landings shall be a minimum of 36" x 36" finished.
- Stairways with (3) or more risers are required to have a handrail.
- Guard rails:
 - Porches, balconies or raised floor surfaces located more than 30" above the floor or grade below shall have guard rails not less than 36" in height. Guard rail spacing shall be designed not to allow passage of an object of 4" or more in diameter.
- The stair manufacturer is responsible for the design and construction of the stair. All work shall comply with local codes.

CONCRETE

- Bottom of footings shall be located at minimum frost line below finished grade, as per local code. Steps or depth of footing/foundation may vary according to local site or frost conditions.
- All interior concrete slabs 30" or greater in any direction shall have 6"x6"x10" welded wire mesh or control joints. Monolithic poured slab for townhouses shall have a control joint between units when required by local code.
- Concrete used in exposed areas implicit to freezing and thawing (both during construction and service life) shall be air-entrained in accordance with local code. Exterior flat-work shall be coated with an approved curing compound.
- Foundation walls of habitable space located below grade shall be water-proofed or damp-proofed using materials and methods approved by the local building jurisdiction.
- Garage / Exterior slabs shall be 5% to 7% air entrained concrete.

Type of Concrete Construction:	Minimum Specified Compressive Strength:
Footings	2500 PSI (MIN)
Foundation Walls	3000 PSI
Interior Concrete Slabs	3000 PSI
Garage Slabs	3500 PSI
Exterior Concrete Slabs (as per local code)	3500 PSI

- The concrete contractor is responsible for the design and construction of all concrete work. All work shall comply with code.

MASONRY

- The maximum vertical distance of unbalanced fill, measured from the top of the lower level floor slab to outside finished grade, shall not exceed the following and shall be re-inforced with 5 bars @ 16" o.c.

Type of Fill:	Height of Fill:
8" CMU	4'-0"
8" CMU (hollow)	5'-0"
8" CMU (solid)	6'-0"
8" Poured Concrete	5'-0"
12" Poured Concrete (as per local code)	7'-0"

- Prescriptive Load-Bearing Values of Foundation Materials shall not be less than 2,000 PSF or greater than 60 PSF lateral pressure. Additional engineering may be required if lateral pressure or load-bearing values are not within the above values.
- All backfill shall consist of sand and/or gravel.
- Top courses of CMU foundation walls shall be filled solid, including the courses under any steel beam or corrugated CMU, as per local code.
- Stone and Masonry veneer shall be attached and anchored in accordance with Section 103 (with Amendments).
- The masonry contractor is responsible for the design and construction of all masonry work. All work shall comply with local codes.

METAL

- Straps/bolts shall be per code and building inspector approved.
- Min. (2) straps/bolts per section of piling 12" max. from each end with immediate straps/bolts at
 - 1/2" bolts spaced per code.
 - Straps spaced per code or per manufacturer's specs.
- Galvanized metal brick ties shall be installed as per local codes.
- Gutters, downspouts, and bleeders shall be installed by MEP contractor as required by local codes.
- All structural steel shall be detailed, fabricated and erected in accordance with the latest edition of AISC (American Institute of Steel Construction) Specification for Structural Steel Buildings - Allowable Stress Design and Plastic Design and AISC code of standard practice, shall be of domestic origin and conform to:
 - Wideflange - ASTM A992, Fy = 50 ksi
 - Plates and Angles - ASTM A36
 - USS Round - ASTM A513, Grade B Fy = 35 ksi

SPECIALTIES

- Pre-Built fireplace units shall be UL approved and installed according to code and manufacturers specifications and recommendations.
- Wood burning fireplaces shall have tight-fitting flue dampers and outdoor combustion air.
- Chimneys shall extend a minimum of 2'-0" above any roof structure within 10'-0".
- Provide overflow pans and drains for wet appliances when located above a finished space.
- Provide a 22"x30" (Min.) attic access with switched light or 22"x40" pull down stair. Seal and insulate as per local code.
- Kitchen and Bath plans are approximate. See manufacturers plans for exact layout and dimensions.
- The drywall contractor is responsible for the design and construction of the party walls, fire walls and fire separator assemblies. All work shall comply with local codes.
- The fire suppression contractor is responsible for the design and construction of the suppression systems. All work shall comply with local codes.

THERM. PROTECTION

R-Value	Thickness	Location
R-4.6	--	Duct insulation in uncond. sp.
R-6	--	Duct insulation in uncond. sp.
R-6	--	Duct ins. below conc. slab.
R-8	--	Duct insulation in attic sp.
R-10	2"	Sub insulation at Perimeter
R-11 (banks)	35'	Basement Walls - unfinished
R-13	35'	Basement Walls - 2x4 Finished
R-13 + 5	35'	2x4 Walls - Exterior
R-21	5.5"	2x6 Walls - Exterior
R-13	6.25"	Crawl space / Floors exposed to unconditioned space
R-20	2"	Ceiling (w/ Energy seal)
R-36 C	10.25"	Vaulted Ceiling
R-38	8"	Ceiling (w/ Energy seal)
R-49	5" (min)	Ceiling (w/ standard seal)

- When using blown insulation, the manufacturer's settled R-value shall be used and the blown insulation shall be installed per manufacturer's specs.
- The building thermal envelope shall meet the requirements of the IECC Section R402.11 through R402.15.
- Prescriptive R-values in IECC Table R402.12 are shown above.
- Per IECC Section R402.14, Alternative U-values of an assembly may be substituted as the U-factor Alternative method to meet building thermal envelope requirements.
- Per IECC Section R402.15, the Total UA Alternative method may be used to meet the building thermal envelope requirements.
- Insulation for slab-on-grade construction shall begin at the inside intersection of the slab and foundation wall and shall extend for a minimum distance of 24" down the inside face of the foundation wall and horizontally under the slab.
- Provide continuous soffit vents and ridge vents as shown on drawings and as per code. Install insulation baffles in accordance with local code, in each rafter bay to maintain free air flow.
- Flashing shall be of pre-finished aluminum (or equal), installed at all roof offsets, chimneys, roof openings, hips, valleys, ridges, dormers and where roof intersects wall (as per local code).
- Contractor shall maintain, in all instances, proper fire, wind and insect ratings when penetrating through walls, floors, ceilings and roofs.

WINDOWS and DOORS

- Provide safety glazing as required by local code.
- All doors and windows shall be sealed and flashed on all sides and installed in accordance with manufacturers specifications and per local code.
- Garage door into dwelling shall have a minimum fire rating of 30 minutes (or per local code). The threshold of the door opening between the garage and adjacent interior space shall not be less than 4" above the garage floor (or per local code).
- Every sleeping room shall have at least one operable window or exterior door approved for emergency egress or rescue. The sill height shall not be more than 44" above the floor. Egress windows must have a minimum net clear opening of 5.7', or per local code.
- Window sill height shall be a minimum 24" above finished floor at all sills greater than 12" above finished grade, or per local code.

WOOD

- Wall bracing shall be installed as per local code.
- All roof trusses and floor systems shall be engineered by others.
- All roof trusses and floor systems shall be braced and installed per manufacturers specifications and per local code. See manufacturers plans for exact layout and construction.
- Fire-stopping shall be provided to cut off concealed draft openings and to form an effective fire barrier between stories, as per local code.
 - At the intersection of Kitchen bulkhead and wall.
 - At the top of all heat chases.
 - At bathroom trap openings.
 - 2x fire-stopping / blocking at every floor or 8'-0" o.c. vert.
- LVL Beams: 1-3/4" wide - 20E Microlam LVL
- LVL Beams: 3-1/2" wide - 155E Timberstrang LVL
- PSL Beams: 3-1/2" wide - 20E Parallel PSL
- PSL Columns: (as noted) - 12E Parallel PSL Columns
- All walls to be 16" o.c. (stud thickness per plan), minimum SFF stud grade unless otherwise noted. Interior non-load bearing partitions may be 2x4 studs at 24" o.c.
- All interior and exterior load bearing walls shall have lepping top plates unless walls intersect.
- All wood less than 6" from grade shall be treated lumber. All sole plates on slabs and foundations shall be treated lumber.
- Provide bracing at all structural members as required by code.
- Provide floor and wall blocking as shown on framing plans as required by local codes.
- See drawings for type of floor construction.
 - Tongue and groove floor decking, glued and fastened on floor joists shall meet the American Plywood Assoc. Sturo-Floor System.
- All materials shall be installed per manufacturers specifications and per applicable local codes.

TABLE R602.3: ALLOWABLE SPANS FOR LINTELS SUPPORTING MASONRY VENEER above

SIZE OF STEEL ANGLE (Inches)	NO STORY ABOVE	ONE STORY ABOVE	TWO STORES ABOVE	NO. OF 1/2" OR EQUIVALENT REINFORCING BARS
3 X 3 X 1/4	6'-0"	4'-6"	3'-0"	1
4 X 3 X 1/4	8'-0"	6'-0"	4'-6"	1
5 X 3 1/2 X 5/16	10'-0"	8'-0"	6'-0"	2
6 X 3 1/2 X 5/16	14'-0"	9'-6"	7'-0"	2
7-6 X 3 1/2 X 5/16	20'-0"	17'-0"	9'-6"	4

- For Sl: 1 inch = 25.4 mm, 1 foot = 304.8 mm
- Long leg of the angle shall be placed in the vertical position.
 - Depth of the re-inforced lintels shall not be less than 5" and all cells of hollow masonry lintels shall be grouted solid.
 - Re-inforcing bars shall extend not less than 5" into the support.
 - Steel members indicated are adequate typical examples. Other steel members meeting structural design requirements may be used.
 - Either steel angle or re-inforced lintel shall span opening.

2018 IRC - 2018 IECC

MECH. PLUMB. ELEC.

- Mechanical contractor is responsible for the design and installation of the mechanical systems, including duct sizes, trunk and register sizes for air conditioning, heating and ventilation. Systems shall be installed per manufacturers specifications and recommendations and per all applicable codes.
- Mechanical systems shall provide a minimum of (3) air exchanges per hour (or per local code). The building shall be provided with ventilation that meets the requirements of the International Residential Code or International Mechanical Code, as applicable.
- Per IRC R303.4, when the air infiltration rate of a dwelling unit is 5 air changes per hour or less, the ducting unit shall be provided with whole-house mechanical ventilation in accordance with IRC section M507.3. Outdoor air intakes or exhausts shall have automatic or gravity dampers that close when the ventilation system is not operating.
- Mechanical systems in unconditioned space shall have a manufacturer's designation for an air leakage of no more than 2% of the design air flow rate when tested in accordance w/ AS-RAE B3.
- Plumbing contractor is responsible for the design and installation of plumbing and piping. All plumbing, piping and fixtures shall be installed per manufacturers specifications and recommendations and per all applicable codes.
- Each Sump shall be sealed and vented as per code, vented through roof with 3" Diameter vent.
- Electrical contractor is responsible for the design and installation of all electrical systems. All electrical work shall meet the requirements of the National Electric Code, the local power company and all applicable codes. Fixtures and apparatus are selected by the builder and shall be UL approved.
- Install programmable thermostats.
- Smoke detectors and Carbon Monoxide detectors:
 - Provide a minimum of (1) ceiling mounted fixture per floor, hard wired to a nearby circuit and interconnected for simultaneous activation with battery backup.
 - Provide smoke detectors at each sleeping room.
- Not less than 90% of the lamps in permanently installed lighting fixtures shall be high efficiency lamps or not less than 90% of permanently installed lighting fixtures shall contain only high-efficiency lamps.
- Sprinkler system (when required) shall be NFPA-BD, installed per manufacturers specifications and recommendations and per all applicable local codes.
- Floor assemblies such as manufactured I-Joist or open web joists, other than minimum 2x10 dimensional lumber or structural composite lumber, located directly over a space that is not protected by an automatic sprinkler system shall be protected by 1/2" gypsum board to the underside of the 1st floor framing members, or other code approved method.

Architecture Collaborative, Inc.
 80304 Main Street
 Ellicott City, MD 21043
 www.archcol.com
 Tel: (410) 465-7500 Fax: (410) 465-0909

IRC GENERAL NOTES
 date: 02/02/20
 scale: 1"=6" (3/4x22) (10)
 UNO: 1"=6" (1/2x11) 2.0
 LEE STUMPF
 STUMPF RESIDENCE

date	revision

SHEET #
 2.0
 Professional Certification
 I hereby certify that these documents were prepared or approved by me and that I am a duly licensed architect under the laws of the State of Maryland.
 License number: 04-05-0002
 expiration date: 04-05-0002

2018 IECC ENERGY PERFORMANCE METHOD DOCUMENTATION
MAY BE USED IN LIEU OF THE FOLLOWING PRESCRIPTIVE
REQUIREMENTS, AS PER CODE.

2018 IECC CODE COMPLIANCE

R301.1 Climate zone 4A

R401.2 Compliance Method: Sections R401 through R404
Mandatory and Prescriptive Provisions

R401.3 Certificate
A permanent Energy Certificate shall be completed by the builder or registered design professional and posted at an approved location.

R402.1.1 Vapor Retarder:
Wall assemblies in the building thermal envelope shall comply with vapor retarder requirements of Section R702.7 of the International Residential Code, 2018 Edition.

R402.1.2 Attic Insulation: Raised Heel Trusses
R-49 R-38

R402.1.2 Wood Frame Wall:
R-20 or R13 + R5 continuous insulation.

R402.1.2 Basement Wall Insulation:
R-13/R-10 Foil Faced Continuous, uninterrupted Batts Full Height

R402.1.2 Crawl Space Wall Insulation:
R-13/R-10 Foil faced Continuous Batts Full Height extending from floor above to finish grade level and then vertically or horizontally an additional 2'-0"

R402.1.2 Floor Insulation over Unconditioned Space:
R-19 batt insulation.

R402.1.2 Window U-Value/SHGC
.32 (U-Value)
.40 (SHGC)

R402.2.10 Slab on Grade Floors Less Than 12' Below Grade:
R-10 Rigid Foam Board Under Slab Extending Either 2'-0" Horizontally or 2'-0" Vertically

R402.2.4 Attic Access:
Attic access scuttle will be weather-stripped and insulated R-49 or equivalent to the insulation on the surrounding surfaces.
Vertical Doors that access unconditioned attic space shall have .32 U-Value

R402.4 Building Thermal Envelope (Air Leakage): Sections R402.4.1 through R402.4.4
Exterior walls and penetrations will be sealed per these sections of the 2018 IECC with caulk, gaskets, weatherstripping or an air barrier of suitable material. Sealing methods between dissimilar materials shall allow sealing for differential expansion and contraction.

R402.4.1.2 Building Thermal Envelope Tightness Test:
Building envelope shall be tested and verified as having an air leakage rate not exceeding 3 air changes per hour. Testing shall be conducted in accordance with ASTM E 779 or ASTM E 1827 with (blower door) at a pressure of 0.2 inches w.g. (50 pascals). Testing shall be conducted by an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the building inspector.

R402.4.2 Fireplaces:
New wood-burning fireplaces will have tight-fitting flue dampers or doors, and outdoor combustion air. Fireplace doors shall be listed and labeled in accordance with UL 127 (factory built fireplace) and UL 907 (masonry fireplace).

R402.4.4 Rooms containing fuel burning appliances:
Where open combustion air ducts provide combustion air to open combustion fuel burning appliances, the appliances and combustion air shall be located outside the building thermal envelope or enclosed in a room isolated from inside the thermal envelope. Exceptions: 1. Direct Vent appliances with both intake and exhaust pipes installed continuous to the outside. 2. Fireplaces and stoves complying with Section R402.4.2 and Section R1006 of the IRC.

R402.4.5 Recessed Lighting
Recessed luminaires installed in the building thermal envelope shall be sealed to limit air leakage.

R403.1.1 Thermostat
All dwelling units will have at least (1) programmable thermostat for each separate heating and cooling system per 2018 IECC Section 403.1.1.

R403.1.2 Heat pumps
Where a heat pump system having supplementary electric-resistance heat is used, the thermostat shall prevent the supplementary heat from coming on when heat pump can meet the heating load.

R403.3.1 Mechanical Duct Insulation
Supply and Return Ducts in Attic: R-8 minimum, R-6 when less than 3"
Supply and Return Ducts outside of conditioned spaces: R-8 minimum.
All other ducts except those located completely inside the building thermal envelope R-6 minimum. Ducts located under concrete slabs must be R6 minimum.

403.3.2 Duct Sealing
All ducts, air handlers and filter boxes will be sealed. Joints and seams will comply with section M1601.4.1 of the IRC.

R403.3.3 Duct Testing
A duct tightness test ("Duct Blaster" duct total leakage test) will be performed on all homes and shall be verified by either a post construction test or a rough-in test. Duct tightness test is not required if the air handler and all ducts are located within the conditioned space.

R403.6 Mechanical Ventilation
The building shall be provided with ventilation that meets the requirements of the International Residential Code or International Mechanical Code, as applicable. Outdoor (make-up and exhausts) air ducts to be provided with automatic or gravity dampers that close when the ventilation system is not operating.

R403.6.1 Whole house mechanical ventilation system fan efficiency to comply with Table R403.6.1

R403.7 Equipment Sizing shall comply with R403.7.

R404.1 Lighting Equipment
A minimum of 95% of all lamps (lights) must be high efficiency lamps.

Water Heater: Minimum efficiency established by NAECA

Mechanical Testing: All mechanical testing to be performed by a certified Mechanical Contractor

This contractor also responsible for generating Certificate of Compliance and affixing to electrical panel or within 6' of the electrical panel and be readily visible.


Architecture Collaborative, Inc.
8034 Main Street
Ellicott City, MD 21043
www.archcol.com
Tel.: (410) 465-7500 Fax: (410) 465-0903

IECC COMPLIANCE NOTES
Scale: 1" = 4' (3/4/22) 1/2"
UNID. 1" = 8' (1/2/17)
content: LEE STUMPF
title: STUMPF RESIDENCE
drawn: SIS date: 02/02/20

date	revision	by

Professional Certification
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed architect in the State of Maryland.
Business number: 5863
expiration date: 04-03-2022

SHEET #
2.1

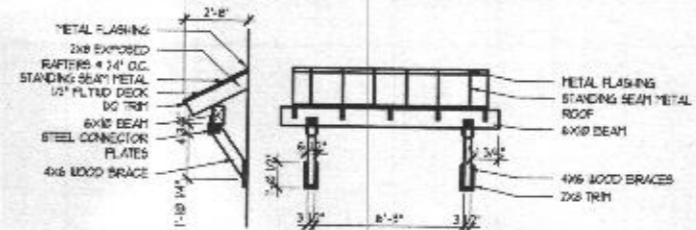

AWNING DETAIL

SCALE (17x11): 1/4" = 1'-0"
SCALE (24x36): 1/2" = 1'-0"



FRONT ELEVATION

SCALE (17x11): 1/8" = 1'-0"
SCALE (24x36): 1/4" = 1'-0"


Architecture Collaborative, Inc.
8334 Main Street
Ellicott City, MD 21043
www.archcol.com
Tel.: (410) 465-7500 Fax: (410) 465-0903

ELKAVATION A
date: 02/02/20
drawn: SIS
scale: 1" = 8' (94x22) file: 3.1
U.S.G. 1" = 8' (17x11) title: LEE STUMPF STUMPF RESIDENCE

content	by
date	revision

SHEET #
3.1

Professional Certification
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed architect under the laws of the State of Maryland.
license number: 9821
expiration date: 04-05-2022

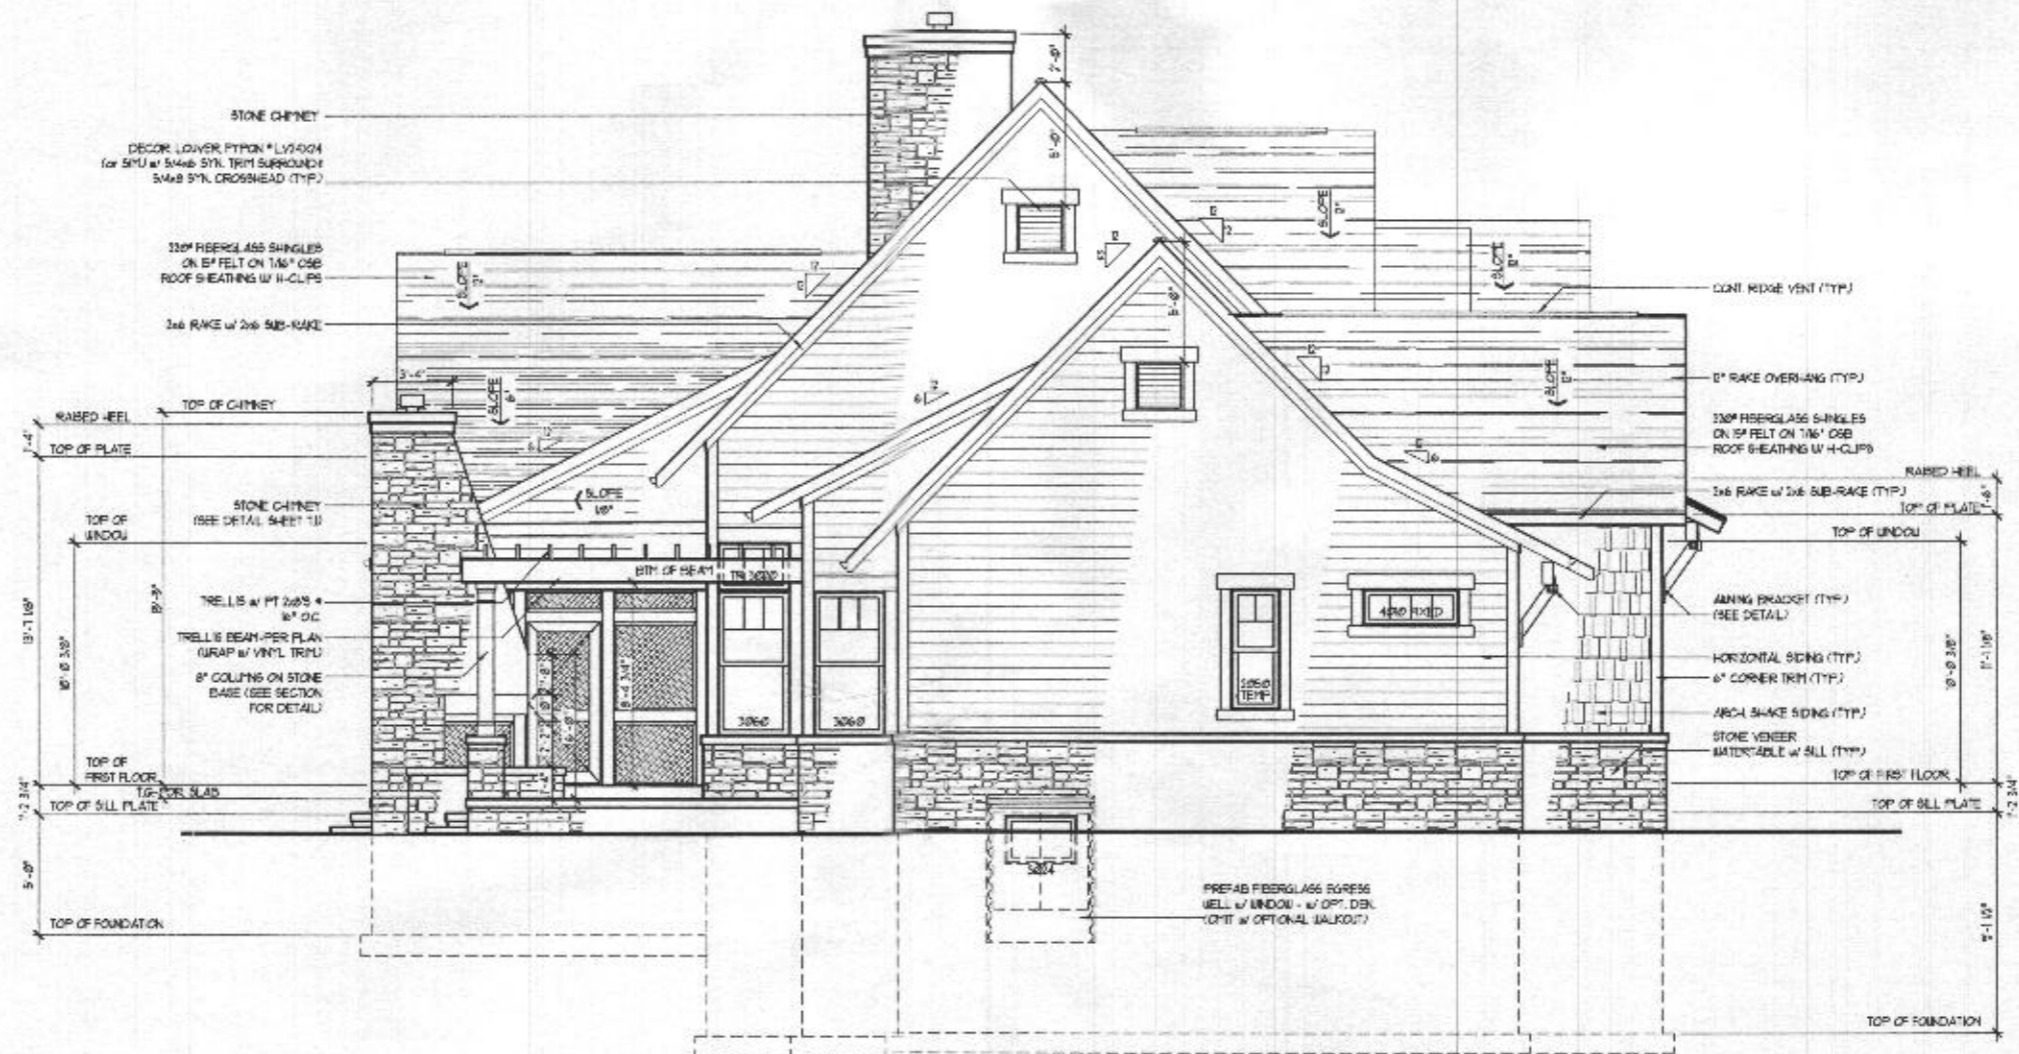

LEFT SIDE ELEVATION
 SCALE (17x11): 1/8" = 1'-0"
 SCALE (34x22): 1/4" = 1'-0"


Architecture Collaborative, Inc.
 8334 Main Street
 Ellicott City, MD 21043
 www.archcol.com
 Tel: (410) 465-7500 Fax: (410) 465-0903

LEFT SIDE ELEVATION A
 U.N.O. 1-8-17217 3.1A
 (3/22/20)
 (17217) 3.1A
 date: 02/02/20
 (rew): SJS
 LEE STUMPF
 STUMPF RESIDENCE

date	revision	by

Professional Certification
 I hereby certify that these documents
 were prepared or approved by me, and
 that I am a duly licensed architect
 of the State of Maryland.
 license number: 6882
 expiration date: 04-03-2022

SHEET #
3.1A

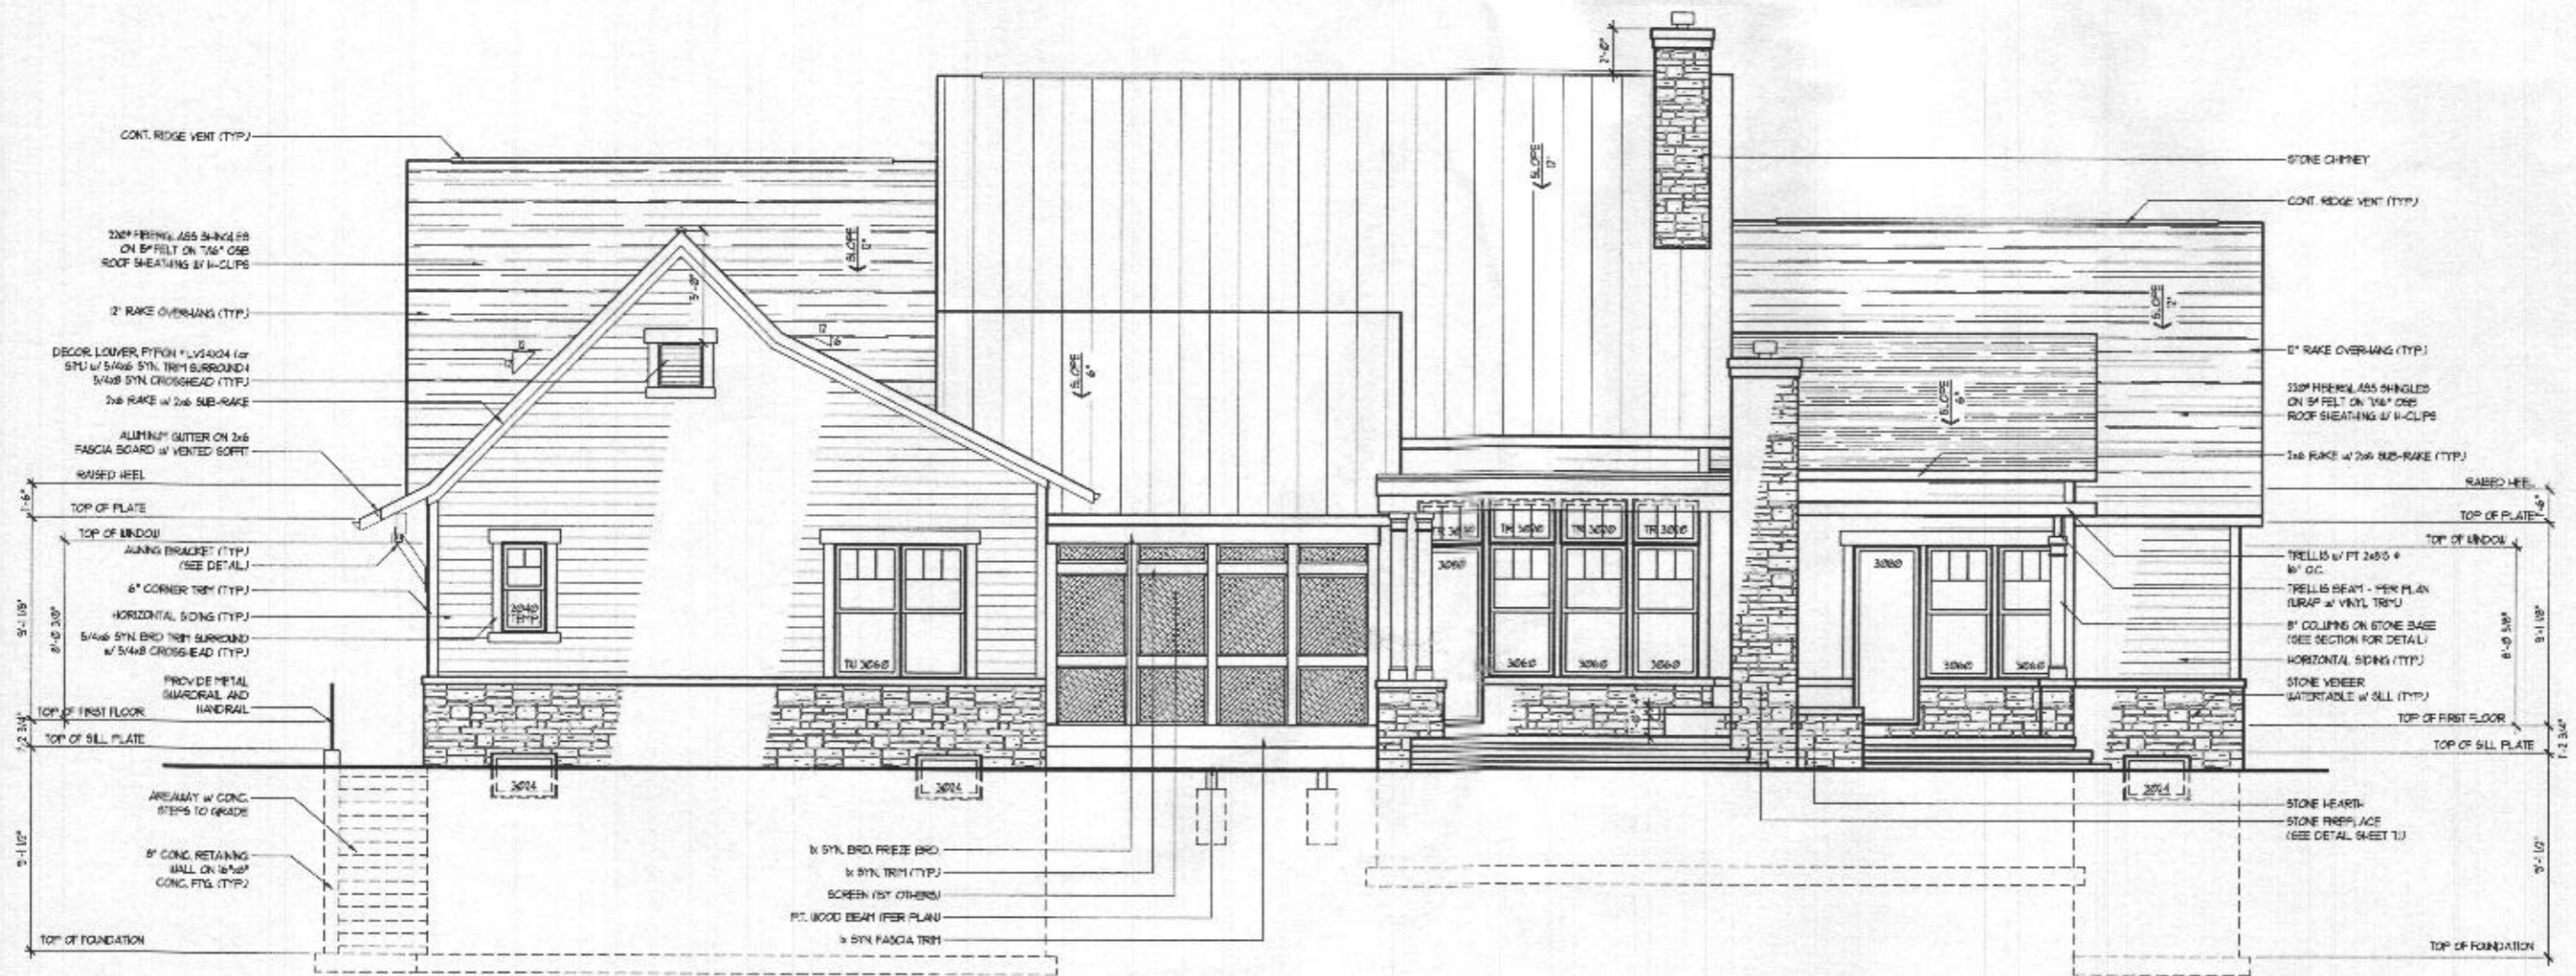

REAR ELEVATION
 SCALE (17x11): 1/8" = 1'-0"
 SCALE (34x22): 1/4" = 1'-0"

Architecture Collaborative, Inc.
 8334 Main Street
 Ellicott City, MD 21043
 www.archcol.com
 Tel: (410) 485-7500 Fax: (410) 465-0903

REAR ELEVATION A
 date: 02/02/20
 drawn: SJS
 scale: 1" = 4' (34x22) 1/8" = 1'-0" (17x11) 3/16"
 U.N.D. 1" = 8'
LEE STUMPF
 STUMPF RESIDENCE
 title

date	revision	by	content

SHEET 4
3.1B
 Professional Certification
 I hereby certify that these documents were prepared or approved by me, and I am a duly Licensed Architect under the laws of the State of Maryland.
 license number: 5821
 expiration date: 04-02-2022

FRAMING NOTES:


1. ALL EXTERIOR WALLS ARE TO BE 2x6 STUDS FRAMED @ 16" O.C., UNLESS NOTED OTHERWISE.
2. ALL INTERIOR WALLS ARE TO BE 2x4 STUDS FRAMED @ 16" O.C., UNLESS NOTED OTHERWISE.
3. SOLID BLOCK ALL BEAMS & HEADERS (GREATER THAN 4" DIA. JACK STUD, 4" DIA. KING STUD, THE NUMBER OF STUDS SPECIFIED AT A SUPPORT INDICATES THE NUMBER OF JACK STUDS REQUIRED (TYP) UNLESS NOTED OTHERWISE.
4. (2) 2" x 4" HEADERS (TYP) @ OPENINGS LESS THAN 12" UNLESS NOTED OTHERWISE.
5. FLOOR JOISTS SHOWN IS ONLY FOR GUIDANCE, SHOP DRAWINGS SHALL BE SUBMITTED FOR REVIEW.
6. SUB-FLOOR SHALL BE 3/4" THICK (MIN) TONGUE & GROOVE TO MEET AIA STANDARD.

PROVIDE SMOKE DETECTORS AND CARBON MONOXIDE DETECTORS AS REQUIRED BY LOCAL CODES WIRE TO A NEARBY CIRCUIT (MFA BATTERY BACKUP) AND INTER-CONNECTED FOR SIMULTANEOUS ACTIVATION.

THESE DRAWINGS ARE SCHEMATIC ONLY. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF ALL ELECTRICAL SYSTEMS. ALL ELECTRICAL WORK SHALL MEET THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE, THE LOCAL POWER COMPANY AND ALL APPLICABLE CODES. FIXTURES AND APPARATUS ARE SELECTED BY THE BUILDER AND SHALL BE ILL APPROVED.

ELECTRICAL SYMBOLS

⊕	DUPLEX OUTLET 8" AFF.
⊕	DUPLEX OUTLET 4" AFF.
⊕	DUPLEX OUTLET 2" AFF. HALF SWITCHED
⊕	220 VOLT DUPLEX OUTLET
⊕	WATERPROOF RECEPTACLE
⊕	GROUND FAULT INTERRUPTER
⊕	GROUND FAULT INTERRUPTER 4" AFF.
⊕	WALL SWITCH
⊕	3-WAY WALL SWITCH
⊕	4-WAY WALL SWITCH
⊕	DIMMER WALL SWITCH
⊕	EXHAUST FAN
⊕	FANLIGHT COMBO
⊕	LIGHT FIXTURE CEILING MOUNTED
⊕	LIGHT FIXTURE RECESSED LIGHT
⊕	FIXTURE PULL CHAIN
⊕	FLUORESCENT LIGHT FIXTURE
⊕	FLOOD LIGHTS
⊕	LIGHT FIXTURE WALL MOUNTED
⊕	THERMOSTAT
⊕	JUNCTION BOX
⊕	DOOR CHIME
⊕	TELEPHONE JACK
⊕	TELEVISION JACK
⊕	GARBAGE DISPOSAL
⊕	SMOKE DETECTOR
⊕	CARBON MONOXIDE DETECTOR
⊕	COMBINATION SMOKE-CARBON DETECTOR
⊕	ELECTRIC PANEL
⊕	ELECTRIC METER
⊕	INTERCOM
⊕	INTERCOM CONSOLE

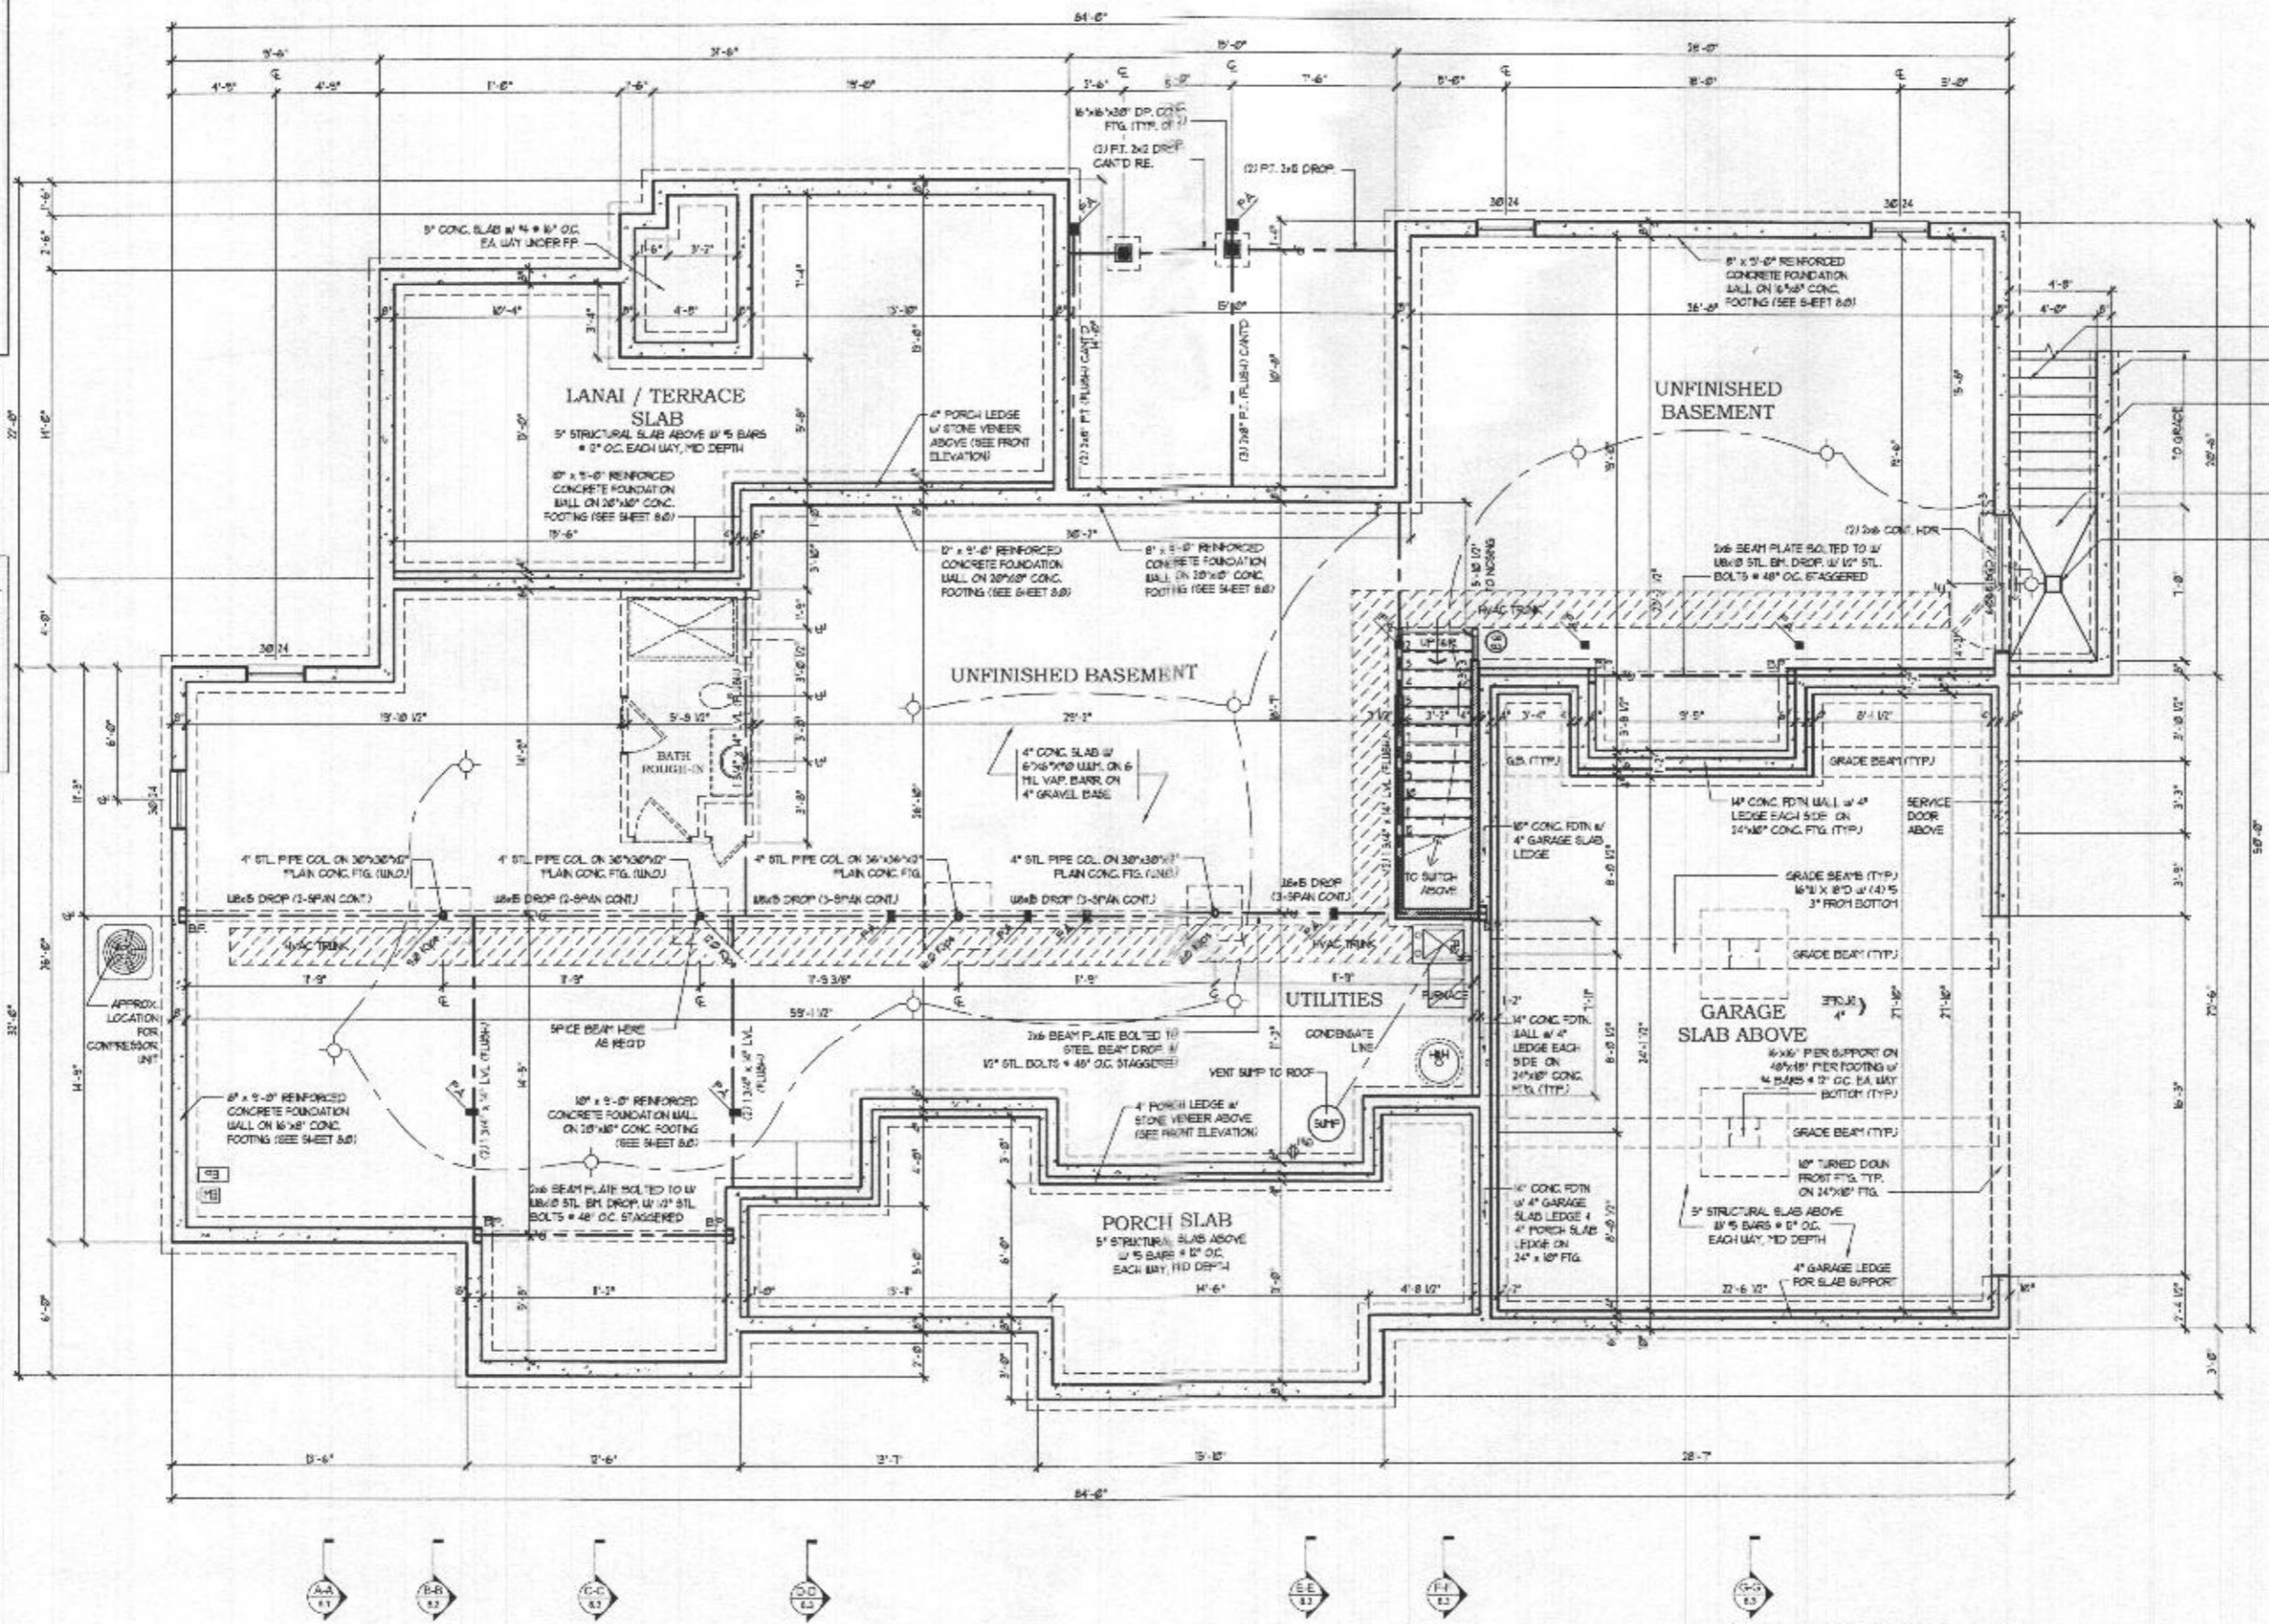

STEPS TO GRADE

PROVIDE THE GUARDRAIL AND HANDRAIL

8" CONC. RETAINING WALL ON 16" O.C. FIG. (TYP)

DROP SLAB 5" TYP. FIG. TO PROST

2" SQUARE GRATE

Architecture Collaborative, Inc.
 8334 Main Street
 Bellicott City, MD 21043
 www.archcol.com
 Tel: (410) 485-7500 Fax: (410) 465-0903

FOUNDATION PLAN
 sheets: 1" = 1" (34x23) (11) 4.1
 U.S.D. 1" = 8" (2x11) 4.1
 ULLA

client: **LEE STUMPF**
 STUMPF RESIDENCE

date: 02/02/20
 draw: SIS

date	revision

SHEET #
 4.1

Professional Certification
 I hereby certify that these documents were prepared or approved by me and that I am a duly licensed professional engineer in the State of Maryland.

license number: 04-05-2022
 expires on: 04-05-2022

FOUNDATION PLAN
 SCALE (1/8" = 1'-0")
 SCALE (3/4" = 1'-0")


den = 1 DR

PROVIDE SMOKE DETECTORS AND CARBON MONOXIDE DETECTORS AS REQUIRED BY LOCAL CODE, WIRING TO A NEARBY CIRCUIT WITH BATTERY BACKUP AND INTER-CONNECTED FOR SIMULTANEOUS ACTIVATION.

THESE DRAWINGS ARE SCHEMATIC ONLY. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF ALL ELECTRICAL SYSTEMS. ALL ELECTRICAL WORK SHALL MEET THE REQUIREMENTS OF THE NATIONAL ELECTRIC CODE, THE LOCAL POWER COMPANY AND ALL APPLICABLE CODES. FIXTURES AND APPARATUS ARE SELECTED BY THE BUILDER AND SHALL BE U.S. APPROVED.

ELECTRICAL SYMBOLS

- ⊙ DUPLEX OUTLET 15' AFF.
- ⊙ DUPLEX OUTLET 4' AFF.
- ⊙ DUPLEX OUTLET 15' AFF. HALF SWITCHED
- ⊕ 220 VOLT DUPLEX OUTLET
- ⊕ WATERPROOF RECEPTACLE
- ⊕ GROUND FAULT INTERRUPTER
- ⊕ GROUND FAULT INTERRUPTER 41' AFF.
- S WALL SWITCH
- S₃ 3-WAY WALL SWITCH
- S₄ 4-WAY WALL SWITCH
- S_{DP} DIMMER WALL SWITCH
- FAN EXHAUST FAN
- FAN LIGHT COMBO
- ⊕ LIGHT FIXTURE CEILING MOUNTED
- ⊕ LIGHT FIXTURE RECESSED LIGHT
- ⊕ LIGHT FIXTURE PULL CHAIN
- ⊕ FLUORESCENT LIGHT FIXTURE
- ⊕ FLOOD LIGHTS
- ⊕ LIGHT FIXTURE WALL MOUNTED
- ⊕ THERMOSTAT
- ⊕ JUNCTION BOX
- ⊕ DOOR CHIME
- ⊕ TELEPHONE JACK
- ⊕ TELEVISION JACK
- ⊕ GARBAGE DISPOSAL
- ⊕ SMOKE DETECTOR
- ⊕ CARBON MONOXIDE DETECTOR
- ⊕ COMBINATION SMOKE-CARBON DETECTOR
- ⊕ ELECTRIC PANEL
- ⊕ ELECTRIC METER
- ⊕ INTERCOM
- ⊕ INTERCOM CONSOLE

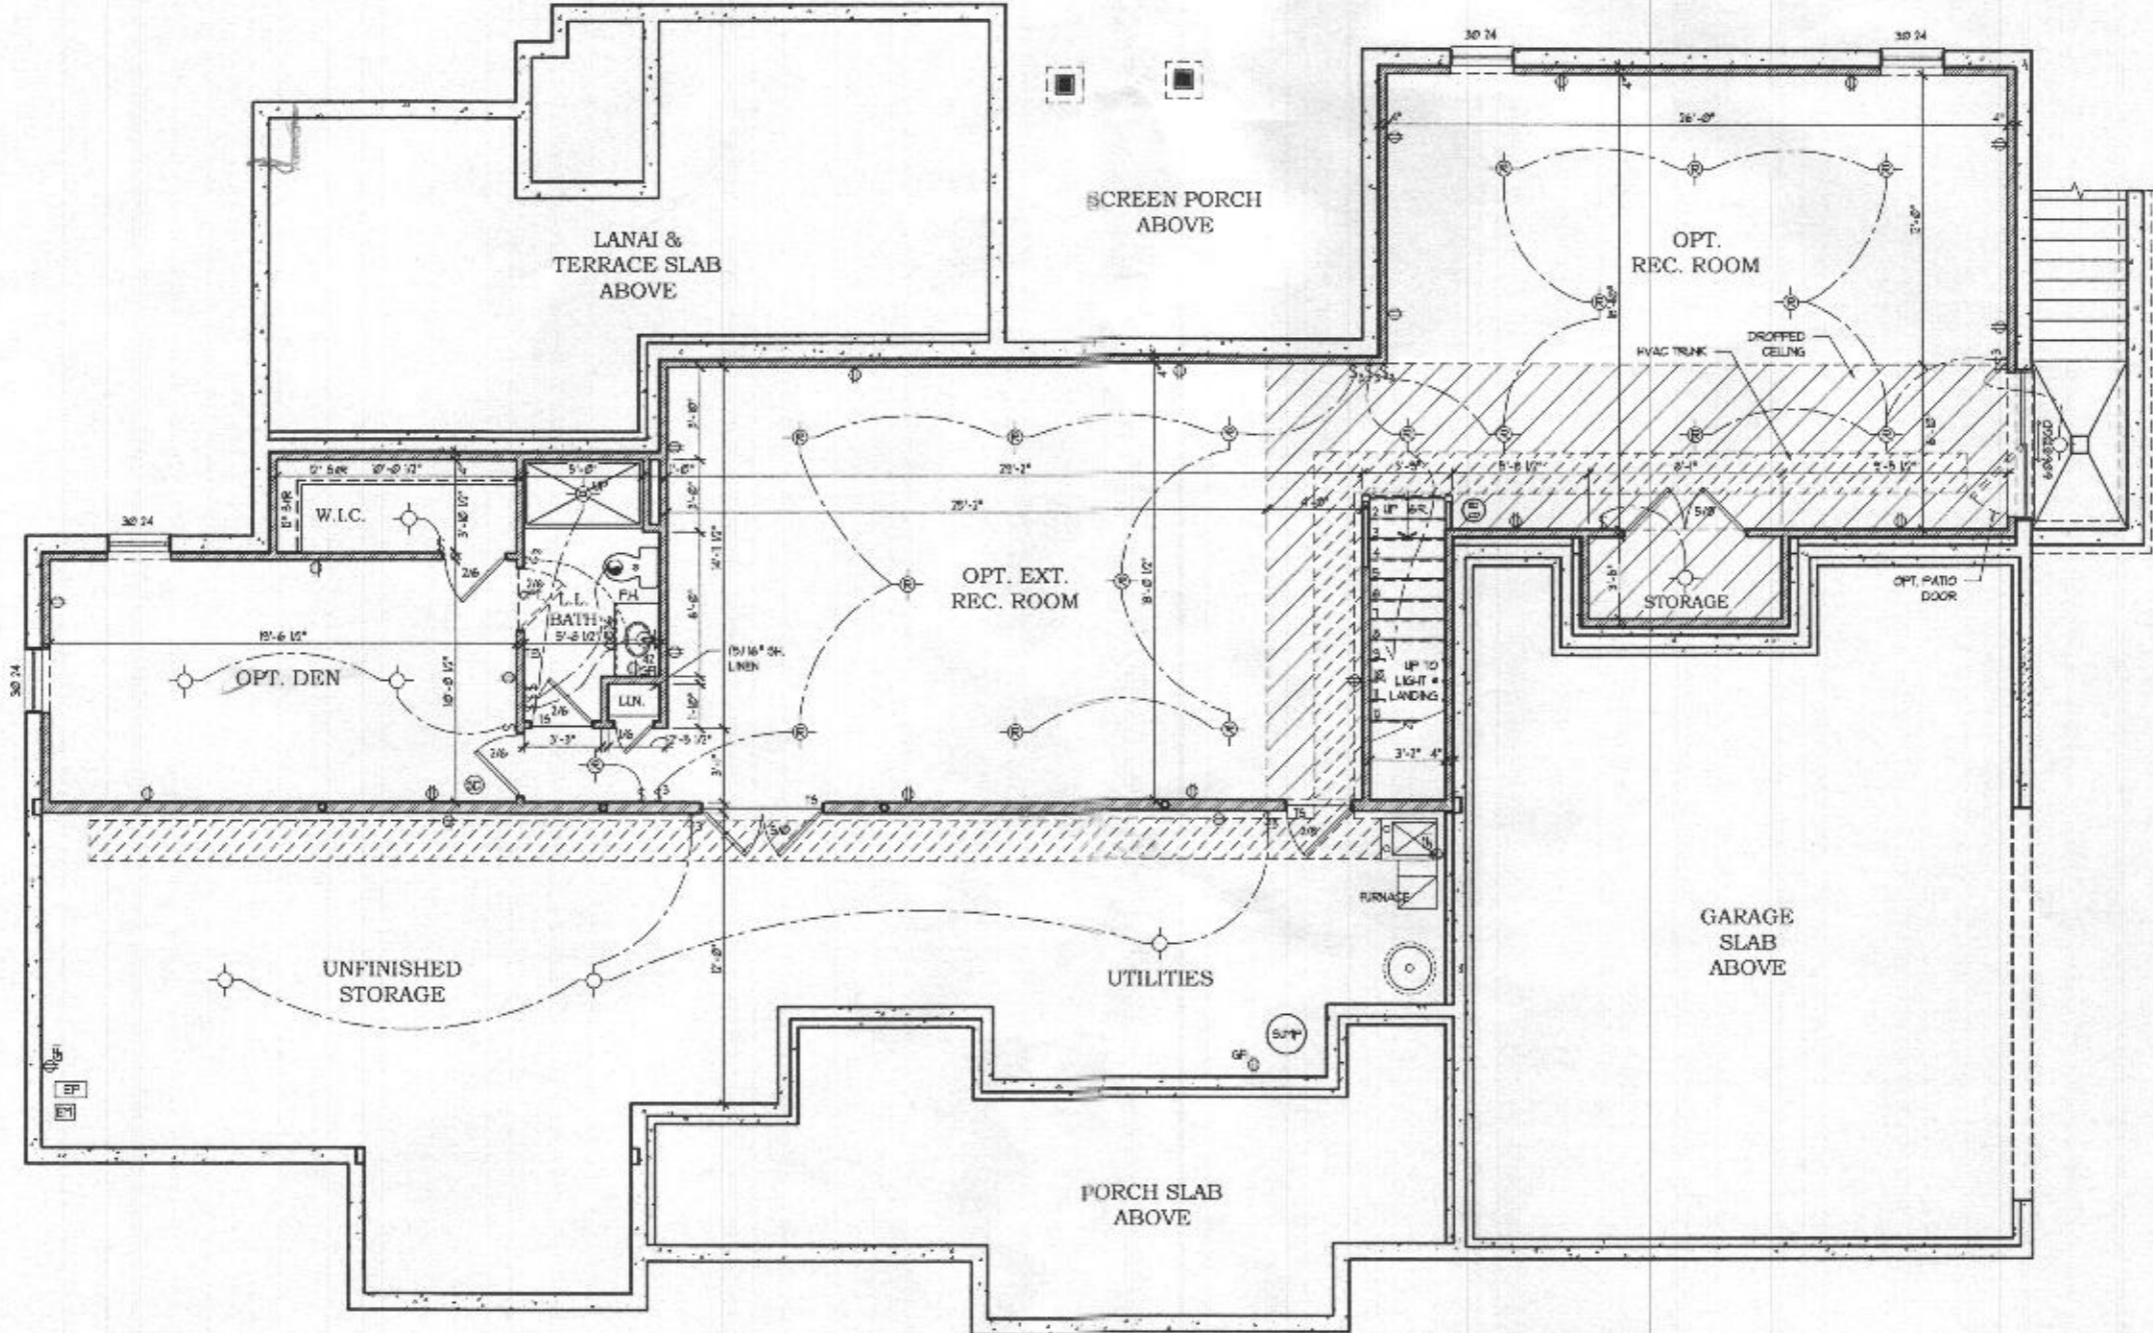

OPT. FINISHED BASEMENT PLAN

SCALE (1/8"=1'-0") 1/8" = 1'-0"
SCALE (1/4"=1'-0") 1/4" = 1'-0"

Architecture Collaborative, Inc.
Ellicott City, MD 21043
8334 Main Street
www.archcol.com
Tel.: (410) 485-7500 Fax: (410) 465-0903

content: OPT. FINISHED LOWER LEVEL PLAN
date: 02/02/20
drawn: SJS
scale: 1/8"=1'-0" (3/4x25) (1/8")
U.S.G. 1"=8" (7/217) 4.2
title: LEE STUMPF STUMPF RESIDENCE

date	revision

SHEET #
4.2

Professional Certification
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional in the State of Maryland.
license number: 04-04-0002
expiration date: 04-04-0002