

Bureau of Environmental Health

8930 Stanford Boulevard, Columbia, MD 21045
Main: 410-313-2640 | Fax: 410-313-2648
TDD 410-313-2323 | Toll Free 1-866-313-6300
www.hchealth.org
Facebook: www.facebook.com/hocohealth
Twitter: HowardCoHealthDep

Maura J. Rossman, M.D., Health Officer

APPLICATION FOR PERCOLATION TESTING AND SITE EVALUATION

PROPERTY LOCATION

SUBDIVISION/PROPERTY NAME CLARKSVILLE MEADOW

PROPERTY ADDRESS 7154 GUILFORD RD CLARKSVILLE MD 21029-1313
STREET TOWN ZIP

TAX ACCOUNT # 346665 TAX MAP 35 GRID 21 PARCEL 296 LOT NO. 8 PROPOSED LOT SIZE (ACRES) 3.078

ZONING CATEGORY RR-DEO TIER

PROPERTY OWNER(S) PETER Y CHON

DAYTIME PHONE CELL EMAIL

MAILING ADDRESS 7154 GUILFORD RD CLARKSVILLE MD 21029-1313
STREET CITY, STATE ZIP

APPLICANT PETER Y CHON RELATIONSHIP TO OWNER: OWNER

DAYTIME PHONE CELL EMAIL

MAILING ADDRESS 7154 GUILFORD RD CLARKSVILLE MD 21029-1313
STREET CITY, STATE ZIP

I HEREBY APPLY FOR THE NECESSARY TESTING/EVALUATION PRIOR TO ISSUANCE OF SEWAGE DISPOSAL SYSTEM PERMIT(S):

PROPERTY:

- SUBDIVISION: NUMBER OF LOTS INCLUDING RESIDUE: SUBDIVISION CLASSIFICATION (PER DEPT. OF PLANNING AND ZONING) MAJOR MINOR
CONSTRUCT NEW OSDS ON UNDEVELOPED LOT
REPAIR OR REPLACE FAILING OSDS
UPGRADE EXISTING OSDS

BUILDING:

- RESIDENTIAL WITH 4 OR 5 EXISTING OR PROPOSED BEDROOMS IN THE COMPLETED STRUCTURE
COMMERCIAL (PROVIDE DETAIL OF TYPE OF USE AND NUMBERS OF EMPLOYEES/CUSTOMERS ON ACCOMPANYING PLAN)

IS THE PROPERTY WITHIN 2500 FEET OF ANY RESERVOIR?

- YES
NO

AS APPLICANT, I UNDERSTAND THE FOLLOWING:

- THIS APPLICATION IS VALID FOR TWO(2) YEARS FROM DATE OF FEE PAYMENT AND APPROVAL IS BASED UPON HEALTH OFFICER SIGNATURE OF A PERC CERTIFICATION PLAN PRIOR TO EXPIRATION OF THIS PERMIT.
THE APPLICATION FEE IS NON-REFUNDABLE
THIS APPLICATION MUST BE ACCOMPANIED BY ALL APPLICABLE FEES AND A SUITABLE SITE PLAN IN ORDER TO BE PROCESSED
THIS IS A PUBLIC DOCUMENT


I declare and affirm that to the best of my knowledge, the information contained herein is correct. I declare that I am the owner of the property or duly authorized to make this application on behalf of the owner. I agree to comply with all applicable state and county regulations.

By signature of this application, I hereby grant Howard County Health Department officials the right to enter onto the property for the purpose of inspecting the property as directly related to the requested permit/service.

SIGNATURE OF APPLICANT

09 DEC 2020
DATE

A/P AS 72891

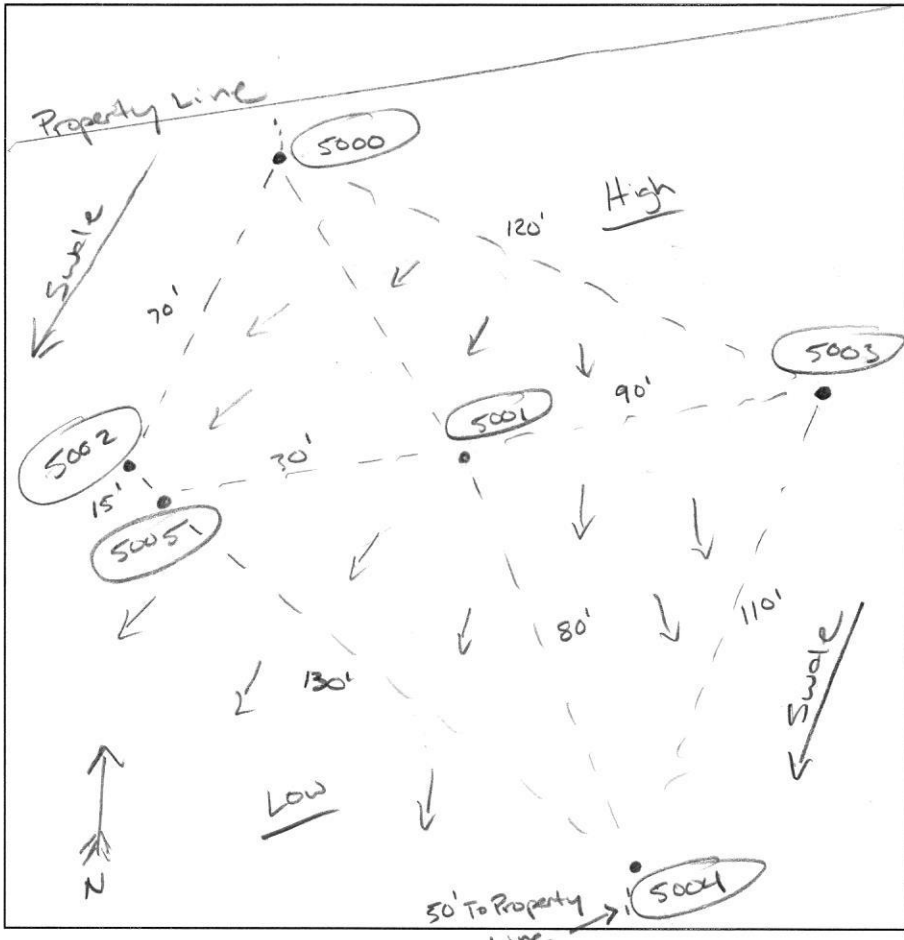

S001
 0.9' SB, MSBK, L
 Loam
 2' YR, MSBK, CL, mfr
 3.2' YB, YR, Platy SCL, mfr
 Micaceous
 4' YB, Thin Platy, SL, mfr
 Micaceous (Very Fine Mica)
 ↓
 12' LS

S004
 0.2' SB, FSBK, L
 1' YR, YS, MPlaty, SL, Micaceous, Mvfr
 Soft SL
 ↓
 12' LS

S002
 0.5' YB, Thick Platy, L
 YR, Thin Platy, coarse SCL, ds,
 dense sidewall, some cobble
 2-3' YR, YB, Platy, coarse sandy Loam, micaceous, separate mix, dense sidewall, inconsistent mix of SCL, SL, LS, densely packed, gravelly cobble
 12'


S003
 0.5' DB, SBK, L
 YR, Thin Platy, CL, mfr, WSP, WSO
 2' YR, Thin Platy SCL, mfr, WSP, WSD, very fine mica
 3' BY, B+L separate color mix, thin Platy, SL-LS mix, micaceous, soft
 12'

S000
 0.5' DB, MSBK, L
 YR, RY, MSBK, CL, mfr, WSP, WSD, WSP
 1.9' RY, SB, MSBK, SCL, WSO, mfr, WPO
 2.2' RY, Thin Platy, SL, mfr, WPO
 7' VPY, Thin Platy, ml, LS
 ↓
 12'

S005
 0.5' DB, SBK, L
 YR, MSBK, L, mfr, WSP, WSO
 3' YR, Thin Platy, SL to LS, Micaceous, soft, ml
 12'

DATE	TEST #	DEPTH	START	BREAK 1" DROP	STOP 2" DROP	TIME OF 2ND INCH	P/F/H
1/21/2021	S001	3/12	9:26	9:54		SLOW	F
	S001	4/RS	10:35	10:43	10:59	16	P
	S002	4/12	10:39	11:15		SLOW	F
	S004	4/12	11:02	11:03	11:07	5	P
	S003	4/12	11:23	11:25	11:27	2	P
	S002	6/RS	11:50			NO MOVEMENT	F
	S000	4/12	12:13	12:20	12:36	16	P
	S005	4/12	1:06	1:09	1:17	6	P

REMARKS 7154 Guilford Rd.
 SANITARIAN RSF BACKHOE Jams Creek OTHERS Cory Cumberland
 TEST HOLES USED IN SDA 5 AVG. PERC TIME 0.8 SQ. FT/BR _____
 TRENCH WIDTH _____ INLET DEPTH _____ MAX. BOT DEPTH 8' EFFECTIVE S/W 3-4

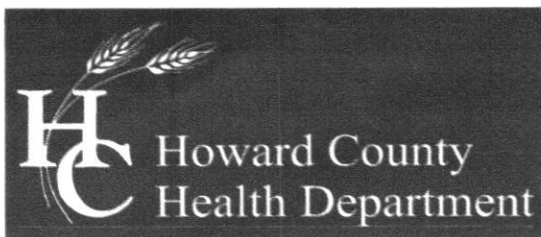

Bureau of Environmental Health

8930 Stanford Boulevard, Columbia, MD 21045

Main: 410-313-2640 | Fax: 410-313-2648

TDD 410-313-2323 | Toll Free 1-866-313-6300

www.hchealth.org

Facebook: www.facebook.com/hocohealth

Twitter: HowardCoHealthDep

Maura J. Rossman, M.D., Health Officer

Date: January 26, 2021

To: Tony Fertitta (via email)
Fisher, Collins & Carter, Inc.
10272 Baltimore National Pike
Ellicott City, MD 21042

Re: ***Percolation Test Report***
7154 Guilford Rd.
Clarksville, MD 21029

Percolation tests were conducted at 7154 Guildford Clarksville, MD 21029 (Tax Map: 35, Parcel: 296). Tests and profile descriptions were documented for locations 5000, 5001, 5002, 5003, 5004 & 5005. Out of 6 test locations 5 passed (5000, 5001, 5003, 5004, & 5005).

All percolation tests conducted were standard tests, measuring rate of fall for a pre-wet period followed by measurement and recordation of the time required for the water level to drop 1 inch. Areas that may be included in the septic reserve area are represented by test locations having satisfactory soil conditions. This area must be at least 10,000sqft and be able to accommodate 3 systems (initial and 2 replacements). If 3 systems cannot fit the Health Dept. may consider allowing 2 systems (initial and 1 replacement) which will require Best Available Technology (BAT). The next step in the process is to have an engineer/consultant submit a finalized percolation certification plan to the Health Dept. for review and signature.

Should you have any questions regarding this evaluation, please contact me. I may be reached at (410) 313-6357 or by email rfreemon@howardcountymd.gov

Respectfully,

A handwritten signature in cursive script, appearing to read 'Robert Freemon'.

Robert Freemon
Bureau of Environmental Health
Well & Septic Program

Attachment: Percolation Field Notes

APPLICATION

Ryan
A 22536
P

12/18/75
4-12' Lined
and 10,000 gpi.

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

WARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES
P. O. BOX 476, ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 485-3000, EXT. 355

Septic Tank { 1-3 bedrooms 1000 gal
4 B. 1250 gal
DATE 11/24/75

12/24/75 (1/2 day)
9:30

⊕ Dry well to have 765 194 sq ft
effective desorbent side wall area per
bedroom below first 5' of original soil and
maximum depth 13' location 45' from pic
17' hole #1, as shown on plans. have started on 12/24/75

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

⊕ Ditch to be 4' below original grade

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE
DISPOSAL SYSTEM { Dry Well (13 x 13) with 8' 5-13 40.0
Reconn. of system { 0 of trench 40.0
PROPERTY OWNER Phase One, Ltd. - Edward P. Ryan 400.

3833 Halloway Circle, Upper Marlboro, Md. 20870
ADDRESS Urban Life Center, Columbia Md. PHONE 730-8200

PROPERTY LOCATION:

SUBDIVISION Clarksville Meadows LOT NO. 1

ROAD AND DESCRIPTION Intersection of Rt. 32 & Whitegate Lane

SIZE OF LOT 3 acres m/l TYPE BLDG. 14

IF NOT SINGLE RESIDENCE DESCRIBE _____
(Single Fmly. Dwllg.)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

SIGNATURE OF APPLICANT /s/ Alan C. Borg - Edward P. Ryan

APPROVED BY C. B. [Signature] FOR Dry Well DATE 12/24/75
(KIND OF SYSTEM)

REJECTED BY _____ FOR _____ DATE _____
(KIND OF SYSTEM)


HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____

BLDG. PERMIT SIGNED
AND RETURNED 12/29/76

THIS IS NOT A PERMIT

A 22536

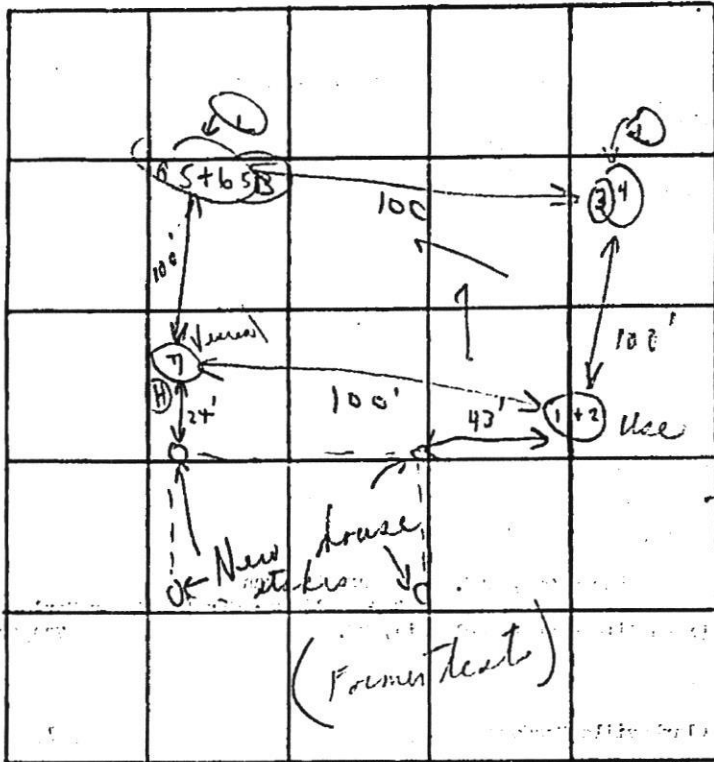

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

R132

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
11/24/75	1	5'	10:45	10:56	10:56	11:20	24m
	(P) 2	13' 0"	10:22	10:25	10:25	10:40	15m
	3	4 1/2'	10:29	10:39	10:39	11:06	29m
	(L) 4	13 1/2'	10:27	10:29	10:27	10:34	5m
	(L) 5A	X 3 1/2'	10:28	11:06	X 1:06	X	X
	(L) 6	12 1/2'	10:37	10:46	10:46	10:58	12m
	(P) 7	11 1/2'	V. usual		similar to test 7		29m
	5B	3 1/2' - 4'	11:27	11:32	11:32	11:49	17m

Under 4'
 good ground
 39 at 5'
 clayish
 32
 key dug down on both sites
 29
 1/100 17

13
 12
 13
 115
 8/110
 400
 2210
 55

(Under load be slow clean!!)

REMARKS: {Note: new house further behind former test holes!}

TYPE OF SOIL: Mr. Ed P. Ryan

TESTED BY: C. B. D. ALSO PRESENT: Mr. Allen & New Owner

10/11/72
9:30

APPLICATION

A 17499

SEWAGE DISPOSAL TESTING

P _____

100 ft. pipe
or 10,000 gal.
MARYLAND STATE DEPARTMENT OF HEALTH
HOWARD COUNTY *Septic Tank* ^{1000 gallon} 1-3 Bedrooms
1200 gallon 4 Bedrooms
ELLICOTT CITY

10/11/72
9:30

Drill Well to have 165 sq. ft. effective
absorbent sidewall area per bell hole below inlet. Caled
well 3' below original grade and maximum depth
12' location 35' off ~~front~~ property line + 135'
from front property line when facing lot from
road Perc hole (3-31)

DISTRICT 5th
DATE AUG 1972

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TESTS IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Phase One, Ltd.

ADDRESS Urban Life Center, Columbia, Md PHONE 730-8200

PROPERTY LOCATION:

(Clarksville Neighbors)

SUBDIVISION Adjacent to Clarksville Ridge LOT NO. 1

ROAD AND DESCRIPTION Intersection Rt 32 & Whitegate Lane

OCCUPANT _____ PHONE _____

PERSON TO CONSTRUCT SYSTEM _____

ADDRESS _____ PHONE _____

SIZE OF LOT 3 acres + TYPE BLDG 4 Bedroom Res.
NUMBER OF BEDROOMS

IF NOT SINGLE RESIDENCE DESCRIBE _____

SIGNATURE OF APPLICANT *Alan C. Borg*
Alan C. Borg, Pres.

APPROVED BY *H. Snyder, pub. C.E.* FOR *Dr. Will* DATE 11/7/72
(KIND OF SYSTEM)

REJECTED BY _____ FOR _____ DATE _____
(KIND OF SYSTEM)

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____ BLDG. PERMIT SIGNED AND RETURNED 8/5/72

Edward P. Rogers

12421 Spring Ln
Ellicott City, Md

Workshop
(8) 872-2545

THIS IS NOT A PERMIT


(18)
942-
7042

LEGEND

- - - - - EXISTING 2' CONTOURS
- - - - - EXISTING 10' CONTOURS
- - - - - EXISTING TREE LINE
- - - - - SOIL LINES AND TYPES
- ⊙ DENOTES PROPOSED WELL
- DENOTES FAILED PERC
- ⊙ DENOTES PASSED PERC
- ⊙ DENOTES PROPOSED PERC
- ⊙ DENOTES PROPOSED HOUSE
- ▨ DENOTES 15%-24.9% SLOPES
- ▨ DENOTES 25% AND GREATER SLOPE
- ⊙ DENOTES 1500 Sq.Ft. ALTERNATE WELL SITE

SOILS LEGEND


SOIL	NAME	CLASS	'K' VALUE
GaC	Gailla loam, 8 to 15 percent slopes	B	.55
GgB	Glenelg loam, 3 to 8 percent slopes	B	.37

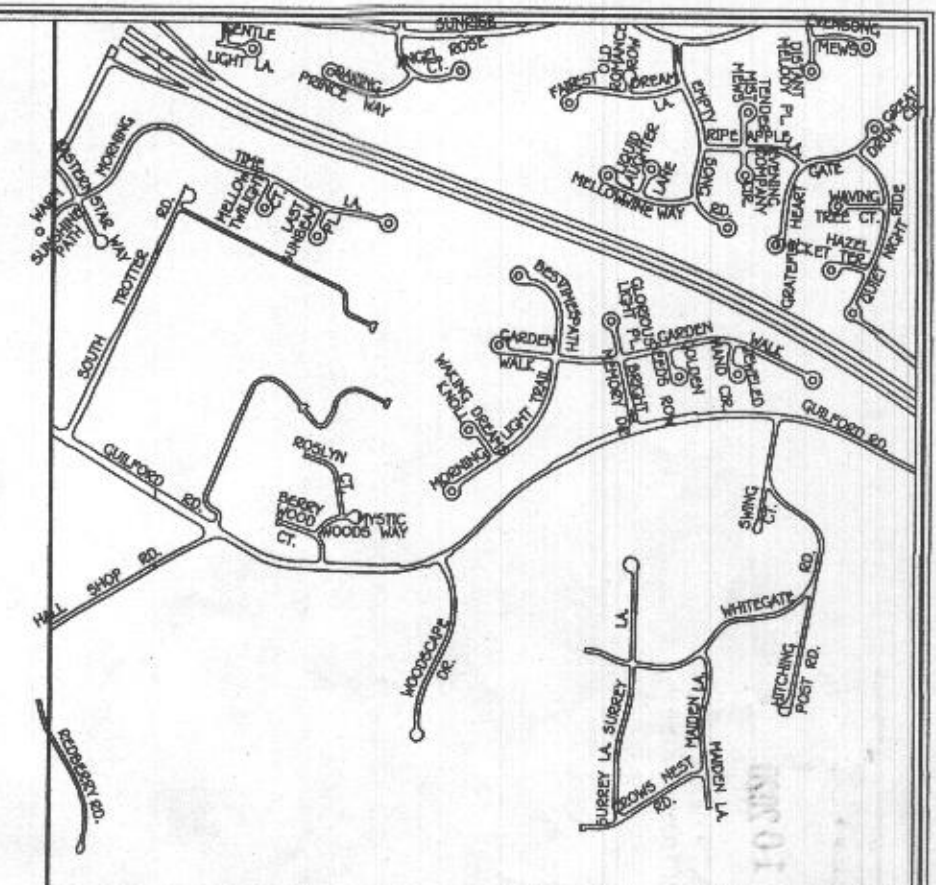

VICINITY MAP
SCALE : 1" = 1200'

GENERAL NOTES:

1. ▨ THIS AREA DESIGNATES A PRIVATE SEWAGE DISPOSAL AREA OF AT LEAST 10,000 SQUARE FEET AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT FOR INDIVIDUAL SEWERAGE DISPOSAL IMPROVEMENTS OF ANY NATURE IN THIS AREA ARE RESTRICTED UNTIL PUBLIC SEWERAGE IS AVAILABLE. THESE EASEMENTS SHALL BECOME NULL AND VOID UPON CONNECTION TO A PUBLIC SEWAGE DISPOSAL AREA. THE COUNTY HEALTH OFFICER SHALL HAVE THE AUTHORITY TO GRANT ADJUSTMENTS TO THE PRIVATE SEWAGE DISPOSAL AREA. RE-RECORDATION OF A MODIFIED SEWERAGE EASEMENT SHALL NOT BE NECESSARY.
2. ADJUSTMENTS TO SEWAGE DISPOSAL AREA IS NOT PERMITTED WITHOUT ADDITIONAL TESTING.
3. THE LOT SHOWN HEREON COMPLIES WITH THE MINIMUM OWNERSHIP WIDTH AND LOT AREA AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT.
4. ALL WELLS AND SEPTIC SYSTEMS WITHIN 100' OF THE PROPERTY BOUNDARIES AND ALL EXISTING OR PROPOSED WELLS LESS THAN 200' DOWN/GRADIENT OF A SEPTIC SYSTEM AND/OR SEPTIC EASEMENT.
5. ALL HOUSE SITES SHOWN COMPLY WITH MINIMUM BUILDING RESTRICTION REGULATIONS.
6. ALL WELLS SHALL BE DRILLED PRIOR TO FINAL PLAT RECORDATION. IT IS THE DEVELOPER'S RESPONSIBILITY TO SCHEDULE THE WELL DRILLING PRIOR TO FINAL PLAT SUBMISSION. IT WILL NOT BE CONSIDERED "GOVERNMENT DELAY" IF THE WELL DRILLING HOLDS-UP THE HEALTH DEPARTMENT SIGNATURE OF THE RECORD PLAT.
7. TOPOGRAPHY SHOWN IS FROM HOWARD COUNTY GIS TOPOGRAPHY AT 5' CONTOUR INTERVAL INTERPOLATED FOR 2' CONTOUR INTERVAL.
8. BOUNDARY OUTLINE BASED ON AVAILABLE DEED OF RECORD WITHOUT THE BENEFIT OF A FIELD SURVEY AT THIS TIME.
9. ANY CHANGES TO A PRIVATE SEWAGE DISPOSAL AREA SHALL REQUIRE A REVISED PERC CERTIFICATION PLAN.
10. DEED REFERENCE LIBER 3078 FOLD 613.

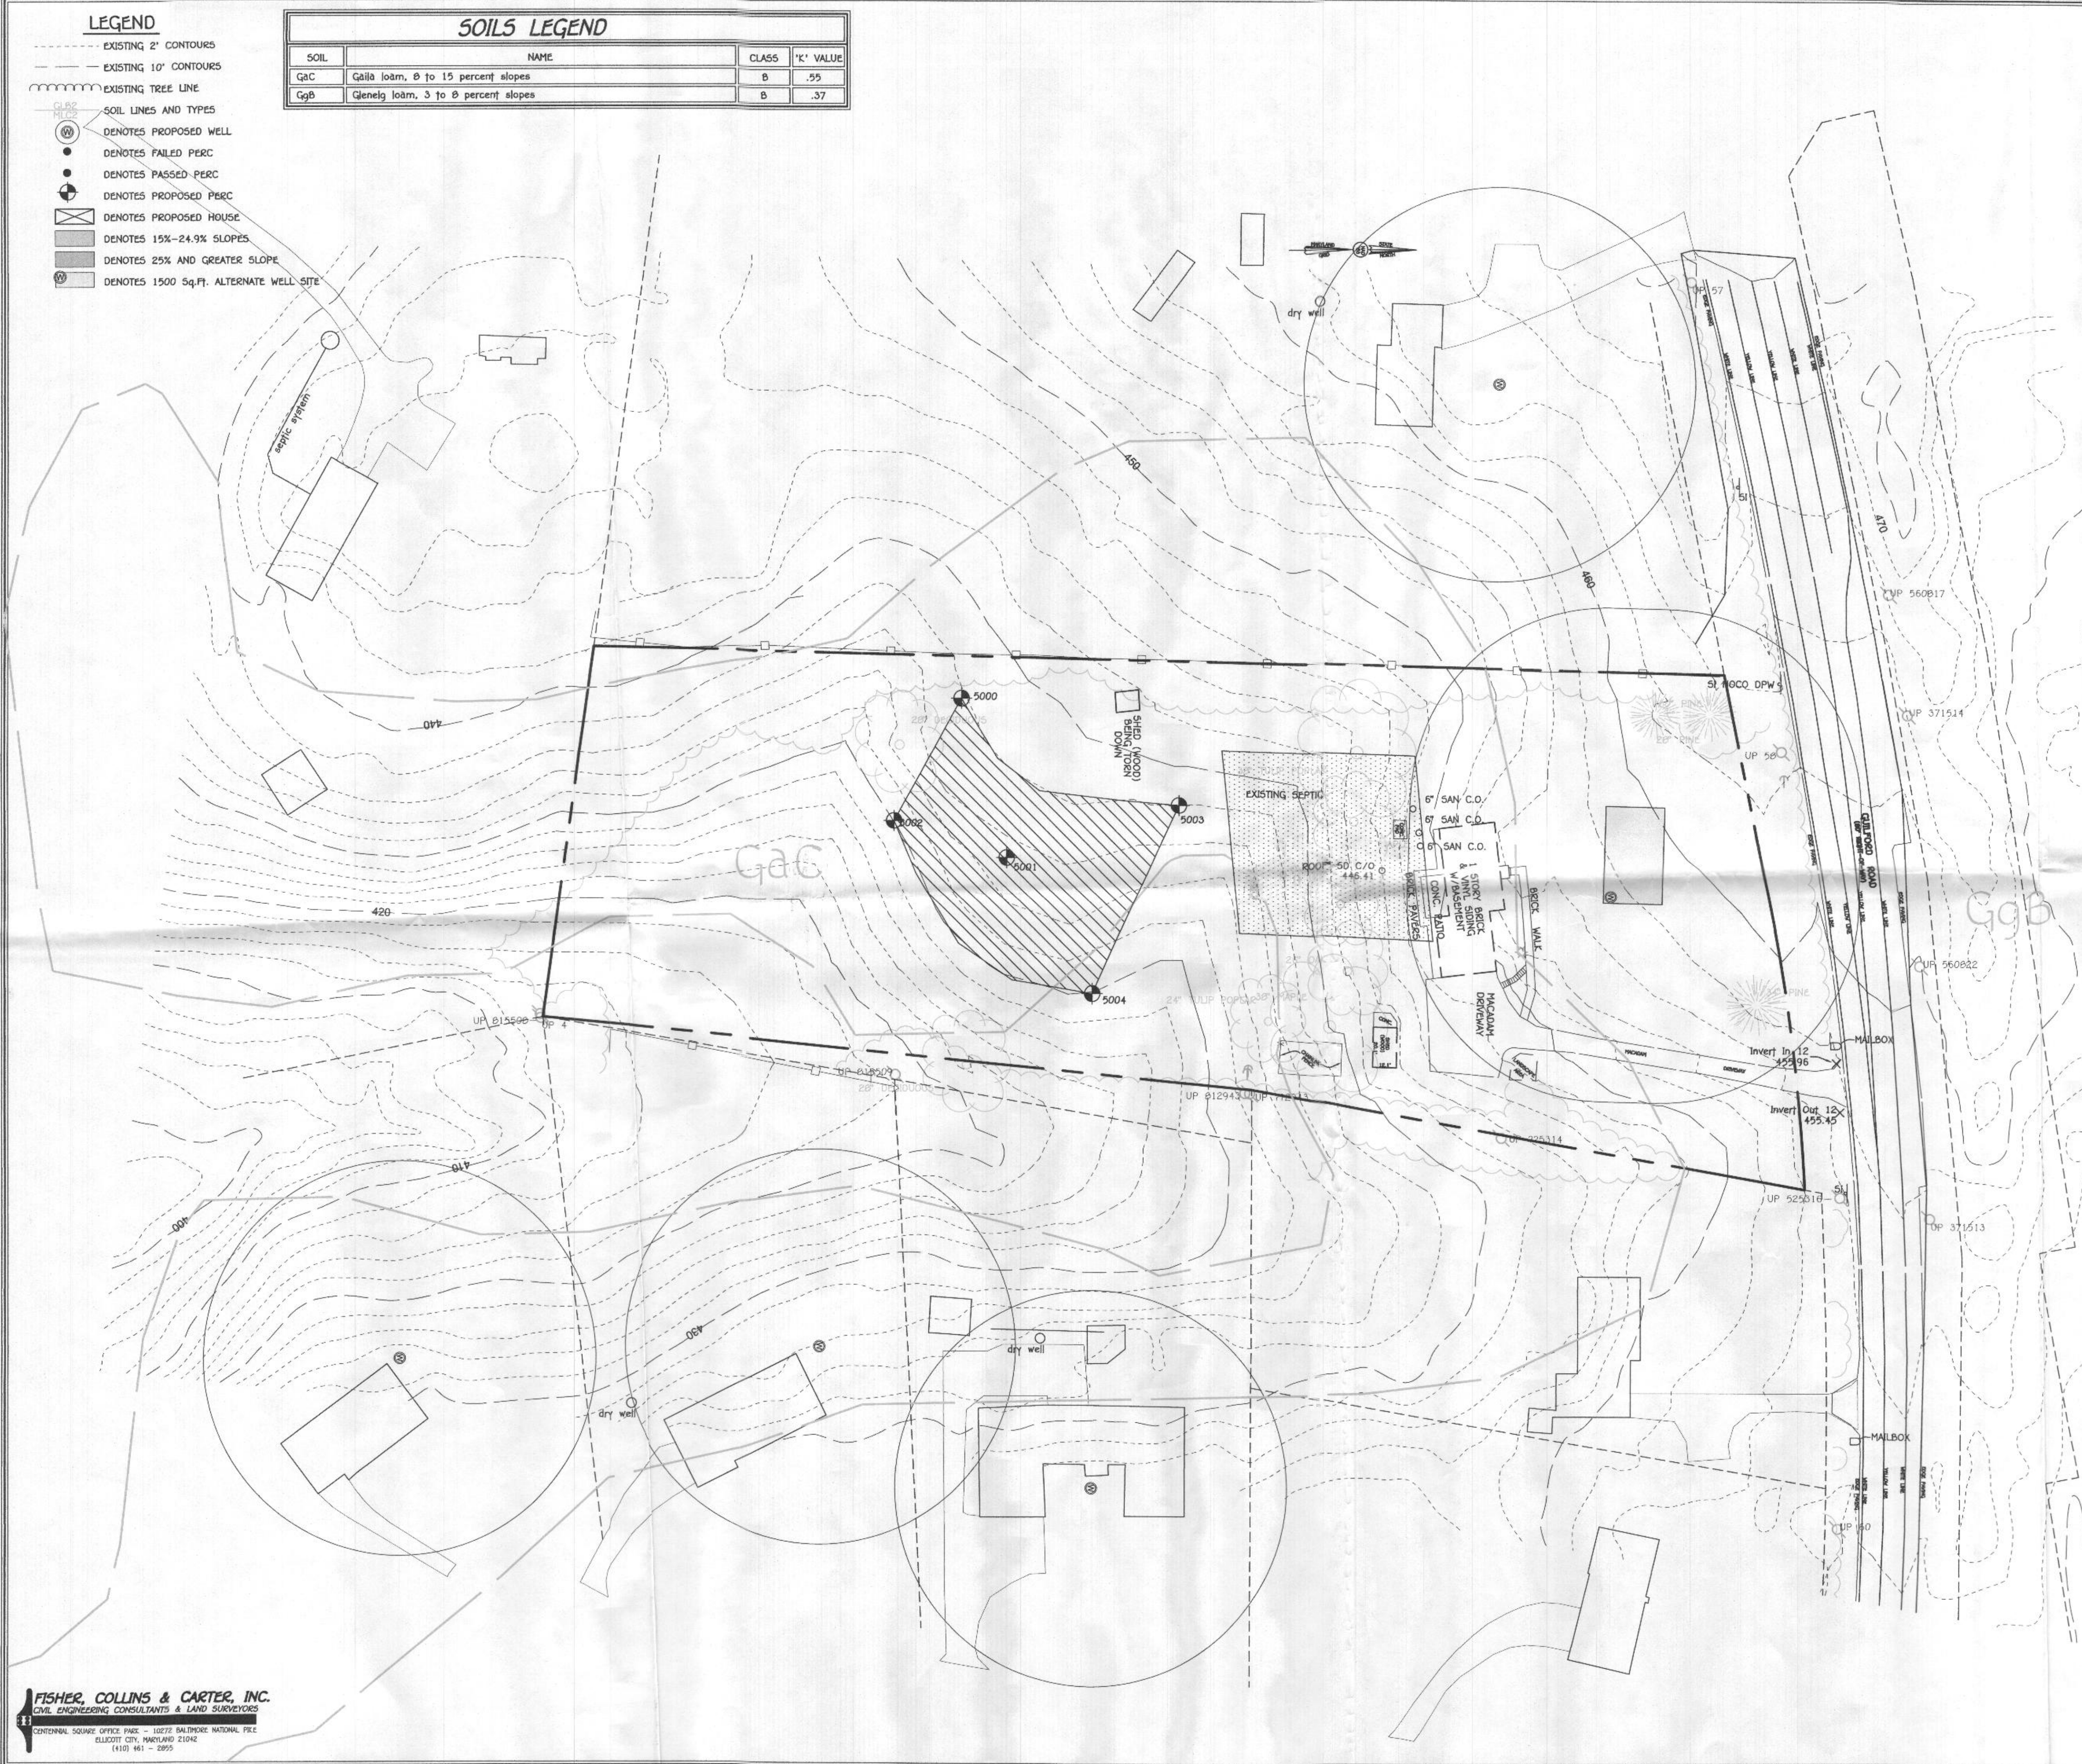

PERC APPLICATION PLAN
#7154 GUILFORD ROAD

TAX MAP #35 GRID: 21 PARCEL: 296
5TH ELECTION DISTRICT HOWARD COUNTY, MARYLAND
SCALE: 1" = 40' DATE: NOVEMBER 18, 2020


I:\2020\02\20\Engineering\Drawings\2020-3001 Perc App.dwg, Model, 1-40

LEGEND

- - - - - EXISTING 2' CONTOURS
- - - - - EXISTING 10' CONTOURS
- EXISTING TREE LINE
- SOIL LINES AND TYPES
- DENOTES FAILED PERC
- DENOTES PASSED PERC
- DENOTES 1500 SQ.FT. ALTERNATE WELL SITE

SOILS LEGEND


SOIL	NAME	CLASS	"K" VALUE
GaC	Gaia loam, 8 to 15 percent slopes	B	.55
GgB	Glenelg loam, 3 to 8 percent slopes	B	.37

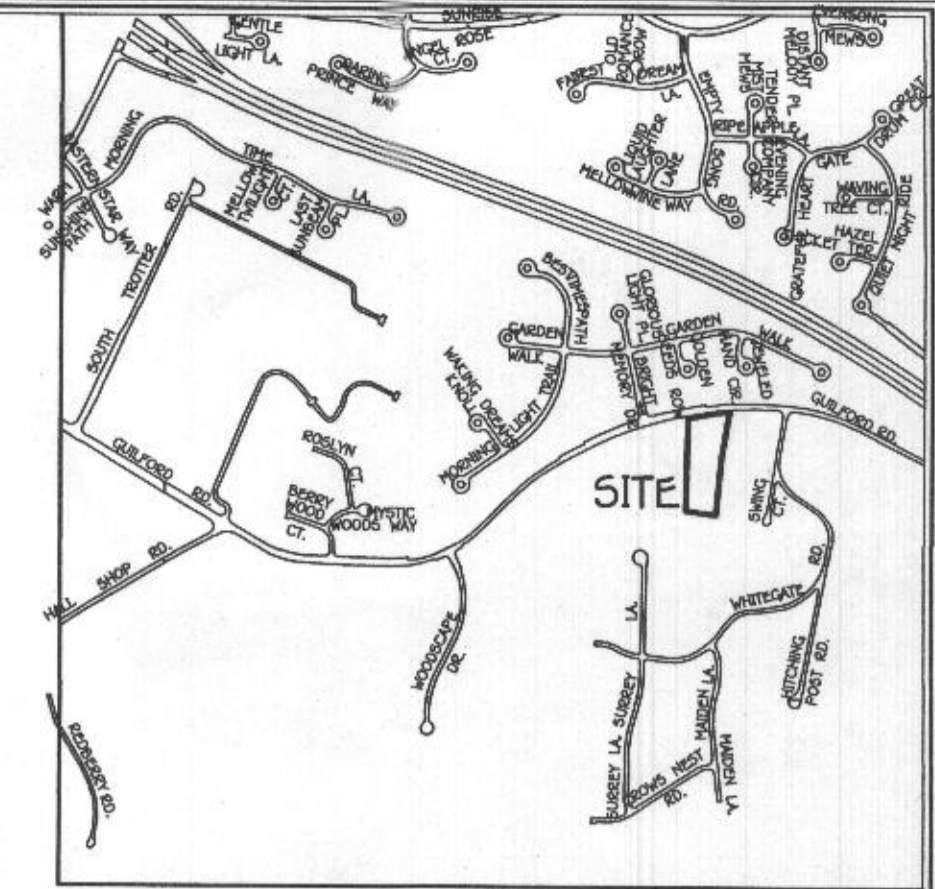

VICINITY MAP
SCALE: 1" = 1200'

GENERAL NOTES:

1. THIS AREA DESIGNATES A PRIVATE SEWAGE DISPOSAL AREA OF AT LEAST 10,000 SQUARE FEET AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT FOR INDIVIDUAL SEWAGE DISPOSAL. IMPROVEMENTS OF ANY NATURE IN THIS AREA ARE RESTRICTED UNTIL PUBLIC SEWERAGE IS AVAILABLE. THESE EASEMENTS SHALL BECOME NULL AND VOID UPON CONNECTION TO A PUBLIC SEWAGE DISPOSAL AREA. THE COUNTY HEALTH OFFICER SHALL HAVE THE AUTHORITY TO GRANT ADJUSTMENTS TO THE PRIVATE SEWAGE DISPOSAL AREA. RECORDATION OF A MODIFIED SEWERAGE EASEMENT SHALL NOT BE NECESSARY.
2. ADJUSTMENTS TO SEWAGE DISPOSAL AREA IS NOT PERMITTED WITHOUT ADDITIONAL TESTING.
3. THE LOT SHOWN HEREON COMPLIES WITH THE MINIMUM OWNERSHIP WIDTH AND LOT AREA AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT.
4. ALL WELLS AND SEPTIC SYSTEMS WITHIN 100' OF THE PROPERTY BOUNDARIES AND ALL EXISTING OR PROPOSED WELLS LESS THAN 200' DOWN/GRADIENT OF A SEPTIC SYSTEM AND/OR SEPTIC EASEMENT.
5. ALL HOUSE SITES SHOWN COMPLY WITH MINIMUM BUILDING RESTRICTION REGULATIONS.
6. TOPOGRAPHY SHOWN IS FIELD RUN BY FISHER, COLLINS & CARTER, INC. ON OR ABOUT OCTOBER, 2020.
7. BOUNDARY OUTLINE BASED ON FIELD RUN BY FISHER, COLLINS & CARTER, INC. ON OR ABOUT NOVEMBER, 2020.
8. ANY CHANGES TO A PRIVATE SEWAGE DISPOSAL AREA SHALL REQUIRE A REVISED PERC CERTIFICATION PLAN.
9. DEED REFERENCE LIBER 30778 FOLIO 613.
10. THE WELL MUST BE FENCED OFF WITH ORANGE CONSTRUCTION FENCING PRIOR TO HEALTH DEPARTMENT APPROVAL OF THE DEMO PERMIT.
11. THE EXISTING SEPTIC SYSTEM MUST BE PROPERLY ABANDONED PRIOR TO BUILDING PERMIT APPROVAL.

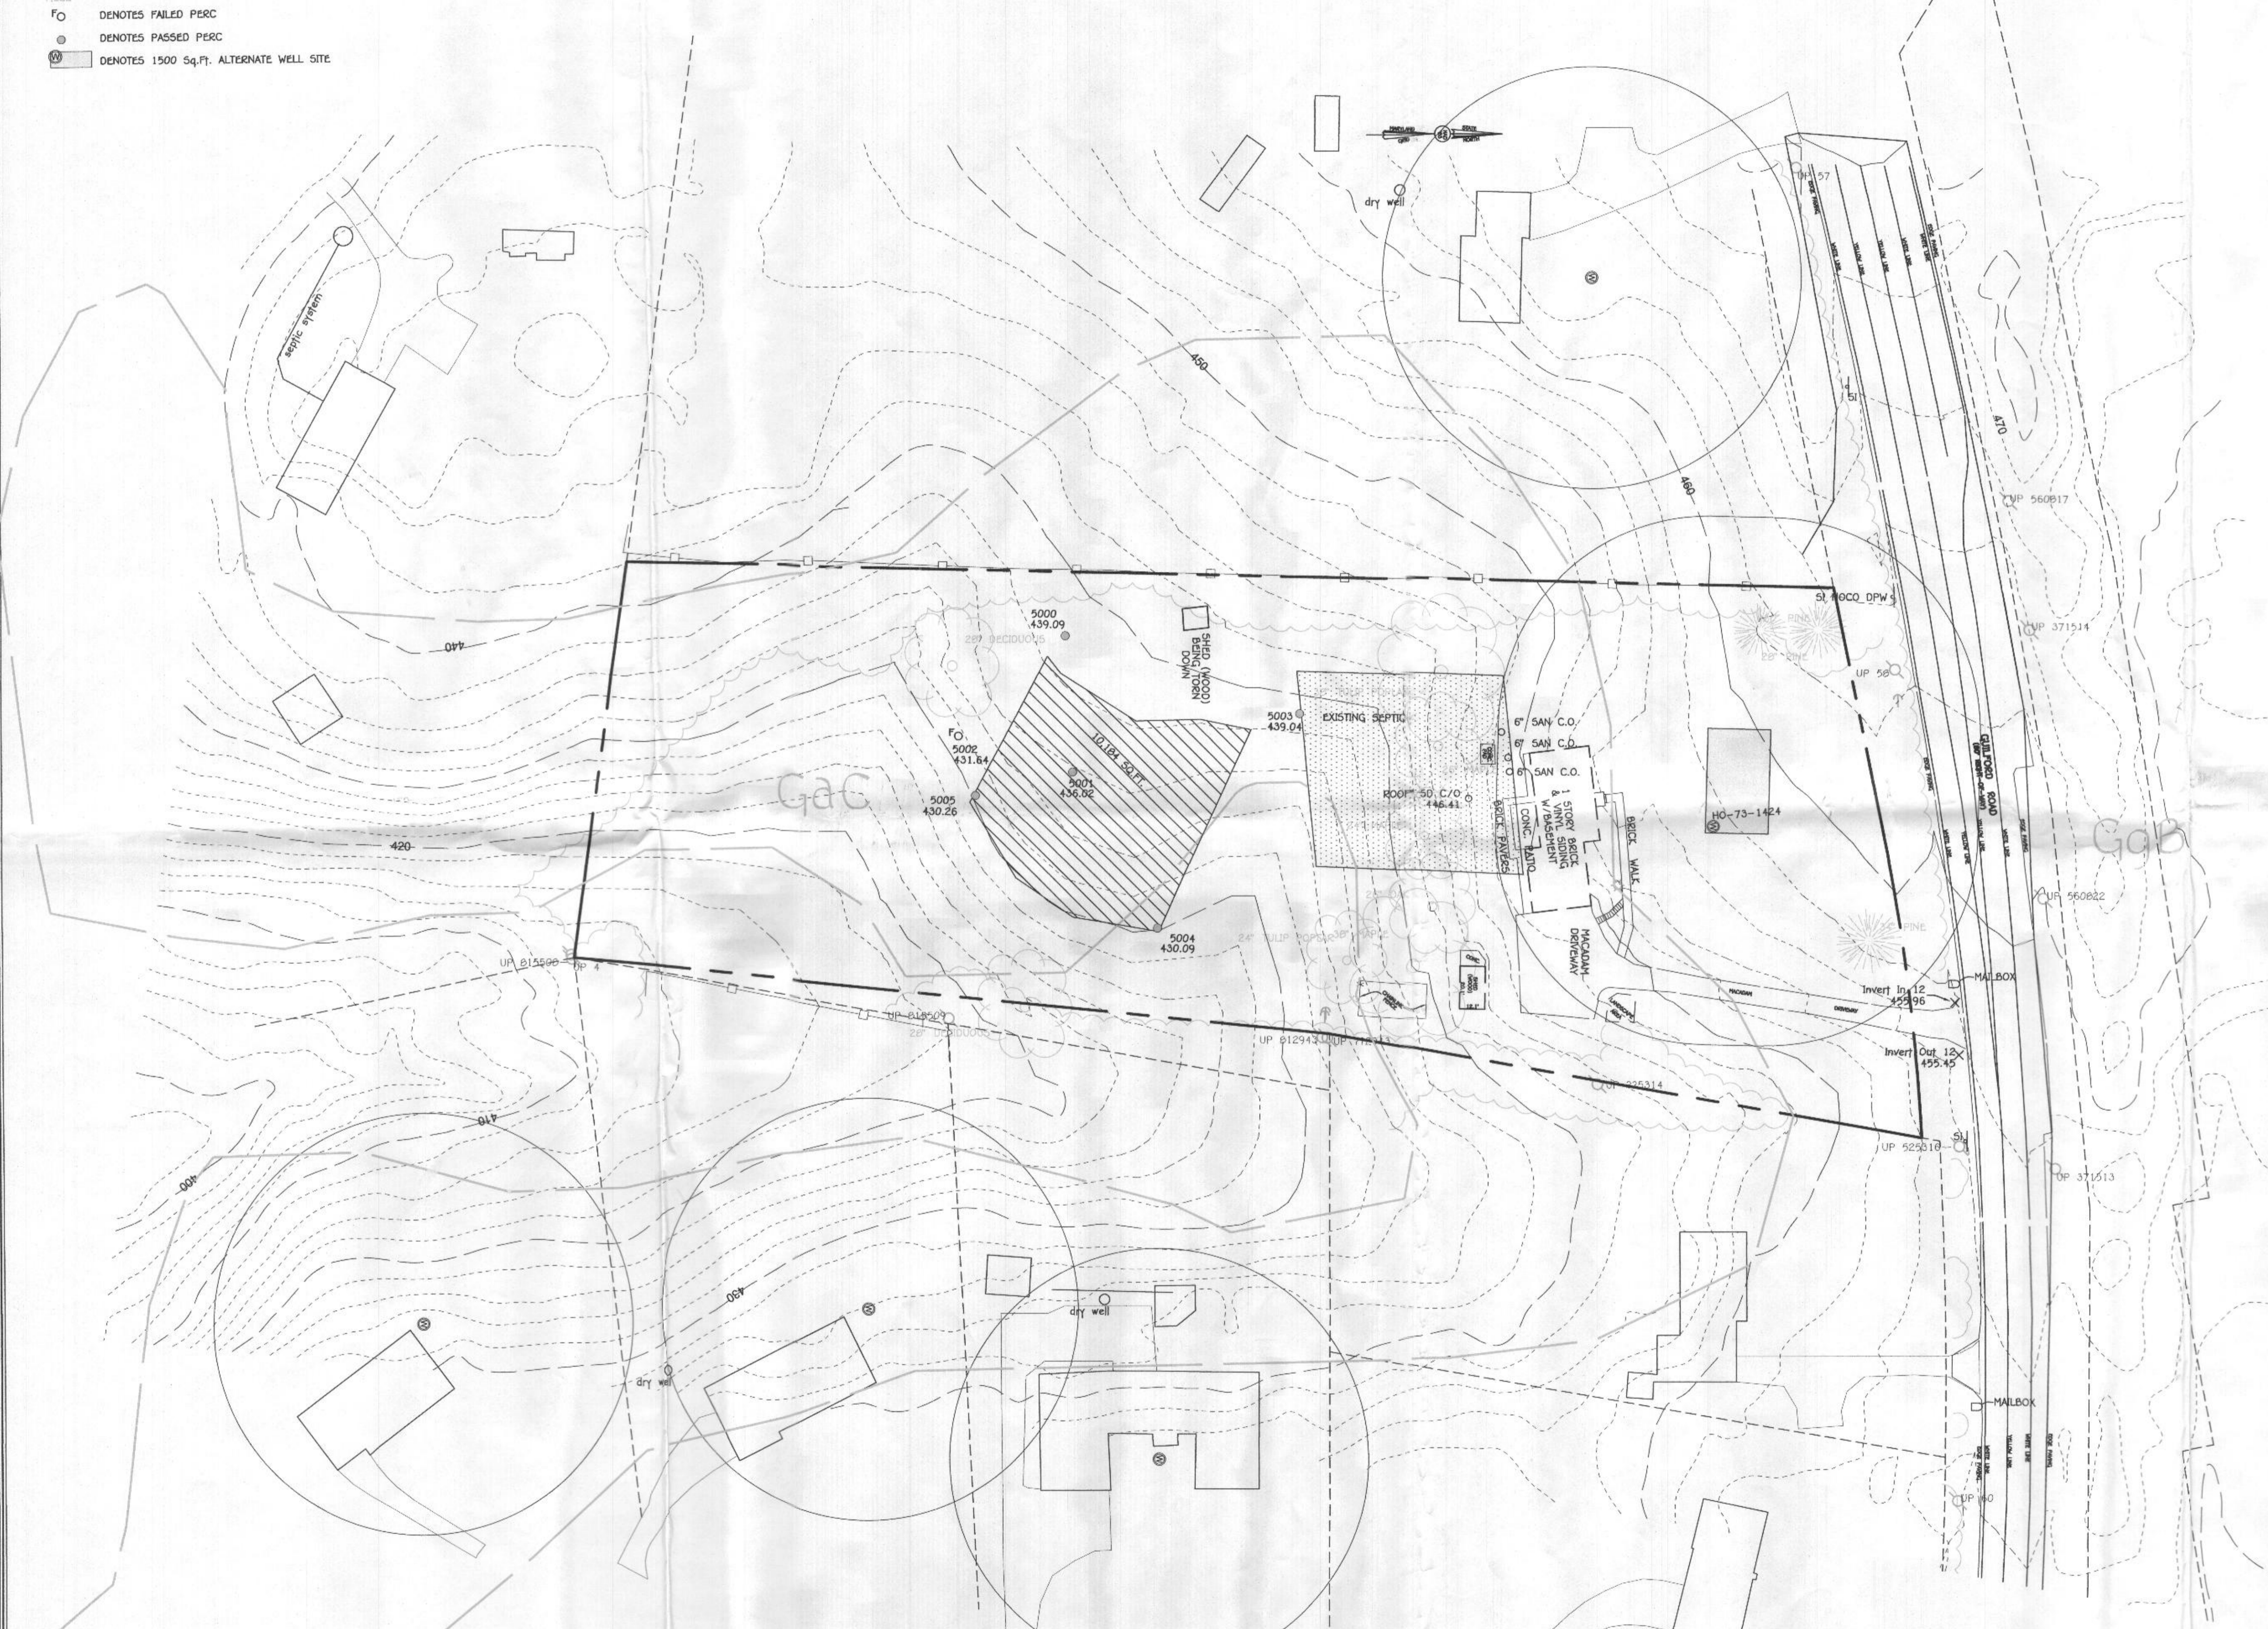

PERC CERTIFICATION
I certify that the locations shown hereon are the field locations done under my direct supervision and are correct to the best of my professional knowledge and belief.

Mark L. Robel
Signature of Property Line Surveyor
Mark L. Robel, Property Line Surveyor, expires 10/04/22

2/25/21
Date

APPROVED FOR PRIVATE WATER AND PRIVATE SEWERAGE SYSTEMS,
HOWARD COUNTY HEALTH DEPARTMENT.

Paula Roseman
Signature of Paula Roseman
COUNTY HEALTH OFFICER

3/9/2021
DATE

THE PURPOSE OF THIS PLAN IS TO ESTABLISH A NEW 10,000 SQ.FT. SEPTIC EASEMENT FOR THE EXISTING PROPERTY.

PERC CERTIFICATION PLAN
#7154 GUILFORD ROAD



TAX MAP #35 GRID: 21 PARCEL: 296
5TH ELECTION DISTRICT HOWARD COUNTY, MARYLAND
SCALE: 1" = 40' DATE: FEBRUARY 25, 2021

LEGEND

- EXISTING 2' CONTOURS
- EXISTING 10' CONTOURS
- EXISTING TREE LINE
- SOIL LINES AND TYPES
- DENOTES FAILED PERC
- DENOTES PASSED PERC
- ⊙ DENOTES 1500 Sq.Ft. ALTERNATE WELL SITE

SOILS LEGEND

SOIL	NAME	CLASS	K' VALUE
G4C	Gaia loam, 8 to 15 percent slopes	B	.55
GgB	Glenelg loam, 3 to 8 percent slopes	B	.37

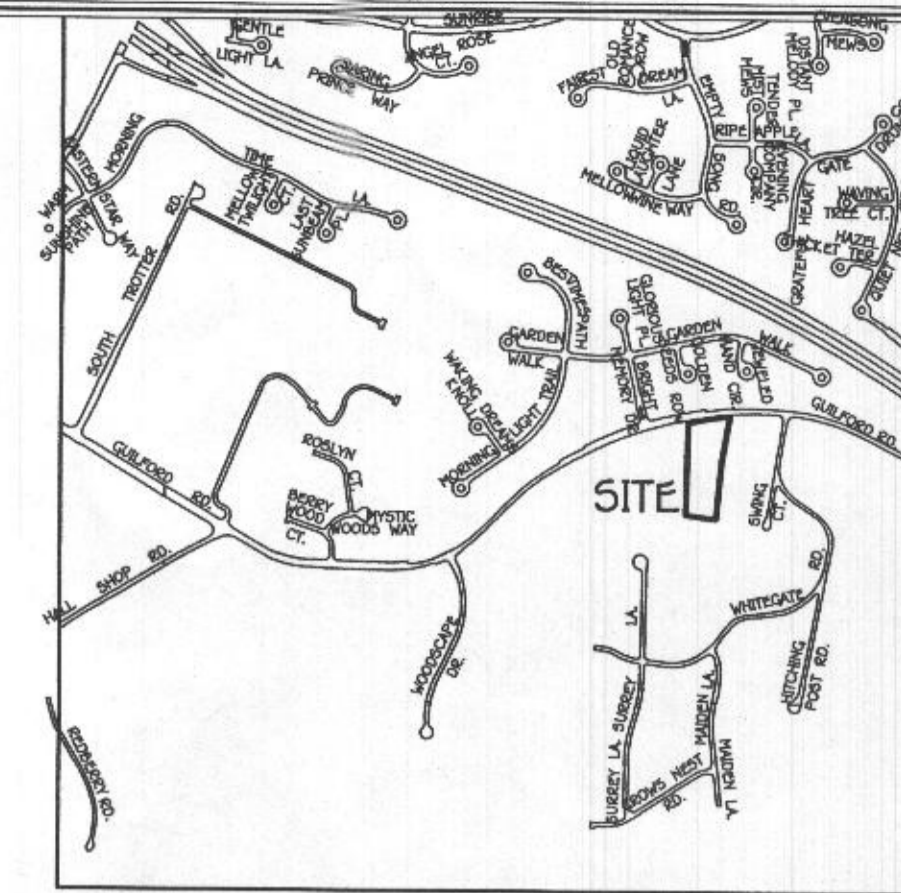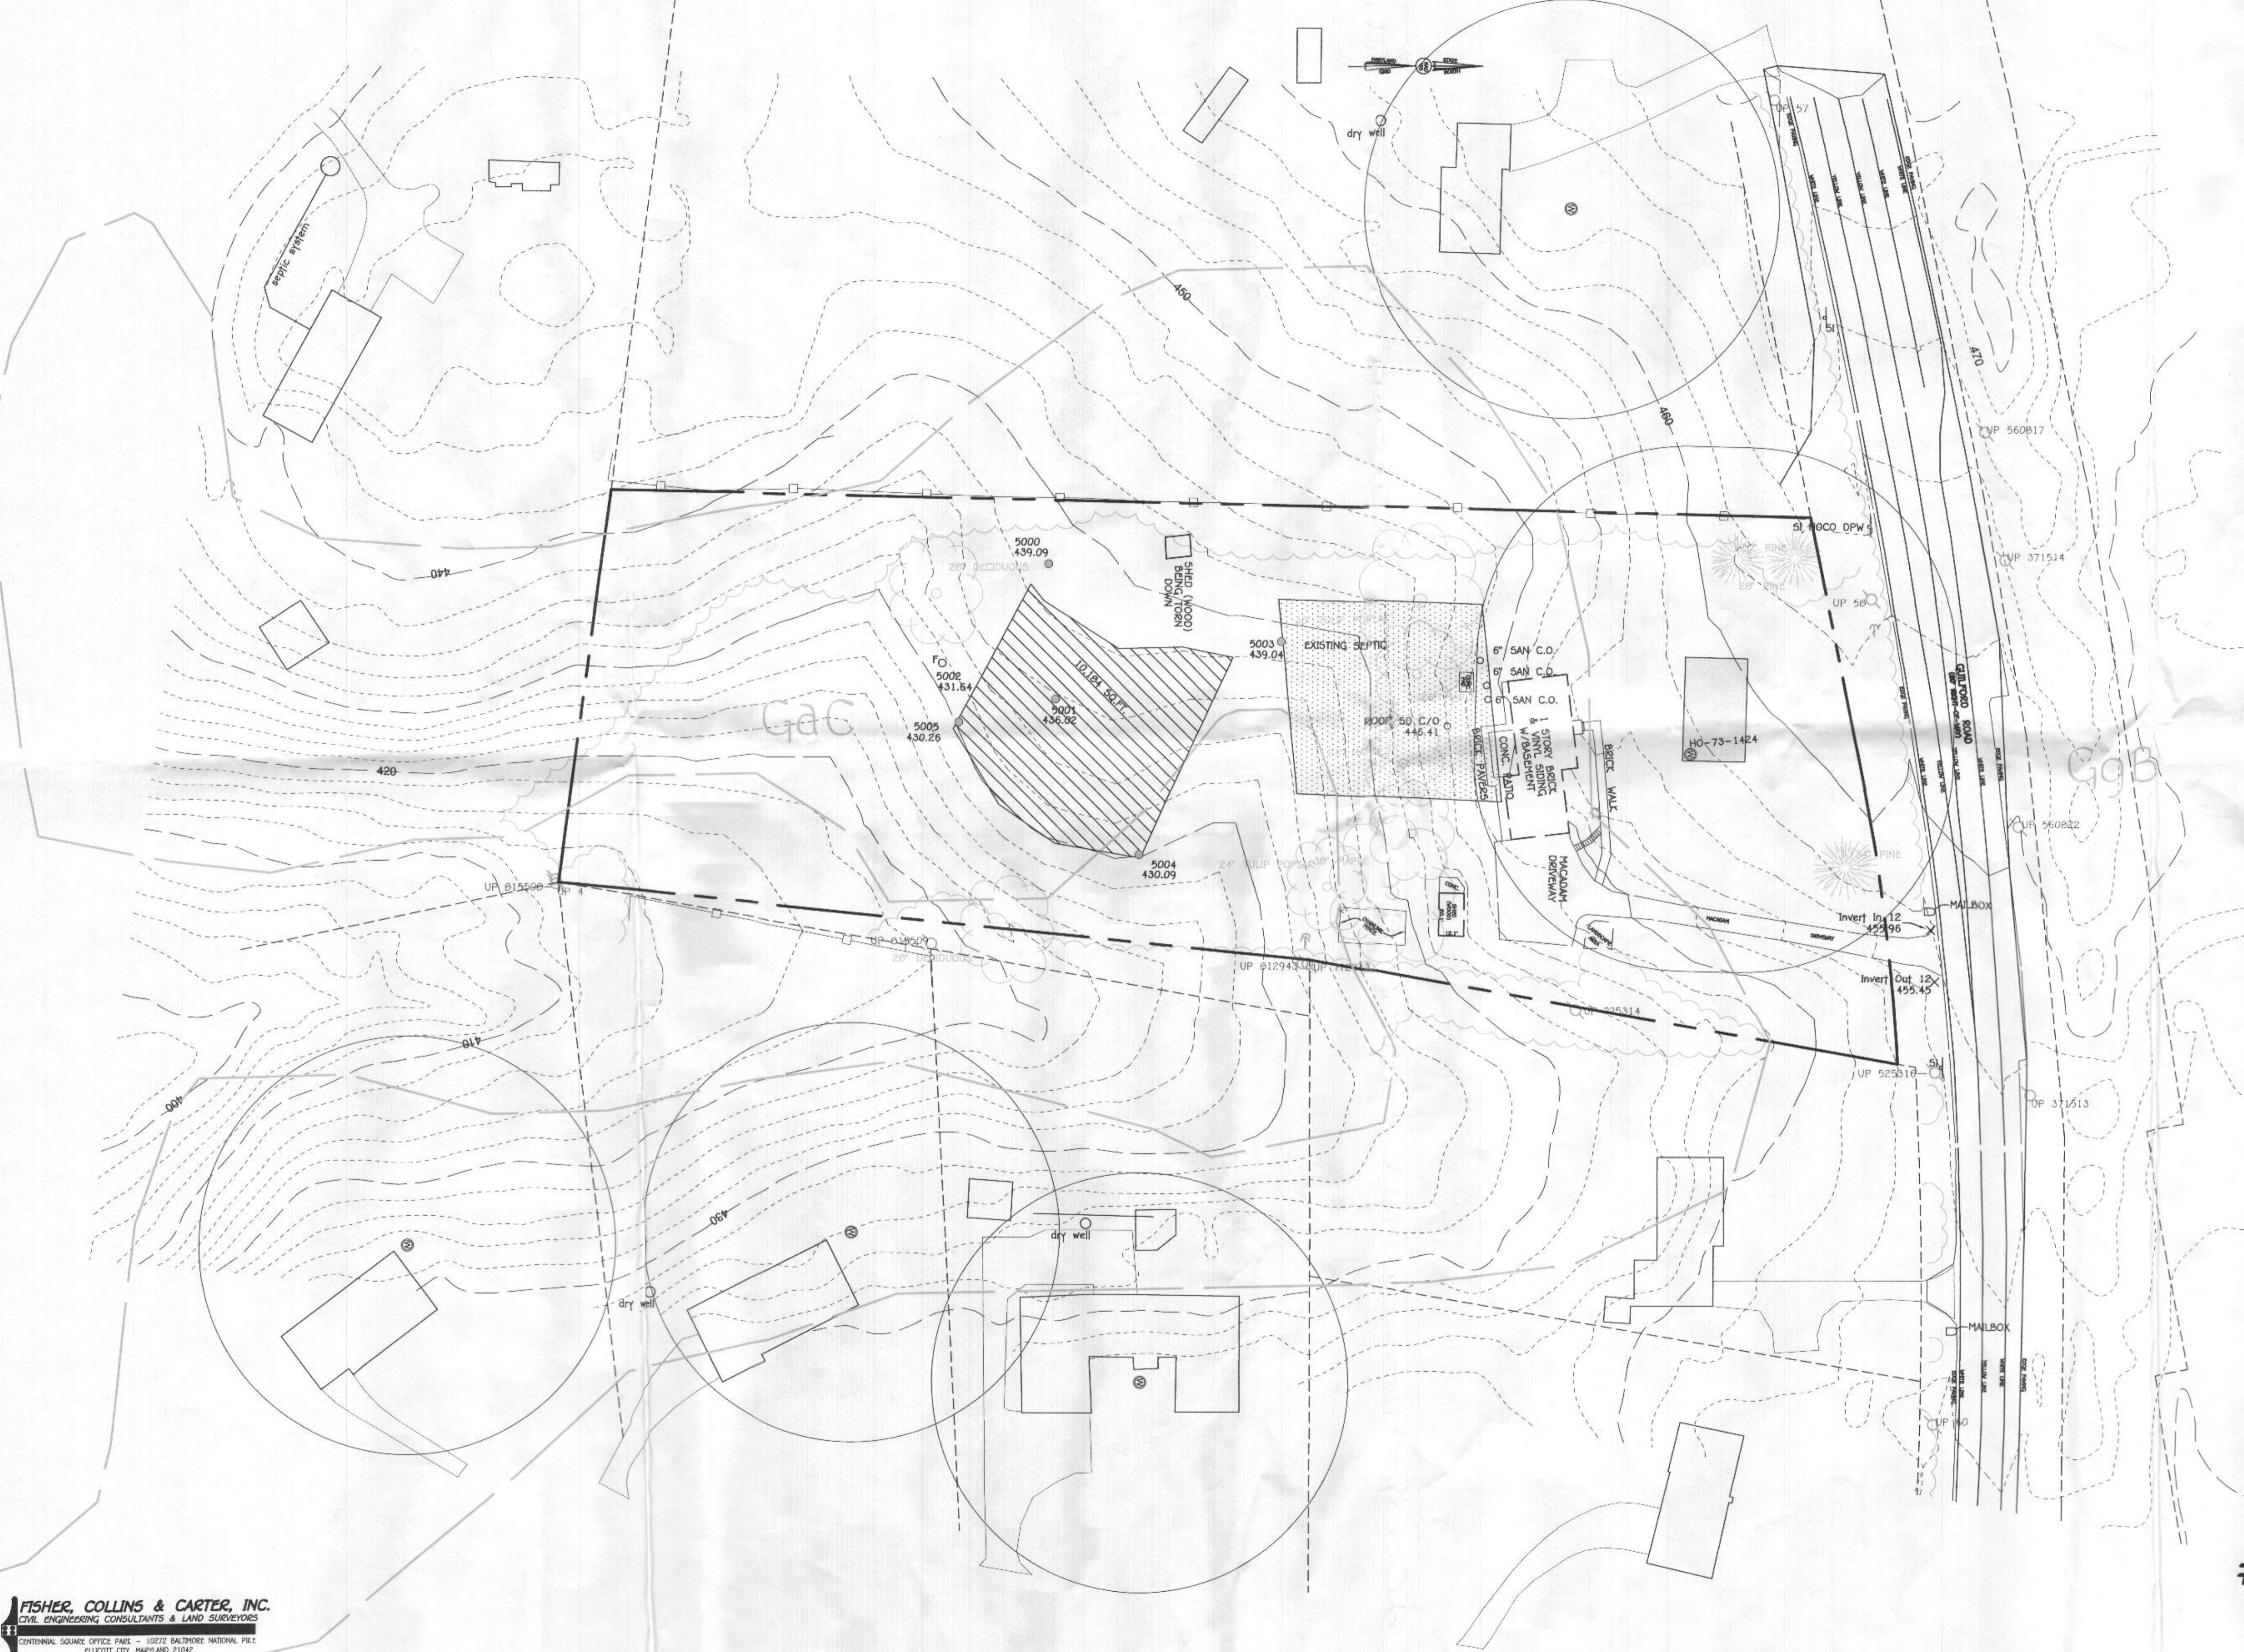

VICINITY MAP
SCALE: 1" = 1200'

GENERAL NOTES:

1. THIS AREA DESIGNATES A PRIVATE SEWAGE DISPOSAL AREA OF AT LEAST 10,000 SQUARE FEET AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT FOR INDIVIDUAL SEWERAGE DISPOSAL IMPROVEMENTS OF ANY NATURE IN THIS AREA ARE RESTRICTED UNTIL PUBLIC SEWERAGE IS AVAILABLE. THESE EASEMENTS SHALL BECOME NULL AND VOID UPON CONNECTION TO A PUBLIC SEWAGE DISPOSAL AREA. THE COUNTY HEALTH OFFICER SHALL HAVE THE AUTHORITY TO GRANT ADJUSTMENTS TO THE PRIVATE SEWAGE DISPOSAL AREA. RECORDATION OF A MODIFIED SEWERAGE EASEMENT SHALL NOT BE NECESSARY.
2. ADJUSTMENTS TO SEWAGE DISPOSAL AREA IS NOT PERMITTED WITHOUT ADDITIONAL TESTING.
3. THE LOT SHOWN HEREON COMPLIES WITH THE MINIMUM OWNERSHIP WIDTH AND LOT AREA AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT.
4. ALL WELLS AND SEPTIC SYSTEMS WITHIN 100' OF THE PROPERTY BOUNDARIES AND ALL EXISTING OR PROPOSED WELLS LESS THAN 200' DOWN/GRADIENT OF A SEPTIC SYSTEM AND/OR SEPTIC EASEMENT.
5. ALL HOUSE SITES SHOWN COMPLY WITH MINIMUM BUILDING RESTRICTION REGULATIONS.
6. TOPOGRAPHY SHOWN IS FIELD RUN BY FISHER, COLLINS & CARTER, INC. ON OR ABOUT OCTOBER, 2020.
7. BOUNDARY OUTLINE BASED ON FIELD RUN BY FISHER, COLLINS & CARTER, INC. ON OR ABOUT NOVEMBER, 2020.
8. ANY CHANGES TO A PRIVATE SEWAGE DISPOSAL AREA SHALL REQUIRE A REVISED PERC CERTIFICATION PLAN.
9. DEED REFERENCE LIBER 3078 FOLIO 613.
10. THE WELL MUST BE FENCED OFF WITH ORANGE CONSTRUCTION FENCING PRIOR TO HEALTH DEPARTMENT APPROVAL OF THE DEMO PERMIT.
11. THE EXISTING SEPTIC SYSTEM MUST BE PROPERLY ABANDONED PRIOR TO BUILDING PERMIT APPROVAL.

PERC CERTIFICATION
I certify that the locations shown on this site plan are field locations done under my direct supervision and are correct to the best of my professional knowledge and belief.

Mark L. Robel
Signature of Property Line Surveyor
Mark L. Robel, Property Line Surveyor, License Expires 10/04/22

2/25/21
Date

APPROVED FOR PRIVATE WATER AND PRIVATE SEWERAGE SYSTEMS,
HOWARD COUNTY HEALTH DEPARTMENT.

Richard J. Moran
Signature of Health Officer
COUNTY HEALTH OFFICER

3/9/2021
DATE

THE PURPOSE OF THIS PLAN IS TO ESTABLISH A NEW 10,000 SQ.FT. SEPTIC EASEMENT FOR THE EXISTING PROPERTY.

PERC CERTIFICATION PLAN
#7154 GUILFORD ROAD


TAX MAP #35 GRID: 21 PARCEL: 296
5TH ELECTION DISTRICT HOWARD COUNTY, MARYLAND
SCALE: 1" = 40' DATE: FEBRUARY 25, 2021

LEGEND

- EXISTING 2' CONTOURS
- EXISTING 10' CONTOURS
- - - EXISTING TREE LINE
- SOIL LINES AND TYPES
- ⊙ DENOTES PROPOSED WELL
- DENOTES FAILED PERC
- ⊙ DENOTES PASSED PERC
- ⊙ DENOTES PROPOSED PERC
- ⊙ DENOTES PROPOSED HOUSE
- ▨ DENOTES 15%-24.9% SLOPES
- ▨ DENOTES 25% AND GREATER SLOPE
- ⊙ DENOTES 1500 Sq.Ft. ALTERNATE WELL SITE

SOILS LEGEND


SOIL	NAME	CLASS	"K" VALUE
GaC	Gaill loam, 8 to 15 percent slopes	B	.55
GgB	Glenelg loam, 3 to 8 percent slopes	B	.37

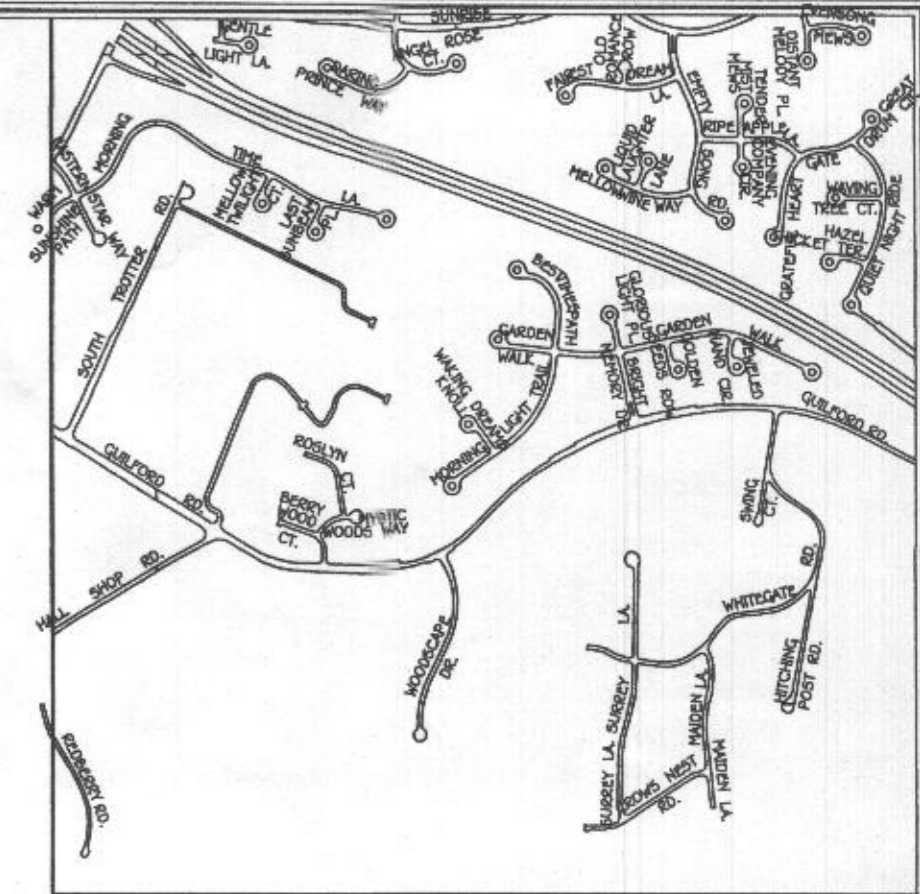

VICINITY MAP
SCALE : 1" = 1200'

GENERAL NOTES:

1. THIS AREA DESIGNATES A PRIVATE SEWAGE DISPOSAL AREA OF AT LEAST 10,000 SQUARE FEET AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT FOR INDIVIDUAL SEWERSAGE DISPOSAL IMPROVEMENTS OF ANY NATURE IN THIS AREA ARE RESTRICTED UNTIL PUBLIC SEWERAGE IS AVAILABLE. THESE EASEMENTS SHALL BECOME NULL AND VOID UPON CONNECTION TO A PUBLIC SEWAGE DISPOSAL AREA. THE COUNTY HEALTH OFFICER SHALL HAVE THE AUTHORITY TO GRANT ADJUSTMENTS TO THE PRIVATE SEWAGE DISPOSAL AREA. RECORDATION OF A MODIFIED SEWERAGE EASEMENT SHALL NOT BE NECESSARY.
2. ADJUSTMENTS TO SEWERAGE DISPOSAL AREA IS NOT PERMITTED WITHOUT ADDITIONAL TESTING.
3. THE LOT SHOWN HEREON COMPLIES WITH THE MINIMUM OWNERSHIP WIDTH AND LOT AREA AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT.
4. ALL WELLS AND SEPTIC SYSTEMS WITHIN 100' OF THE PROPERTY BOUNDARIES AND ALL EXISTING OR PROPOSED WELLS LESS THAN 200' DOWN/GRADIENT OF A SEPTIC SYSTEM AND/OR SEPTIC EASEMENT.
5. ALL HOUSE SITES SHOWN COMPLY WITH MINIMUM BUILDING RESTRICTION REGULATIONS.
6. ALL WELLS SHALL BE DRILLED PRIOR TO FINAL PLAT RECORDATION. IT IS THE DEVELOPERS RESPONSIBILITY TO SCHEDULE THE WELL DRILLING PRIOR TO FINAL PLAT SUBMISSION. IT WILL NOT BE CONSIDERED "GOVERNMENT DELAY" IF THE WELL DRILLING HOLDS-UP THE HEALTH DEPARTMENT SIGNATURE OF THE RECORD PLAT.
7. TOPOGRAPHY SHOWN IS FROM HOWARD COUNTY GIS TOPOGRAPHY AT 5' CONTOUR INTERVAL INTERPOLATED FOR 2' CONTOUR INTERVAL.
8. BOUNDARY OUTLINE BASED ON AVAILABLE DEED OF RECORD WITHOUT THE THE BENEFIT OF A FIELD SURVEY AT THIS TIME.
9. ANY CHANGES TO A PRIVATE SEWAGE DISPOSAL AREA SHALL REQUIRE A REVISED PERC CERTIFICATION PLAN.
10. DEED REFERENCE LIBER 3078 FOLIO 613.

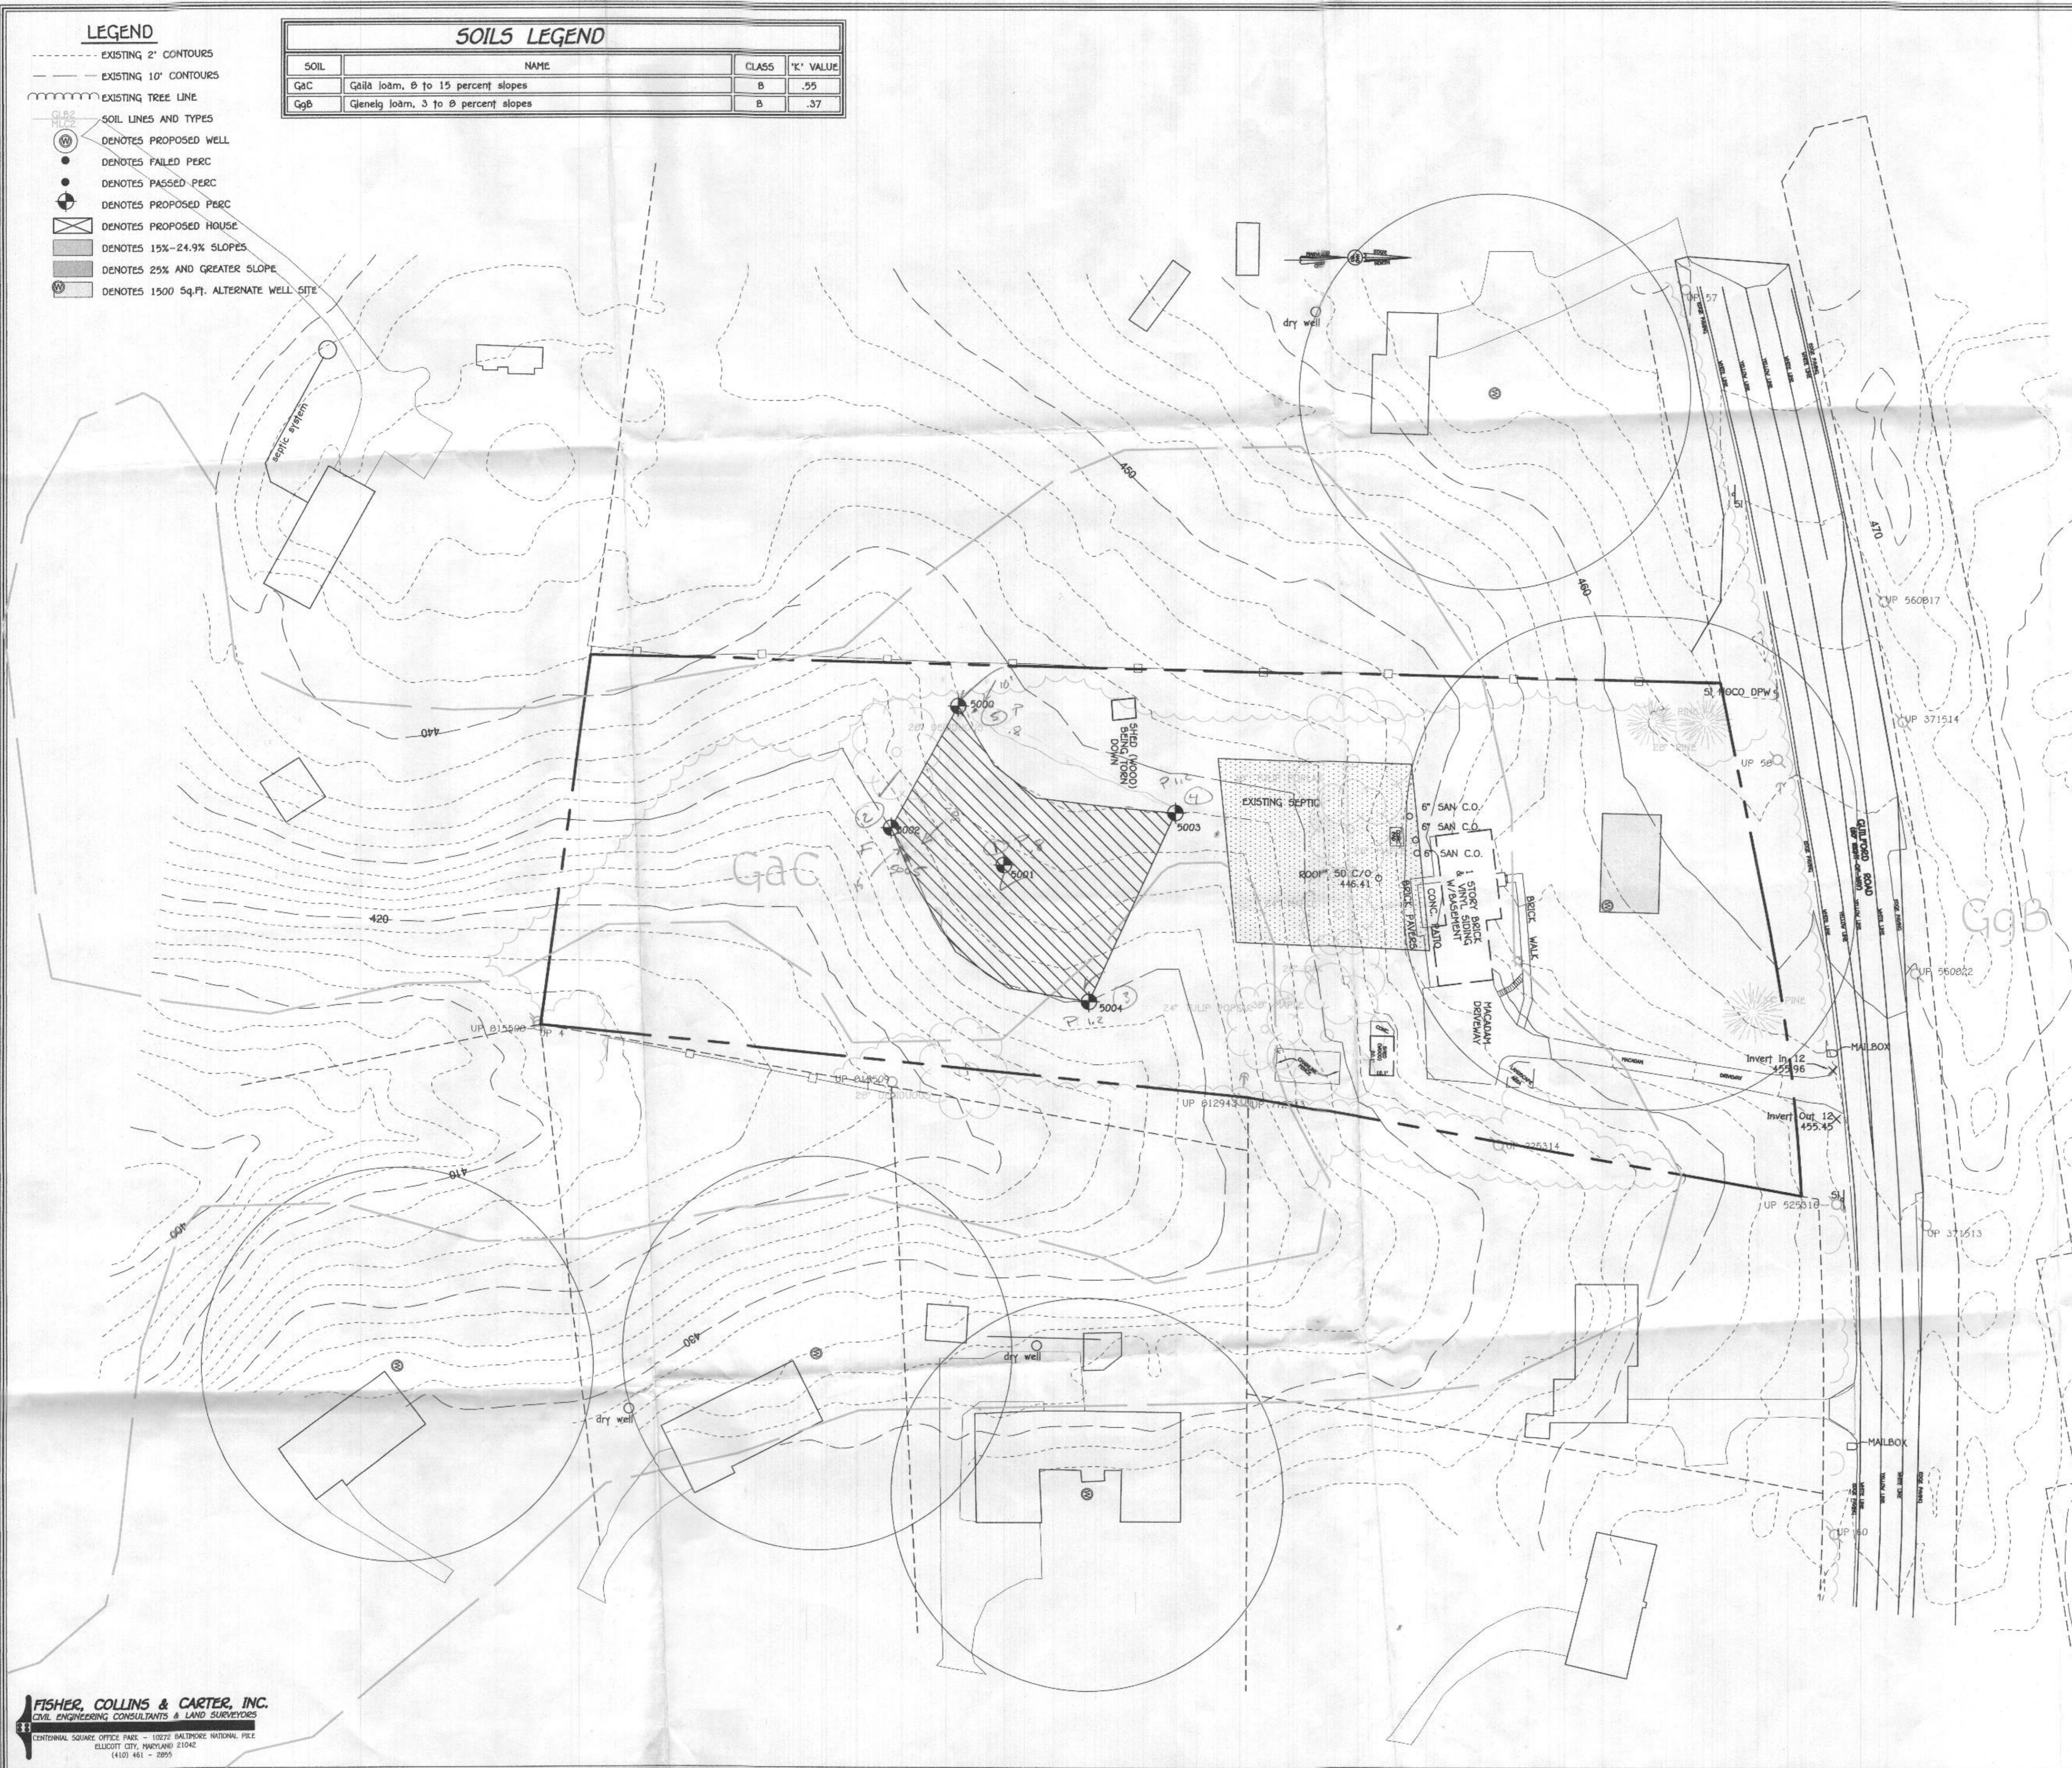

FISHER, COLLINS & CARTER, INC.
 CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
 CENTRAL SQUARE OFFICE PARK - 10775 GAITHERS NATIONAL PIKE
 ELLICOTT CITY, MARYLAND 21042
 (410) 461-3299

PERC APPLICATION PLAN
#7154 GUILFORD ROAD

TAX MAP #35 GRID: 21 PARCEL: 296
 5TH ELECTION DISTRICT HOWARD COUNTY, MARYLAND
 SCALE: 1" = 40' DATE: NOVEMBER 18, 2020

I:\2020\2020\Engineering\Drawings\2020-5901 Proj. App. Reg. Model. 140