10/11/11/ 1/20

03.311709 PERMIT

SEWAGE DISPOSAL SYSTEM

DEPARTMENT OF HEALTH AND MENTAL HYGIENE

P	<u> </u>

365	14	

DI	STRICT	3ra
	-	//
		11/7/94
	DATE	"1//94

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH

INDEXED

DATE SYSTEM APPROVED 10-11-94

INSPECTOR ALM

	Compliance eptic Service	•	IS PERM	MITTED TO INSTAL	L X ALTER	
ADDRESS 13775 Tr	iadelphia Road,	Glenelg, Maryland				
SUBDIVISION Ways	ide Manor	ьот3	ROAD1	2735 Triadel	lphia Road	
PROPERTY OWNER	W	esley R. & Cecili	a M. Daub			
ADDRESS		·				<u>.</u>
SEPTIC TANK CAPACITY	1500 GALLONS	·				
NUMBER OF BEDROOMS 210 SQUARE F		219 2 1050 511	10			
LINEAR FEET OF TRENCH	REQUIRED 210	<u>. </u>				
dept orig LOCATION - Plac righ	h 8 feet below o inal grade. 5 f e distribution b t (634.44') lot	wide. Inlet 3 fe riginal grade. E eet of stone belo ox 90 feet from r line as viewed fr	ffective are w distributi ear (260.77' om Triadelp	a begins at on pipe.) lot line a hia Road.	3 feet below	from
NOTES - No t	rench to exceed	ctions away from 100 feet in lengt e on septic tank.	h. Provide	<u>6" - 8" dian</u>	neter cleanou	ıt and
PLANS APROVED BY	Ronald J. PIn	kley			_DATE09/14/	93

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS, 90° ELBOWS NOT ACCEPTABLE.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(ES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(ES)

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 35/40 PVC OR ABS


AND RETURNED 11/2/199

PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL STAND PIPES MUST BE 6 INCHES IN DIAMETER CAST IRON. CONCRETE OR TERRA COTTA OR PVA OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET. MANHOLE TO GRADE REQUIRED. That I would be a concrete or terra cotta or pva or abs accepted.

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

propone lonk

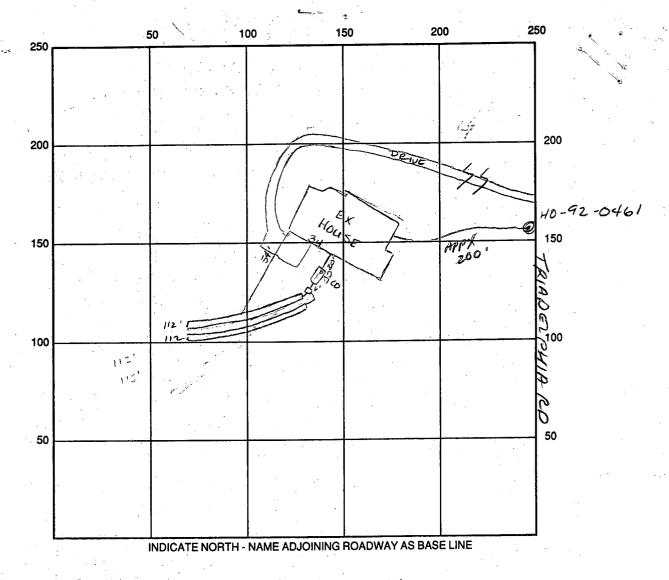

SEPTIC TANK LEVEL 1500 gal CLEANOUTS OL
DISTRIBUTION BOX LEVEL OK balle 15 in
DRAIN FIELD/TITLE DEPTH 8' REV. FT. TRENCH WIDTH 2' FT. INLET DEPTH 3' FT.
EFFECTIVE CRAVEL DEPTH 5' ET TOTAL I FINGTH @ 1/2 FT = 1,24
NUMBER OF TRENCHES ONE SIDEWALL/BOTTOM AREA SQ. FT.
DRYWALL INSIDE DIAMETER FT. EFFECTIVE DEPTH BELOW INLET FT.
ABSORBENT AREASQ. FT.
REMARKS: 10-11-94 OR to cover well work from the
DATE SYSTEM APPROVED 10-11-94 INSPECTOR Amy M'Muller

