

Approved 10/15/25
- H.O.

Record Detail * (This section is required.)

Permit Type	Permit Number	Opened Date
Building/Residential/Addition/SFD	B25004314	10/01/2025

Description of Work
SFD/ CONSTRUCT FIRST FLOOR 24' X 26 ADDITION TO CREATE A BEDROOM, FULL BATH, HALF BATH, LAUNDRY ROOM, MUDROOM, AND CLOSET AND FINISH BASEMENT TO CREATE A REC ROOM, 1 STORY, Full Basement, 4R, 1FB, 1HB, 0FP, OTHER STRUCTURE = None, 1BR, PORCH/DECK = N/A, ENERGY METHOD = Prescriptive Method,

Online BP.
g8 10/9/25

[check spelling](#)

Address * (This section is required.)

Search Reset Clear Get Parcel & Owner

Street #	Street Name	Street Type
683	WATERSVILLE	RD
Unit Type	Unit #	X Coordinate
--Select--		-77.0962
		Y Coordinate
		39.35274
City	State	Zip Code
MOUNT AIRY	MD	21771
	Primary	
	Yes	

Parcel * (This section is required.)

Search Reset Clear Get Address & Owner

GIS ID *	Parcel	Parcel Area	Land Value	Improved Value	Exemption Value	Plan Area
830223	79	1.17	186700	350500	163800	RURAL

Legal Description
IMPS1.17 ACRES[]683 WATERSVILLE RD[]WOODBINE

[check spelling](#)

Block	Lot	Census Tract	Council Dist	Inspection Dist	Supervisor Dist	Map #	DAP Zone
		604001	5				
Plan Area		State Tax Id	Subdivision Name				
		1404324617					
Section		Area	Tax Map				
			2				
Grid		Zoning District	ADC Map				
2-21		RC-DEO	4691-E4				
SDP No.		Final Plan No.	WP File No.				
Record Plat No.		WS Contract No.	FDP No.	Primary			
				Yes			
Owner Occupied		Year Built	Historic District				
<input type="radio"/> Yes <input type="radio"/> No		1956	<input type="radio"/> Yes <input checked="" type="radio"/> No				
Historic District Registry No.		Stat Area	Flood Plain				
		4-02	<input type="radio"/> Yes <input checked="" type="radio"/> No				
Building No							

Owner (This section is not required.)

Search Reset Clear

Name *
KRAUE
Address Line 1
683 WATERSVILLE RD
Address Line 2

Address Line 3

Mail City
MOUNT AIRY
Mail State
MD
Mail Zip Code
21771
Phone
410-302-3653
Primary
Yes
E-mail

louiskrausz@gmail.com

Cell Number

Fax Number

Professionals (This section is not required.)

License # * 0
 License Type * Property Owner
 Primary Yes

Business Name
 PROPERTY OWNER TO ACT AS CONTRACTOR

First Name Middle Name Last Name
 LOUIS KRAUSZ

Address Line 1
 683 WATERSVILLE RD
 Address Line 2

City State ZIP Code
 MOUNT AIRY MD 21771

Phone 1 Phone 2 Fax
 410-302-3653

E-mail
 louiskrausz@gmail.com

Applicant (This section is not required.)

Search As Owner As Lic. Prof As Contact

Type * Applicant
 Relationship Applicant
 Primary No

First Name MI Last Name
 Louis Krausz

Full Name
 Louis Krausz

Organization Name

Street Address
 683 E. Watersville Rd.
 Address Line 2

City State Zip Code
 Mount Airy MD 21771

Phone Cell Fax
 410-302-3653

E-mail *
 louiskrausz@gmail.com

Contact (This section is not required.)

Search As Owner As Lic. Prof As Contact

Type Contact
 Relationship Applicant
 Primary Yes

First Name MI Last Name
 Louis Krausz

Full Name
 Louis Krausz

Organization Name

Street Address
 683 E. Watersville Rd.
 Address Line 2

City State Zip Code
 Mount Airy MD 21771

Phone Cell Fax
 410-302-3653

E-mail
 louiskrausz@gmail.com

Addtl Info

Est Construction Cost * 150000
 Housing Units * 0
 Number of Buildings * 0
 Public Owned No

Construction Type
 --Select--

RESIDENTIAL ADDITION INFORMATION

RESIDENTIAL ADDITION INFORMATION

Capital Project-No Fee *
 Yes No

Capital Project Number
 (Text)

Fee Exempt *
 Yes No

Roadside Tree Project Permit
 Yes No

Roadside Tree Pr

No of Stories * 1 (Text) Foundation * Full Basement Basement * Full Finished No of Rooms * 4 (Text) Full Baths * 1 (Number) Ha 1

Model * SFD/ CONSTRUCT FIRST FLOOR 24' X 26 ADDITION TO CREATE A BEDROOM, FULL BATH, HALF BATH, LAUNDRY ROOM, MUDROOM, check spelling

Other Structure * None Bedrooms * 1 (Number) Porch Deck * N/A No of Fireplaces * 0 (Number) Type of Fireplace --Select-- W & S Fees Paid Water * Private Sewage * Private Utilities * Electric Heating System * Electric Sprinkler System * None

1st Floor Width FT (Number) 1st Floor Depth FT (Number) 2nd Floor Width FT (Number) 2nd Floor Depth FT (Number) Basement Width FT (Number) Basement Depth FT (Number) Height FT (Number)

Total Square Footage * 1045 SQFT (Number) Occupiable Square Footage * 0 SQFT (Number) Affordable Housing Funding * N/A Foundation Measurement (Text)

Walls (Text) Roof (Text) Change In Use Change In Use Grading Permit No Senior Housing MIHU Outside Downtown Columbia

Additional Description Info Expiration Date 4/7/2026

check spelling

MIHU Required Units 0 (Num)


GREEN INFORMATION

Goal Level --Select-- Actual Level --Select-- Leed Registration Number (Text) Date of Leed Certification

STORM WATER MANAGEMENT



Green Roofs A1 Permeable Pavements A2 Reinforced Turf A3 Disconnection of Rooftop Runoff N1 Sheetflow to Conservation Areas N3 Rainwater Harvesting M1 Submerged Gravel Wetlands M2 Landscape Infiltration Dry Wells M5 Micro Bioretention M6 Rain Gardens M7 Swales M8 PSWM Certification Received in CID on

Submit Cancel

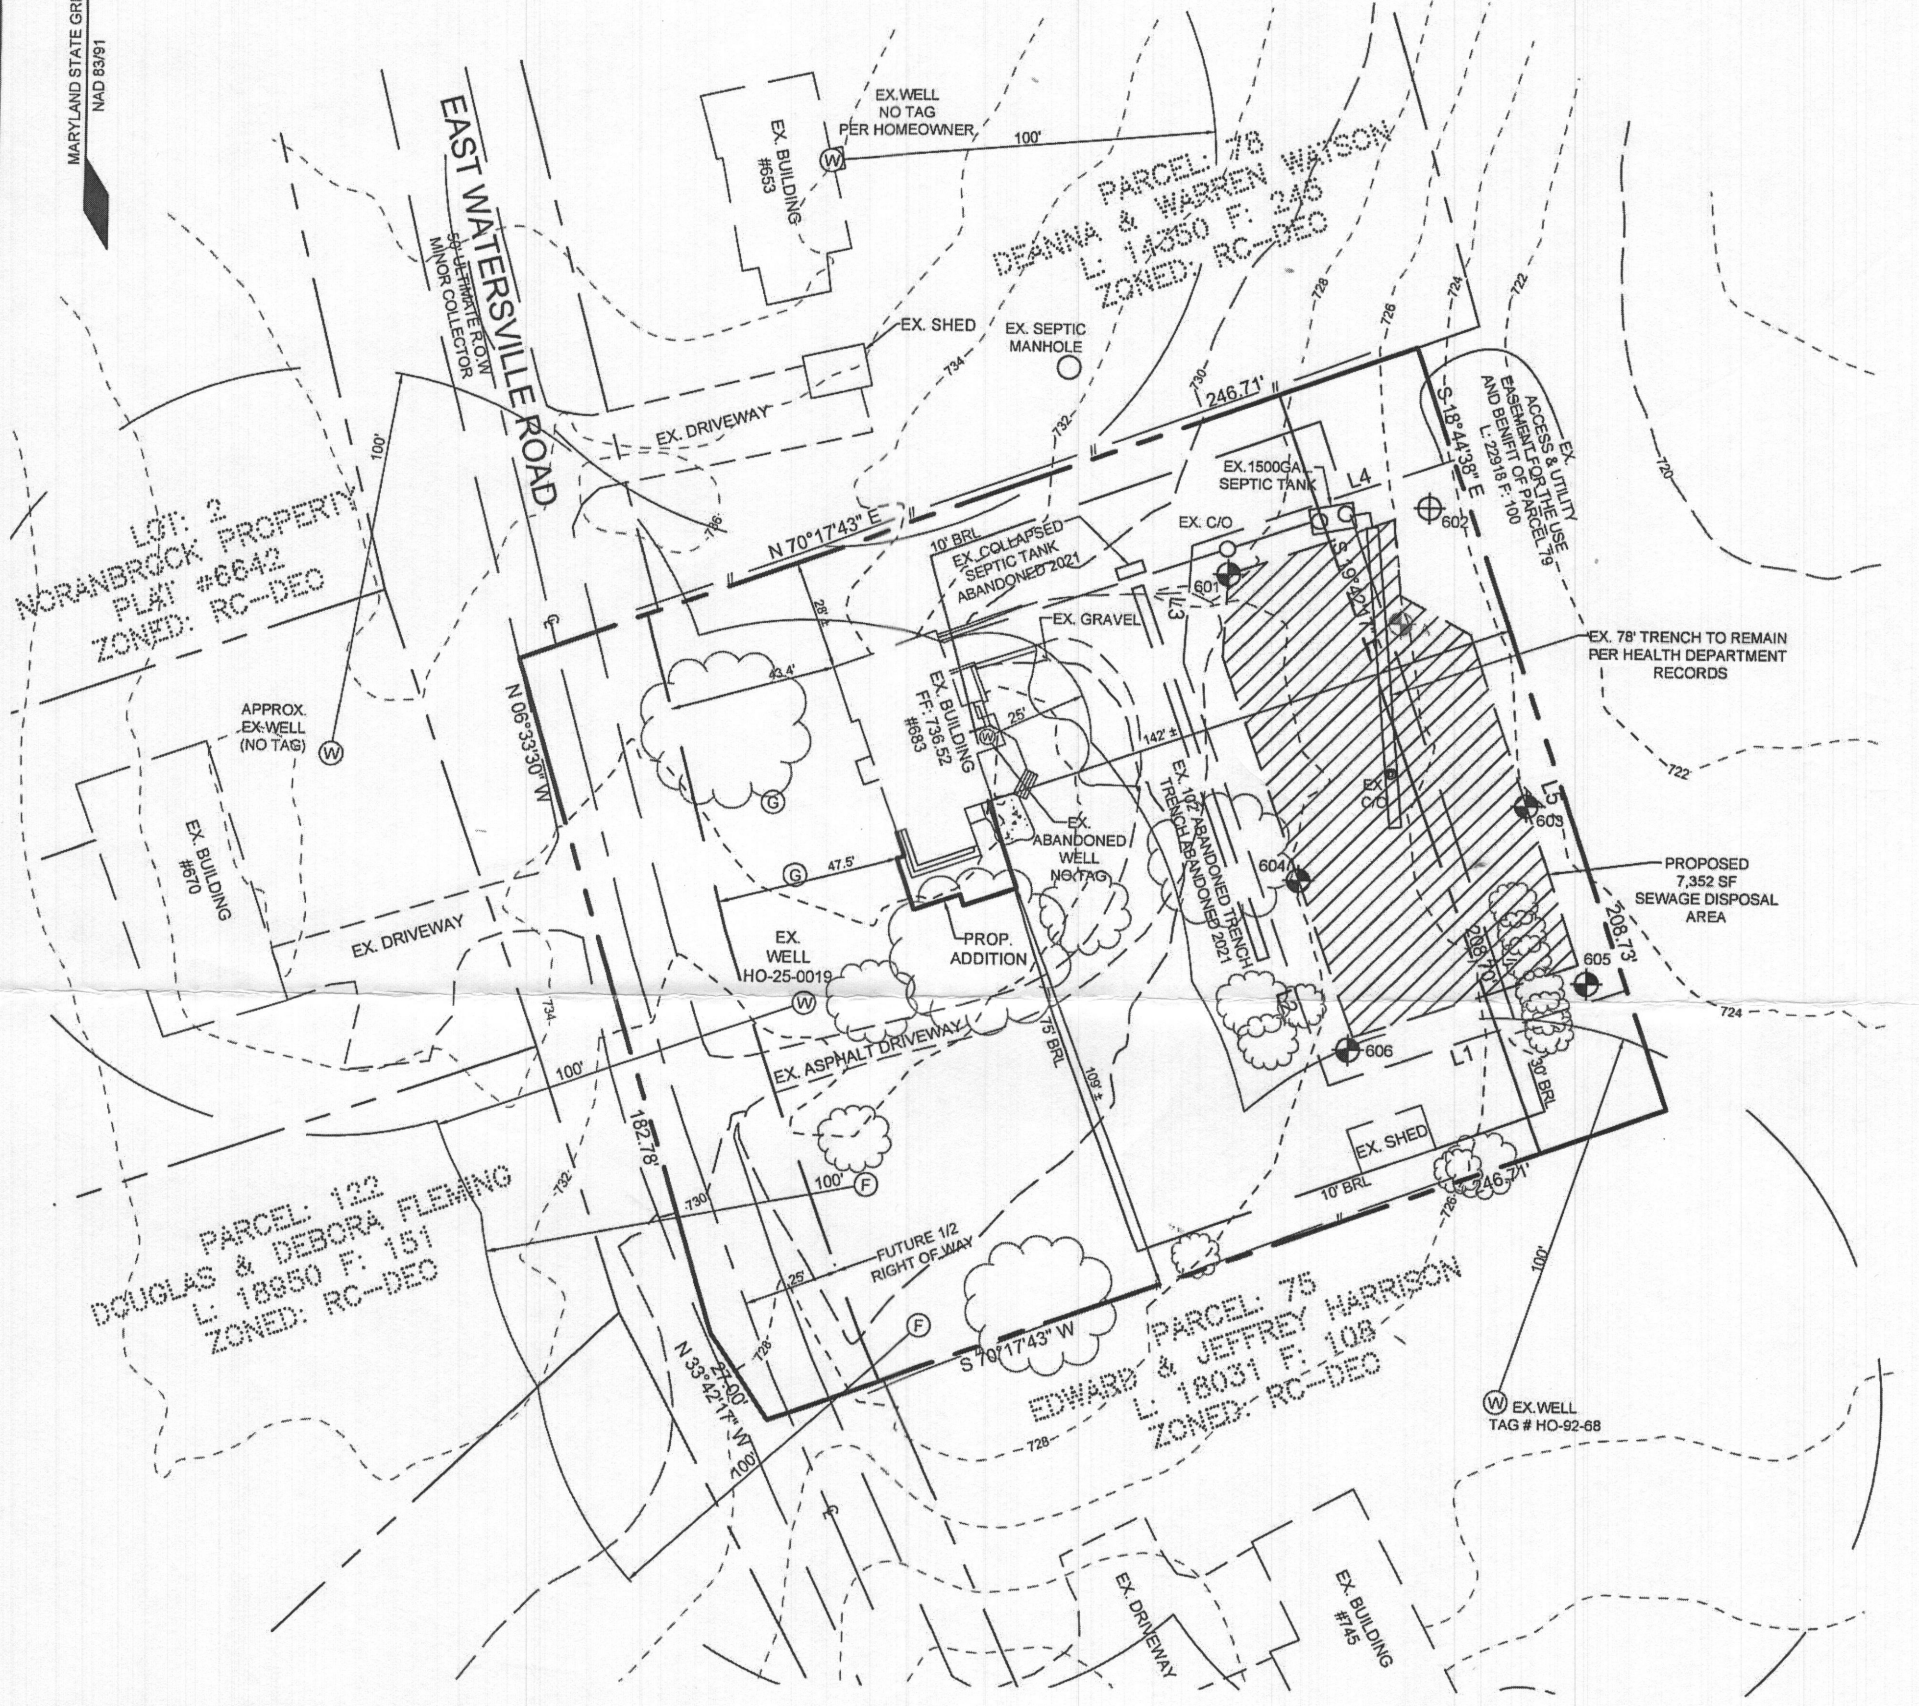

ACCESS & UTILITY EASEMENT LINE TABLE

LINE NUMBER	BEARING & DISTANCE
L1	S 71°15'22" W 81.24'
L2	N 19°40'52" W 116.59'
L3	N 03°43'34" E 30.31'
L4	N 71°15'22" E 71.59'
L5	S 18°44'38" E 208.73'

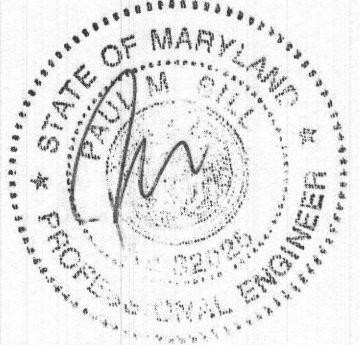

SILL ENGINEERING GROUP, LLC

16005 Frederick Road, 2nd Floor
Woodbine, Maryland 21797
Phone: 443.325.5076
Fax: 410.696.2022
Email: info@sillengineering.com
Civil Engineering & Surveying for Land Development

DESIGN BY: PS
DRAWN BY: ZS
CHECKED BY: PS
SCALE: 1"=50'
DATE: OCTOBER 1, 2025
PROJECT #: 24-088
SHEET #: 1 OF 1

PLOT PLAN
KRAUSZ PROPERTY

683 EAST WATERSVILLE ROAD

TAX MAP 2 GRID 22
5TH ELECTION DISTRICT

PARCEL 79
HOWARD COUNTY, MARYLAND

B25004314
Approved 10/15/25
C.H.O.

2021 IECC CODE COMPLIANCE

R301.1 Climate zone 4A

R401.2 Compliance Method: Mandatory and Prescriptive Provisions

R402.1.1 Vapor Retarder: Wall assemblies in the building thermal envelope shall comply with vapor retarder requirements of Section R702.7 of the International Residential Code, 2021 Edition.

R402.1.3.1 Attic Insulation: R-49, Raised Heel Trusses: R-38

R402.1.3.1 Wood Frame Wall: R-20 or R13 + R5 continuous insulation.

R402.1.3.1 Basement Wall Insulation: R-13/R-10 Foil Faced Continuous, uninterrupted Batts Full Height

R402.1.3.1 Crawl Space Wall Insulation: R-13/R-10 Foil faced Continuous Batts Full Height extending from floor above to finish grade level

R402.1.3.1 Floor Insulation over Unconditioned Space: R-19 batt insulation.

R402.1.3.1 Window U-Value/SHGC .30 (U-Value)/.40 (SHGC)

R402.1.3 Slab on Grade Floors: R-10 continuous insulation extending 4' -0" vertically, or any combination of vertical and horizontal insulation to equal 4'-0"

R402.2.4 Attic Access: Attic access scuttle will be weatherstripped and insulated R-49

R402.4 Air Leakage: Exterior walls and penetrations will be sealed per this section of the 2021 IECC with caulk, gaskets, weatherstripping or an air barrier of suitable material. Sealing methods between dissimilar materials shall allow sealing for differential expansion and contraction.

R402.4.1.2 Testing (Building Thermal Envelope Tightness): Building envelope shall be tested and verified as having an air leakage rate of not exceeding 3 air changes per hour. Testing shall be conducted in accordance with ASTM E779 or ASTM E 1827 with (blower door) at a pressure of 0.2 inches w.g. (50 pascals). Testing shall be conducted by an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the building inspector.

R402.4.2 Fireplaces: New wood burning fireplaces will have light-fitting flue dampers or doors, and outdoor combustion air. Fireplace doors shall be listed and labeled in accordance with UL 127 (factory built fireplace) and UL 907 (masonry fireplace).

R402.4.4 Rooms containing fuel-burning appliances where open combustion air ducts provide combustion air to open combustion fuel burning appliances, the appliances and combustion air shall be located outside the building thermal envelope or enclosed in a room isolated from inside the thermal envelope. Exceptions: 1. Direct vent appliances with both intake and exhaust pipes installed continuous to the outside. 2. Fireplaces and stoves complying with Section R402.4.2 and Section R1006 of the IRC.

R402.4.5 Recessed Lighting: Recessed luminaires installed in the building thermal envelope shall be sealed to limit air leakage between conditioned and unconditioned spaces. All recessed luminaires shall be IC-rated and labeled as having an air leakage rate not more than 2.0 cfm (0.994 L/s) when tested in accordance with ASTM E 283 at a 1.57 psf (75 Pa) pressure differential. All recessed luminaires shall be sealed with a gasket or caulk between the housing and the interior wall or ceiling covering.

R403.1.1 Thermostat: All dwelling units will have at least (1) programmable thermostat for each separate heating and cooling system per 2021 IECC Section 403.1.1.

R403.1.2 Where a Heat pump system having supplementary electric resistance heat is used (except during de frost) the thermostat shall prevent the supplementary heat from coming on when heat pump can meet heating load.

R403.3.1 Ducts Located Outside Conditioned Space: Supply and return ducts outside of conditioned spaces shall be insulated to R-8 minimum, R-6 when less than 3 inches.

R403.3.4 Duct Sealing: All ducts, air handlers, filter boxes will be sealed. Joints and seams will comply with 2021 IRC or 2021 IMC.

R403.3.5 Duct Testing: A duct tightness test shall be performed in accordance with ANSI/ RESNET/ ICC 380 or ASTM E1554 to determine air leakage and shall be verified by either a post construction test or rough-in test. Test not required for ducts serving ventilation systems not integrated with ducts serving heating and cooling systems.

R403.6 Mechanical Ventilation: Outdoor ,make-up, and exhausts air ducts to be provided with automatic or gravity damper that close when the ventilation system is not operating. Ventilation systems shall comply with section M1505 of the 2021 IRC or the 2021 IMC.

R403.6.2 Whole-Dwelling Mechanical Ventilation System Fan Efficacy System shall meet requirements of TABLE R403.6.2.

R403.7 Equipment Sizing shall comply with R403.7.

R404.1 Lighting Equipment: All lights (excluding kitchen appliance lights) must contain high efficacy lighting sources.

R404.1 Interior Lighting Controls: Lighting fixtures shall be controlled with either a dimmer or occupant sensor (not required for bathrooms, hallways, or security lighting).

The contractor also responsible for generating Certificate of Compliance and affixing to electrical panel or within 6 feet of the electrical panel and be readily visible.

GENERAL NOTES

All work shall comply to all applicable local codes.

All construction shall be classified as and comply to either of the following:
-- Use Group R-4 under the 2021 International Residential Code & Howard County Code

All work shall comply to International Energy Conservation Code, 2021 edit.
SEE IECC CODE COMPLIANCE notes

These plans and notes are the property and sole responsibility of JRArchitecture, LLC. Use of these plans without the written consent of JRArchitecture, LLC. is prohibited.

These plans are subject to modification as necessary to meet code requirements and or facilitate mechanical/plumbing installations or to incorporate design improvements. The Architect and the Owner reserves the right to make any changes, for any reason, at any time, providing they comply with the code.

The Sub-Contractor shall compare and coordinate all drawings. When a discrepancy or an error or omission exists, he shall comply with the code and contact the Architect and the Owner in writing for proper adjustment.

These plans are not to be scaled for Construction purposes. Written dimensions and notes supersede all scaled reference.

In the event certain features of Construction are not fully shown on the drawings, their construction shall be of the same character as for similar conditions that are shown or noted.

Integral garages in dwelling units shall be separated from all adjacent living space with fire separation as required by local code.

Field verify ALL dimensions

GENERAL FRAMING NOTES

Double all floor joists under walls above, that are framed parallel to floor framing unless noted otherwise on the plans.

Provide solid 2x10 blocking to be located between floor joists where posts, from above, carrying structural headers land between floor joist below. blocking to be built up to the same width as post it is carrying above.

Provide adequate clearance @ plumbing stacks as req.

All dimensions must be verified in the field by the contractor before start of construction. any discrepancies on the plans, or specifications, must be reported to the architect or engineer prior to the start of construction.

Any variation from these plans that will require changes to the structural members shall be brought to the attention of the architect immediately.

DESIGN CRITERIA

CLIMATE AND GEOGRAPHIC DESIGN CRITERIA - table 301.2 (1)

GROUND SNOW LOAD (lbs./s.f.)	40	
DESIGN WIND SPEED	115 m.p.h.	
SEISMIC CONDITION BY ZONE	A	
SUBJECT TO DAMAGE	WEATHERING	SEVERE
	FROST LINE DEPTH	30
	TERMITE	MODERATE to HEAVY
	DECAY	MODERATE
WINTER DESIGN TEMP. FOR HEAT. FACILITIES	20°	
RADON RESISTANT CONSTRUCTION REQ		
FLOOD ZONE		

ITEMS OF PARTICULAR NOTE

Contractor, sub-contractor or supplier shall verify all job conditions and measurements prior to commencing work or ordering materials. Discrepancies between dimensions shown on drawings and actual field conditions should be brought to the Architect and Owner's attention immediately for clarification prior to proceeding with work. These plans are not to be scaled for Construction purposes. Written dimensions and notes supersede all scaled reference. If there are any conflicts, discrepancies or ambiguity with dimensioning the Contractor shall notify the Architect immediately for clarification. Field verify ALL proposed dimensions

As a matter of record, JRArchitecture, LLC shall not be responsible for construction means and methods or omissions by the contractor, sub-contractor or any other persons performing work in accordance with these drawings.

On this Project, the Contractor shall have sole supervision over, and exclusive responsibility for: demolition and temporary construction; construction means, methods, techniques, sequences, procedures, safety precautions and safety programs in connection with all demolition and construction work; and protection of persons and property during construction until final completion is attained. Services performed by Architect or its consultants during construction, if any, are intended to promote the goal that, in general, the construction work, when fully completed, will be consistent with the design intent reflected in the permit or construction drawings. Means and methods responsibility always shall be the exclusive responsibility of the Contractor and Contractor shall separately engage specialty engineers or other consultants as required to fulfill this responsibility.

DRAWING LIST

0.01	COVER SHEET
0.02	GENERAL INFO
0.03	MARYLAND INFO
0.04	SIMPLIFIED PLANS
0.51	DEMOLITION PLANS
1.01	ELEVATIONS
2.01	FOUNDATION
2.02	FOUNDATION SHELF DETAIL
3.01	FIRST FLOOR PLAN
3.02	FRAMING DETAILS
3.51	BRACING - DETAILS
4.01	ROOF PLAN
5.01	SECTIONS

AREA INFO

FLOOR	SQUARE FOOTAGE
FIRST FLOOR	593 s.f.
BASEMENT	452 s.f.

CODE INFORMATION

2021 International Residential Code
2021 Existing Building Code
2021 Energy Conservation Code
2021 National Fuel Gas Code
2021 International Plumbing Code
2021 International Mechanical Code
2023 National Electrical Code
2021 NFPA 101 Life Safety Code

DESIGN - LIVE LOADS

RECOMMENDED MINIMUMS:

- Ground Snow Load 40 psf
- Roof Live Load 30 psf
- Sleeping Floors 30 psf
- Living Floors 40 psf
- Exterior Decks 40 psf
- Stairs 40 psf
- Garage Slabs 40 psf
- Wind Load 18 psf
- Guardrails 200' at any point in any direction.

(or as per local code)



02/04/2025
Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 41431, Expiration Date: 01-05-2028



PROFESSIONAL CERTIFICATION
I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14478, Expiration Date: 6/30/2026

WARNING:
THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.
Copyright © 2025
Jonathan Rivera Architect
All Rights Reserved

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE

683 Watersville Road,
Mt. Airy, Maryland 21771

ARCHITECT
Jonathan Rivera AIA, NCARB
Howard County, Maryland

443.226.5745
jrvera@jonathanrivera.com

STRUCTURAL ENGINEER
Naylor Structural Engineering
Greg Naylor
Ellicott City, Maryland

410-952-4797
greg@naylorstructural.com

BUILDER

ISSUE DATE

1	12-03-24	PERMIT SET
2	2-4-25	PERMIT SET
3		
4		
5		
6		
7		
8		
9		
10		

SCALE:

INFO SHEET
0.01
PRINT DATE:
Tuesday, February 4, 2025

MASONRY

- Maximum vertical distance of unbalanced fill measured from the top of the lower level slab to outside finished grade shall not exceed the following, for unreinforced walls where unstable soil or ground water conditions do not exist.

Type of Wall	Height of Fill
8" C.M.U.	4'-0"
12" C.M.U. (hollow)	6'-0"
12" C.M.U. (solid)	7'-0"
8" Poured Concrete	7'-0"
10" Poured Concrete	8'-0"

- Masonry veneer shall be installed over 15# felt or approved water repellent sheathing. Through-wall flashing and weeps shall be provided at any location where interior space projects beyond the face of the veneer, i.e. bay windows, Off-set chimneys, etc..

- Masonry veneer shall be attached and anchored in accordance with the local code requirements.

- Walls over 7'-0" or on unstable soil shall be engineered and certified by a registered professional engineer.

- Concrete masonry units shall meet ASTM C-90 Grade A solid block or ASTM C-145 Grade B Standards and be 28 DAYS OLD before installation. Minimum net compression strength of block to be 2000 psi.

- Parging over CMU walls to be not less than 3/8" Portland cement parging from footing to finished grade. Parging and poured concrete walls shall be covered with a coat of approved bituminous material applied at the recommended rate below grade.

- MASONRY LINTELS: Provide lightweight pre-cast lintels for all openings and recesses in CMU walls. Provide (1) 4x8 lintel for each 4" of wall thickness. Reinforce each lintel with two #4 bars at top and bottom and with #2 ties spaced 9" O.C., unless noted otherwise. Precast lintel to have minimum 8" bearing at each end. Such lintels shall not support any superimposed loads.

- Use Type "M" mortar for masonry below grade in contact with earth.

- Use Type "S" mortar for exterior above-grade load bearing and non-load bearing walls, and for other applications where another type is not indicated.

- Galvanized metal brick veneer ties shall be installed 16" o.c. each way.

- Steel lintels for all opening and recesses in brick or Brick Faced Masonry wall not specifically detailed: Provide (1) steel angle for each 4" of wall thickness. Steel angles to have minimum 6" bearing at each end. Horizontal leg shall be 3 1/2", unless noted otherwise.

LINTEL SCHEDULE (UNLESS NOTED OTHERWISE ON PLANS):

L-1	3 1/2"x3-1/2"x5/16"	steel angle	up to 3' opp.
L-2	4"x 3-1/2"x5/16"	steel angle	3' to 5' opp.
L-3	5"x 3-1/2"x3/8"	steel angle	5' to 6'-6" opp.
L-4	6"x3-1/2"x1/2"	steel angle	up to 9' opp.
L-5	6"x 4"x5/8"	steel angle	up to 10'-0"
L-6	8" OR 9"x4"x9/16"	steel angle	16' garage

- Lintels shown shall not support any superimposed loads.

- All steel angles in masonry walls are to be flashed and painted.

- Paint all exterior ferrous or galvanized metals EXCEPT completely pre-finished factory items.

- All work shall comply to local code.

STAIR CRITERIA

- INTERIOR and EXTERIOR STAIRS

- All stairs shall comply with all local codes.

- Minimum finish width: 36"
- Minimum finished headroom height: 6'-8"
- Maximum riser height: 7 3/4"
- Minimum tread depth: 11"
- Maximum space between balusters: 4"
- Handrail height shall not be less than 34" or greater than 38" and may not project more than 3 1/2" into stair width.

- Provide a minimum of 1 1/2" space between handrail and wall.

- Stair winder shall have a minimum inside width of 6" and a minimum of a 9" tread when measured 12" from inside corner.

- Stair landings shall be a minimum of 36" x 36"

- Stairways with 3 or more risers are required to have a handrail.

WOOD

- Wall bracing shall be installed as per local code.

- All roof trusses and floor systems shall be engineered by others.

- All roof trusses and floor systems shall be braced and installed per manufacturer's specifications and as per local code. See manufacturer's plans for exact layout and construction.

- All trusses are stamped and certified by a registered engineer and meet TPI manufacturer's minimum requirement.

- See drawings for type of floor construction.

- Tongue and groove floor decking glued and nailed on (SPF #2) 2x8 or 2x10 or 2x12 floor joists at 16" o.c. maximum to meet the American Plywood Association Sturd-i-Floor system.

- Tongue and groove floor decking glued and nailed on pre-engineered wood joists/trusses at 24" o.c. maximum to meet the American Plywood Association Sturd-i-Floor system.

- Fire-stopping shall be provided to cut-off concealed draft openings and to form an effective fire barrier between stories as per local code.

- Structural sawn lumber shall be SPF #2 or better

- All exterior walls are 2x6 stud #16" centers, minimum SPF stud grade unless otherwise noted.

- All interior walls are 2x4 stud #16" centers, minimum SPF stud grade unless otherwise noted.

- All opening headers to be 3-2x10's unless noted otherwise

- Joist hangers to be installed as required.

- All wood less than 8" from grade shall be pressure treated. All sole plates on slabs shall be pressure treated.

- Provide bearing at all structural members as required by local code.

- All materials shall be installed per manufacturer's specifications and as per applicable building codes.

- All laminated veneer lumber (LVL) beams, girders and headers labeled on the plans, to have a Fb rating of 2,950 and modulus of elasticity of 2,000,000 min. unless otherwise noted. Structural laminated beams to be installed as per manufacturer specifications.

- Where applicable, refer to engineered lumber manufacturer specifications for multi-member installation & connection requirements.

- Fasten multiple jacks together w/ min. 10d nails @ 6" o.c. staggered both sides along the entire length of members. Provide nailing within 3.5" of top or bottom of members.

- Fasten multiple member beams together w/ min. 16d nails @ 12" o.c. staggered along the entire length of members. Two rows required for depths up to 12". Three rows required for depths of 12-18". Provide nailing within 22" of each end of members. For beams 7" or greater in width provide bolted connection w/ ASTM Grade A-307 (or better) 1/2" dia. bolts in two rows 3" from each end of beam @ 24" o.c. staggered.

- All work shall comply to local code.

CONCRETE

- Concrete works shall conform to American Concrete Institute Standard 318-19

- Bottom of all footings shall be located a minimum of 30", (or as per local code) below finished grade. Steps or depth of footing / foundation may vary according to local site or frost conditions.

- All interior concrete slabs shall have 6"x6"-W1.4x1.4 W.W.M. or control joints. Monolithic turned down slabs for townhouses shall have a control joint between units.

- Concrete used in exposed areas implicit to freezing and thawing (both during construction and service life) shall be air-entrained in accordance with local code. Exterior flat-work shall be coated with an approved curing compound.

- Foundation walls of habitable rooms located below grade shall be dampproofed or water proofed using materials and methods approved by local building jurisdiction.

Type of Concrete Construction	Minimum Specified Compressive Strength
- Footings	2500 PSI
- Interior Basement Slabs	2500 PSI
- Foundation Walls	3000 PSI
- Garage and Exterior Slabs	3500 PSI
- Rat Slabs	2500 PSI

(or as per local code)

- Deformed reinforcing bars: ASTM A-615 Grade 60 and A-305 Mesh: 6x6-W1.4x1.4 WWF ASTM A-185. Reinforcing in footings is required where variations in soil conditions may exist.

- All interior slabs of 30 FEET or more in any dimension shall have WWF, Control Joints, or Fiber Reinforcement.

- Vapor barrier under all slabs EXCEPT garages: 6 Mil Polyethylene. Lap all edges 6". Lay over 4" Gravel bed.

- Exterior Concrete Slabs: 5% to 7% Air Entrained and shall have a minimum 28 Day Compressive Strength of 2500 psi - unless noted otherwise.

- All work shall comply to local code.

WEATHER/THERMAL

- Insulation for slab on grade construction shall begin at the inside intersection of the slab and the foundation wall and shall extend for a minimum distance of 24" down the inside face of the foundation wall and horizontally 24" under the slab. For unheated slabs a material with an R-value of 42 is required; for heated slabs an R-value of 63 is required (or as per local code)

- Sill Sealer-compressible material shall be installed under all mud plates (foundation wall and wood floor systems) and sole plates (slab on grade)

R-Value	Thickness	Location
R-11 FS25	3 1/2"	Basement Walls
R-21	8 1/2"	2x6 Walls (exterior)
R-38	9"	Crawl Space
R-38	1"	Floors exposed to unheated condition
R-49 Batt.	12"	Roof
R-49 Blown	1"	Apply blown insulation as required by manufacturer's specifications

- Provide vents as per local code.

- Flashing: Prefinished aluminum or equal, at all roof offsets, chimneys, roof openings, hips, valleys, ridges, dormers and where roof intersects wall.

- Contractor shall maintain in all circumstances proper fire, sound and insulation ratings when penetrating through walls, floors, ceilings and roofs.

- All miscellaneous penetrations during construction shall be patched and repaired according to manufacturer's specifications and as per code.

- All exterior joints between windows, doors and other surfaces shall be caulked and sealed appropriately.

- DAMPPROOFING: Apply (1) coat of asphalt emulsion to exterior of all below grade walls at basement conditions. When habitable space occurs below grade, provide waterproofing membrane, aqueous based elastomeric, vinyl acrylic mastic, 35 Mil. min. thickness or other approved equal.

- SLAB VAPOR BARRIER: 6 Mil. polyethylene sheet where noted on drawings. Overlay all edges 6".

- SILL SEALER: 1/2" x 5 1/8" compressible fiberglass beneath all exterior sill plates or other approved sill sealer.

- Provide approved corrosion-resistive flashing at the intersections of masonry and wood frame construction; over projecting wood trim; where decks, porches etc. attach to wood frame construction; at wall and roof intersection; at chimney and roof intersections; in roof valleys; at all roof penetrations; and at wall openings if recommended by window and door manufacturers.

- Slab perimeters exposed to outside or within 30" of grade; 4.5x24", either vertical or horizontal from slab intersection.

- ROOFING: unless noted otherwise, roofing shall be min 200# Class "C" Fiberglass based asphalt shingles over 15 pound felt. Eave flashing to a point 24" inside of interior face of wall line may be also installed at the owner discretion.

- WALL SHEATHING: As shown on drawings and installed in accordance with MANUFACTURER'S RECOMMENDATIONS.

- GUTTERS AND LEADERS: .032" Prefinished aluminum gutters with .024" prefinished aluminum leaders. Lead to splashblocks or collector as required.

MECH. PLUMB. ELEC.

- Mechanical contractor is responsible for the design and installation of mechanical systems including duct sizes, trunk and register size for air conditioning and heating. Systems shall be installed per manufacturer's specifications and recommendations and as per all applicable building codes.

- Plumbing contractor is responsible for the design and installation of plumbing and piping. All plumbing, piping and fixtures shall be installed per manufacturer's specifications and recommendations and as per all applicable codes.

- Electrical contractor is responsible for the design and installation of all electrical systems. All electrical work shall meet the requirements of the National Electric Code, the local power company and all applicable codes. Fixtures and apparatus are selected by the builder and shall be UL approved.

- Smoke & Carbon Monoxide detectors - Provide a minimum of one ceiling mounted fixture per floor, hard wired to a nearby circuit and interconnected for simultaneous activation with battery backup. Provide detectors at each sleeping room if required by local code. Provide detectors outside each sleeping area within 10'-0" of each door.

- Fire suppression systems shall be installed as per local building code.

- All work shall comply to local code.

SITework

- GENERAL: These drawings do not cover sitework, grading or landscaping

- Building foundations have been designed based on an assumed soil bearing capacity of 1500 PSF. Additional engineering is required if soil bearing capacity is less than 1500 PSF.

- Provide continuous perimeter foundation drainage in accordance with local code requirements. Where both interior and exterior drains are required, provide minimum 1 1/2" dia. bleeder pipes through mid line of footing at max 8" o.c. Typically, drains shall lead to sump pits or to positive daylight discharge points.

- Slope all stoops, porches, walks and garage slabs away from building 1/8" minimum per foot.

- All work shall comply to local code.

DOORS and WINDOWS

- Provide safety glazing as required by local code.

- Garage door into dwelling shall be fire rated minimum 45 minute or as per local building code. The threshold of the door opening between the garage and the adjacent interior space shall not be less than 4" above the garage door. (or as per local code)

- All doors and windows shall be installed in accordance with manufacturer's specifications, and as per local code.

STRUCTURAL STEEL

- All materials and workmanship shall comply with the requirements of the following codes and standards:

- "Steel Construction Manual", Fourteenth Edition, 2011, American Institutes of Steel Construction (including specifications for structural steel buildings, specifications for structural joints using ASTM A325 or A490 bolts, and AISC code of standard practice)

- "Detailing for steel construction", American Institutes of Steel Construction

- "Structural welding code ANSI/AWSd D.1", American Welding Society

Channels, angles, & plates:

Wide flange shapes:

Structural tubing (rect):

Structural pipe:

High-strength bolts:

Anchor rods:

Nuts:

Washers:

Plate washers:

Threaded rod:

Headed shear studs:

Welding electrodes:

Nonshrink grout:

Expansion bolts:

Adhesive anchors:



PROFESSIONAL CERTIFICATION
I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14678 Expiration Date: 6/30/2026

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.
Copyright © 2025 Jonathan Rivera Architect All Rights Reserved

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE

683 Watersville Road, Mt. Airy, Maryland 21771

ARCHITECT
Jonathan Rivera AIA, NCARB
Howard County, Maryland

443.226.5745
jrvera@jonathanrivera.com

STRUCTURAL ENGINEER
Naylor Structural Engineering
Greg Naylor
Ellicott City, Maryland

410-952-4797
greg@naylorstructural.com

BUILDER

ISSUE DATE

1 12-03-24 PERMIT SET

2 2-4-25 PERMIT SET

3

4

5

6

7

8

9

SCALE:

GENERAL INFO

0.02

PRINT DATE :
Tuesday, February 4, 2025

PROFESSIONAL CERTIFICATION
 I certify that these documents
 were prepared or approved
 by me, and that I am a duly
 licensed professional
 architect under the laws of the
 State of Maryland.
 License Number #14678
 Expiration Date: 6/30/2026

WARNING:
 THIS DOCUMENT IS AN INSTRUMENT OF
 PROFESSIONAL SERVICE PREPARED BY JONATHAN
 RIVERA ARCHITECT. AUTHORIZATION OF THIS
 DOCUMENT BY ANY PARTY OTHER THAN JONATHAN
 RIVERA ARCHITECT IS A VIOLATION OF LAW THAT
 WILL BE PROSECUTED TO THE FULLEST EXTENT.
 Copyright © 2025
 Jonathan Rivera Architect
 All Rights Reserved

**PROPOSED
 ADDITION**

**KRAUSZ-WATSON
 RESIDENCE**
 683 Watersville Road,
 Mt. Airy, Maryland 21771

ARCHITECT
 Jonathan Rivera AIA, NCARB
 Howard County, Maryland

443.226.5745
 jrivera@jonathanrivera.com

STRUCTURAL ENGINEER
 Naylor Structural Engineering
 Greg Naylor
 Ellicott City, Maryland

410-952-4797
 greg@naylorstructural.com

BUILDER

ISSUE DATE


1	12-03-24	PERMIT SET
2	2-4-25	PERMIT SET

SCALE: NTS


SIMPLIFIED PLANS

0.04


PRINT DATE:
 Tuesday, February 4, 2025

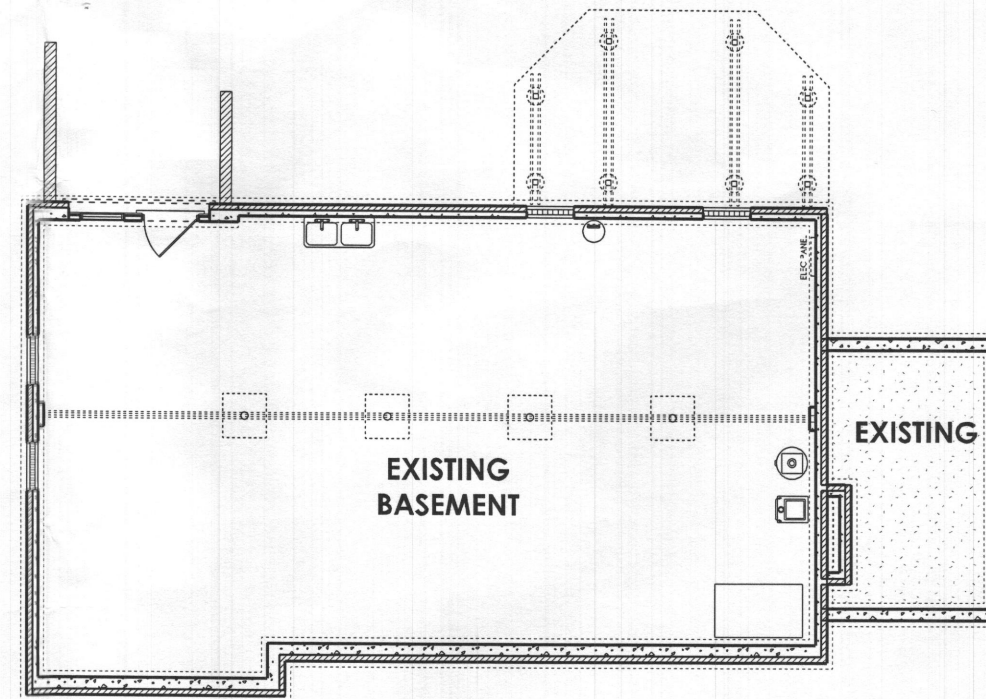


EXISTING FOUNDATION

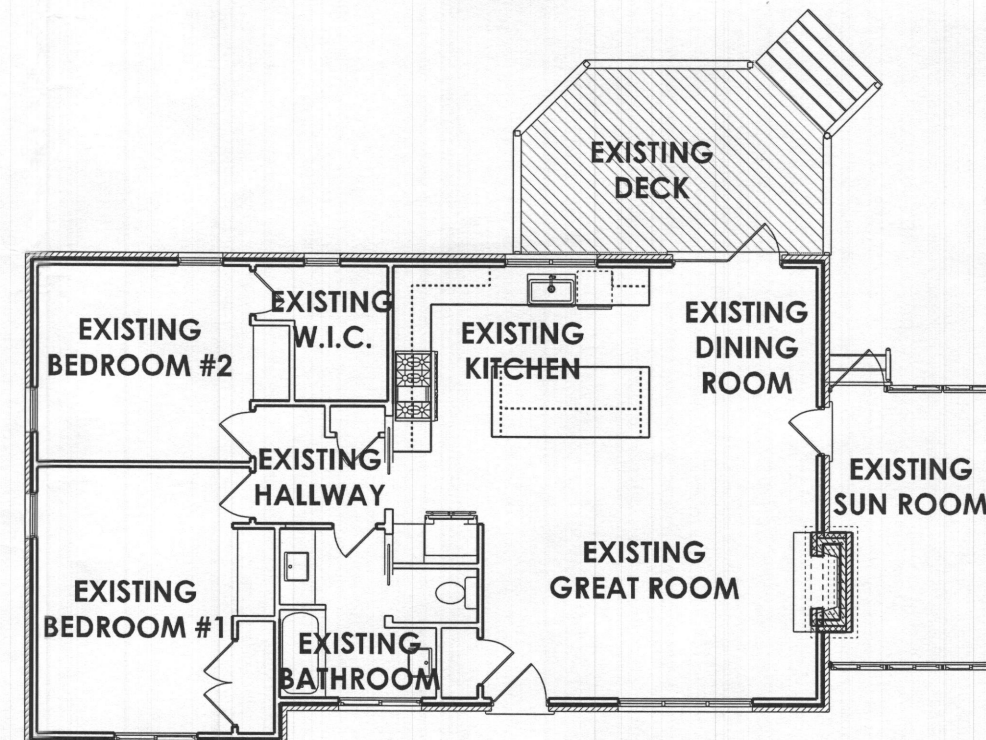

EXISTING FIRST FLOOR

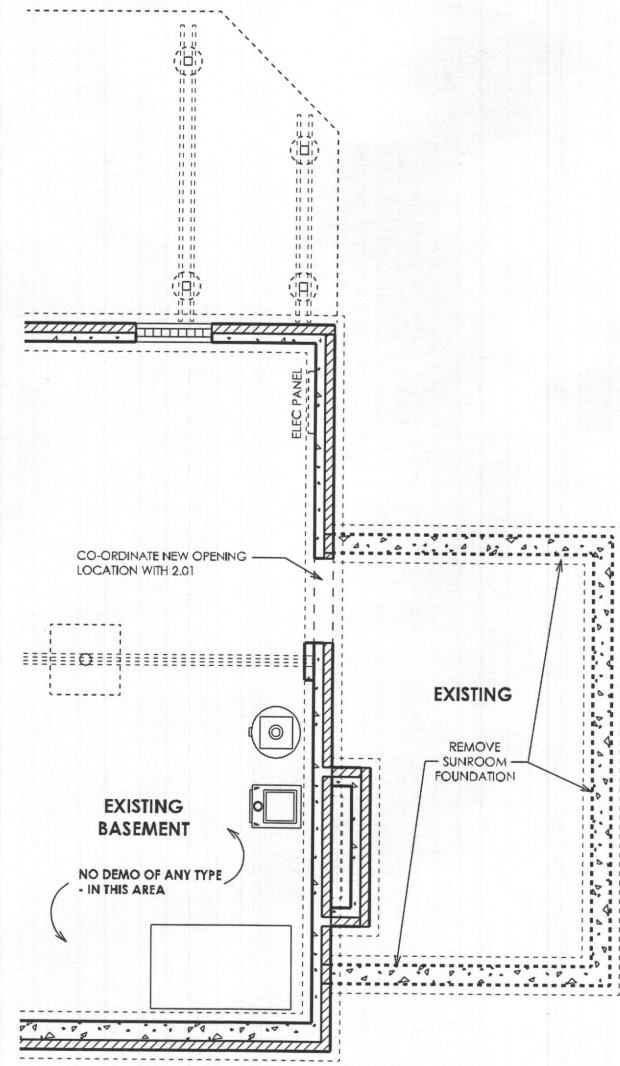

FOUNDATION DEMO

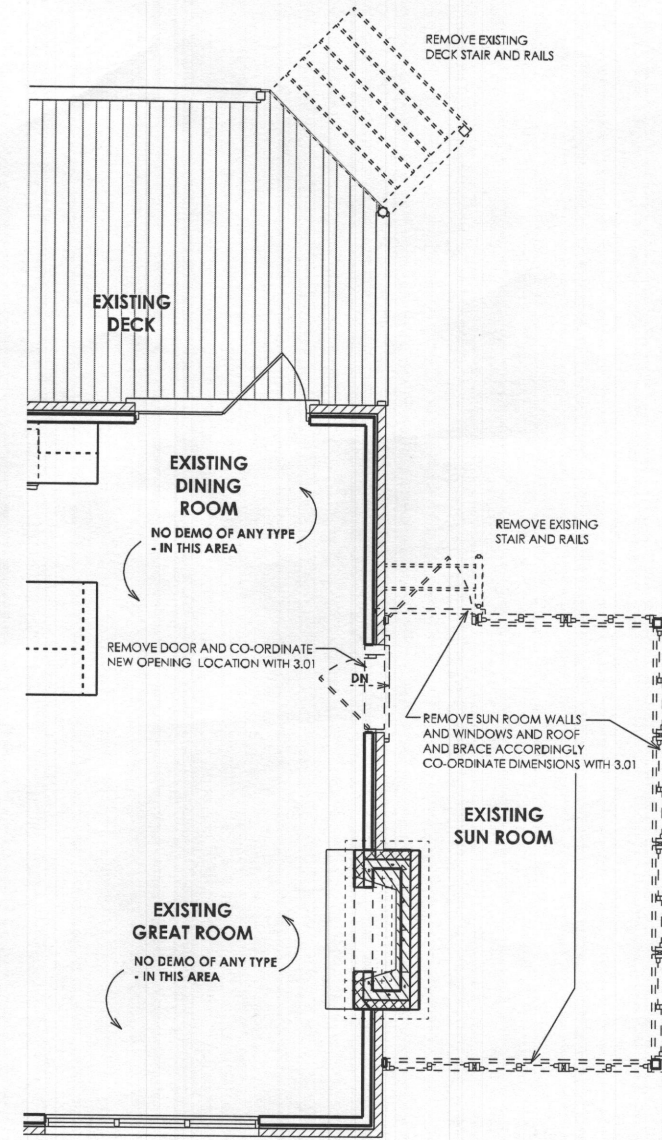

FIRST FLOOR DEMO

PROFESSIONAL CERTIFICATION
 I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland.
 License Number #14678
 Expiration Date: 6/30/2026

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.
 Copyright © 2025
 Jonathan Rivera Architect
 All Rights Reserved

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE

683 Watersville Road,
 Mt. Airy, Maryland 21771

ARCHITECT
 Jonathan Rivera AIA, NCARB
 Howard County, Maryland

443.226.5745
 jrvera@jonathanrivera.com

STRUCTURAL ENGINEER
 Naylor Structural Engineering
 Greg Naylor
 Ellicott City, Maryland

410-952-4797
 greg@naylorstructural.com

BUILDER

ISSUE DATE

1 12-03-24 PERMIT SET

2 2-4-25 PERMIT SET

△

△

△

△

△

△

△

SCALE: 1/4" = 1'-0"

DEMO

0.51

PRINT DATE:
 Tuesday, February 4, 2025

W

PROFESSIONAL CERTIFICATION
 I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland.
 License Number #14678
 Expiration Date: 6/30/2026

WARNING:
 THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.
 Copyright © 2025
 Jonathan Rivera Architect
 All Rights Reserved

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE
 683 Watersville Road,
 Mt. Airy, Maryland 21771

ARCHITECT
 Jonathan Rivera AIA, NCARB
 Howard County, Maryland

443.226.5745
 jrivera@jonathanrivera.com

STRUCTURAL ENGINEER
 Naylor Structural Engineering
 Greg Naylor
 Ellicott City, Maryland

410-952-4797
 greg@naylorstructural.com

BUILDER

ISSUE DATE


1	12-03-24	PERMIT SET
2	2-4-25	PERMIT SET

SCALE: 1/4" = 1'-0"

ELEVATIONS

1.01

PRINT DATE:
 Tuesday, February 4, 2025

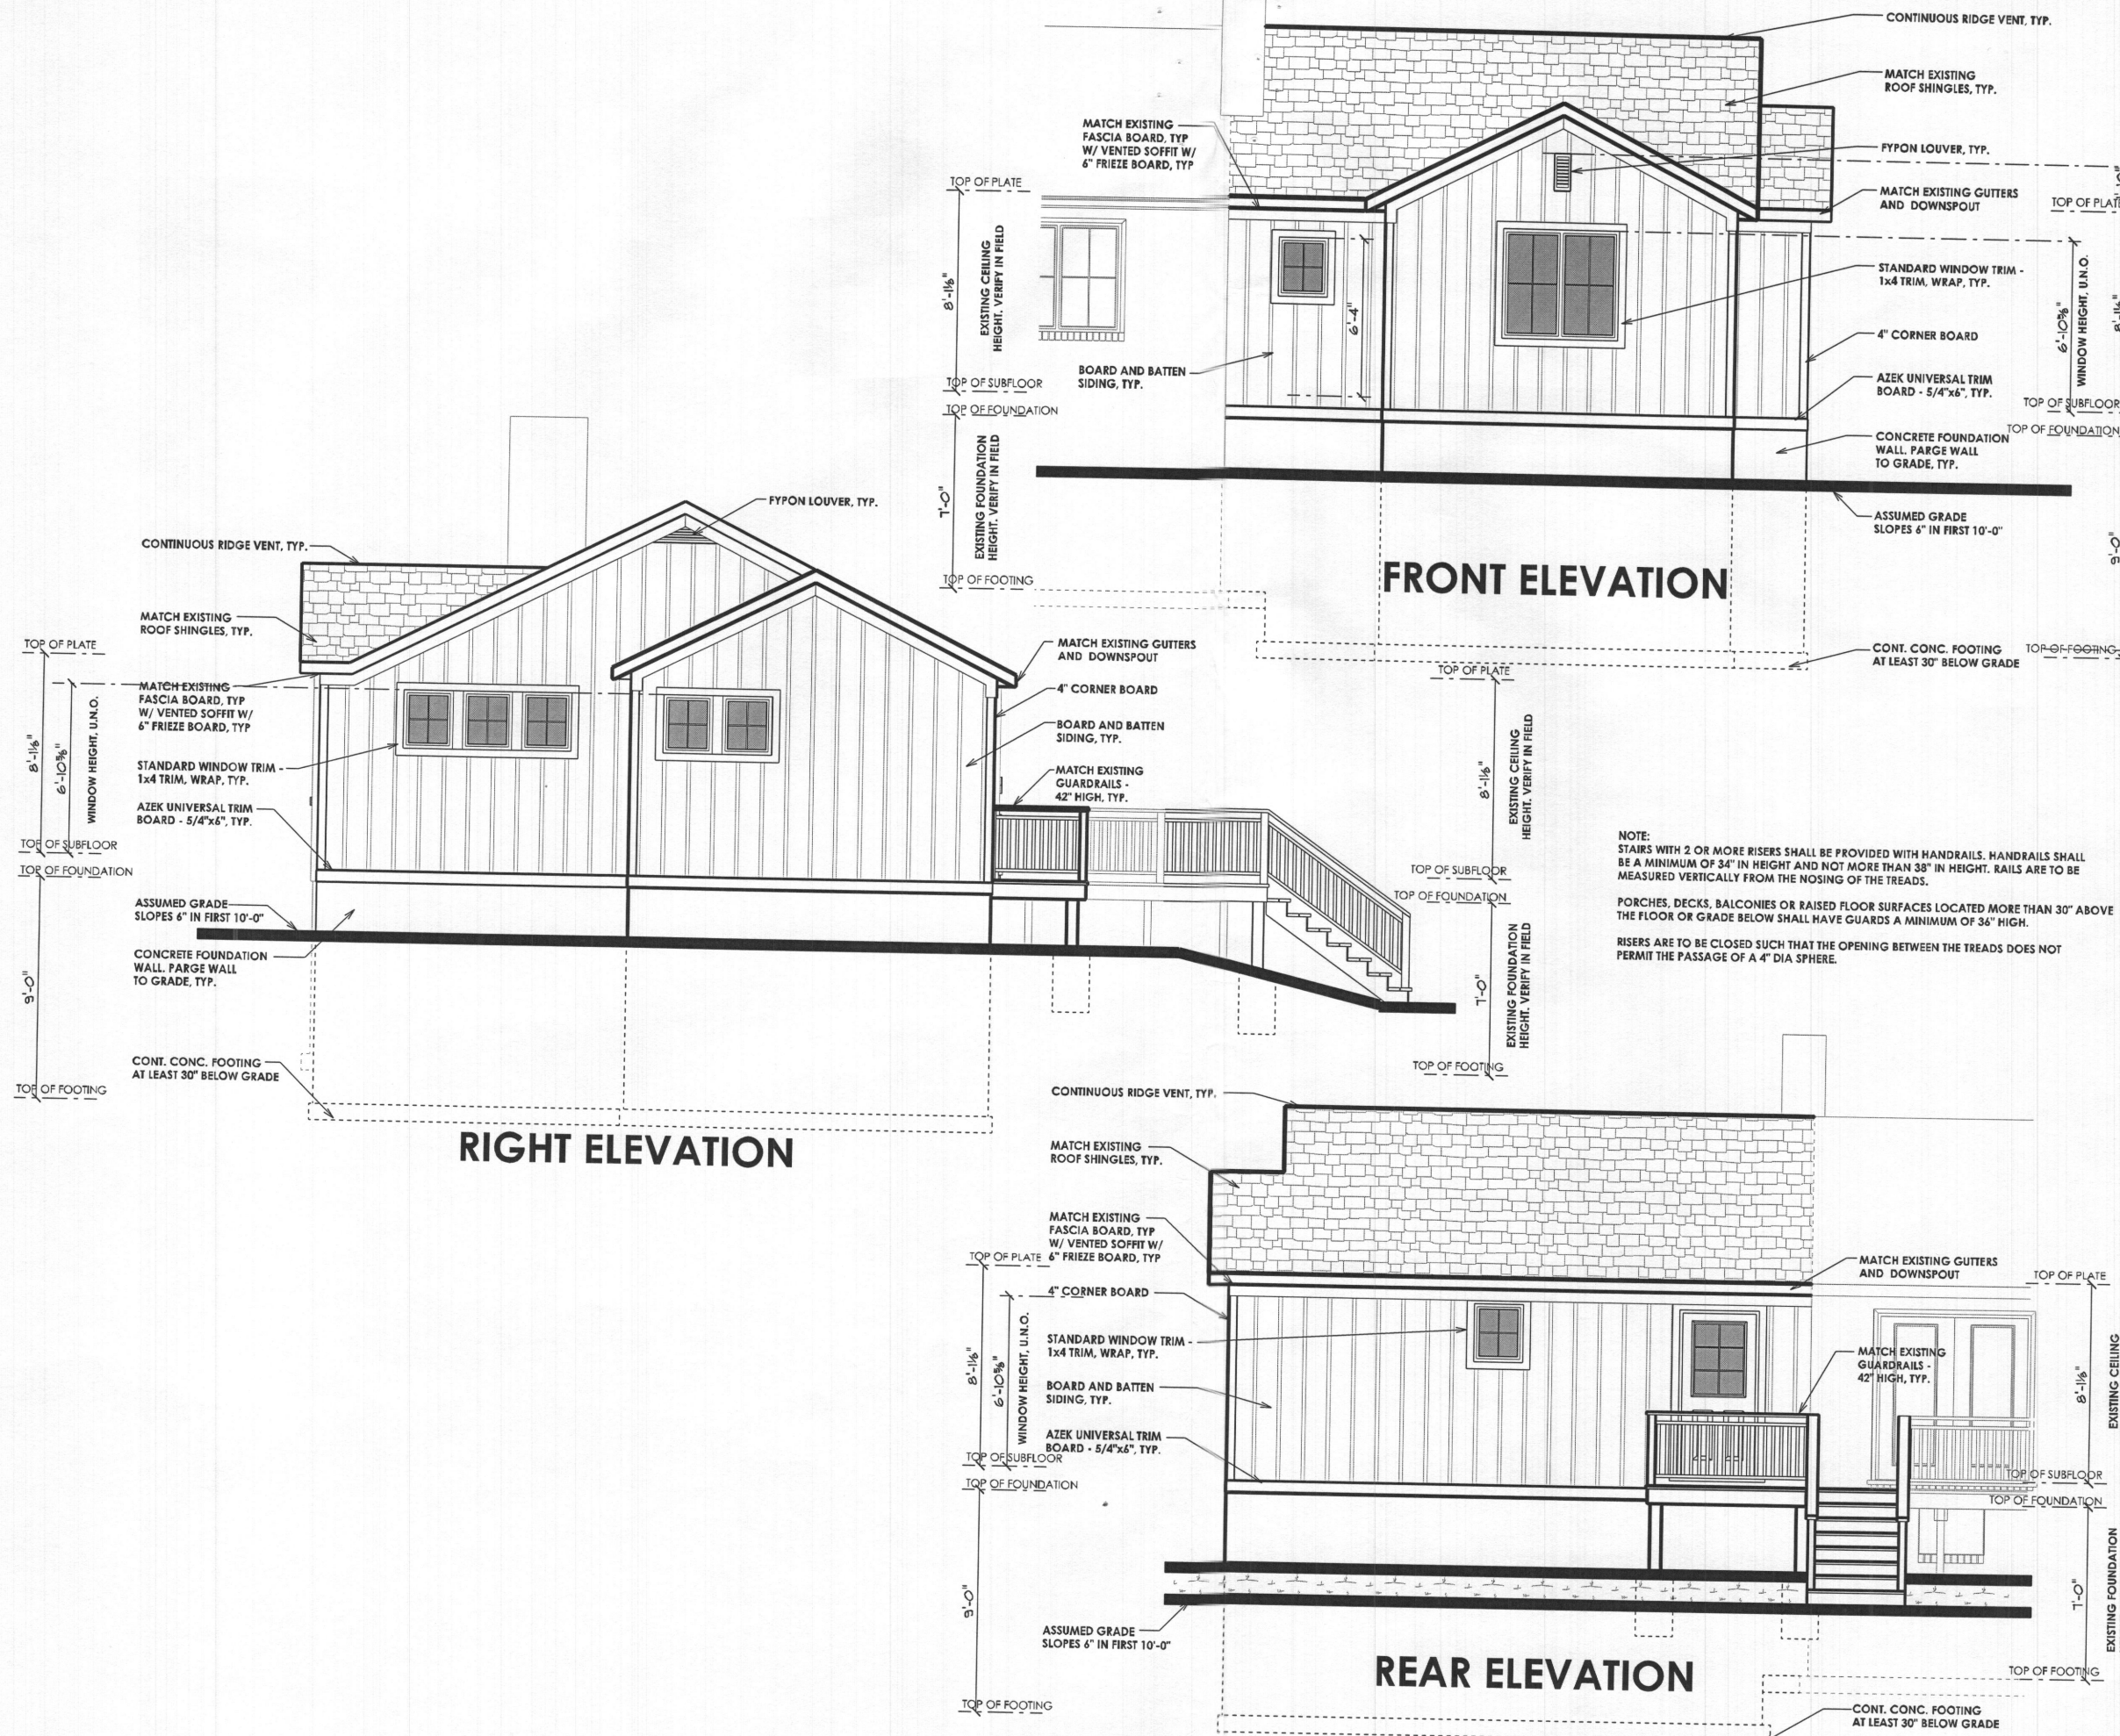

PROFESSIONAL CERTIFICATION
 I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland.
 License Number #14678
 Expiration Date: 6/30/2026

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALIENATION OF THE DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.

Copyright © 2025
 Jonathan Rivera Architect
 All Rights Reserved

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE

683 Watersville Road,
 Mt. Airy, Maryland 21771


ARCHITECT
 Jonathan Rivera AIA, NCARB
 Howard County, Maryland

443.226.5745
 jrivera@jonathanrivera.com


STRUCTURAL ENGINEER
 Naylor Structural Engineering
 Greg Naylor
 Ellicott City, Maryland

410-952-4797
 greg@naylorstructural.com

BUILDER



Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 41431, Expiration Date: 02-04-2025

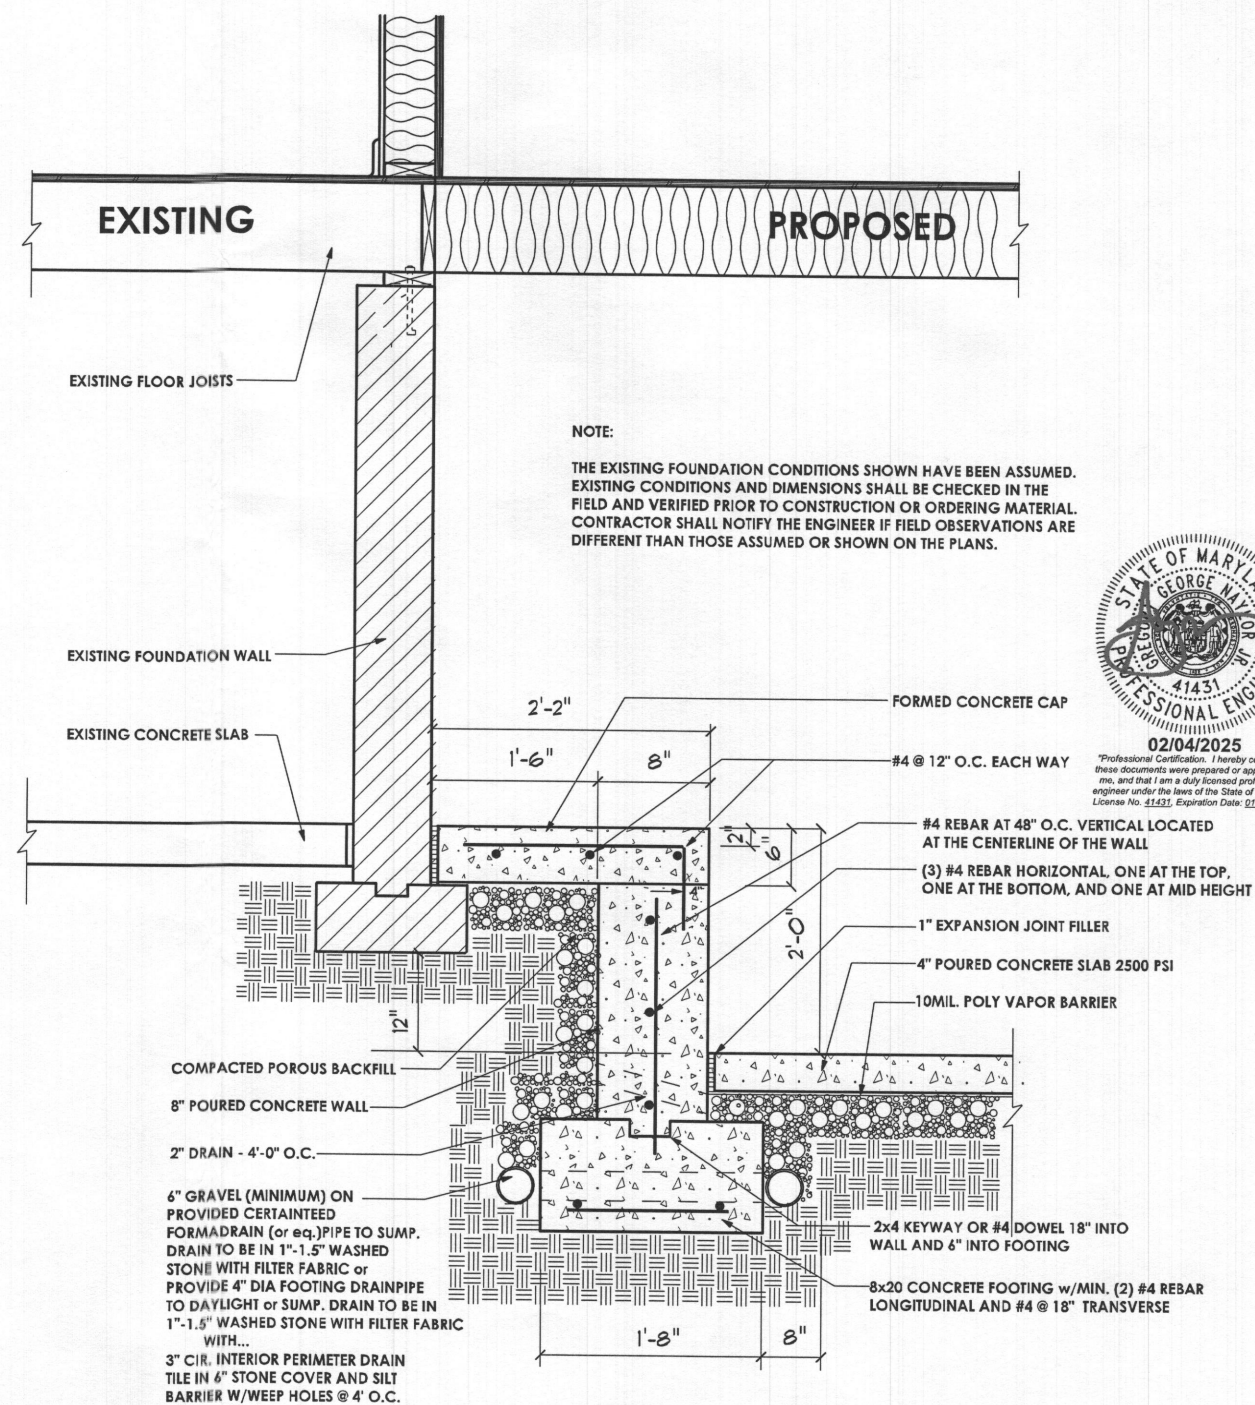

NOTE:
 THE EXISTING FOUNDATION CONDITIONS SHOWN HAVE BEEN ASSUMED. EXISTING CONDITIONS AND DIMENSIONS SHALL BE CHECKED IN THE FIELD AND VERIFIED PRIOR TO CONSTRUCTION OR ORDERING MATERIAL. CONTRACTOR SHALL NOTIFY THE ENGINEER IF FIELD OBSERVATIONS ARE DIFFERENT THAN THOSE ASSUMED OR SHOWN ON THE PLANS.

WALL SECTION AT FOUNDATION SHELF

ISSUE DATE

NO.	DATE	DESCRIPTION
1	12-03-24	PERMIT SET
2	2-4-25	PERMIT SET

SCALE: 1/4" = 1'-0"

SHELF DETAIL

2.02

PRINT DATE:
 Tuesday, February 4, 2025

NOTE: ALL LOAD BEARING STUD WALLS TO BE DOUBLE TOP PLATE PER WALL SECTIONS

PROFESSIONAL CERTIFICATION
I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14678, Expiration Date: 6/30/2026

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.
Copyright © 2025
Jonathan Rivera Architect
All Rights Reserved

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE
683 Watersville Road,
Mt. Airy, Maryland 21771

ARCHITECT
Jonathan Rivera AIA, NCARB
Howard County, Maryland

443.226.5745
jrvera@jonathanrivera.com

STRUCTURAL ENGINEER
Naylor Structural Engineering
Greg Naylor
Ellicott City, Maryland

410-952-4797
greg@naylorstructural.com

BUILDER

ISSUE DATE


1	12-03-24	PERMIT SET
2	2-4-25	PERMIT SET

SCALE: N.T.S.


DETAILS

3.02


PRINT DATE:
Tuesday, February 4, 2025

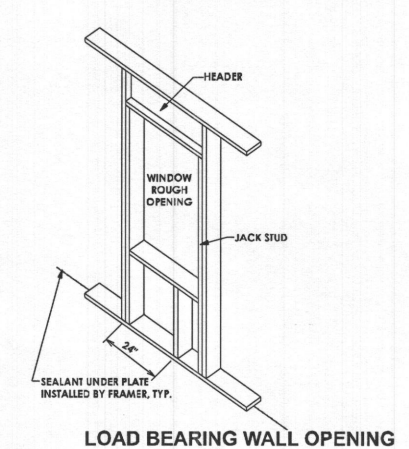

LOAD BEARING WALL OPENING

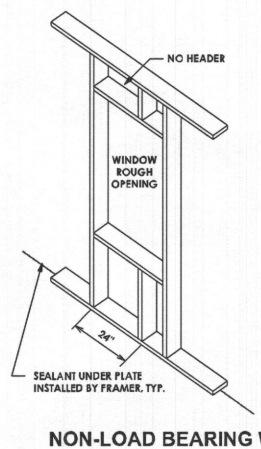


NON-LOAD BEARING WALL OPENING

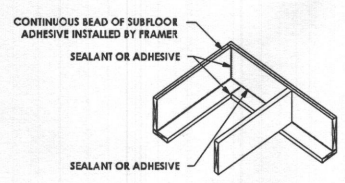


14 RIM JOIST AIR SEALING


NOT TO SCALE




ROOF WALL FRAMING CONNECTION

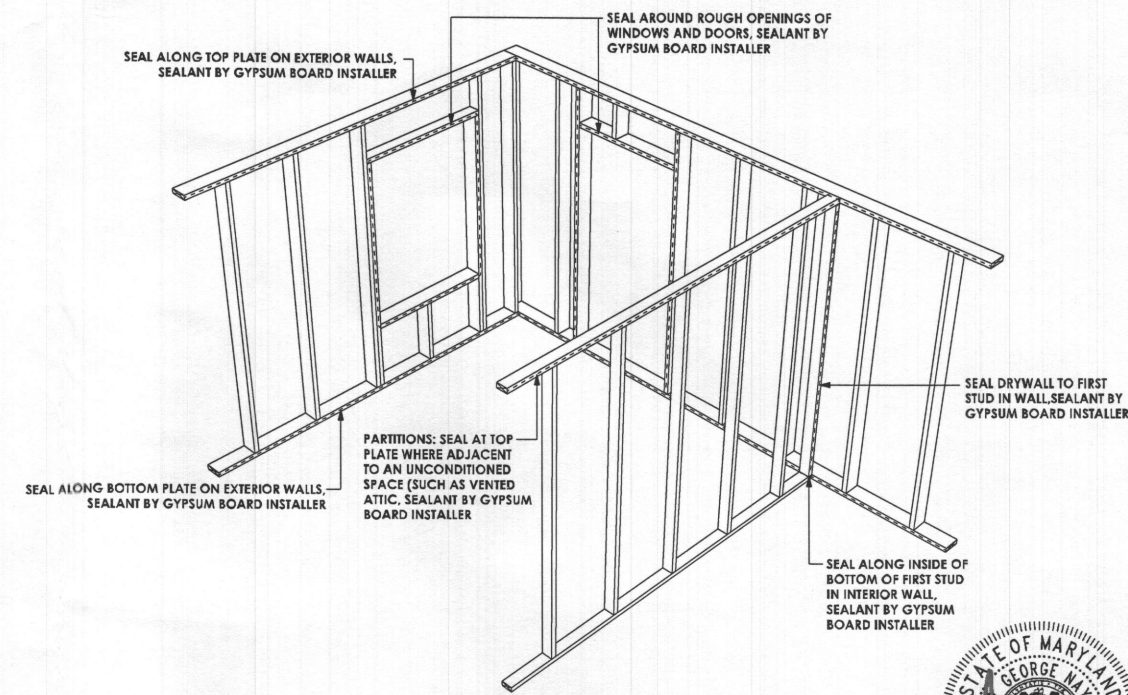


AIR BARRIER AT WALLS AND CEILING PERSPECTIVE




Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 41431, Expiration Date: 02-04-2025

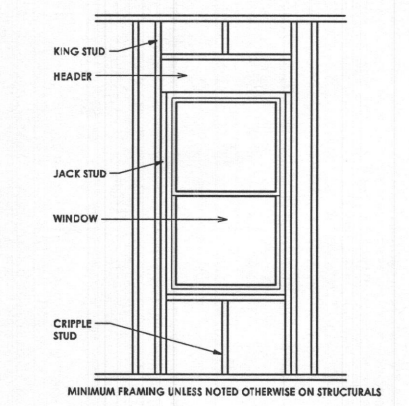


WINDOW FRAMING ELEVATION

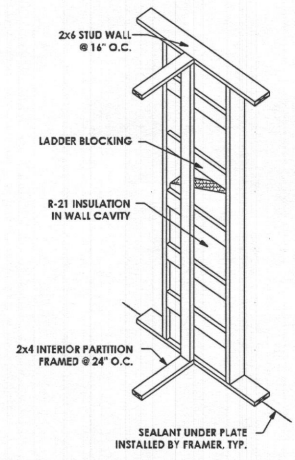


LADDER FRAMING @ PARTITION

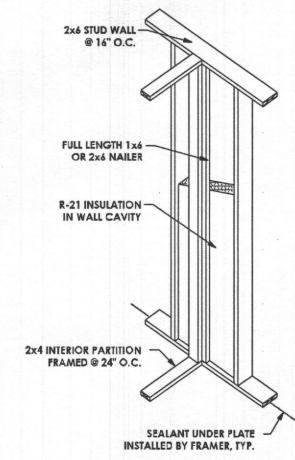


NAILER @ PARTITION




TWO-STUD CORNER-TOP

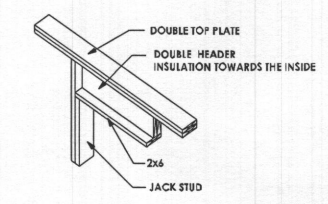


DOUBLE HEADER

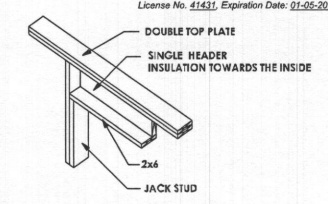


SINGLE HEADER

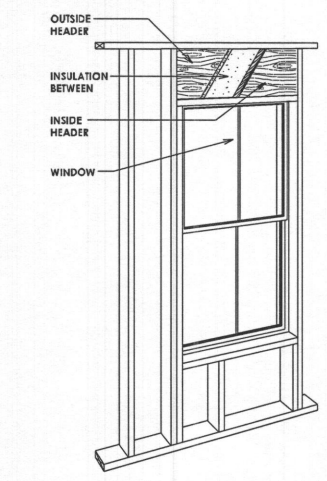


HEADER INSULATION BETWEEN

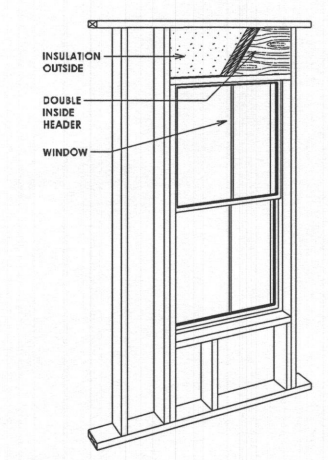


HEADER INSULATION OUTSIDE

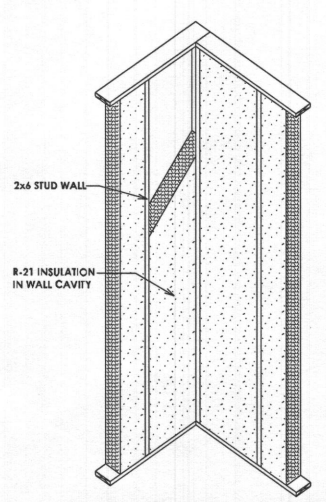


TWO-STUD CORNER-INSULATION

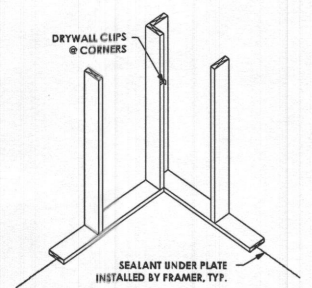

TWO-STUD CORNER-BOTTOM




BOTTOM PLATE @ PARTITION

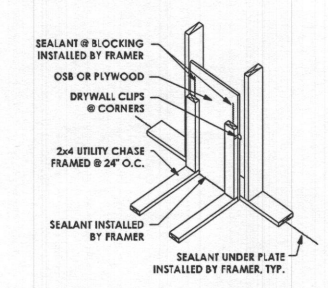


AIR SEALING @ MECH CHASE

EXTERIOR CORNER WALL DETAILS

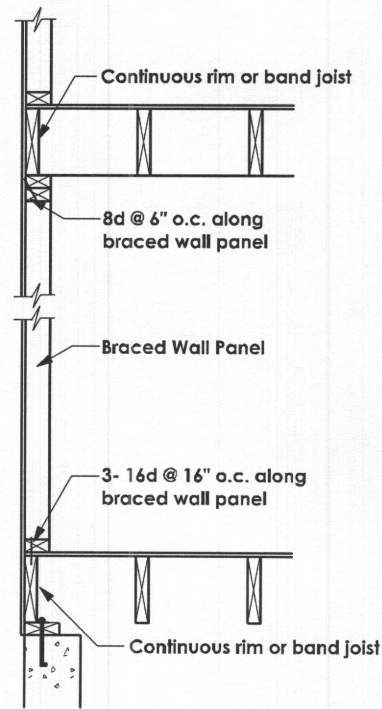

BRACED EXTERIOR WALL PANEL CONNECTION WHEN PARALLEL TO FLOOR/CEILING FRAMING

TYPICAL AT ALL EXTERIOR, PLYWOOD SHEATHED WALLS

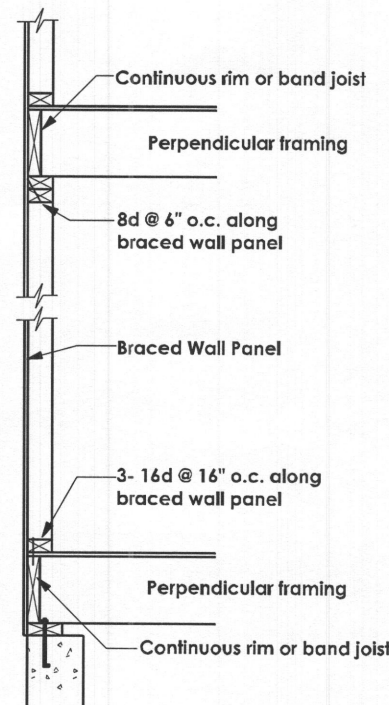


BRACED EXTERIOR WALL PANEL CONNECTION WHEN PERPENDICULAR TO FLOOR/CEILING FRAMING


TYPICAL AT ALL EXTERIOR, PLYWOOD SHEATHED WALLS

METHODS WSP & CS-WSP: ALL AREAS TO BE SHEATHED WITH 7/16" OSB SHEATHING, INCLUDING AREAS ABOVE DOORS AND WINDOWS, AND JOINTS BLOCKED. FASTENERS SHALL BE 8D COMMON (2 1/2" X 0.131") NAILS AT 6" SPACING (EDGES) AND 12" SPACING (FIELD).

METHOD GB: GYPSUM WALL BOARD SHALL NOT BE LESS THAN 1/2" IN THICKNESS AND SHALL BE FASTENED WITH NAILS OR SCREWS IN ACCORDANCE WITH IRC TABLES R602.3(1) FOR EXTERIOR LOCATIONS AND R702.3.5 FOR INTERIOR LOCATIONS AT 7" SPACING (EDGES) AND 7" SPACING (FIELD)

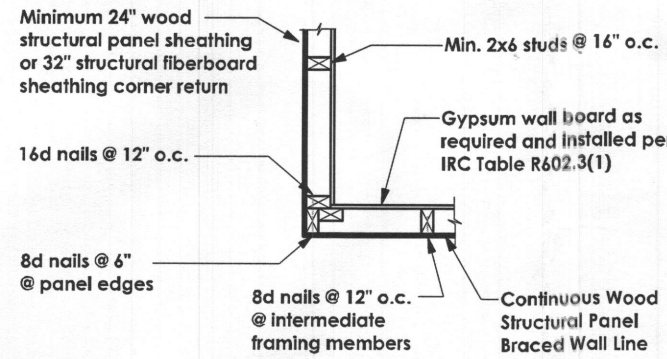

OUTSIDE CORNER

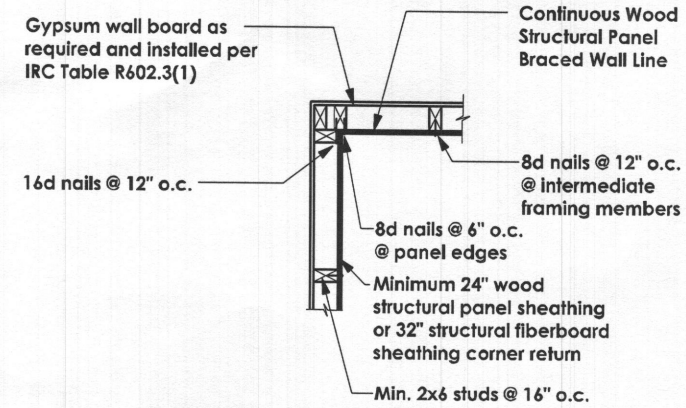


INSIDE CORNER



02/04/2025
Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 41431, Expiration Date: 02-04-2025

PROFESSIONAL CERTIFICATION
I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14678, Expiration Date: 6/30/2026

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.
Copyright © 2025
Jonathan Rivera Architect
All Rights Reserved

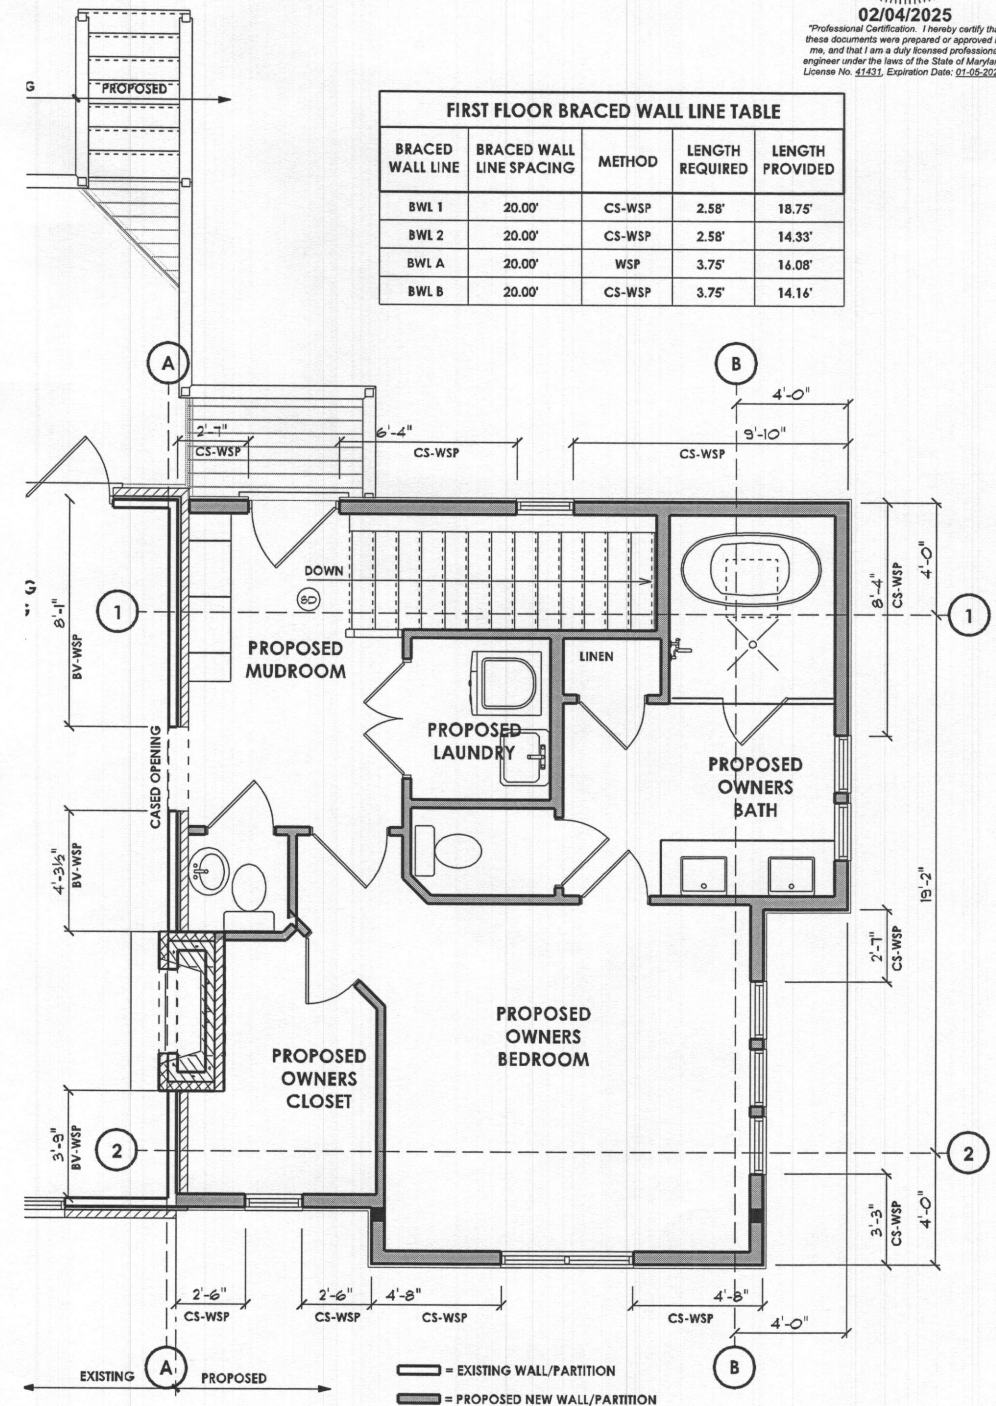

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE
683 Watersville Road,
Mt. Airy, Maryland 21771

ARCHITECT
Jonathan Rivera AIA, NCARB
Howard County, Maryland

443.226.5745
jrvera@jonathanrivera.com

STRUCTURAL ENGINEER
Naylor Structural Engineering
Greg Naylor
Ellicott City, Maryland

410-952-4797
greg@naylorstructural.com

BUILDER

ISSUE DATE

- 1 12-03-24 PERMIT SET
- 2 2-4-25 PERMIT SET
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10


SCALE: 1/4" = 1'-0"

BRACING DETAILS

3.51
PRINT DATE:
Tuesday, February 4, 2025

WINDOW SCHEDULE

TYP	MODEL NO.	MANUFACTURER	MIN. ROUGH OPENING (h x w)	QTY	FLOOR	LOCATION	HEAD HEIGHT	SCREENS	NOTES
A	AN31	ANDERSEN	21" x 36 1/2"	2	BASEMENT	PROPOSED BASEMENT	7'-8"	N/A	N/A
B	C125	ANDERSEN	28 3/4" x 24 1/4"	2	FIRST	PROPOSED OWNERS CLOSET/ PROPOSED MUDROOM	6'-4" / 6'-10 1/2"	N/A	N/A
C	CW245	ANDERSEN	53 1/4" x 57"	1	FIRST	PROPOSED OWNERS BEDROOM	6'-10"	N/A	N/A
D	AW21	ANDERSEN	28 3/4" x 24 1/4"	3	FIRST	PROPOSED OWNERS BEDROOM	6'-10"	N/A	N/A
E	AXW281	ANDERSEN	32" x 36 1/2"	1	FIRST	EXPANDED GARAGE	6'-10 1/2"	N/A	TEMPERED

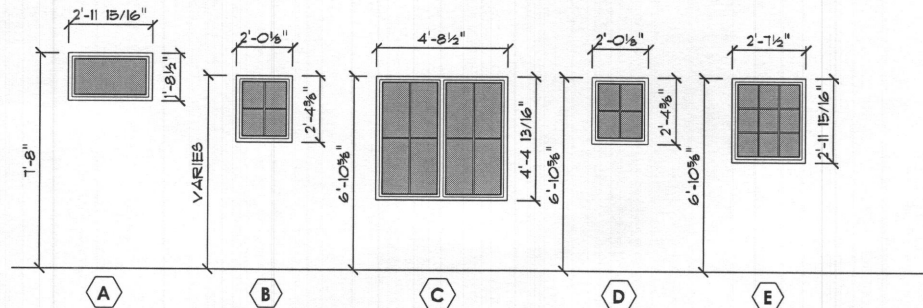


WINDOW NOTES

1. REFER TO DRAWINGS FOR GRILL PATTERN.
2. ALL GRILLE PROFILES ARE 3/4".
3. ALL GLASS SHALL BE LOW-E 4 U.N.O.
4. MATCH EXISTING WINDOW COLOR AND FINISHES.
5. MATCH EXISTING WINDOW HARDWARE.
6. ALL GRILLE CONFIGURATIONS ARE SDL.

WINDOW TYP. ELEVATIONS

DOOR SCHEDULE


TYP	MODEL NO.	MANUFACTURER	SIZE (w x h)	QTY	FLOOR	INTERIOR OR EXTERIOR	LOCATION	NOTES
1	3068	N/A	36" x 80"	1	FIRST	EXTERIOR	PROPOSED MUDROOM	SDL
2	2'-4"	N/A	28" x 80"	5	FIRST	INTERIOR	PROPOSED MUDROOM/ PROPOSED OWNERS CLOSET/ PROPOSED OWNERS BATH	N/A
3	2'-8"	N/A	32" x 80"	1	FIRST	INTERIOR	PROPOSED MUDROOM	N/A
4	4'-0"	N/A	48" x 80"	1	FIRST	INTERIOR	PROPOSED MUDROOM	N/A

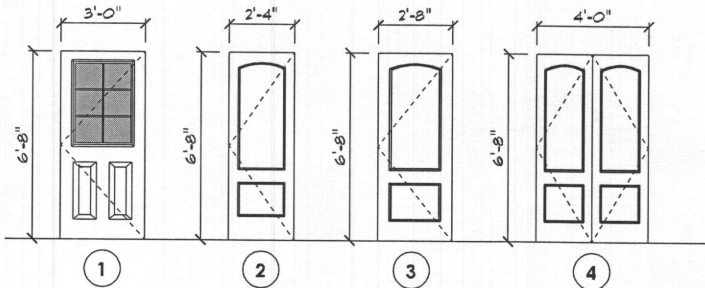

DOOR NOTES

1. REFER TO DRAWINGS FOR GRILL PATTERN.
2. ALL GRILLE PROFILES ARE 3/4".
3. ALL GLASS SHALL BE LOW-E 4 U.N.O.
4. MATCH EXISTING WINDOW COLOR AND FINISHES.
5. MATCH EXISTING WINDOW HARDWARE.

DOOR TYP. ELEVATIONS

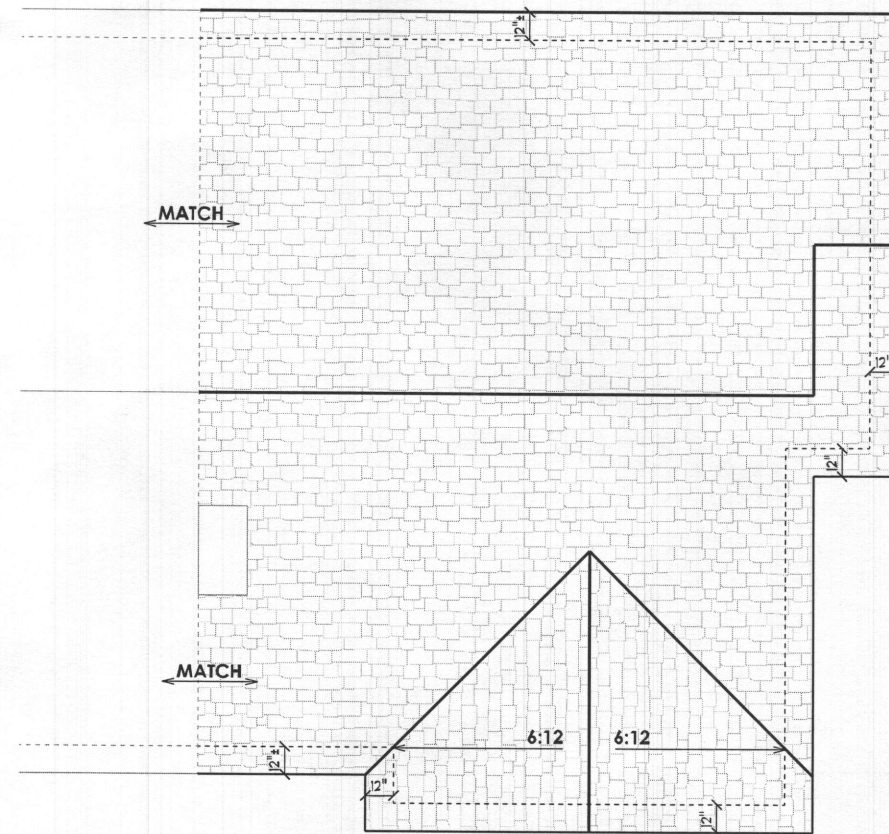

ROOF PLAN

PROFESSIONAL CERTIFICATION
I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland.
License Number #14478
Expiration Date: 6/30/2026

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.
Copyright © 2025
Jonathan Rivera Architect
All Rights Reserved

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE

683 Watersville Road,
Mt. Airy, Maryland 21771

ARCHITECT
Jonathan Rivera AIA, NCARB
Howard County, Maryland

443.226.5745
jriv@jonathanrivera.com

STRUCTURAL ENGINEER
Naylor Structural Engineering
Greg Naylor
Ellicott City, Maryland

410-952-4797
greg@naylorstructural.com

BUILDER

ISSUE DATE

1 12-03-24 PERMIT SET

2 2-4-25 PERMIT SET

3

4

5

6

7

8

SCALE: 1/4" = 1'-0"

ROOF PLAN

4.01

PRINT DATE:
Tuesday, February 4, 2025

PROFESSIONAL CERTIFICATION
 I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland. License Number #14678 Expiration Date: 6/30/2026

WARNING:
 THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. VIOLATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.
 Copyright © 2025
 Jonathan Rivera Architect
 All Rights Reserved

PROPOSED ADDITION

KRAUSZ-WATSON RESIDENCE

683 Watersville Road,
 Mt. Airy, Maryland 21771

ARCHITECT
 Jonathan Rivera AIA, NCARB
 Howard County, Maryland

443.226.5745
 jrivera@jonathanrivera.com

STRUCTURAL ENGINEER
 Naylor Structural Engineering
 Greg Naylor
 Ellicott City, Maryland

410-952-4797
 greg@naylorstructural.com

BUILDER

ISSUE DATE


1	12-03-24	PERMIT SET
2	2-4-25	PERMIT SET

SCALE: 1/4" = 1'-0"


SECTIONS

5.01


PRINT DATE:
 Tuesday, February 4, 2025

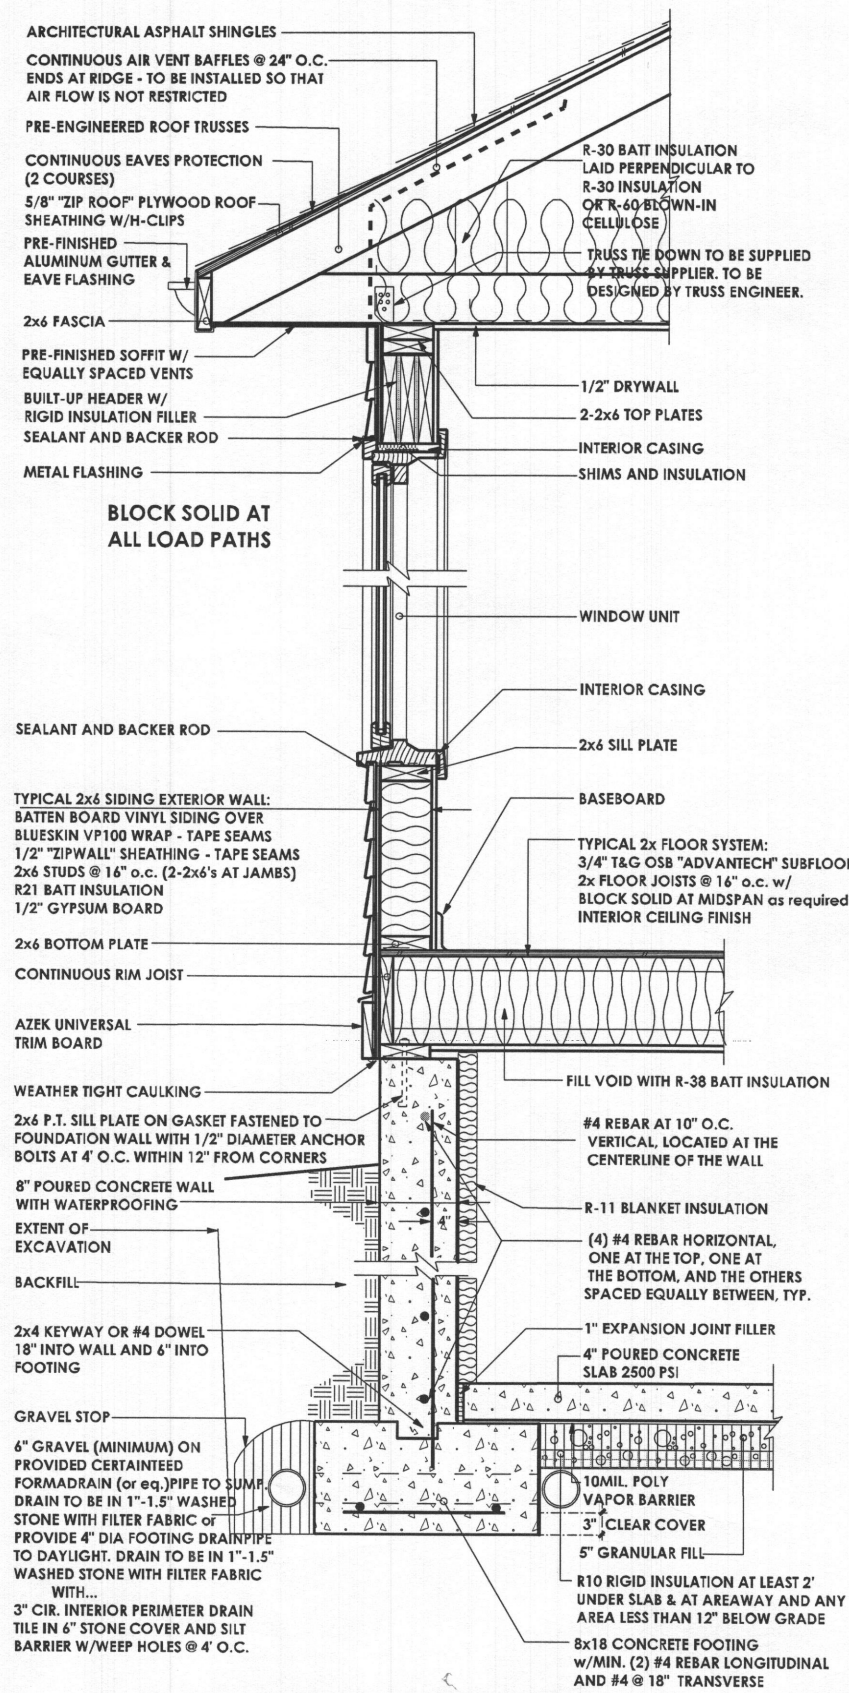

WALL SECTION AT HOUSE BOX

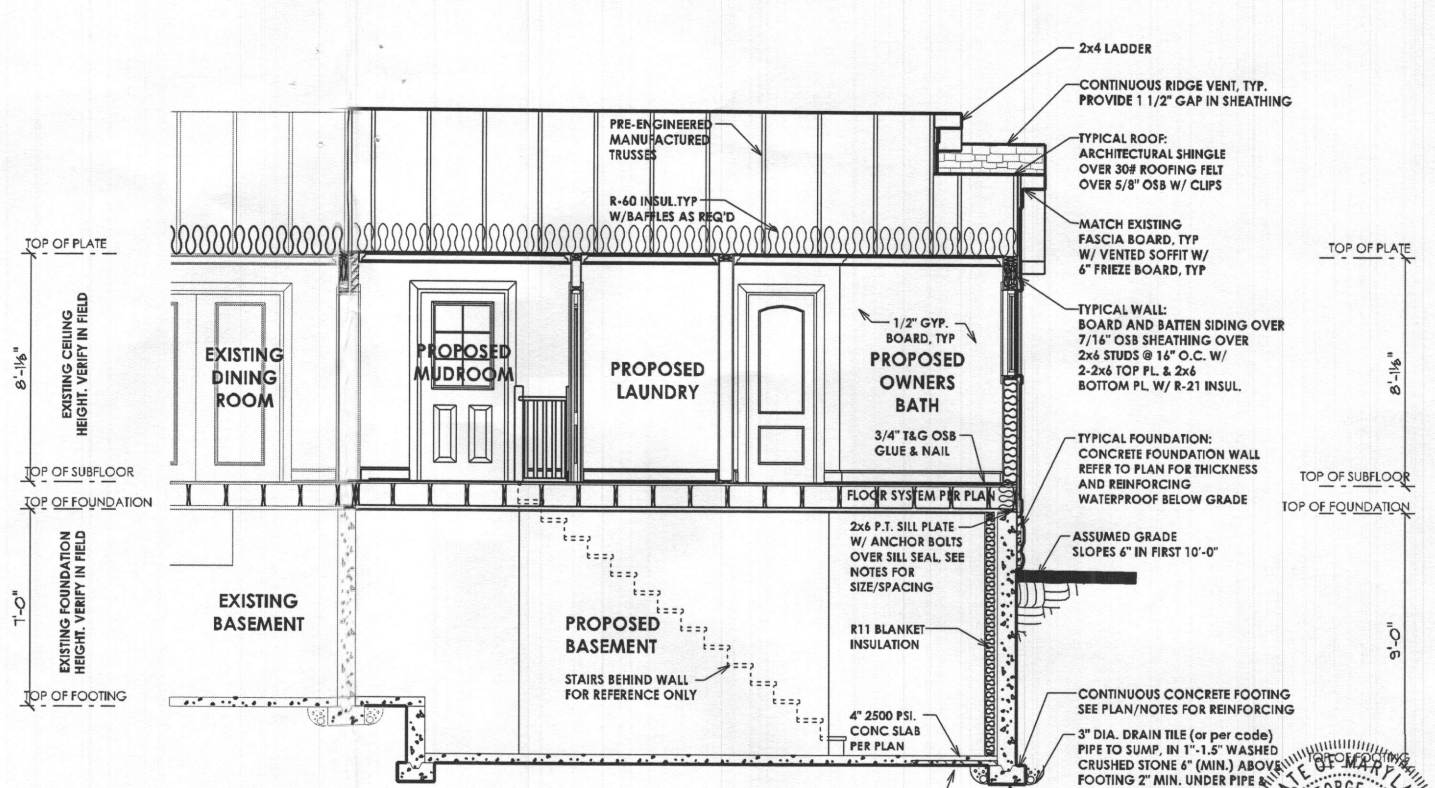

SECTION A-A

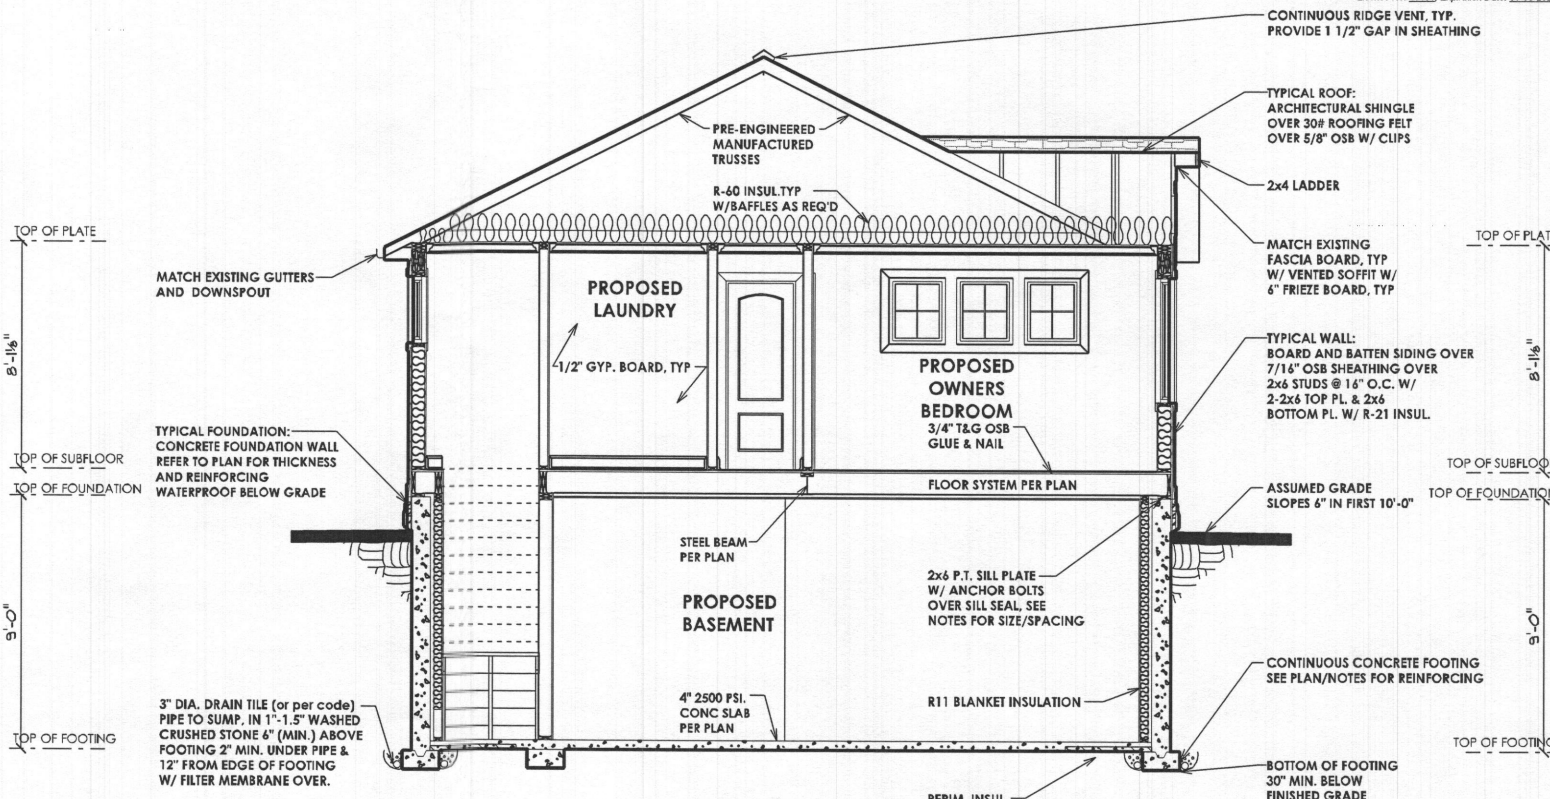

SECTION B-B