

OR 5/19/2008

C 1 6978

SEQUENCE NO. (MDE USE ONLY)

STATE OF MARYLAND WELL COMPLETION REPORT

THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED.

COUNTY NUMBER 13

(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)

ST/CO USE ONLY DATE RECEIVED MM DD YY 03 12 20

DATE WELL COMPLETED MM DD YY 04 23 26

Depth of Well 22 195 26 (TO NEAREST FOOT)

PERMIT NO. FROM "PERMIT TO DRILL WELL" HO - 75 - 0074

OWNER BENDLER SAMATHA first name last name TOWN DAYTON

WELL LOG Not required for driven wells

Table with columns: DESCRIPTION, FEET (FROM, TO), check if water bearing. Rows include Topsoil, Brown mica, Grey mica, and opening.

GROUTING RECORD

WELL HAS BEEN GROUTED (Y) (N) TYPE OF GROUTING MATERIAL (C) (M) (B) (C) NO. OF BAGS 23 NO. OF POUNDS 2500

CASING RECORD

MAIN CASING TYPE (S) (T) Nominal diameter top (main) casing (nearest inch)! 6 Total depth of main casing (nearest foot) 60

Table for OTHER CASING (if used) with columns for diameter and depth.

SCREEN RECORD

DEPTH (nearest ft.) H O 59 195

PUMPING TEST

HOURS PUMPED (nearest hour) 3 PUMPING RATE (gal. per min.) 18 METHOD USED TO MEASURE PUMPING RATE Bucket

PUMP INSTALLED

DRILLER INSTALLED PUMP (YES or NO) TYPE OF PUMP INSTALLED PLACE (A,C,J,P,R,S,T,O) IN BOX 29

LATITUDE 39.264652 LONGITUDE 76.921883 (DEFAULT COORD. WGS 84)

Pursuant to §10-624 of the State Govt. Article of the Maryland Code personal info. requested on this form is used in processing this form pursuant to COMAR 26.04.04.

NUMBER OF UNSUCCESSFUL WELLS: 0 WELL HYDROFRACTURED (Y) (N)

- A A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED E ELECTRIC LOG OBTAINED P TEST WELL CONVERTED TO PRODUCTION WELL

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 26.04.04 "WELL CONSTRUCTION" AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE ABOVE CAPTIONED PERMIT...

DRILLERS LIC. NO.: MWD 603

DRILLERS SIGNATURE (MUST MATCH SIGNATURE ON APPLICATION) LIC. NO.: JSD 172

SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)

GRAVEL PACK IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68

MDE USE ONLY (NOT TO BE FILLED IN BY DRILLER) T (E.R.O.S.) W Q

TELESCOPE CASING LOG INDICATOR OTHER DATA

Maura J. Rossman, M.D., Health Officer

Information Form for the Installation of the Well Pump, Pitless Adapter, and Supply Piping

NOTE: The installer is responsible for requesting an inspection prior to 9 am on the day of the desired inspection. No work is to be covered until approved by the Health Department. All installations must comply with the National Standard Plumbing Code (NSPC, as amended locally) and COMAR 26.04.04 (MD Well Construction Regulations). Submission of a complete form is required prior to Use and Occupancy approval.

Company Name: Eastday-Wilson Water Services Telephone #: 301-831-7057
 Address: 9865 Brown Church Rd
MT Airy md 21771

Must circle one: Licensed Plumber / Licensed Well Driller / Licensed Well Pump Installer

License # and name of individual responsible for the field installation:
 Name (Print): Dallon Wilson License# MDS 188

*A licensed individual must perform the actual installation. Apprentices must be under the supervision of a licensed journeyman or master plumber, pump installer or well driller. Licenses may be subjected to field verification. Unlicensed individuals may be reported to the appropriate licensing agency.

Name of Property Owner: Sam Bender Telephone #: 6030-915-7264
 Subdivision: _____ Lot #: _____ Well Tag #: HO-25-0074
 Site Address: 3872 Folly Quarter Rd
Elliotts City md 21042

Submersible Pump Data

Make: Goolds
 Model #: 7H50542C
 Pump Capacity: 7.5gpm
 Well Yield: 80gpm
 Depth of well encountered at time of pump installation: 195 (feet)

Pitless Adapter

Make: Bushert +
 Model#: R-125-35
 GPM Depth: 48" (36" min)
 GPM NSF/WSC approved: _____

Well Cap and Electric Conduit

Two piece watertight cap: yes
 Screened, vented well cap: yes
 Cap secured to casing: yes
 Conduit min 18" B.G.: yes
 Conduit secured to well cap: yes

If pump capacity exceeds well yield, a low water cut off switch is required by NSPC 1990 Section 17.8.4

Must circle one: Torque arrestors / Cable guards / Other acceptable method used

Safety rope, if used, attached to brass rope adapter or other acceptable method inside of well casing yes

Piping to house

Type: PE
 PSI: 210 (160 psi min)
 Depth of supply line: 48 (36" min)

House Connection

PVC sleeve to undisturbed soil at wall penetration: yes
 Length of sleeve (5' minimum from foundation): 5ft
 Sleeve sealed properly: yes


The water supply line is required to be at least ten feet from the septic tank, pump chamber, sewage piping, distribution box, drainfields, and sewage reserve area. If this cannot be accomplished, contact this office for approval prior to installation.

Dallon Wilson 5-12-26
 Signature of company representative responsible for installation date


For Health Department Use Only - Not to be completed by Installer

Date Insp. Requested: 5/11/26 Date Insp. Approved: 5/12/26 Inspector: MB
 Inspection Data: Pitless adapter watertight & water supply line at least 36" below grade ✓ 48"
 Two piece cap installed and attached to casing securely ✓
 Elec. conduit extends at least 18" below grade/attached to cap properly ✓ 39"
 Safety rope not outside of well cap/casing ✓
 Correct well tag attached properly and casing 8" above finished grade ✓
 Water supply line sleeved adequately at house connection N/A Tied in line to existing line
 Adequate grout observed below pitless adapter ✓

(Revised form 10/24/2018)

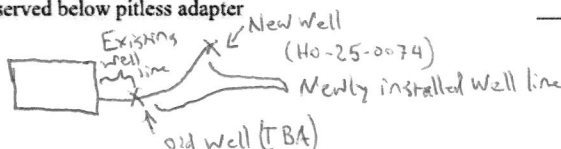

4/22/26 - 3182 Folly Quarter
Driller not on site for insp. well
Completed - annual space protected until
for 4/23/26 - 111
Construction
grout scheduled
R.S. 2 pm

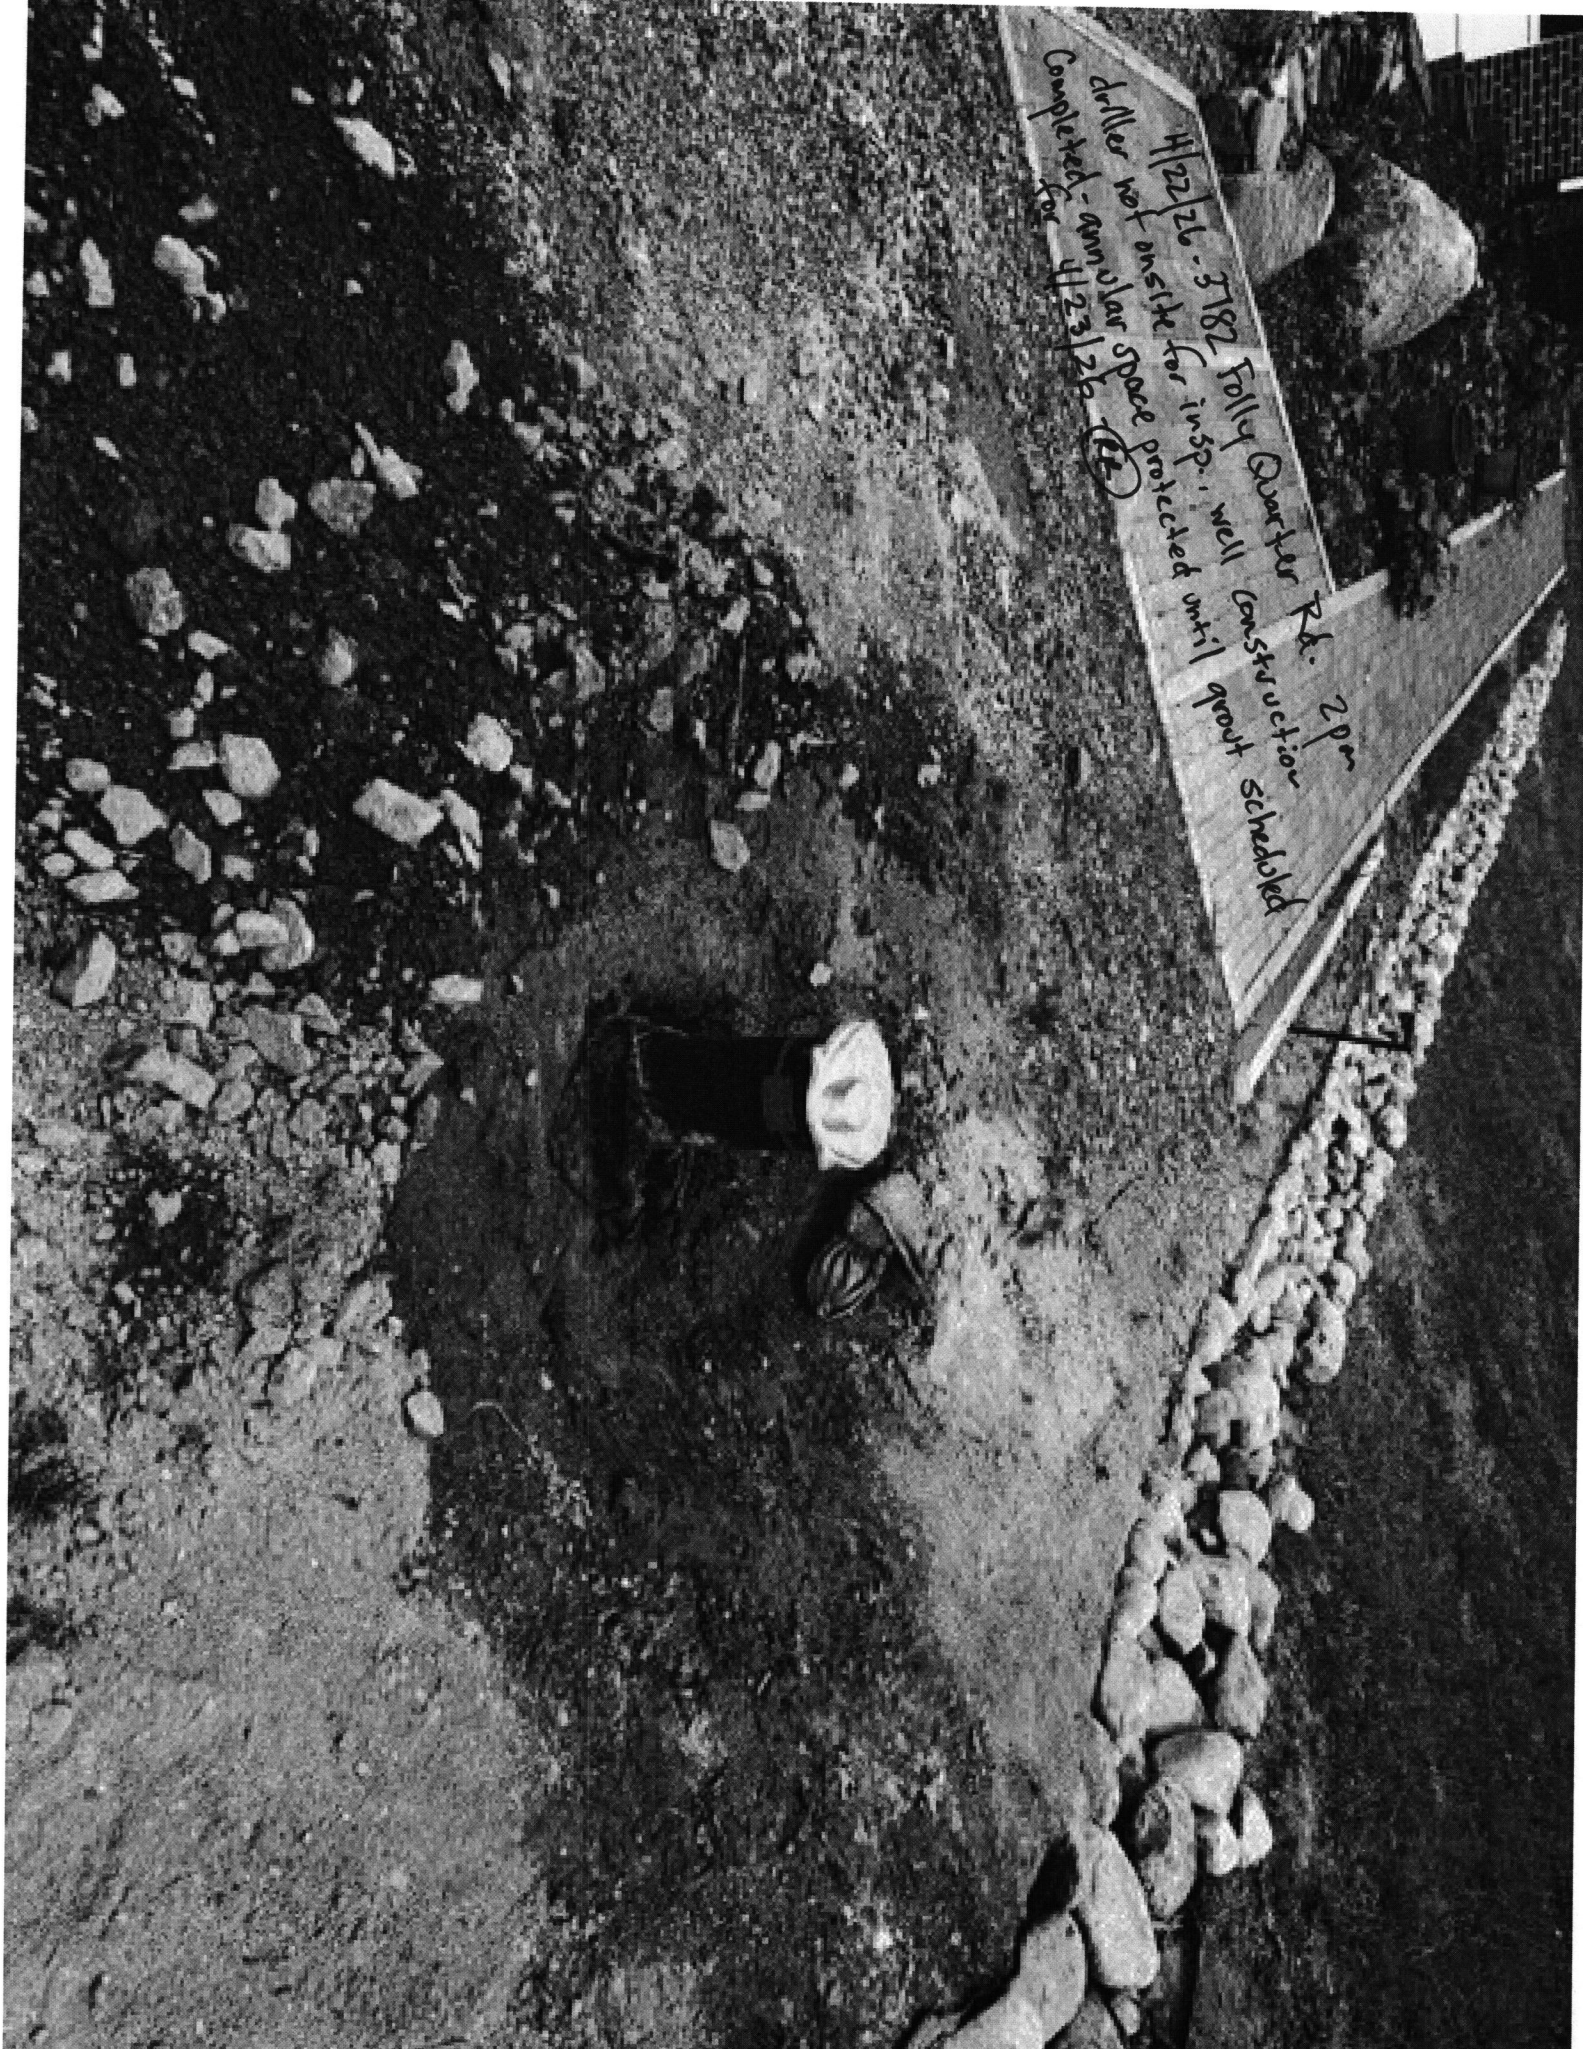

Maura J. Rossman, M.D., Health Officer

MEMORANDUM

May 12, 2026

Samantha Bendler
3872 Folly Quarter Rd
Ellicott City, MD 21042

RE: **Well Sampling**
3872 Folly Quarter Rd
Ellicott City, MD 21042
Well Permit # HO-25-0074


Dear Ms. Bendler,

Your replacement well has been connected to the dwelling on May 11, 2026. We request that you contact the Community Hygiene Program at **(410) 313-1773** to schedule initial water sampling for the above referenced well, as required by the Maryland Well Construction Regulation (COMAR 26.04.04). This sampling includes testing for bacteria, nitrates, turbidity, and sand. There is currently **no charge** for the sampling and it is to your benefit to have it tested.

It is preferred that the sample be collected from the primary indoor drinking tap, but if suitable scheduling is not possible, the sample may be taken from an outside tap to complete your sampling obligation. However, the potential for unsuccessful sample results increases when samples are collected from taps exposed to the outside environment.

If sampling has already been performed by an outside lab, please help us by forwarding the results of the samples to our office. If you have any further questions, you can call me at 410-313-2643. Otherwise, call Community Hygiene at 410-313-1773 to schedule or arrange for them to collect the subsequent water samples.

Sincerely,



Matthew Burns – LEHS
Environmental Health Specialist
Howard County Health Department
Well and Septic Program

MEMORANDUM

TO: Howard County Health Department
Groundwater Mgmt. Sec.
Well & Septic Program

FROM: Sam Bendler
3872 Folly Quarter Rd.
Ellicott City, MD 21042
630-915-7264

DATE: 19 March 2026

RE: **3872 Folly Quarter Rd – Replacement Well Deviation
Special Condition**

To whom it may concern,

The Howard County Health Dept. has granted a variance to the distance requirements of the regulations provided in COMAR 26.04.04.02. The distance from the septic area to the proposed replacement well site is 95'. I reviewed and approved that the proposed replacement well site on my property is located 95' away from the dwelling's septic system area.

Please use this letter as confirmation that I understand the above-mentioned circumstance regarding my well and septic systems and that I am okay with drilling a replacement well less than 100 feet from my septic system. I understand that in order to preserve the quality of ground drinking water, a special condition has been set for the above-mentioned well. This condition will require the driller to seal off upper strata by placing a minimum of **50 feet** of steel casing OR **10 feet** into competent bedrock (whichever comes first).


Sincerely,



SITE INSPECTION SHEET

OWNER: Samantha Bender PHONE #: 301-241-7662
ADDRESS: 3872 Folly Quarter Rd CONTRACTOR: Carroll Water
Ellicott City, MD 21042 WELL TAG #: _____
SUBDIVISION: 2002 LOT: 7 COUNTY #: Howard
PROPOSAL: Emergency Replacement Well

LOCATION DIAGRAM

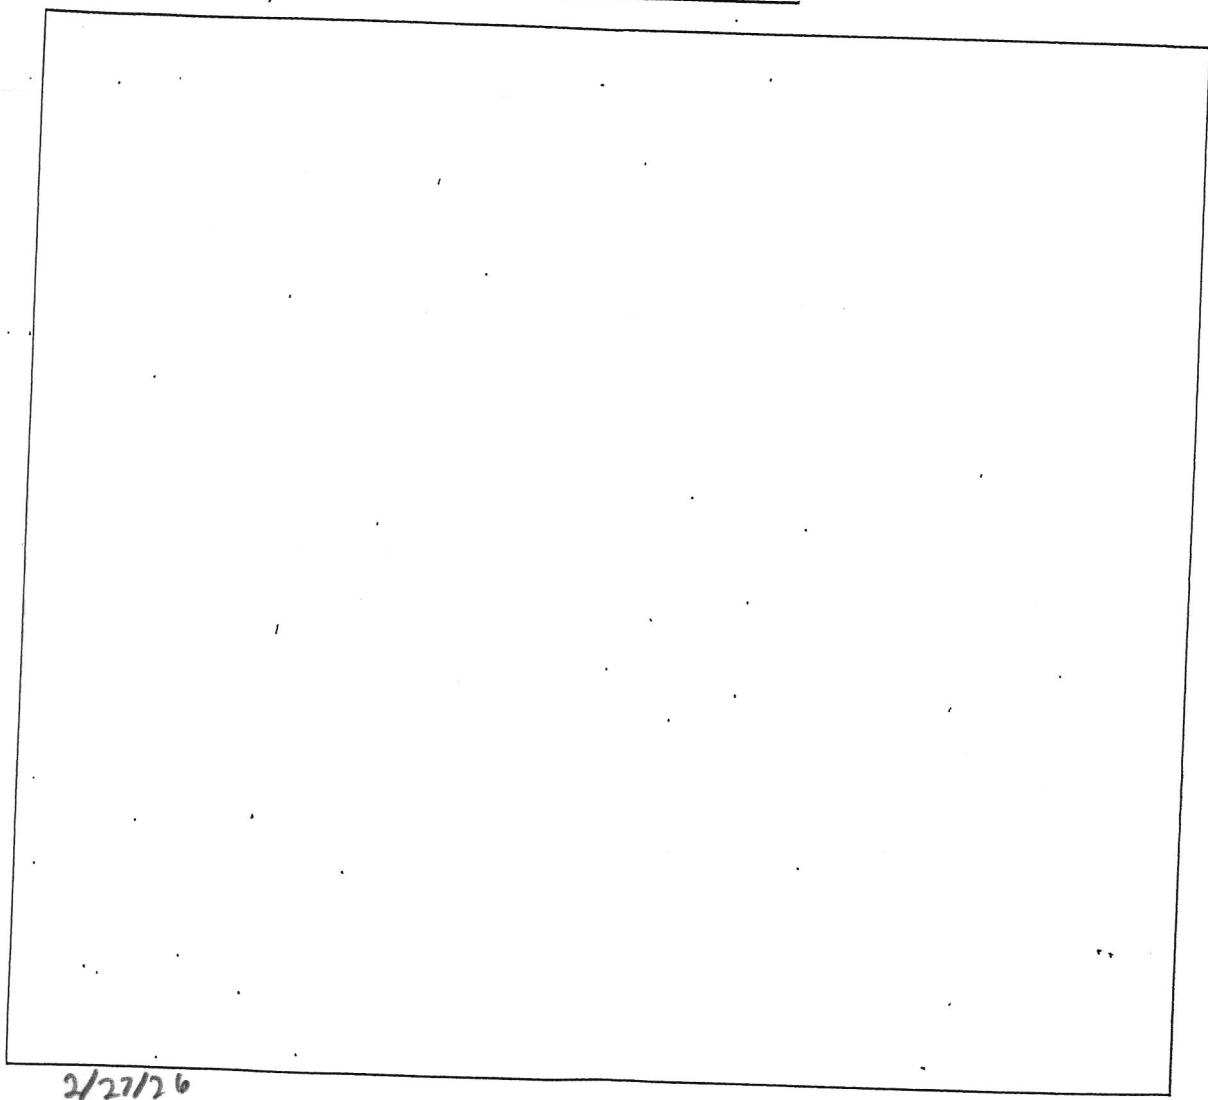

2/27/26


COMMENTS: Met with Driller and homeowner on site. Initial proposed locations not feasible due to
drill rig accessibility issues. Proposed ^{New} location meets setbacks to house, road, driveway, and septic system
May need special notice regarding the drywell serving 3849 Folly Quarter Rd only being about 165' away.
Discussing with RW. (MS) 3/5/26 spoke with Kevin about well placement. Well is to be moved further back from
the road due to road salt concerns. Special condition added that the well driller needs to seal off upper strata
by placing a minimum of 50' steel casing or 10' into competent bedrock, whichever is deeper. (MS)

DATE: _____ INSPECTOR: _____

* Baltimore Graciss Area - Naturally occurring ^{trace element} radioactive elements within the rock, alpha/beta particles from radium 228/226.
Old data suggests about 20% of wells in this area are affected with high levels of radium. If this is the case, radium can
we will take a radium sample at the yield test * Special Condition 50' of steel casing or 10' into competent
OR, whichever is deeper
Reverse Ion exchange or

3/20/26 *Well Sites approved (MB)

Special Condition: 50' steel casing or 10' into competent Bedrock whichever is deeper
Water Samples for gross alpha, gross beta, TDS, Cl, and Na to be taken at yield test.

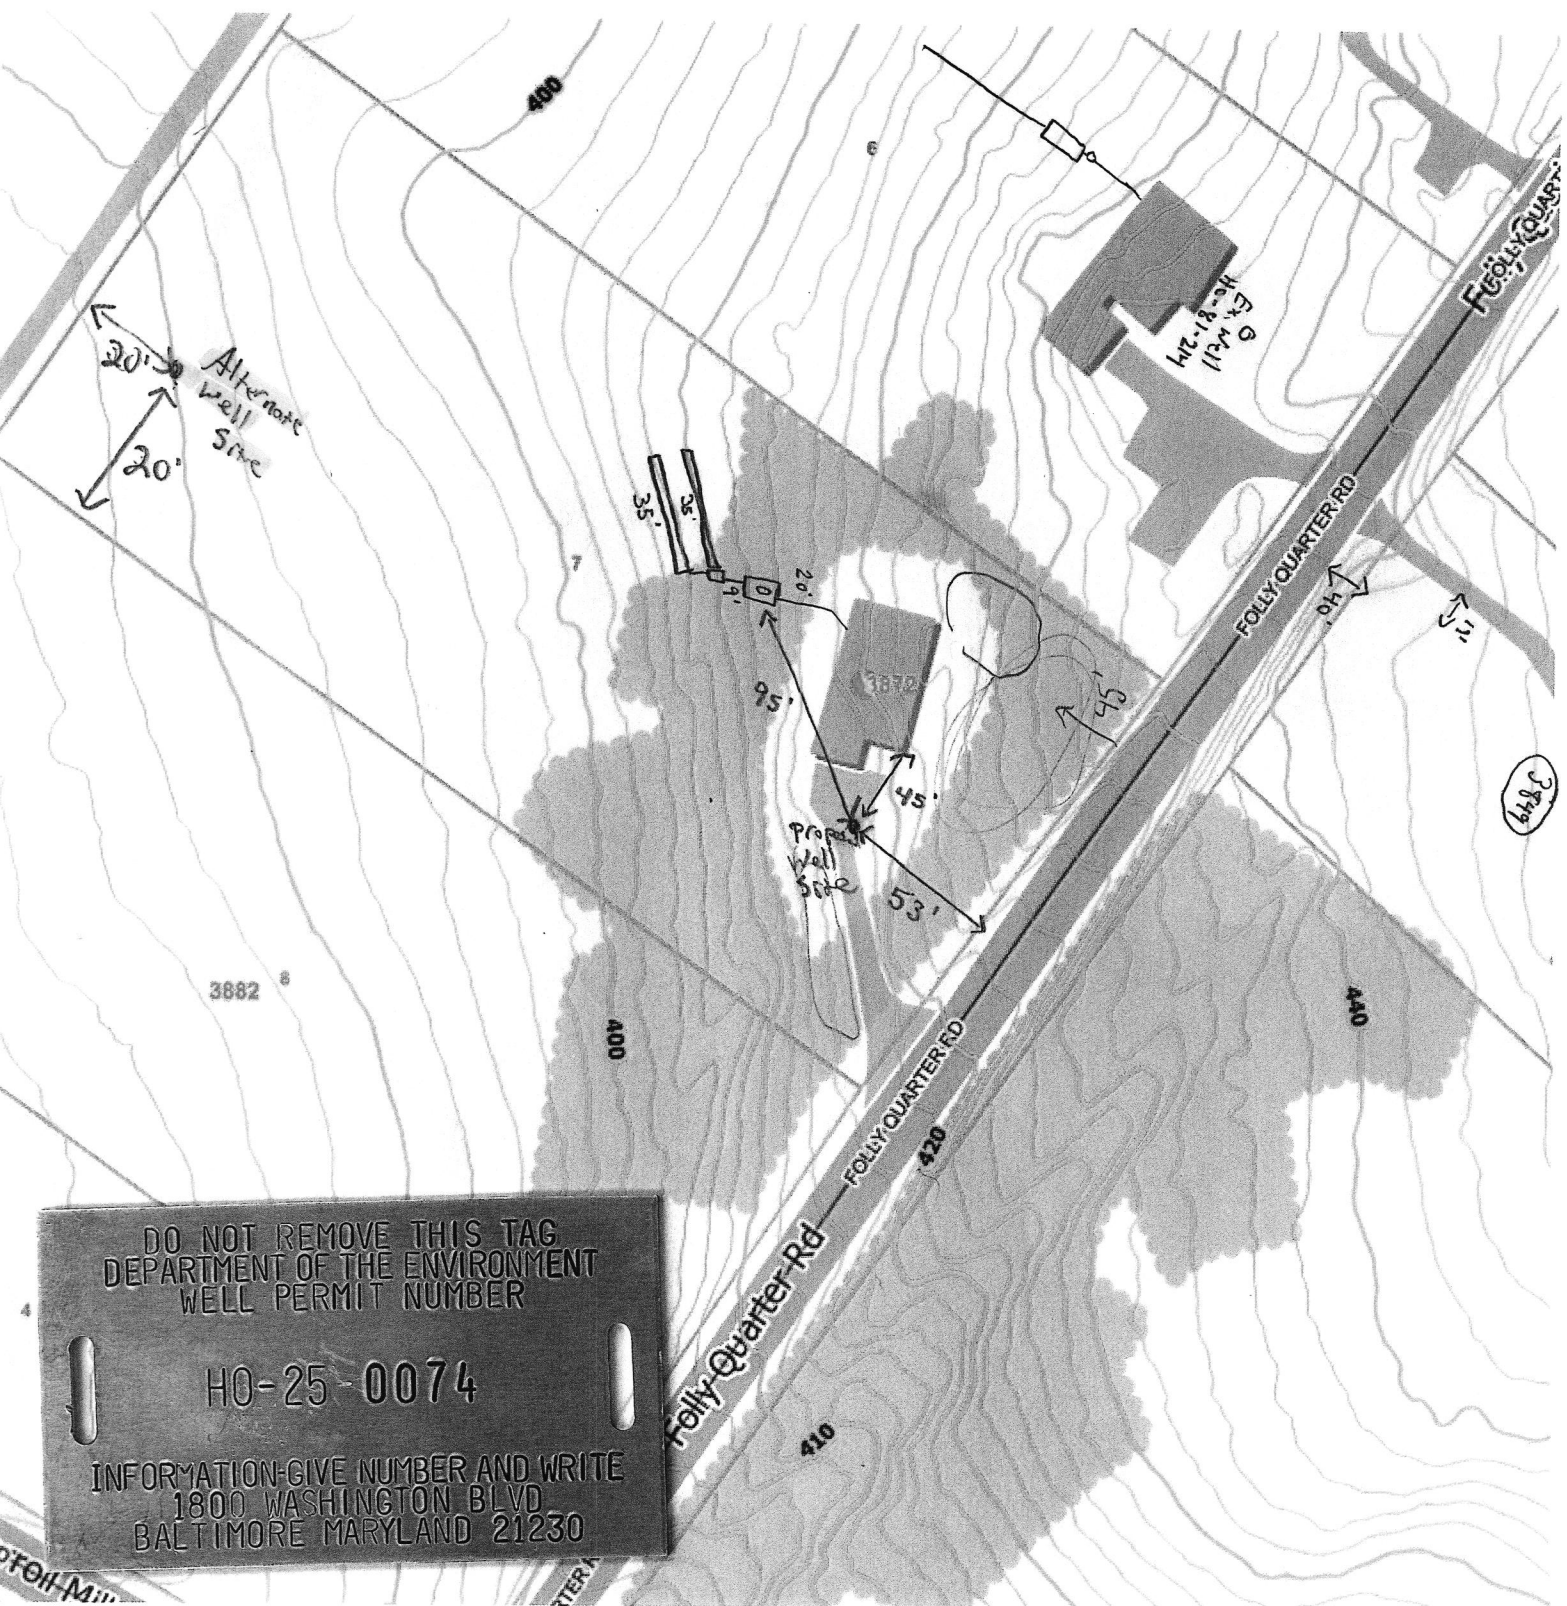

DO NOT REMOVE THIS TAG
 DEPARTMENT OF THE ENVIRONMENT
 WELL PERMIT NUMBER

HO-25-0074

INFORMATION-GIVE NUMBER AND WRITE
 1800 WASHINGTON BLVD
 BALTIMORE MARYLAND 21230

Special Condition 50' steel casing or 10' in to competent Bk
whichever is deeper

