

Record Detail * (This section is required.)

Permit Type Building/Residential/Misc/Tanks	Permit Number B26001394	Opened Date 04/30/2026
Description of Work SFD// INSTALL (1) 500GAL UNDERGROUND PROPANE TANK		

[check spelling](#)

Address * (This section is required.)

Search Reset Clear Get Parcel & Owner

Street # 2801	Street Name BELLE HOLLOW	Street Type CT
Unit Type --Select--	Unit #	X Coordinate -77.01211
		Y Coordinate 39.30505
City GLENWOOD	State MD	Zip Code 21738
		Primary Yes

Approved 5/1/26
[Signature]

Parcel * (This section is required.)

Search Reset Clear Get Address & Owner

GIS ID *	Parcel	Parcel Area	Land Value	Improved Value	Exemption Value	Plan Area
916638	123	1.28	299000	1103400	804400	RURAL

Legal Description
IMPSLOT 18 1.28 A[]2801 BELLE HOLLOW CT[]GWYNDYL OAK ESTATES

[check spelling](#)

Block 18	Lot 18	Census Tract 605601	Council Dist 5	Inspection Dist	Supervisor Dist	Map #	DAP Zone
Plan Area	State Tax Id 1404356144	Subdivision Name GWYNDYL OAK ESTATES					
Section	Area	Tax Map 14					
Grid 14-11	Zoning District RC-DEO	ADC Map 4812-J2					
SDP No.	Final Plan No.	WP File No.					
Record Plat No. 11550	WS Contract No.	FDP No.	Primary Yes				
Owner Occupied <input type="radio"/> Yes <input type="radio"/> No	Year Built 1996	Historic District <input type="radio"/> Yes <input checked="" type="radio"/> No					
Historic District Registry No.	Stat Area 4-06	Flood Plain <input type="radio"/> Yes <input checked="" type="radio"/> No					
Building No							

Owner * (This section is required.)

Search Reset Clear

Name *
HAGGI

Address Line 1
2801 BELLE HOLLOW CT

Address Line 2

Address Line 3

Mail City
GLENWOOD
Mail State
MD
Mail Zip Code
21738
Phone
484-401-4658
Primary
Yes
E-mail

for contractor

Cell Number Fax Number

Professionals (This section is not required.)

License # * Business Name
20100085886 GREAT VALLEY PROPANE INC.
License Type * First Name Middle Name Last Name
Propane Gs SCOTT ERIC ANTKOWIAK
Primary Address Line 1
Yes 57 LANCASTER AVENUE
Address Line 2

City State ZIP Code
MALVERN PA 19355-0000
Phone 1 Phone 2 Fax
4104584767 4103742425
E-mail
SANTKOWIAK@TEVISPROPANE.COM

gvpropane.com

Applicant (This section is not required.)

Search As Owner As Lic. Prof As Contact

Type * First Name MI Last Name
Applicant MICHELLE
Relationship Full Name
Applicant MICHELLE CLANCY
Primary Organization Name
Yes APPLIED & APPROVED PERMITS LLC
Street Address
P.O. BOX 310
Address Line 2

City State Zip Code
PERRY HALL MD 21128
Phone Cell Fax
443-340-1229
E-mail *
MICHELLE@APPLIEDANDAPPROVED.COM

Addtl Info

Est Construction Cost * Housing Units * Number of Buildings * Public Owned
700 0 0 No
Construction Type
329 - Structures Other Than Buildings (Retaining Walls/Tents)


TANK INFORMATION

RESIDENTIAL TANK INFORMATION


Capital Project-No Fee * Capital Project Number Fee Exempt * Roadside Tree Project Permit * Roadside Tree Permit #
 Yes No (Text) Yes No Yes No (Text)
Existing Use * Number of Tanks Installed * Number of Tanks Removed *
SFD 1 (Number) 0 (Number)




ABOVEGROUND/UNDERGROUND PROPANE STORAGE TANKS 120 - 1000 Gallons



DOME



SHROUD

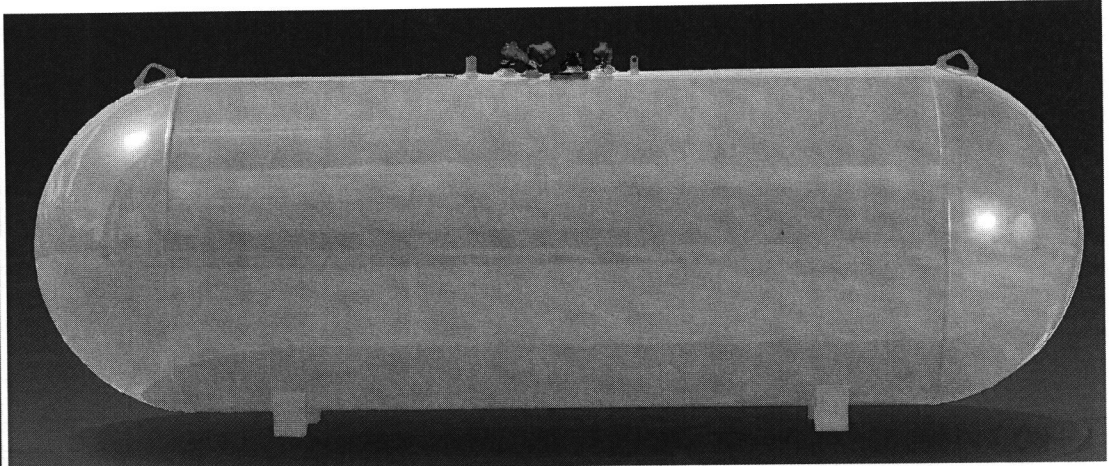

PRESSURE VESSEL CODES & REGISTRATION

- Designed and constructed in accordance with the ASME Section VIII, Division 1 Code
- Registered with the National Board of Boiler & Pressure Vessels Inspectors
- Complies with NFPA 58
- Conforms to specifications set forth by the Railroad Commission of Texas

VESSEL FEATURES

- Tanks fully fitted with RegO valves and Rochester liquid level gauges
- Dual service options for aboveground or underground applications
- Product supplied with steel dome (custom colors available upon request) or plastic AG/UG shroud, specify at time of order
- Container pressure rated at 250 PSI @ 400°F
- Vacuum purged
- Stainless steel data plate
- Anode bolt connection located under the dome
- #54 liquid level outage valve orifice

PROCESS CONTROL

All welded products are x-rayed and pressure tested @ 325 PSI per ASME Sec VIII, Div I requirements, followed by rigorous leak test inspections, both pre and post valving

STORAGE & DISTRIBUTION

Contact Propane Education & Research Council for additional resources and information at propane.com

PAINT SPECIFICATIONS

At the time of order, customer must specify intended application thus determining paint applied at the time of manufacturing

Aboveground tank applications:

- Painted Sky White with super durable TGIC polyester powder paint for maximum rust protection
- Custom colors available upon request
- If an aboveground painted tank is intended for underground use, tank must be field painted for such application

Underground tank applications:

- Painted gray with a "ready to bury", durable epoxy powder paint for underground applications
- Product used underground may require additional protective coating and cathodic protections, contact your federal, state or local authorities for specifications

Made With Pride



Made In the U.S.A.



ABOVEGROUND/UNDERGROUND PROPANE STORAGE TANKS 120 - 1000 Gallons

ABOVEGROUND/UNDERGROUND VESSEL DIMENSIONS & SPECIFICATIONS (All Vessel Dimensions are Approximate)

Part Number	Description	Water Capacity Gal/l	Outside Diameter In/mm	Head Type	Overall Length In/mm	Overall Height In/mm	Leg Width In/mm	Leg Spacing In/mm	Weight Lbs/kg	Quantity	
										Full Load	Per Stack
68280.6	120 Gallon AG/UG Storage Tank, Gray	120 454.2	24" 609.6	Ellip	5' 8" 1727.2	3' 1 3/16" 944.5	10 1/8" 257.2	3' 0" 914.4	312 141.5	96	12
68281.6	250 Gallon AG/UG Storage Tank, Gray	250 946.3	30" 762	Hemi	7' 10" 2387.6	3' 6 15/16" 1090.6	12 3/4" 323.9	3' 6" 1066.8	462 209.5	54	9
68282.6	320 Gallon AG/UG Storage Tank, Gray	320 1211.3	30" 762	Hemi	9' 7" 2921	3' 6 15/16" 1090.6	12 3/4" 323.9	4' 0 1/4" 1225.6	567 257.2	45	9
68283.26**	500 Gallon AG/UG Storage Tank, Gray	500 1892.7	41" 1041.4	Hemi	8' 8 1/2" 2654.3	4' 4" 1320.8	16 1/4" 412.8	3' 6" 1066.8	987 447.7	30	5
68284.26**	1000 Gallon AG/UG Storage Tank, Gray	1000 3785.4	41" 1041.4	Hemi	15' 11" 4851.4	4' 5 3/4" 1365.3	16 1/4" 412.8	9' 0" 2743.2	1739 788.8	15	5

† Federal, state or local regulations may contain specific applicable requirements for protective coatings and cathodic protection. The purchaser and installer are responsible for compliance with such federal, state, local and NFPA industry regulations, including, but not limited to, proper purging prior to putting into service. Cathodic protection is required. Coating (s) must be continuous, uninterrupted and must comply with local, state or national codes or regulations.

* Drain **No Drain

