

Menu Save Reset Cancel Help

Record Detail * (This section is required.)

Permit Type

Building/Residential/Misc/Tanks

Permit Number

828003012

Opened Date

07/31/2025



Description of Work

SFD/ INSTALL (1) 1000 GAL UNDERGROUND PROPANE TANK

[check spelling](#)

Address * (This section is required.)

Search Reset Clear Get Parcel & Owner

Street #	Street Name	Street Type	
11813	CHAPEL WOODS	CT	▼
Unit Type	Unit #	X Coordinate	Y Coordinate
--Select--	▼	-76.93263	39.22875
City	State	Zip Code	Primary
CLARKSVILLE	MD	21029	Yes ▼

Approved 8/1/25
AA

Parcel * (This section is required.)

Search Reset Clear Get Address & Owner

GIS ID *	Parcel	Parcel Area	Land Value	Improved Value	Exemption Value	Plan Area
879131	36	3.44	265200	265200	0	RURAL

Legal Description

LOT 2 3.441 A[]CHAPEL WOODS CT[]MALLANS PROPERTY

[check spelling](#)

Block	Lot	Census Tract	Council Dist	Inspection Dist	Supervisor Dist	Map #	DAP Zone
	2	605101	5				
Plan Area	State Tax Id	Subdivision Name					
	1405411459	MALLANS PROPERTY					
Section	Area	Tax Map					
		29					
Grid	Zoning District	ADC Map					
29-13	RC-DEO	4934-A4					
SDP No.	Final Plan No.	WP File No.					
	F-24-024						
Record Plat No.	WS Contract No.	FDP No.			Primary	▼	
8787					Yes		
Owner Occupied	Year Built	Historic District					
☐ Yes ☒ No		☐ Yes ☒ No					
Historic District Registry No.	Stat Area	Flood Plain					
	5-03	☐ Yes ☒ No					
Building No							

Owner * (This section is required.)

Search Reset Clear

Name *

CHANL

Address Line 1

11808 BARE SKY LN

Address Line 2

Address Line 3

Mail City.
COLUMBIA
Mail State
MD
Mail Zip Code
21044
Phone
443-610-7514
Primary
Yes
E-mail

Cell Number Fax Number

Professionals (This section is not required.)

License # *
20020089549
License Type *
Plumb/Gas
Primary
Yes
Business Name
TEVIS OIL, INC.
First Name
FRANK
Middle Name
E
Last Name
HENSLEY
Address Line 1
82 JOHN STREET
Address Line 2
City
WESTMINSTER
State
MD
ZIP Code
21157-0000
Phone 1
4432777364
Phone 2
Fax
E-mail
FHENSLEY@MODERNCOMFORTSYSTEMS.COM

Applicant (This section is not required.)

Search As Owner As Lic. Prof As Contact

Type *
Applicant
Relationship
Applicant
Primary
Yes
First Name
MICHELLE
MI
Last Name
CLANCY
Full Name
MICHELLE CLANCY
Organization Name
APPLIED & APPROVED PERMITS LLC
Street Address
P.O. BOX 310
Address Line 2
City
PERRY HALL
State
MD
Zip Code
21128
Phone
443-340-1229
Cell
Fax
E-mail *
MICHELLE@APPLIEDANDAPPROVED.COM


Addtl Info

Est Construction Cost *
1200
Housing Units *
0
Number of Buildings *
0
Public Owned
No
Construction Type
--Select--

TANK INFORMATION

RESIDENTIAL TANK INFORMATION


Capital Project-No Fee * Capital Project Number Fee Exempt * Roadside Tree Project Permit * Roadside Tree Permit #
☐ Yes ☐ No (Text) ☐ Yes ☐ No ☐ Yes ☒ No (Text)
Existing Use * Number of Tanks Installed * Number of Tanks Removed *
SFD 1 (Number) 0 (Number)

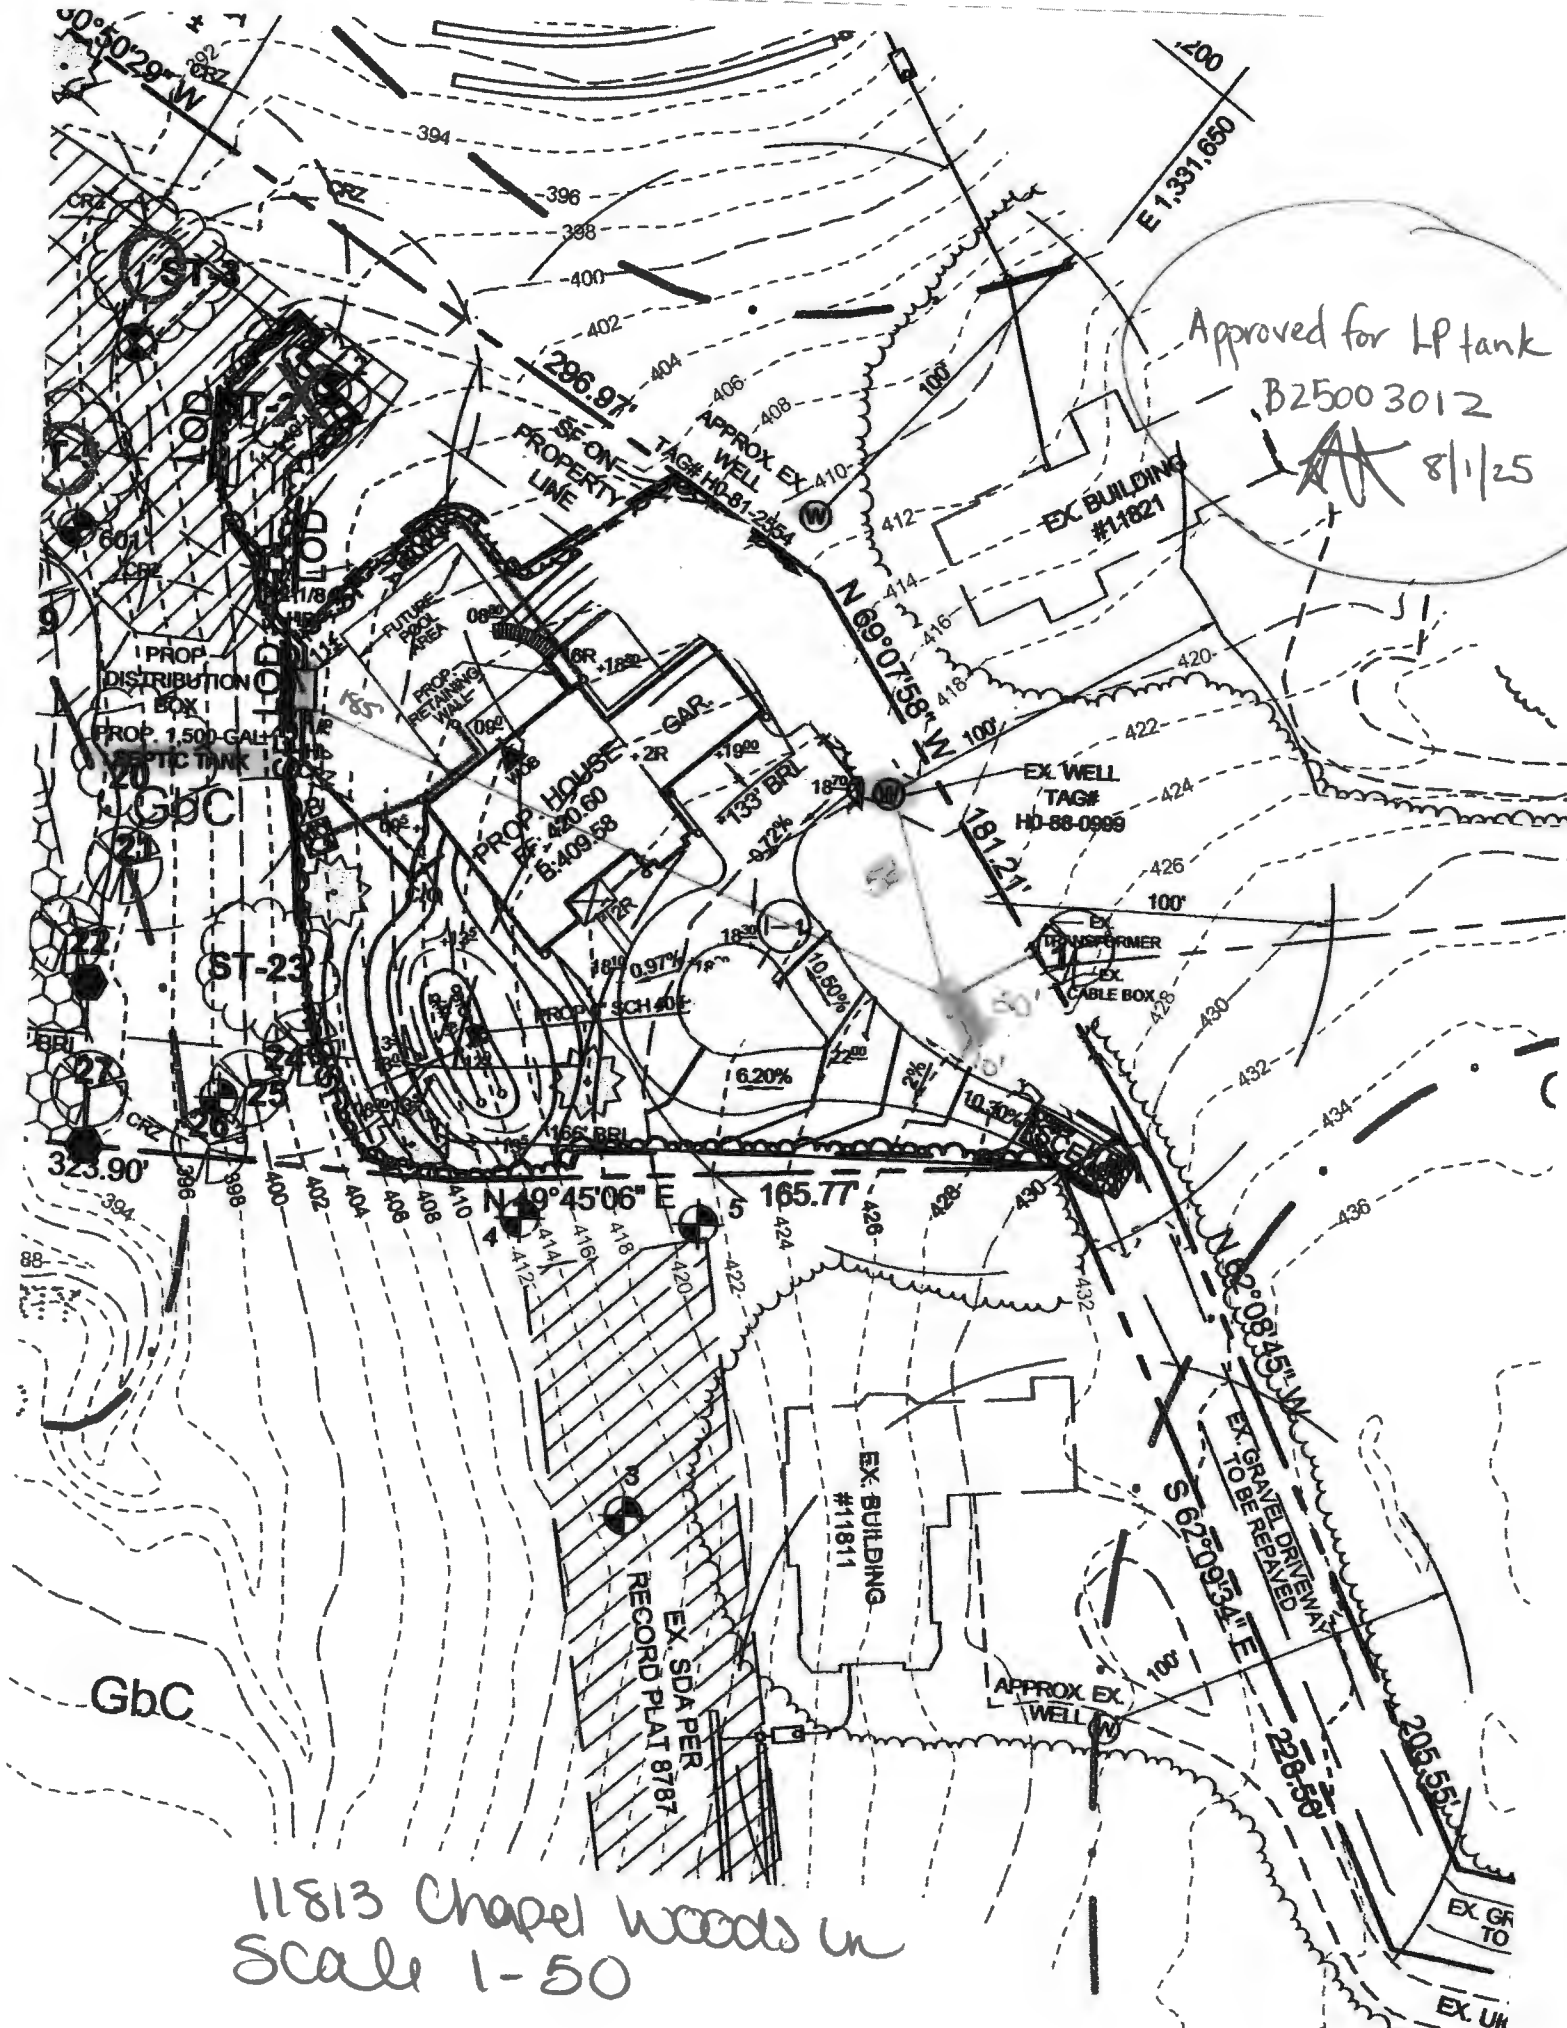

Approved for LP tank
B2500 3012
8/1/25


11813 Chapel Woods Ln
Scale 1-50

7 LOCATED AND SHOWN AS THUS (0).

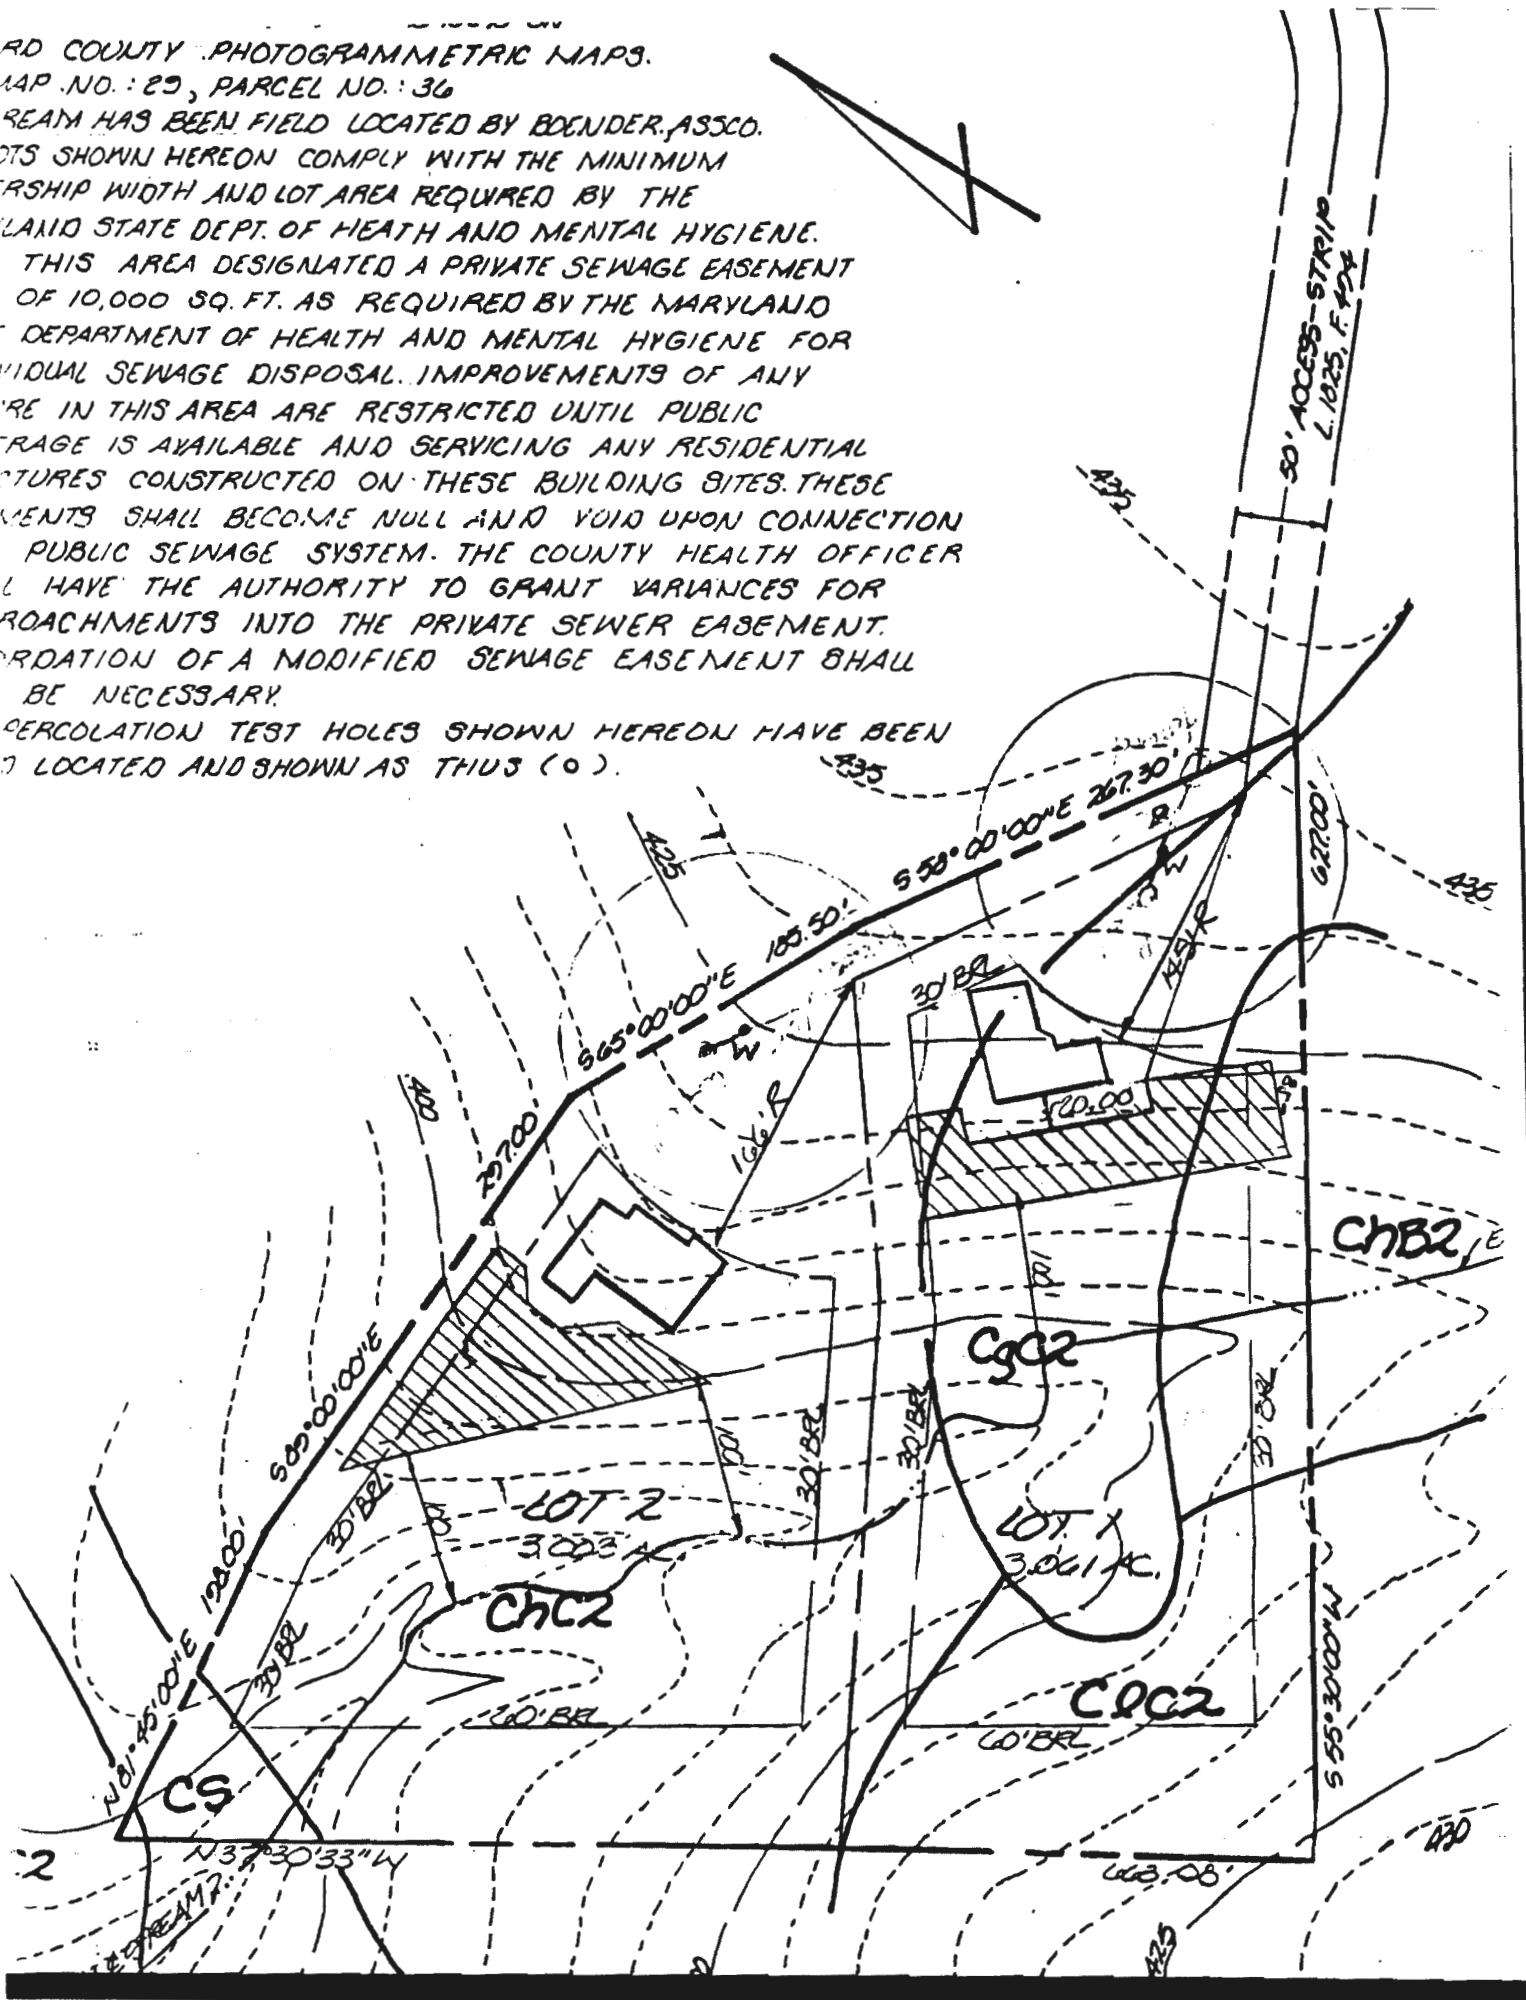

NOTES:

1. BOUNDARY SHOWN HEREON BASED ON A DEED PLOTTING.
2. TOPOGRAPHY SHOWN HEREON BASED ON HOWARD COUNTY PHOTOGRAMMETRIC MAPS.
3. TAX MAP: 29
4. PARCEL: 36
5. EX. STREAM HAS BEEN FIELD LOCATED BY BOENDER ASSOCIATES.

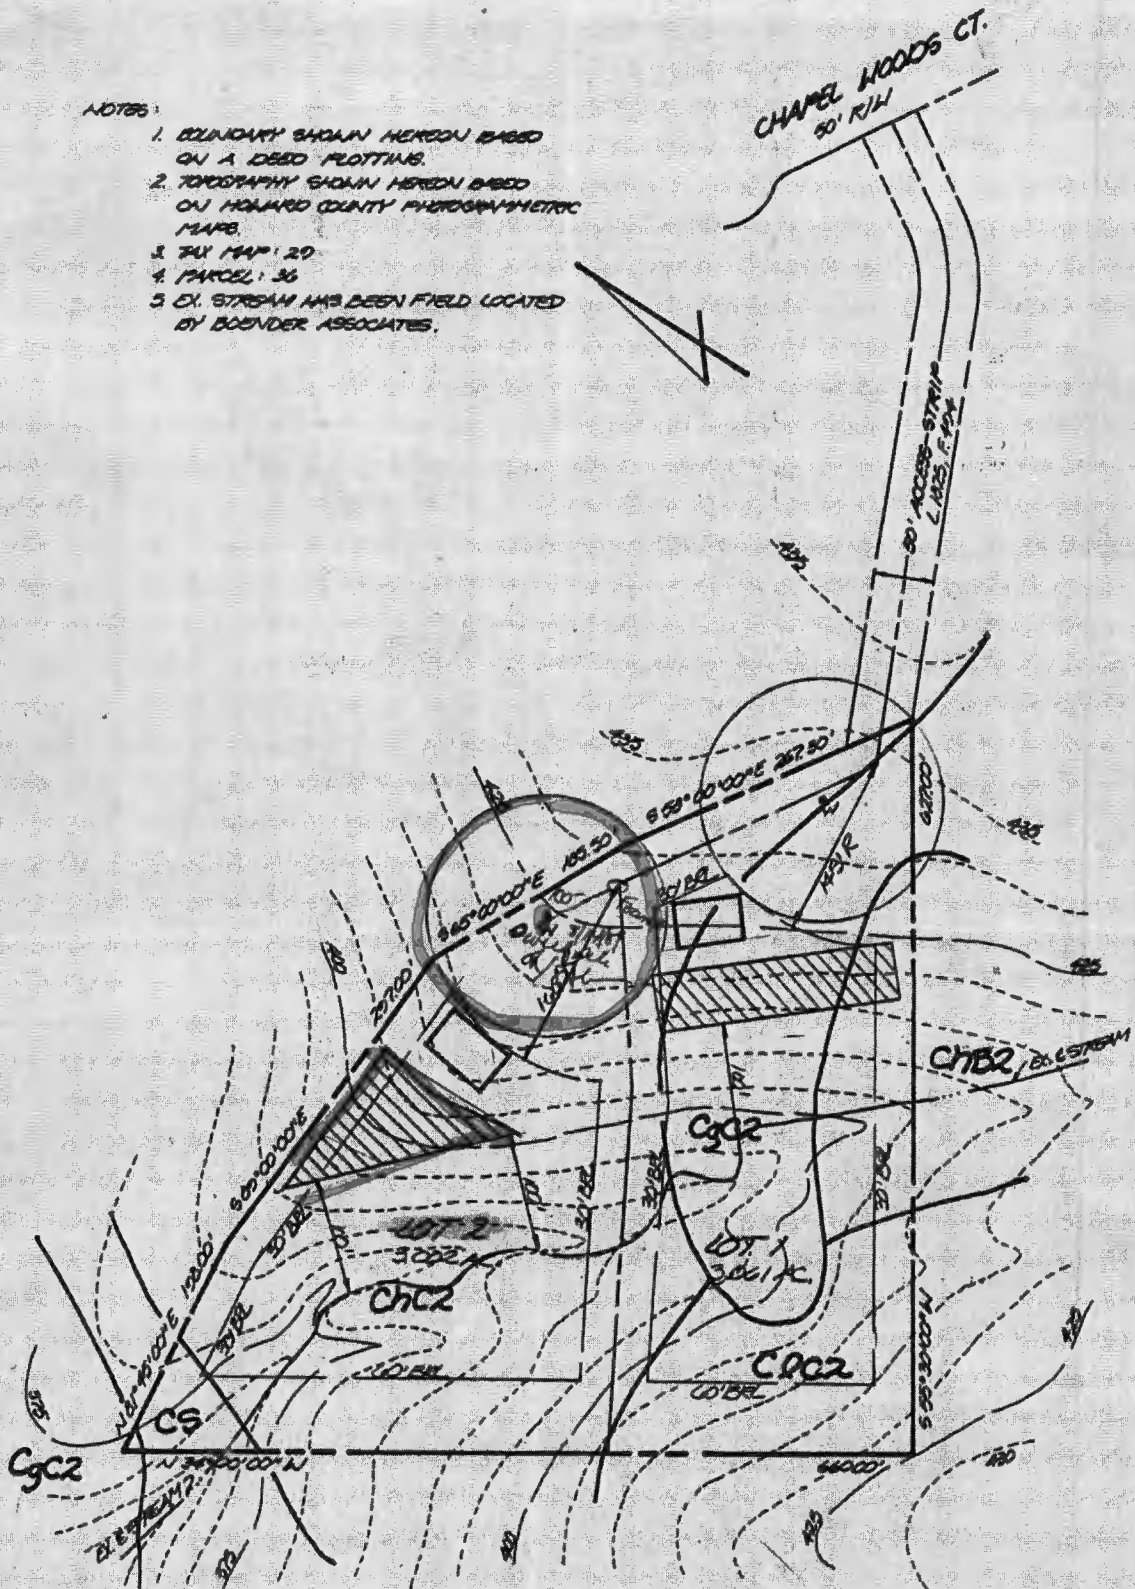

TITLE: PERCOLATION TEST PLAT				
PROJECT: REA PROPERTY				
LOCATION: 5 TH ELECTION DISTRICT HOWARD CO., MD.				
SCALE: 1" = 100'	DESIGNED BY: —	DRAWN BY: J.C.O.	CHECKED BY: L.E.B.	DATE: 9/27/1988
FIELD BOOK: —	PAGE NO.: —	JOB NO.: 06927	DRAWING NO.: 1 OF 1	

boender associates
inc.
consulting engineers
land surveyors
land planners

COURTHOUSE SQUARE
3865 ELLICOTT MILLS DRIVE
ELLICOTT CITY, MD. 21043
(301) 465-7777




UNDERGROUND PROPANE STORAGE TANKS 120 - 1000 Gallons



SHROUD
For 500 & 1,000
gallon tanks



SHROUD
For 120, 250
& 320
gallon tanks

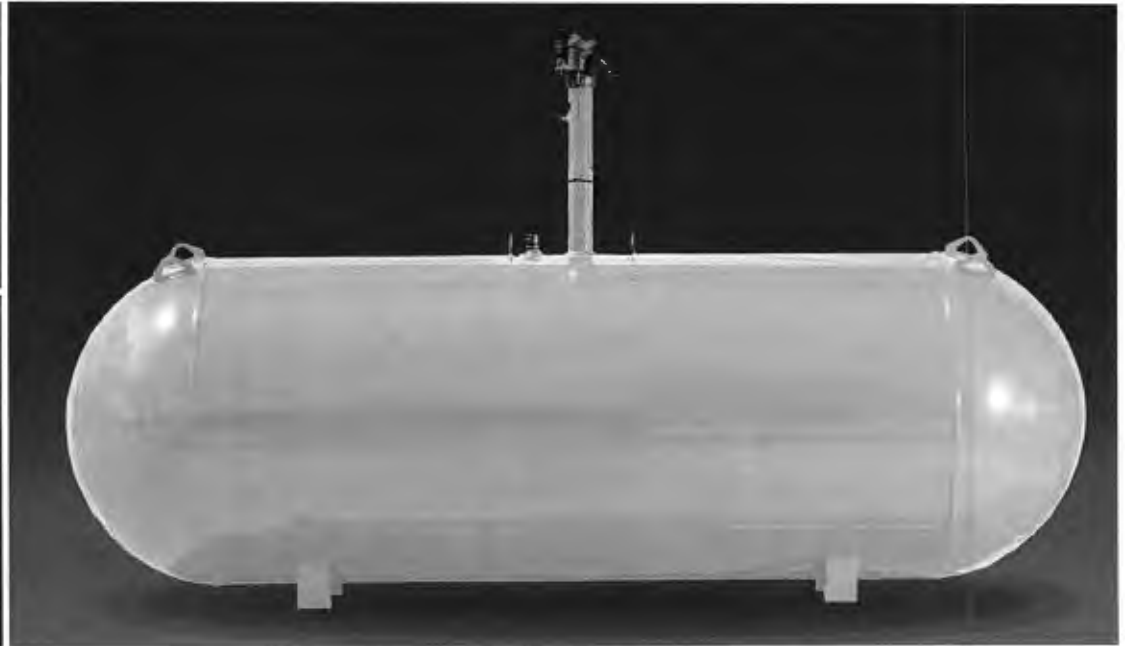

PRESSURE VESSEL CODES & REGISTRATION

- Designed and constructed in accordance with the ASME Section VIII, Division 1 Code
- Registered with the National Board of Boiler & Pressure Vessels Inspectors
- Complies with NFPA 58
- Conforms to specifications set forth by the Railroad Commission of Texas

PAINT SPECIFICATIONS

- Epoxy powder paint for maximum rust protection
- Tanks painted gray
- Ready to bury durable epoxy powder coating†

SHROUD FEATURES (500 & 1,000 gallon)

- Durable construction
- Large opening for easy filling and maintenance
- Recessed markers to indicate proper burial depth
- Permanent hole for mounting location flag
- Access on sides for flexible riser connection
- New shroud available for 500 gallon and 1,000 gallon UG tanks, shroud dimensions:
 - * Shroud for long riser 32 3/16" X 26 5/16"
 - * Shroud for short riser 19 3/8" X 26 5/16"

VESSEL FEATURES

- Tanks fully fitted with RegO valves and Rochester liquid level gauges
- Container pressure rated at 250 PSI @ 400°F
- Vacuum purged
- Duplicate data plate is zip tied on the riser pipe below the anode bolt connection for convenience
- Product is offered with 14" short or 28" tall risers
- Anode bolt connection located under the dome
- Short or tall plastic shroud assemblies (w/lid) supplied accordingly
- #54 liquid level outage valve orifice

PROCESS CONTROL

All welded products are x-rayed and pressure tested @ 325 PSI per ASME Sec VIII, Div 1 requirements, followed by rigorous leak test inspections, both pre and post valving

STORAGE & DISTRIBUTION

Contact Propane Education & Research Council for additional resources and information at propane.com

Made With Pride



Made In the U.S.A.



UNDERGROUND PROPANE STORAGE TANKS 120 - 1000 Gallons

UNDERGROUND VESSEL DIMENSIONS & SPECIFICATIONS

(All Vessel Dimensions are Approximate)

Part Number	Description	Water Capacity Gal/l	Outside Diameter In/mm	Head Type	Overall Length In/mm	Overall Riser Height In/mm		Leg Width In/mm	Leg Spacing In/mm	Weight Lbs/kg	Quantity	
						18" Riser	28" Riser				Full Load	Per Stack
68289	120 Gallon Underground LR Storage Tank	120 454.2	24" 609.6	Ellip	5' 8" 1727.2	— —	4' 7 13/16" 1417.6	10 1/8" 257.2	3' 0" 914.4	342 155.4	63	9
68269	120 Gallon Underground SR Storage Tank	120 454.2	24" 609.6	Ellip	5' 8" 1727.2	3' 9 1/4" 1149.4	— —	10 1/8" 257.2	3' 6" 914.4	329 149.2	72	9
68288	250 Gallon Underground LR Storage Tank	250 946.3	30" 762	Hemi	7' 10" 2387.6	— —	5' 1 9/16" 1563.7	12 3/4" 323.9	3' 6" 1066.8	494 224.1	42	7
68271	250 Gallon Underground SR Storage Tank	250 946.3	30" 762	Hemi	7' 10" 2387.6	4' 3" 1295.4	— —	12 3/4" 323.9	3' 6" 1066.8	480 217.7	42	7
68273	320 Gallon Underground LR Storage Tank	320 1211.3	30" 762	Hemi	9' 7" 2921	— —	5' 1 9/16" 1563.7	12 3/4" 323.9	4' 0 1/4" 1225.6	597 270.8	35	7
68285	320 Gallon Underground SR Storage Tank	320 1211.3	30" 762	Hemi	9' 7" 2921	4' 3" 1295.4	— —	12 3/4" 323.9	4' 0 1/4" 1225.6	593 269	35	7
68275	500 Gallon Underground LR Storage Tank	500 1892.7	37.5" 952.5	Hemi	9' 10" 2997.2	— —	5' 9 3/8" 1762.1	15" 381	5' 0" 1524	953 432.3	25	5
68286	500 Gallon Underground SR Storage Tank	500 1892.7	37.5" 952.5	Hemi	9' 10" 2997.2	4' 8 1/2" 1435.1	— —	15" 381	5' 0" 1524	949 430.5	25	5
68277	1000 Gallon Underground LR Storage Tank	1000 3785.4	41" 1041.4	Hemi	15' 11" 4851.4	— —	6' 3/16" 1849.4	16 1/4" 412.8	9' 0" 2743.2	1812 821.9	12	4
68287	1000 Gallon Underground SR Storage Tank	1000 3785.4	41" 1041.4	Hemi	15' 11" 4851.4	5' 0" 1524	— —	16 1/4" 412.8	9' 0" 2743.2	1793 813.3	12	4

† Federal, state or local regulations may contain specific applicable requirements for protective coatings and cathodic protection. The purchaser and installer are responsible for compliance with such federal, state, local and NFPA industry regulations, including, but not limited to, proper purging prior to putting into service. Cathodic protection is required. Coating(s) must be continuous, uninterrupted and must comply with local, state or national codes or regulations.

