

11/18/93
A.M.A.S.A.P.
11/19/93 AM
11/22/93 PM

05-463699

PERMIT

SEWAGE DISPOSAL SYSTEM

DEPARTMENT OF HEALTH AND MENTAL HYGIENE

P 49660

A 41345

DISTRICT 5th

DATE 10/5/93

DATE SYSTEM APPROVED 11/23/93

INSPECTOR M. Rifkin

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
~~461-9933~~ 313-2640

INDEXED

Charles A. Klein & Sons, Inc. IS PERMITTED TO INSTALL ALTER

ADDRESS 5220 Klees Mill Road, Sykesville, Maryland 21784 PHONE 549-6960

SUBDIVISION Ashleigh Greene LOT 29 ROAD 11807 Wollingford Court

PROPERTY OWNER Brian Boy

ADDRESS _____

SEPTIC TANK CAPACITY 1500 GALLONS

NUMBER OF BEDROOMS 5

210 SQUARE FEET PER BEDROOM

210
5
4 | 1025.00
202.5 30.90

LINEAR FEET OF TRENCH REQUIRED 263

TRENCHES - Trench to be 2 feet wide. Inlet 4.5 feet below original grade. Bottom maximum depth 8.5 feet below original grade. Effective area begins at 4.5 feet below original grade. 4 feet of stone below distribution pipe.

LOCATION - Starting from the intersection of the 29.25' and 545.51' lot lines, place the distribution box 320 feet down the 545.51' and 80' off this same lot line.

Run trenches on contour in both directions.
NOTES - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank. OK MR 10/5/93

PLANS APPROVED BY Mark Rifkin REVISED _____ DATE 9/09/93

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS, 90° ELBOWS NOT ACCEPTABLE.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(ES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(ES)

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 35/40 PVC OR ABS


PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL STAND PIPES MUST BE 6 INCHES IN DIAMETER CAST IRON. CONCRETE OR TERRA COTTA OR PVA OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET. MANHOLE TO GRADE REQUIRED.

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

***INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT**

A
41345

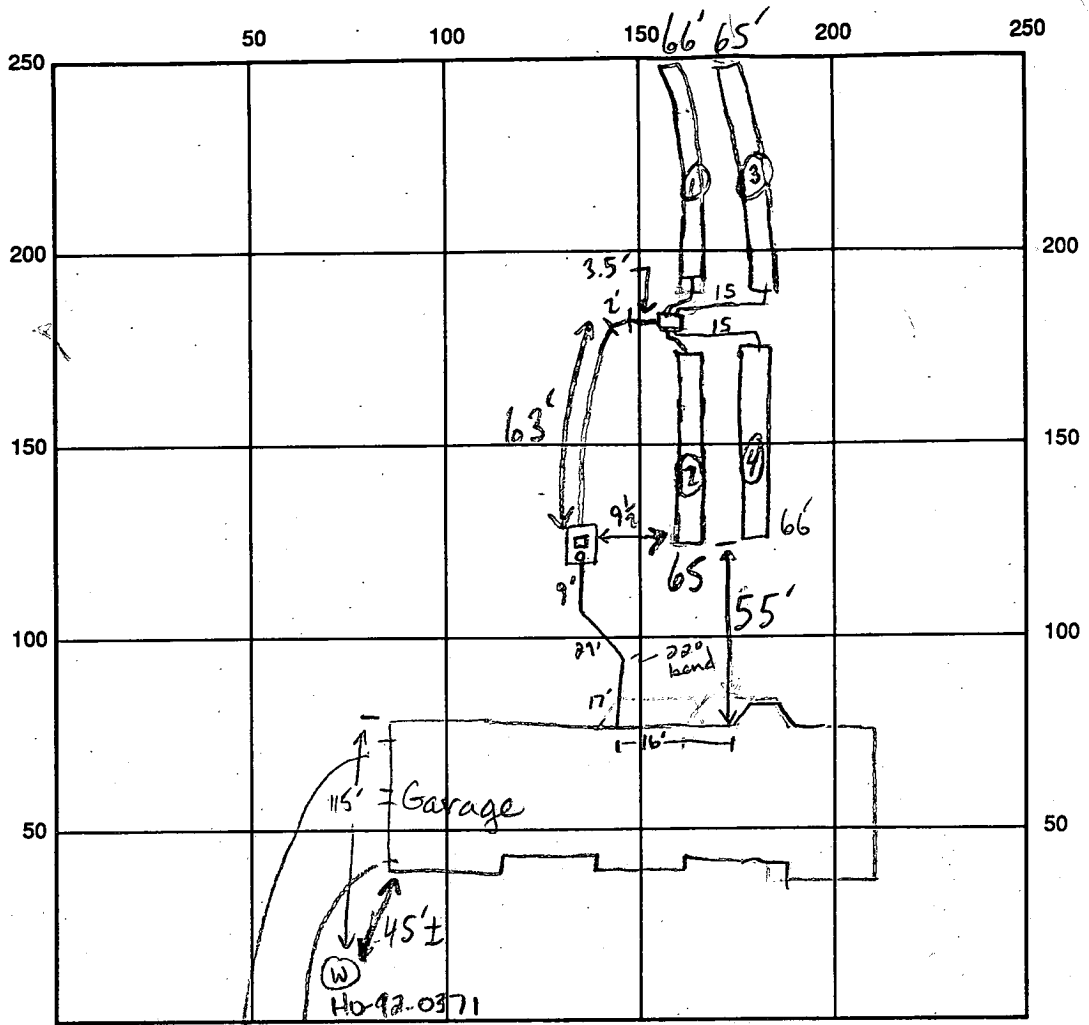

81
 49
 2.0
 196
 98
 117

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

Wollington Court

SEPTIC TANK LEVEL 2000 gallon - OK CLEANOUTS S.T. - OK (8" & MANHOLE)

DISTRIBUTION BOX LEVEL OK - BAFFLE IN

DRAIN FIELD/TITLE DEPTH $\frac{1}{2} \frac{2}{3} \frac{3}{4}$ 8.5 FT. TRENCH WIDTH 2 FT. INLET DEPTH $\frac{1}{2} \frac{2}{3} \frac{3}{4}$ 3.4 FT.

EFFECTIVE GRAVEL DEPTH $\frac{1}{2} \frac{2}{3} \frac{3}{4}$ 4.4 FT. TOTAL LENGTH 166 FT.

NUMBER OF TRENCHES 4 ONE SIDEWALL/BOTTOM AREA 264 SQ. FT.

DRYWALL INSIDE DIAMETER — FT. EFFECTIVE DEPTH BELOW INLET — FT.

ABSORBENT AREA 1052 SQ. FT.

REMARKS: 11-18-93 OK to cover line from house to last bend before septic tank. TEN
11/19/93 #1 CONTINUE MR 11/19/93 #2 STONE TRENCH @, CONTINUE MR
11/22/93 OK - CONTINUE MR
11/23/93 #1 OK - CONTINUE MR 11/23/93 #2 OK TO COVER MR

DATE SYSTEM APPROVED 11/23/93 INSPECTOR M. Rifkin

APPLICATION

PERCOLATION TESTING

A 41345

P _____

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
P.O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 461-9933

WS

DISTRICT 5th

DATE 2/2/88

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM

Brian Boy

PROPERTY OWNER Winchester Homes, Inc. Real Estate Development Group

ADDRESS 6301 Ivy Lane, Suite 714 PHONE 379-0157
Greenbelt, Maryland 20770 301-220-1117

PROSPECTIVE BUYER _____

ADDRESS _____ PHONE _____

PROPERTY LOCATION:

Prelim Lot-29

SUBDIVISION Ashleigh Greene Section II LOT NO. 27

ROAD AND DESCRIPTION Intersections Browns Bridge Road/Hall Shop Road,
Hall Shop Road/Simpson Road (11807 Wollingford Court)

TAX MAP 41 PARCEL # 174

SIZE OF LOT 3.0 Ac. TYPE BLDG SF
(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE

FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY

WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT. *B. H. Hauke*
(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 4-22-88 For perc hole locations and subdivision
plat approval DEN.

BLDG. PERMIT SIGNED
AND RETURNED 9/9/90
Serial # 50357 - SFD

5 Bedrooms

THIS IS NOT A PERMIT

HD-216

B 1 05431 SEQUENCE NO. (DP USE ONLY)
(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)


STATE OF MARYLAND PERMIT TO DRILL WELL please print or type

STATE PERMIT NUMBER HD-92-0371 fill in this form completely

Date Received (APA) 052793 OWNER INFORMATION
WINCHESTER HOMES
818 W DIAMOND AVE
GAITHERSBURG MD 20878

B 3 LOCATION OF WELL
HOWARD
ASALEIGH CREEVE
SECTION 2 LOT 29
HIGHLAND
MILES FROM TOWN 2 MI

DRILLER INFORMATION
George F. Easterday
L. Franklin Easterday, Inc.
9265 Brown Church Rd., Mt. Airy, Md. 21771
Address: George F. Easterday 4/26/93

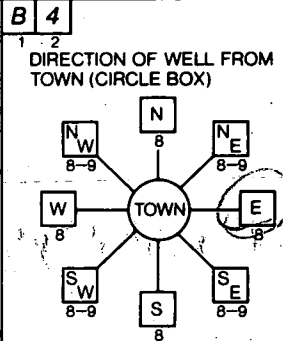

B 4 WALLINGFORD CT
NEAR WHAT ROAD
ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX)
DISTANCE FROM ROAD 600 FT

B 2 WELL INFORMATION
APPROX. PUMPING RATE (GAL. PER MIN.) 5
AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 500

NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL
Howard A41345
COUNTY NAME COUNTY NO.
DATE ISSUED 052193
CO SIGNATURE James E. Mademan 5-21-94
NORTH GRID 486000 EAST GRID 0821000


USE FOR WATER (CIRCLE APPROPRIATE BOX)
D HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY)
F FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION)
I INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT)
P PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE HEALTH DEPARTMENT APPROVAL)
T TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)

APPROXIMATE DEPTH OF WELL 200 FEET
APPROXIMATE DIAMETER OF WELL 6 INCH

SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X
SOURCES OF DRILLING WATER well
WRITE THE BOX NUMBER FROM THE MAP HERE
840
480

METHOD OF DRILLING (circle one)
BORED (or Augered) JETTED Jetted & DRIVEN
AIR-ROTARY AIR-Percussion ROTARY (Hydraulic Rotary)
CABLE REVERSE-ROTARY Drive-POINT

REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX)
N THIS WELL WILL NOT REPLACE AN EXISTING WELL
Y THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED
S THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS-A-STANDBY
D THIS WELL WILL DEEPEM AN EXISTING WELL
PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEMED (IF AVAILABLE)

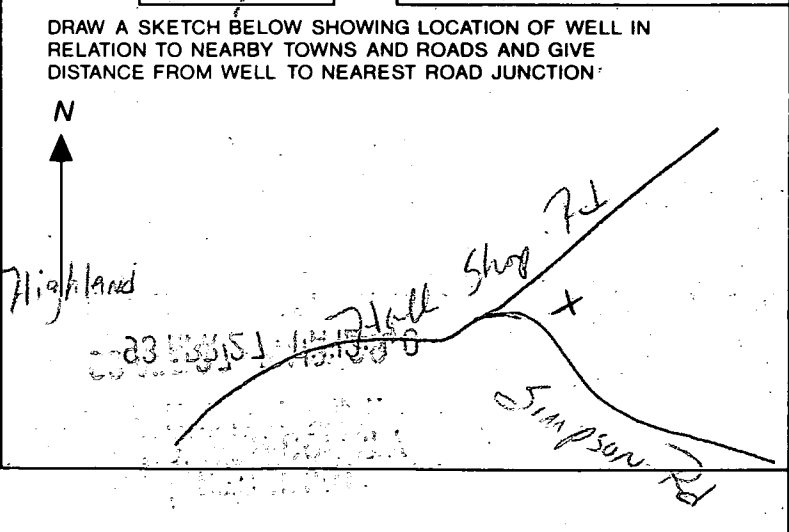

Not to be filled in by driller (OEP USE ONLY)
APPROX. PERMIT NUMBER GAP
FORCE MAIN PERMIT No. 40-92-0371

SPECIAL CONDITIONS

C1 7897

SEQUENCE NO. (DENV USE ONLY)

STATE OF MARYLAND WELL COMPLETION REPORT

FILL IN THIS FORM COMPLETELY PLEASE PRINT OR TYPE

THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED.

COUNTY NUMBER

A41345

ST/CO USE ONLY

DATE RECEIVED

DATE WELL COMPLETED

Depth of Well

PERMIT NO. FROM "PERMIT TO DRILL WELL"

DATE RECEIVED grid

DATE WELL COMPLETED grid

Depth of Well grid

PERMIT NO. grid

OWNER Winchester James last name Wallingford first name TOWN Highland SUBDIVISION Ashcroft Green SECTION 2 LOT 29

WELL LOG Not required for driven wells STATE THE KIND OF FORMATIONS PENETRATED, THEIR COLOR, DEPTH, THICKNESS AND IF WATER BEARING

Table with columns: DESCRIPTION, FEET FROM, FEET TO, Check if water bearing. Rows include TOP soil, Red Clay, Sand Silt, Clay, Sand Stone, Gray Mica, Sand Stone, Gray Mica, Sand Stone, Gray Mica.

GROUTING RECORD WELL HAS BEEN GROUTED (Circle Appropriate Box) TYPE OF GROUTING MATERIAL CEMENT CM BENTONITE CLAY BC NO. OF BAGS 22 NO. OF POUNDS 200 GALLONS OF WATER 150 DEPTH OF GROUT SEAL (to nearest foot) from 0 ft. to 0 ft.

CASING RECORD casing types insert appropriate code below MAIN CASING TYPE ST Nominal diameter top (main) casing (nearest inch) 6 Total depth of main casing (nearest foot) 84

OTHER CASING (if used) diameter inch depth (feet) from to

SCREEN RECORD screen type or open hole insert appropriate code below ST STEEL BR BRASS BRONZE PL PLASTIC HO OPEN HOLE OT OTHER

DEPTH (nearest ft.) HO 82 400 SLOT SIZE 1 2 3 DIAMETER OF SCREEN 56 (NEAREST INCH) from to

CIRCLE APPROPRIATE LETTER A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED. E ELECTRIC LOG OBTAINED. P TEST WELL CONVERTED TO PRODUCTION WELL.

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 26.04.04 "WELL CONSTRUCTION" AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE ABOVE CAPTIONED PERMIT...

DRILLERS IDENT. NO. 40

DRILLERS SIGNATURE (MUST MATCH SIGNATURE ON APPLICATION)


SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)

GRAVEL PACK IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68

OEP USE ONLY (NOT TO BE FILLED IN BY DRILLER) T (E.R.O.S.) WQ (74 75 76) TELESCOPE CASING LOG INDICATOR OTHER DATA

PUMPING TEST HOURS PUMPED (nearest hour) 8 9 PUMPING RATE (gal. per min. to nearest gal.) 11 15 METHOD USED TO MEASURE PUMPING RATE WATER LEVEL (distance from land surface) BEFORE PUMPING 17 20 WHEN PUMPING 22 25 TYPE OF PUMP USED (for test) A air P piston T turbine C centrifugal R rotary O other (describe below) J jet S submersible

PUMP INSTALLED DRILLER WILL INSTALL PUMP (CIRCLE) (YES or NO) YES IF DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS EXCEPT HOME USE TYPE OF PUMP INSTALLED PLACE (A,C,J,P,R,S,T,O) IN BOX - SEE ABOVE: CAPACITY: GALLONS PER MINUTE (to nearest gallon) PUMP HORSE POWER PUMP COLUMN LENGTH (nearest ft.) CASING HEIGHT (circle appropriate box and enter casing height) + above - below LAND SURFACE 2 (nearest foot)

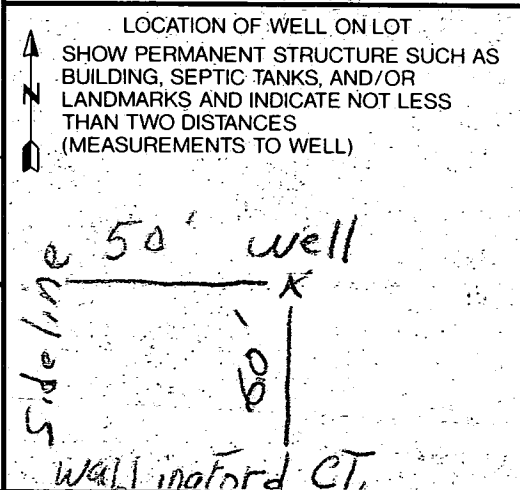

COUNTY

11/30/93
Anytime

HOWARD COUNTY HEALTH DEPARTMENT
Bureau of Environmental Health
3525-H Ellicott Mills Drive
Ellicott City, MD 21043
461-9933

MUD COVERED
Final
11/30/93
No INSPECT
C.B.D.

APPLICATION FOR PITLESS ADAPTER, WELL PUMP AND PRESSURE TANK INSTALLATION

PITLESS ADAPTER (MUD COVERED)
WELL PUMP (Line)

[Backfilled except at casing] C.B.D.

New Installation Replacement X

Receipt # 0
Date 10/5/93

Name of Installer CHARLES A. KLEIN + SONS

Telephone 549 6960

License Number 6551

Certified Well Pump Installer _____ Well Driller _____ Registered Plumber _____

Name of Property Owner BRIAN BOY

Telephone 604-7453

Subdivision Ashleigh GREENE Lot # 09

Well Tag # HO-92-0371

Site Address 11807 Wollingford Ct

11/30

Pump

- 1. Type
 - a. Deep well jet _____
 - b. Shallow well jet _____
 - c. Submersible _____
- 2. Make _____
- 3. Model # _____
- 4. Capacity _____ GPM
- 5. Pump exceeds well capacity Yes _____ No _____
- 6. If Yes, is low pressure cutoff switch installed? Yes _____ No _____
- 7. What methods are used to protect the pump and electrical wiring from vibrations? Torque arrestors _____ Cable guards _____ Other _____

Motor

- 1. Horsepower _____
- 2. RPM _____
- 3. Voltage _____
 - a. 110 _____
 - b. 220 _____

Pitless Adapter

- 1. Make _____
- 2. Model # _____
- 3. Depth _____

Tank

- 1. Capacity _____
- 2. Pressure relief valve? _____

Piping

- 1. Type _____
- 2. Size _____
- 3. NSF and/or BOCA Code approved _____
- 4. Depth of supply line _____

Well data

- 1. Depth _____ ft.
- 2. Yield _____ GPM
- 3. Static water level _____ ft.
- 4. Will water supply be disinfected by installer? _____

I understand that it is my responsibility to notify the Howard County Health Department when the installation is ready for inspection (otherwise this permit is null and void).

All information given above is true to the best of my knowledge.

Signature of Applicant: Charles Klein


Date: 10/5/93

11/30
(No inspection card)

Note: A sticker indicating approval/status of the installation will be placed on the well casing at the time of the inspection.

HD-215

Note: (1) No inspection 11/30/93 P.M.
(2) all covered with mud @ 2:20 P.M.
C.B.D.

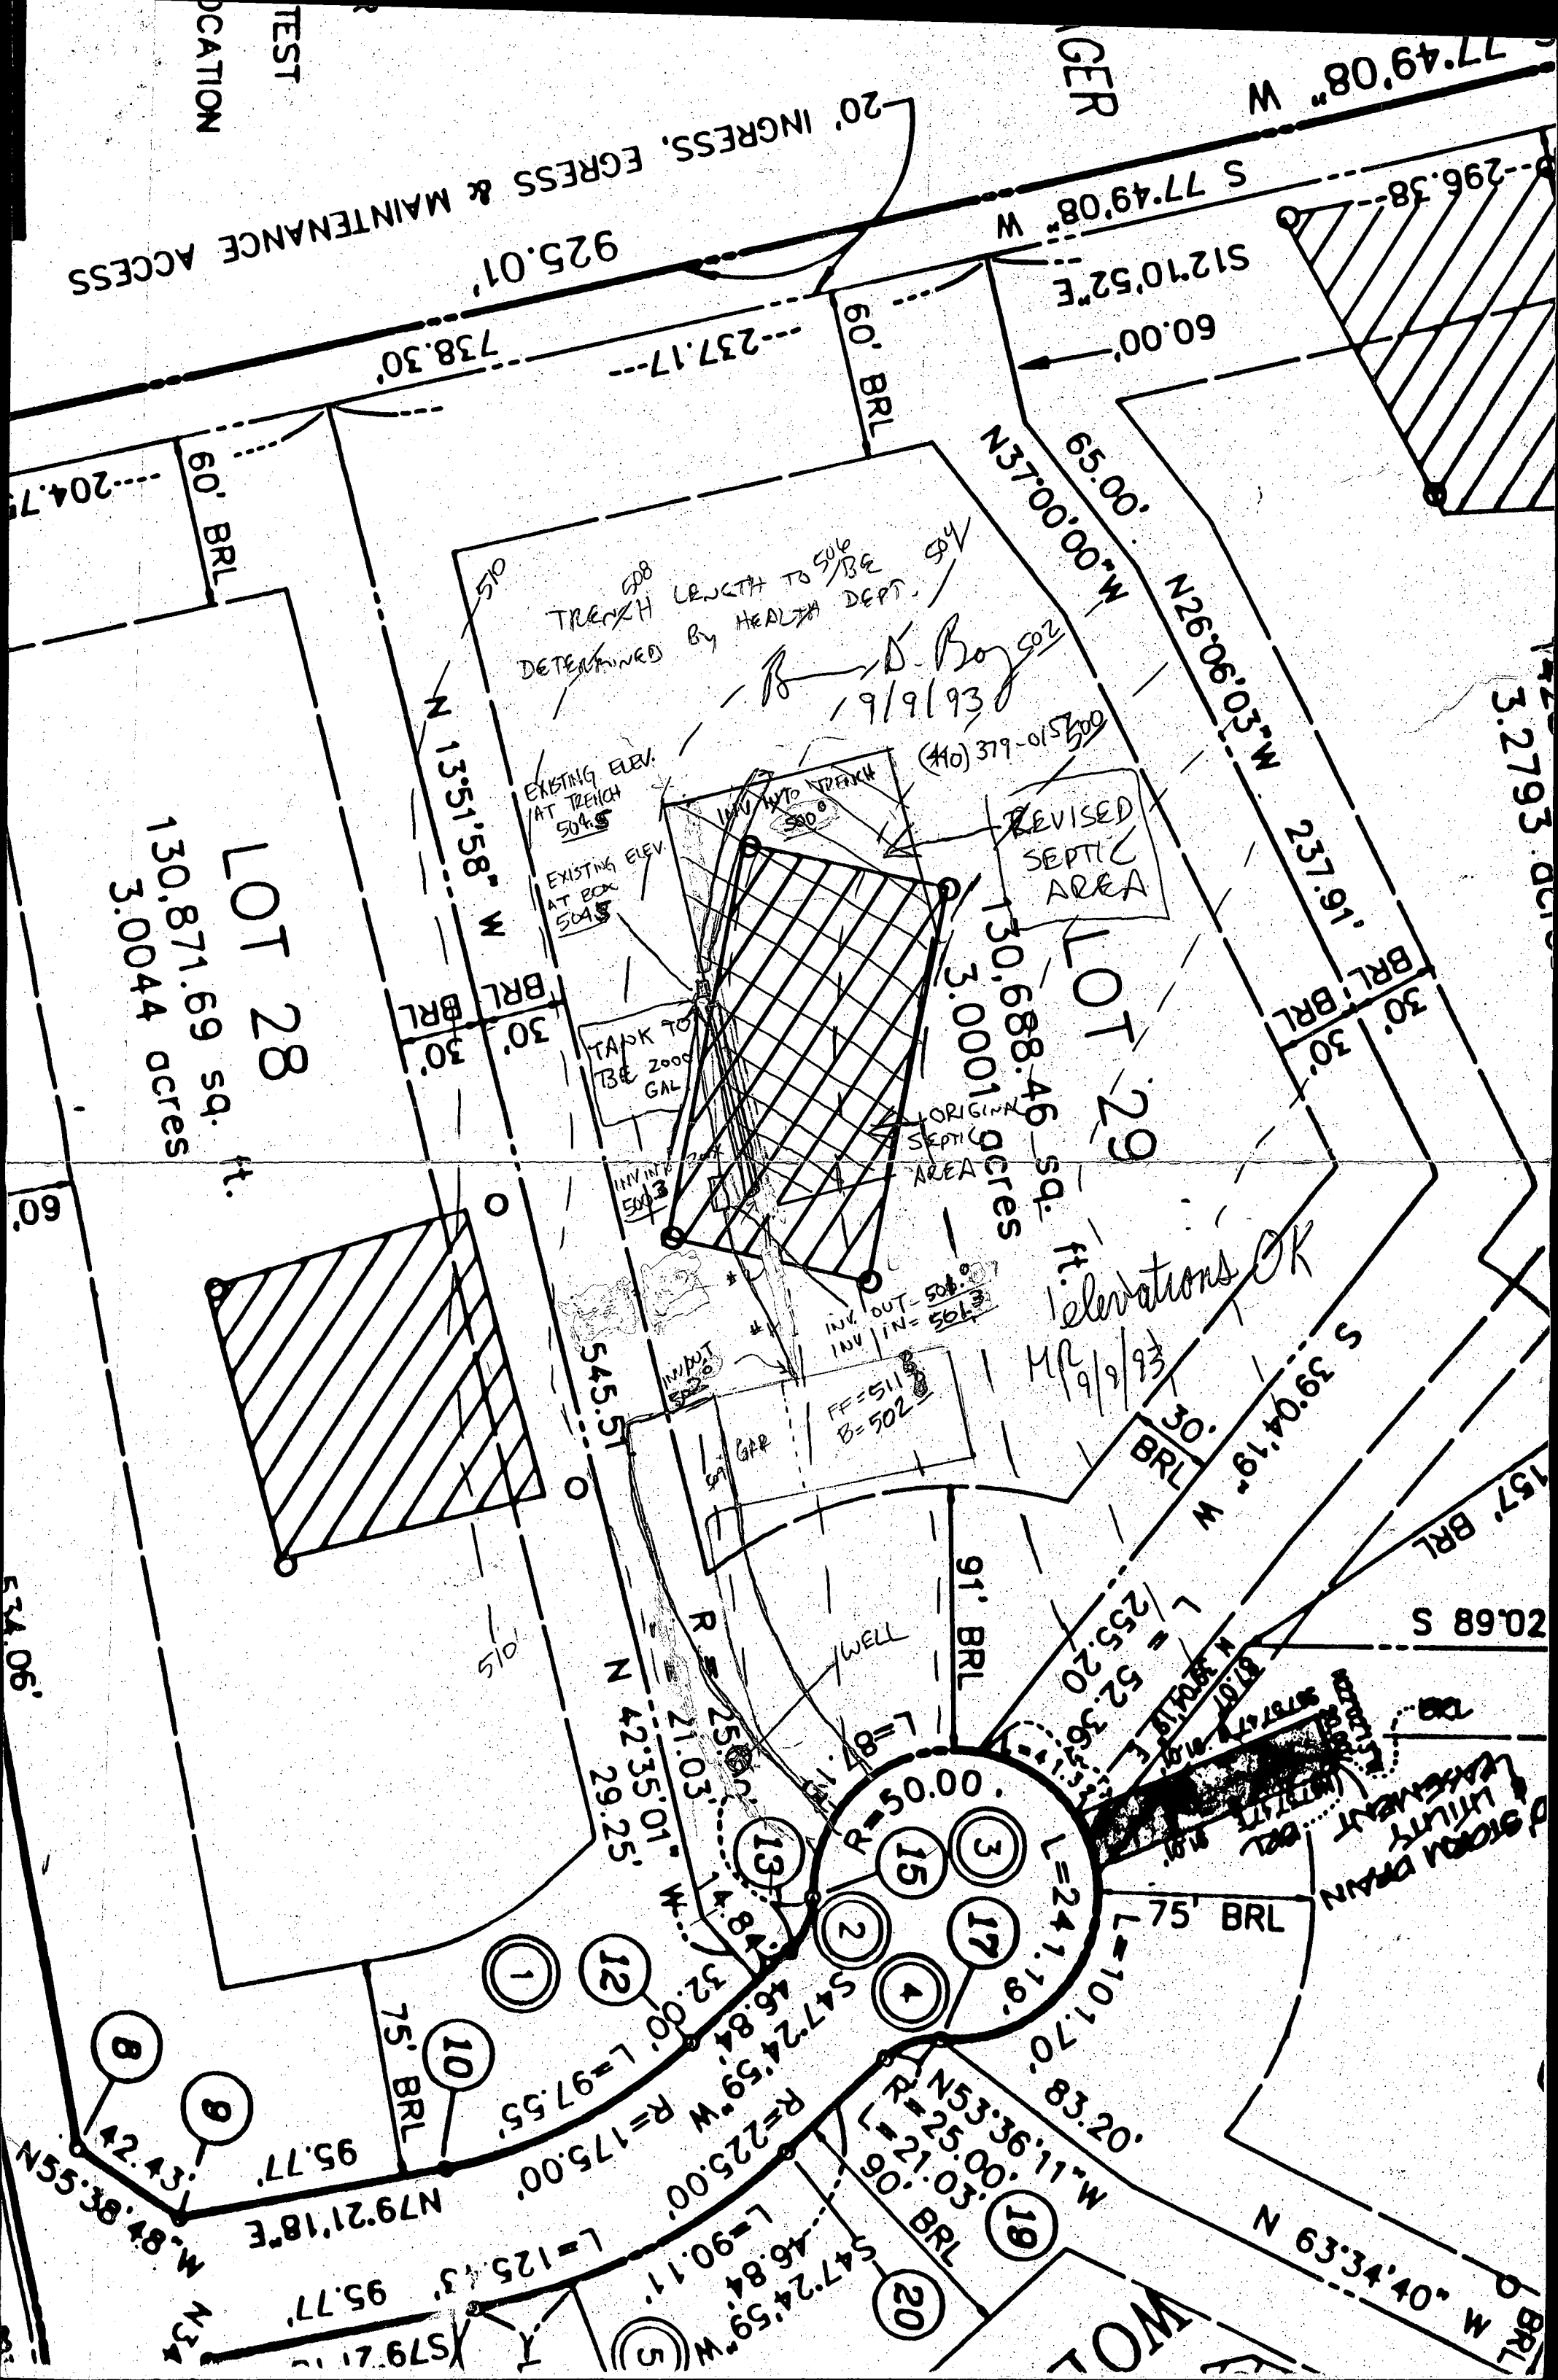

20' INGRESS, EGRESS & MAINTENANCE ACCESS
925.01'
738.30'
237.17'60' BRL

LOT 28
130,871.69 sq. ft.
3.0044 acres

LOT 29
130,688.46 sq. ft.
3.0001 acres

TRENCH LENGTH TO SUB/BE DETERMINED BY HEALTH DEPT.
9/9/93
R. D. Boy

EXISTING ELEV. AT TRENCH 504.5
EXISTING ELEV. AT BOX 504.5

REVISED SEPTIC AREA

ORIGINAL SEPTIC AREA

Elevations OK
M/R 9/9/93

TANK TO TBE 2000 GAL

INPUT 502.0
INLET 502.0
FF=511
B=502

8

9

10

12

13

15

17

19

20

N79°21'18"E 95.77'

75' BRL

L=97.55'

L=32.00'

L=46.84'

L=87.13'

L=255.20'

L=52.36'

L=247.19'

L=107.70'

L=75'

L=207.83'

L=11.96'

L=25.00'

N57°17'11"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'


N79°21'18"E 95.77'

N79°21'18"E 95.77'

N79°21'18"E 95.77'

This area designates a private sewage easement of 10,000 square feet as required by the Maryland Department of the Environment for individual sewage disposal. Improvements of any nature in this area are restricted until public sewage is available. These easements shall null and void upon connection to a public sewage system.

The purpose of this plan is to establish a modified sewage disposal easement for lot 29, Ashleigh Greene.

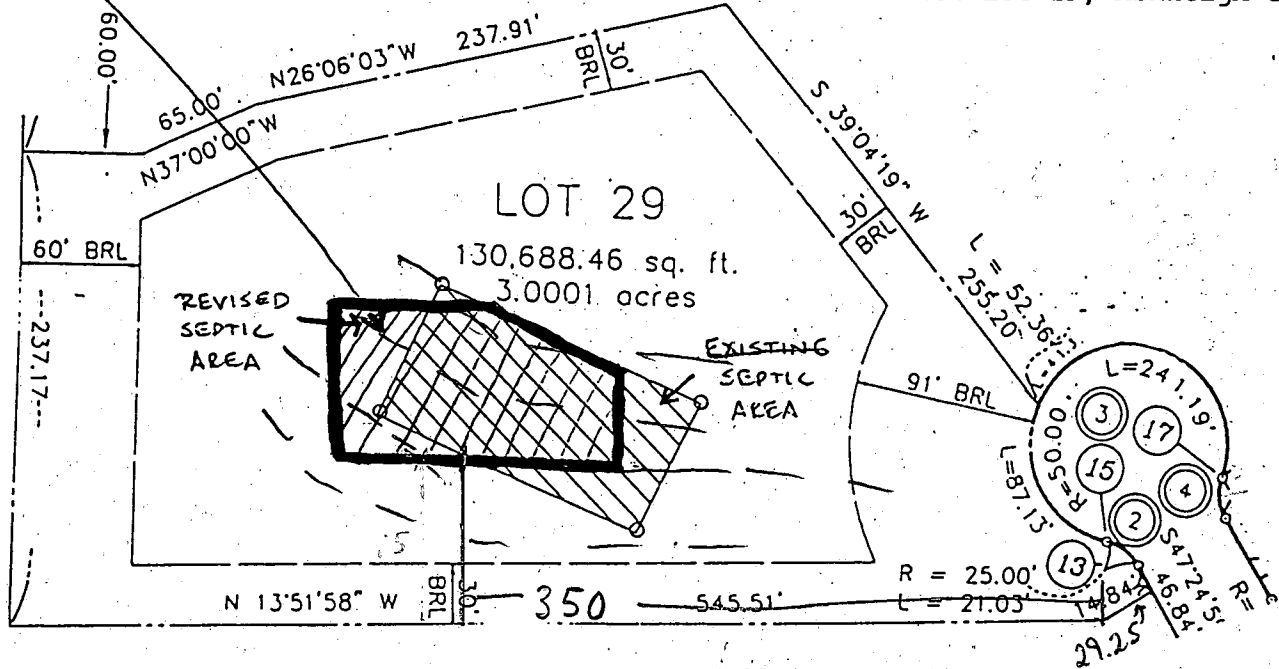

APPROVED:
 HOWARD COUNTY HEALTH DEPT.
 4-26-93
 DATE (CW) APPROVING AUTHORITY

RECORDED AS PLAT NUMBER 10669
 DATED 1/08/93
 AMONG THE LAND RECORDS OF
 HOWARD COUNTY, MARYLAND

I certify measurements accurate to best of my ability:

4/23/93
 DATE R. D. Boy

Amended Plat ASHLEIGH GREENE

SECTION 2 AREA 1
 LOTS 28 - 34
 Election District No. 5
 Howard County, Maryland
 Tax Map 41 Parcel 174
 SCALE: 1" = 100' OCTOBER 1992

M MILDENBERG,
MOCHI & ASSOCIATES, INC.
 (301) 461-0078 D.C. Metro: 621-5768

Current Zoning: RR
 Sketch Plan S-88-80
 Preliminary Plan P-89-25
 P-90-02
 Final Plan F-90-61

3300 North Ridge Road, Suite 235, Ellicott City, Maryland 21043-3350