

03-294706

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

P 37530

A REPAIR

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH

~~992-2330~~
461-9933

INDEXED

ELLICOTT CITY

DISTRICT _____

DATE 8/19/86

Thomas F. Roseway

IS PERMITTED TO INSTALL _____ ALTER X

ADDRESS 12755 Triadelphia Road, Ellicott City, MD

PHONE _____

SUBDIVISION Wayside Manor ROAD Triadelphia Road LOT EXISTING LOT

ADJOINER DEED
LOT

PROPERTY OWNER _____

ADDRESS _____

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES _____ NO _____

SEPTIC TANK CAPACITY _____ GALLONS NUMBER OF BEDROOMS _____

Percolation test to establish sufficient area to allow for future repairs to existing
septic system.

PLANS APPROVED BY Craig Williams DATE 8/19/86

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: IF TRENCH IS USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH.

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER. NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS.

PERMIT VOID AFTER THREE YEARS.

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA, OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET MANHOLE TO GRADE REQUIRED.


***INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT**

*CALL 992-2330 FOR INSPECTION OF SEPTIC SYSTEMS.

EH - 2-1082

REPAIR
37530

9"
 AP
 RED
 BROWN
 SILT
 LOAM
 12-15%
 CLAY
 <10%
 FRAGMENTS
 4'
 RED
 BROWN
 SILT
 LOAM
 <9% CLAY
 10% FRAGMENTS
 5'
 YELLOW
 BROWN
 SILT LOAM
 HIGHLY
 MICACEOUS
 12.5'

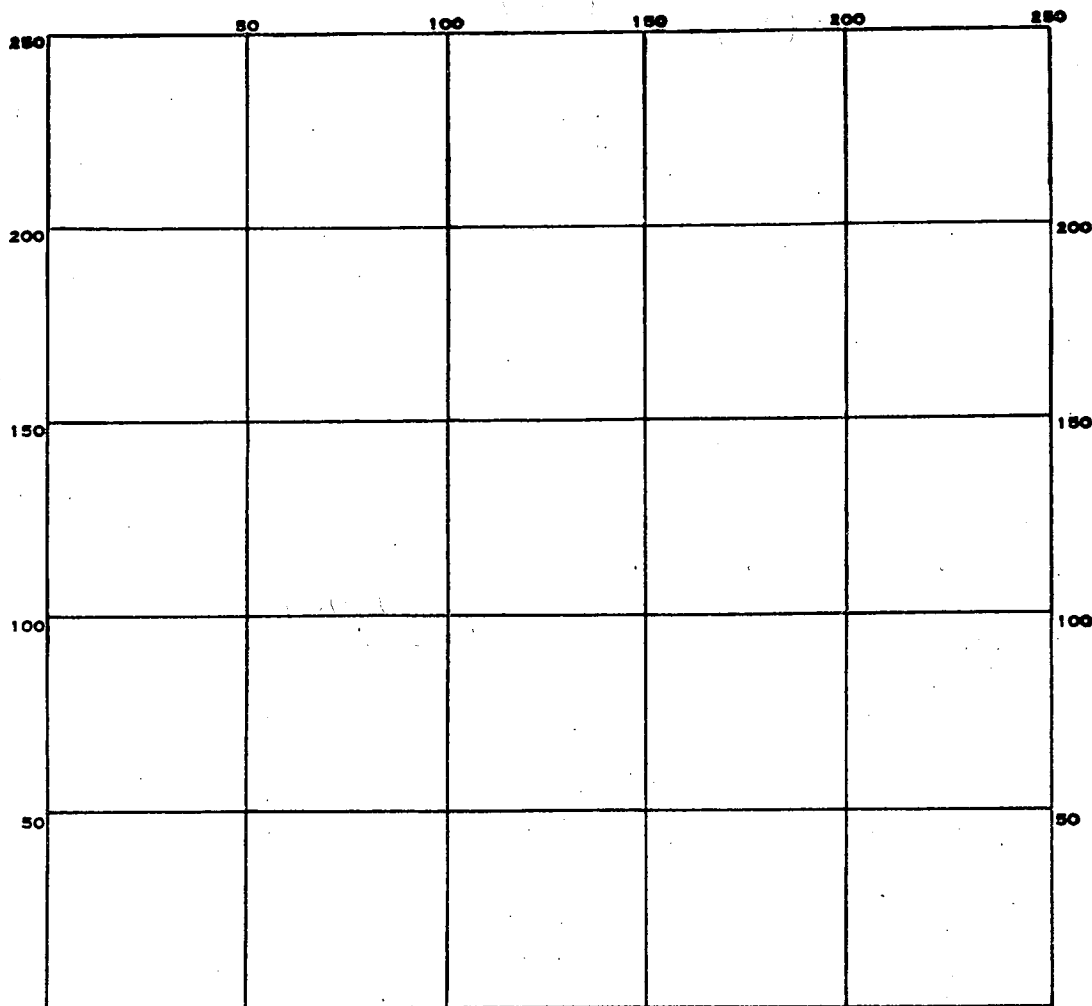

INDICATE NORTH. - NAME ADJOINING ROADWAY AS BASE LINE.

PERMIT CARD _____

SEPTIC TANK, LEVEL _____

CLEANOUTS _____

DISTRIBUTION BOX, LEVEL _____

TILE FIELD, DEPTH _____ FT. TRENCH WIDTH _____ FT.

GRAVEL DEPTH _____ IN. TOTAL LENGTH _____ FT.

NUMBER OF TRENCHES _____ TOTAL BOTTOM AREA _____

SEEPAGE PITS, INSIDE DIAMETER _____ FT. DEPTH BELOW INLET _____ FT.

ABSORBENT AREA _____ SQ. FT.

REMARKS
 8/20/86 1 5 4' 11:30 - 11:42 11:42 - STOPPED DUE TO RAIN,
 12.5'

TYPE SOIL - GLENGLE

TESTED BY - SID ABEL

ALSO PRESENT - ROSEWALK

DATE SYSTEM APPROVED _____ INSPECTOR _____

10/27/71
9:30

Final G.O.
10/27/71
R. Tamm

File

INDEXED PERMIT

SEWAGE DISPOSAL SYSTEM

P-16410

A-

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY

ELLCOTT CITY

DISTRICT 3

DATE 10/26/71

Jack Fyock IS PERMITTED TO INSTALL ☒ ALTER

ADDRESS Ten Oaks Road, Glenelg, Md. PHONE 286-2939

A SEWAGE DISPOSAL SYSTEM LOCATED AT

SUBDIVISION ROAD 12769 Triadelphia LOT

PROPERTY OWNER Mr. Roseway (2 houses past Benson Subdivision)

ADDRESS

SPECIFICATIONS

DRAIN FIELD DEPTH FEET, BOTTOM AREA SQ. FT.

SEEPAGE PITS ABSORBENT SIDE-WALL AREA SQ. FT.

SEPTIC TANK CAPACITY GALLONS

FOR GARBAGE GRINDER, INCREASE DISPOSAL AREA 22% & TANK CAPACITY 50%.

OTHER REPAIR - Call for inspection when ground is opened up and

Sanitarian will recommend repair system.

PLANS APPROVED BY Palmer F. Wine DATE 10/26/71

FILL SEPTIC TANK AND DISTRIBUTION BOX WITH WATER BEFORE CALLING FOR AN INSPECTION. COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COMMISSIONERS NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

16410

